SHEET NOTES

1. DEMOLISH EXISTING COOLING TOWER, SPRAY PUMP, CONTROL PANEL, DISCONNECT, AND VFD, REMOVE FROM SITE AND DISPOSE OF.
2. DEMOLISH PIPING FROM COOLING TOWER UP TO POINT OF CONNECTION (POC) SYMBOL.
3. TEMPORARILY REMOVE & REPLACE CHAIN LINK FENCE SECTIONS AS NEEDED TO REMOVE COOLING TOWER.
4. PROVIDE NEW COOLING TOWER, SPRAY PUMP, FLANGED PIPE FLEX CONNECTOR, CONTROL PANEL, DISCONNECT, AND VFD. PROVIDE HEAT TRACE ON ALL NEW PIPING PROVIDED.
5. EXISTING WATER TREATMENT SYSTEM TO REMAIN, INCLUDING CONTROLS, METERS & PIPING CONNECTIONS.
6. CONTRACTOR TO PROVIDE A FUNCTIONAL TEMPORARY COOLING TOWER SYSTEM WITH TEMPORARY POWER FROM TIME OF THE START OF DEMOLITION UNTIL THE NEW COOLING TOWER CAN BE INSTALLED AND IS FULLY FUNCTIONAL. THE BID SHALL INCLUDE ALL PROVISIONS TO PROVIDE CONTINUOUS COOLING TO THE FACILITY DURING CONSTRUCTION INCLUDING BUT NOT LIMMIITTED TO; PLANNED LOATION FOR TEMPORARY TOWER, FLEX PIPING EXTENSIONS & POWER CONNECTION FROM EXISTING BUILDING.

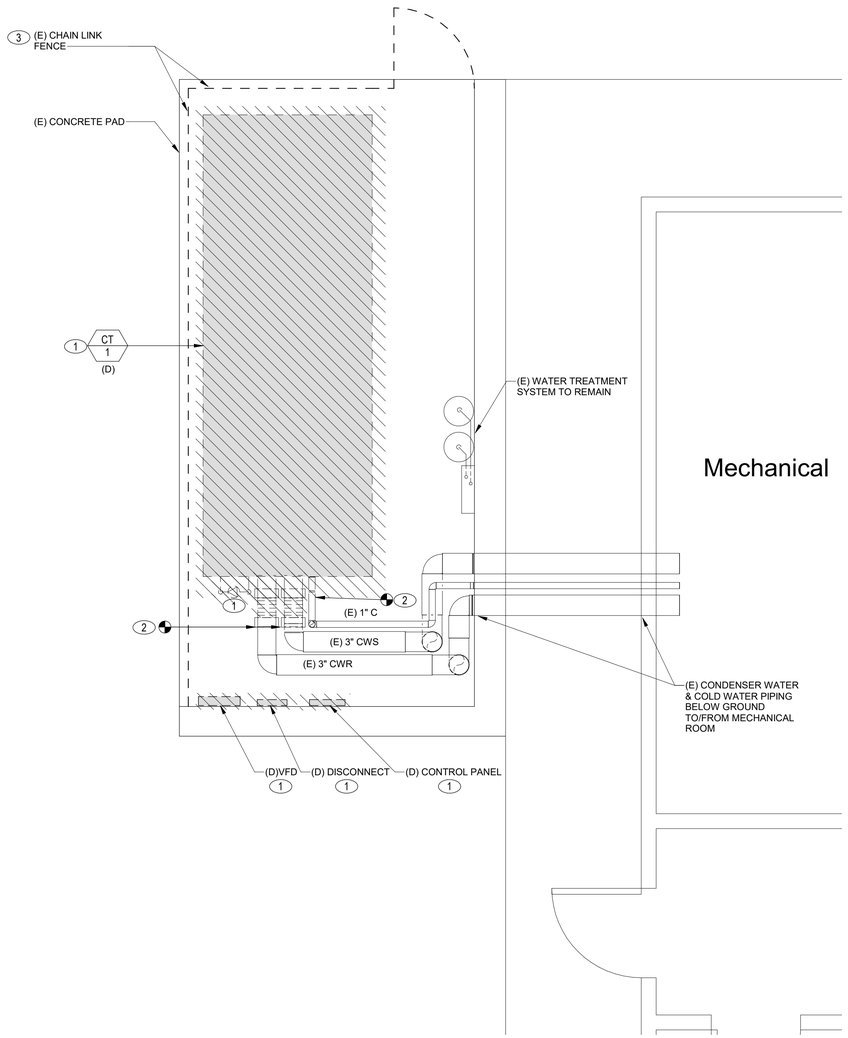

1 **LEVEL 1 - ENLARGED MECHANICAL DEMOLITION PLAN - HVAC**

SCALE: 1/2" = 1'-0"

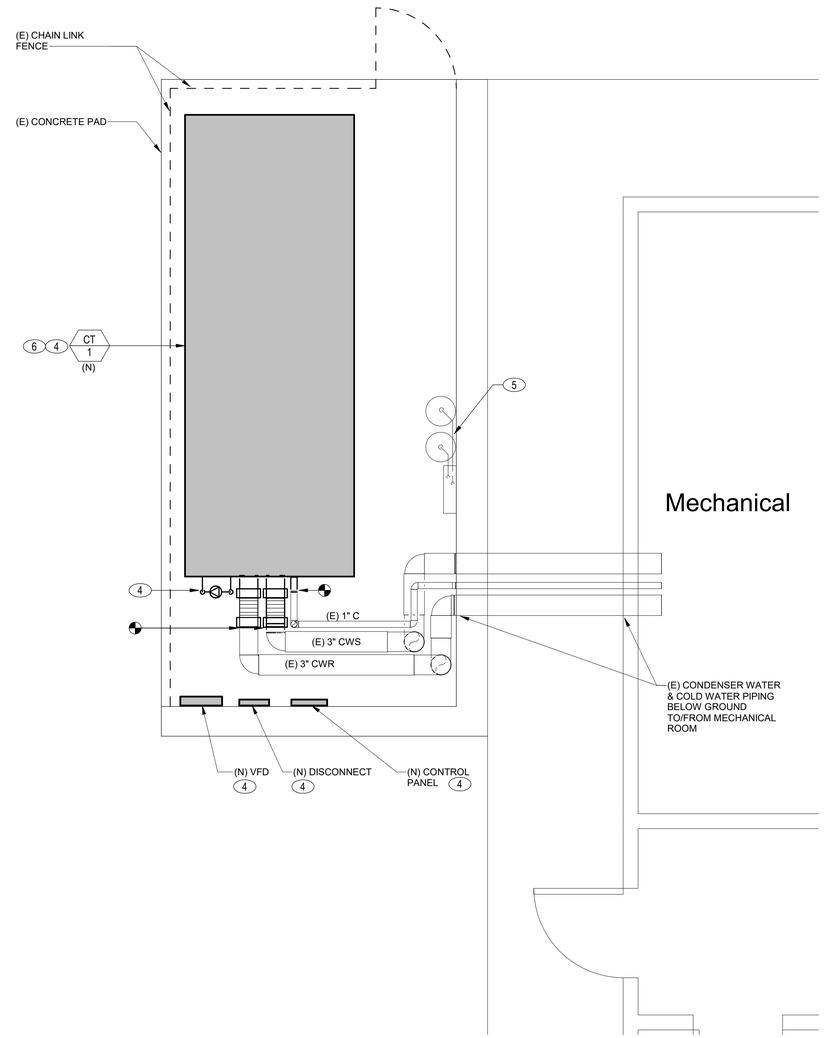

2 **LEVEL 1 - ENLARGED MECHANICAL PLAN - HVAC**

SCALE: 1/2" = 1'-0"

NORTH

Construction Documents 2/19/2024

GLUMAC
A TETRA TECH COMPANY
engineers for a sustainable future™

1601 Fifth Ave., Suite 2210
Seattle, WA 98101
www.glumac.com
T. 206.262.1010
Project Manager: DeNayne Glenn
Job. No.: 24US00135

Client

WSIPC
Inspired by education. Empowered by technology.™

Project

WSIPC Cooling Tower Replacement
2121 W. Casino Road, Everette, WA

©2014 - GLUMAC ALL RIGHTS RESERVED
THESE DRAWINGS ARE THE PROPERTY OF GLUMAC ARE NOT TO BE USED OR REPRODUCED IN ANY MANNER, WITHOUT PRIOR WRITTEN PERMISSION

Revisions

#	Description	Date

SHEET TITLE:
ENLARGED PLANS

DRAWN BY: DCG

CHECKED BY: MA

SHEET

M3.1

JOB NO. **24US00135**