


41TE (A604)

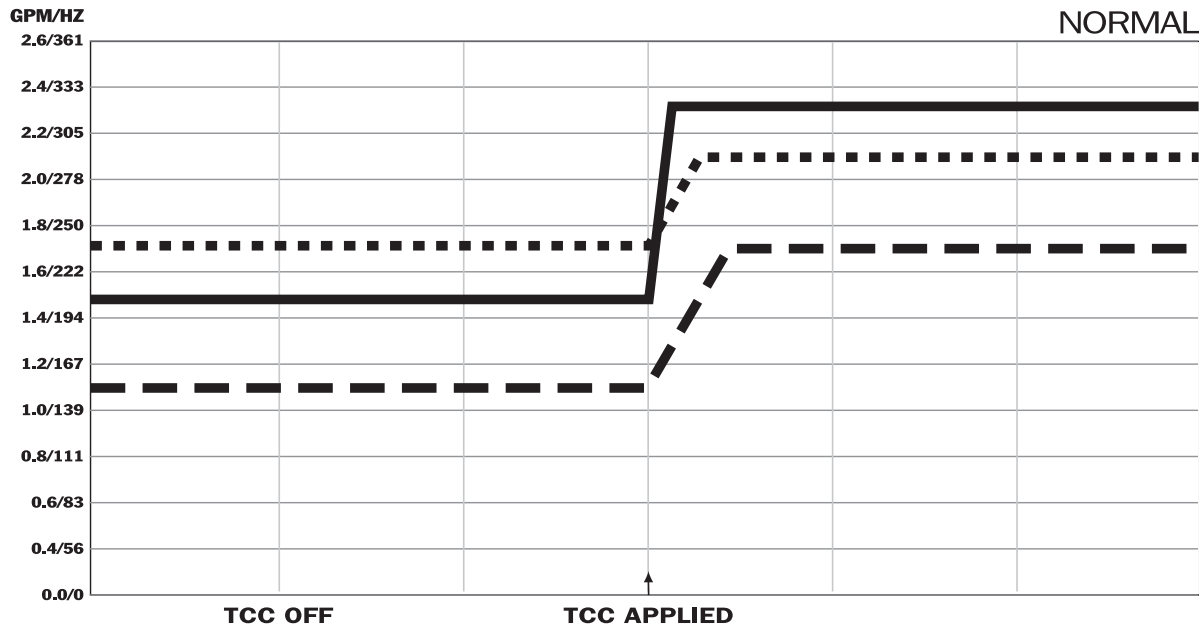

Condition: All three are normal.

Notes: Reading with Sonnax TCC Regulator Valve 92835-03K installed and bypass valve plugged.