



4L80-E

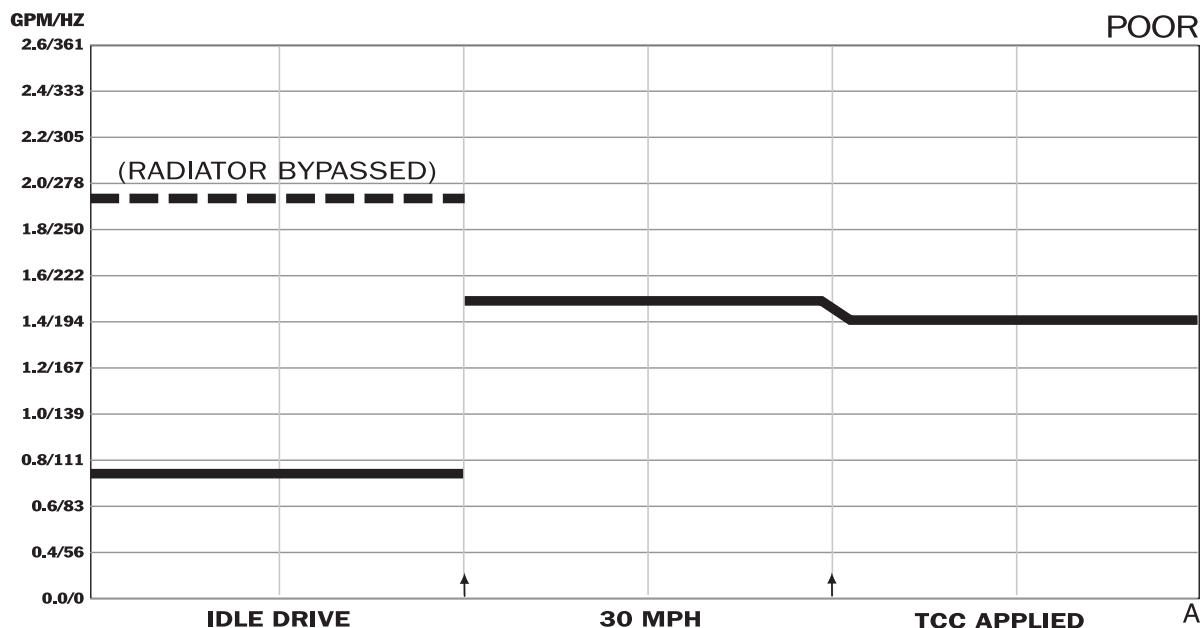

Condition: With OEM valves and poor TCC control
Notes: These units are very sensitive to cooler restrictions.

4L60 (700-R4)

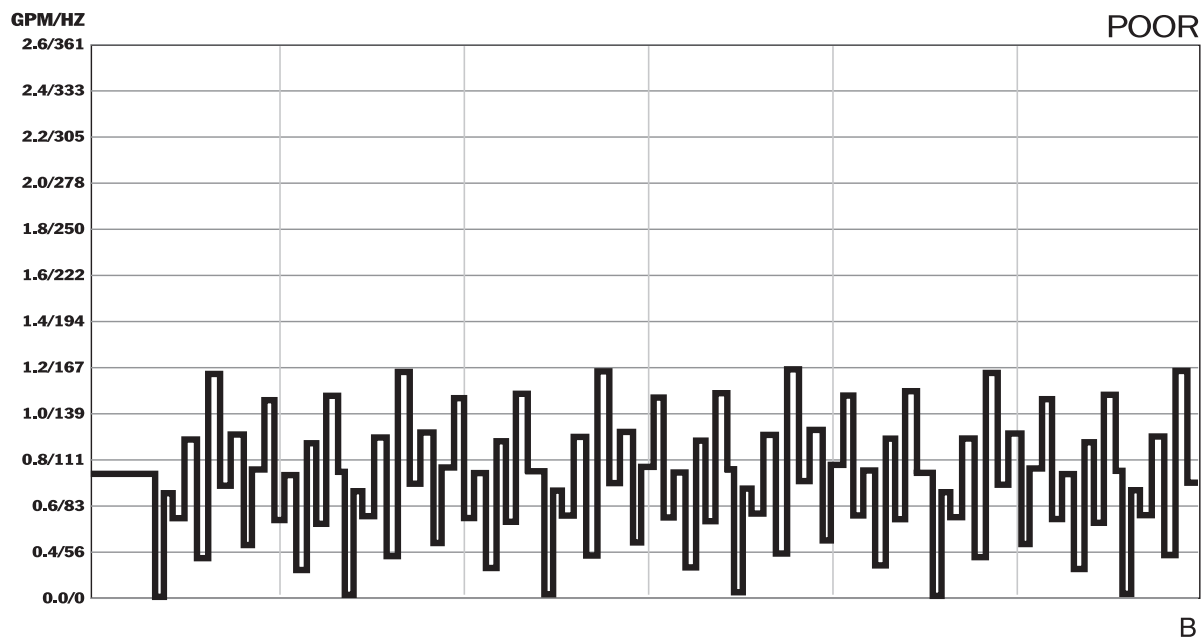

Event: Idle drive

Condition: Low fluid level, one-second screen.

Notes: Heavy pump rattle. SonnaFlow box steady at .2gpm.(Box average Hz output so aeration reads steady, must use multimeter.) Line psi steady at 60 psi.