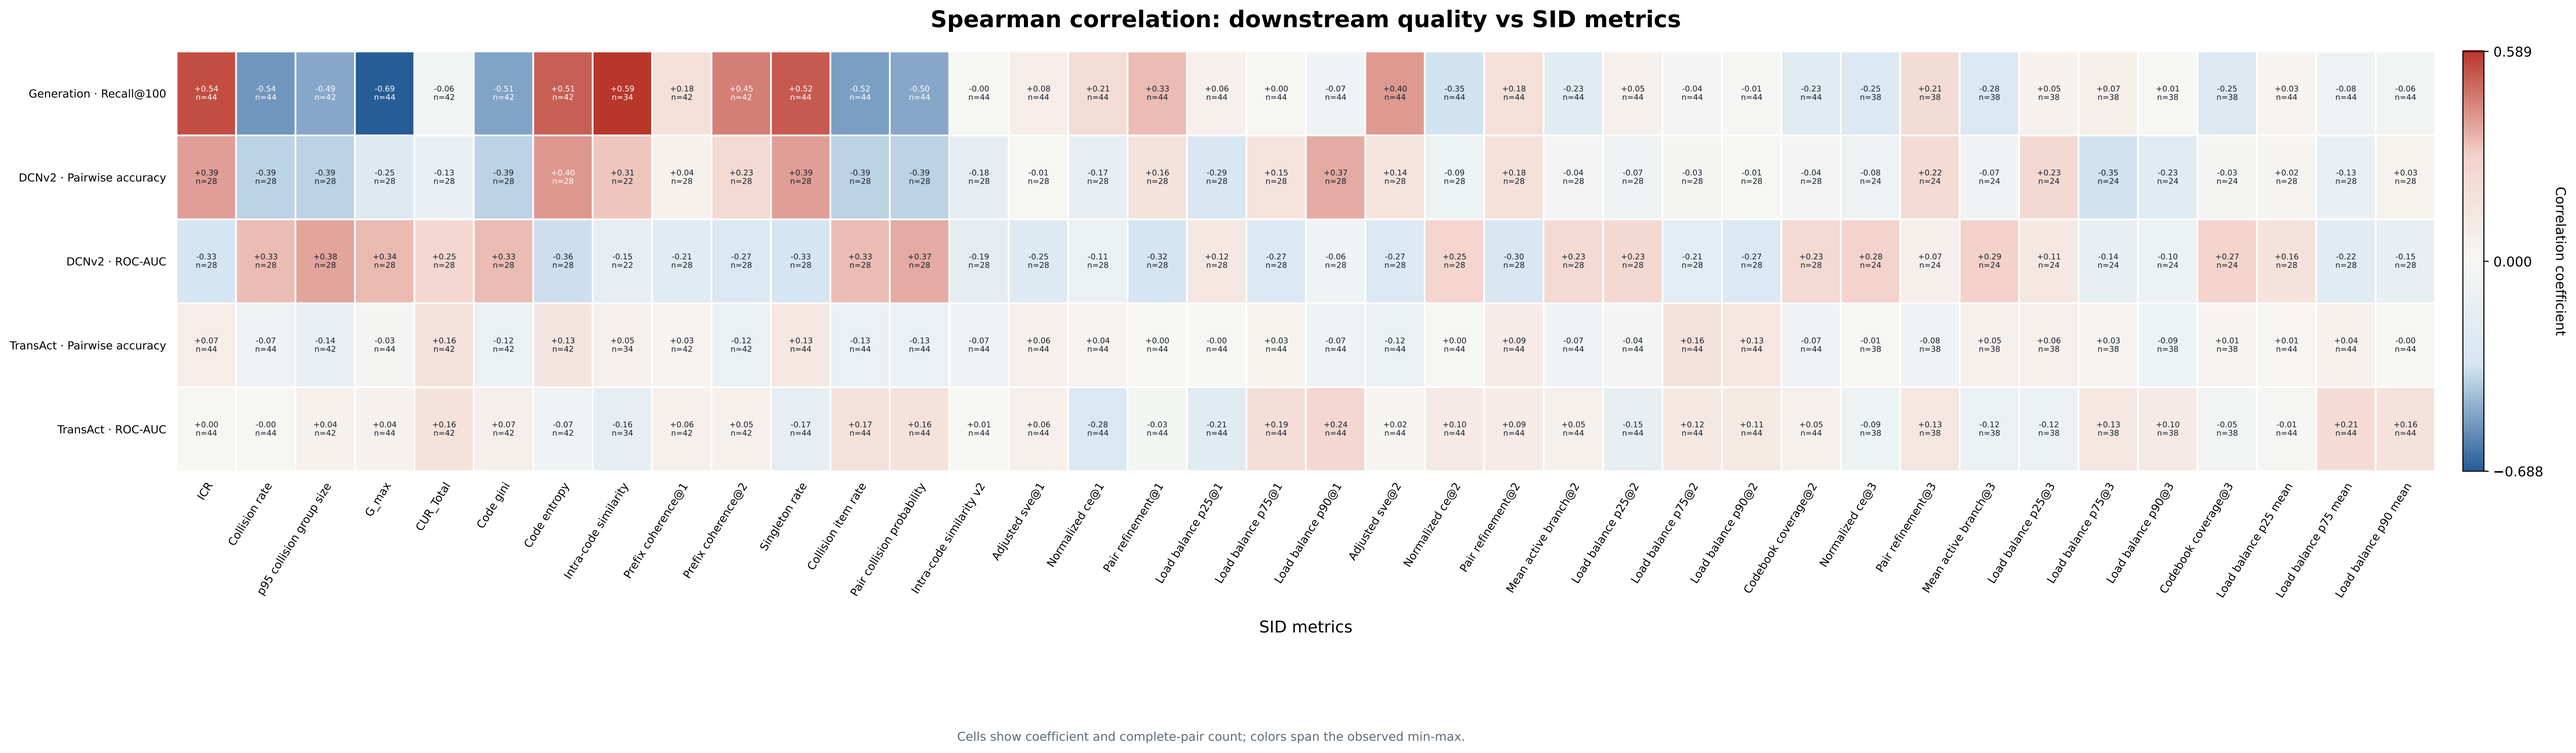
Spearman correlation: downstream quality vs SID metrics
Generation · Recall@100
DCNv2 · Pairwise accuracy
DCNv2 · ROC-AUC
TransAct · Pairwise accuracy
TransAct · ROC-AUC
+0.54 n=44
-0.54 n=44
-0.49 n=42
-0.69 n=44
-0.06 n=42
-0.51 n=42
+0.51 n=42
+0.59 n=34
+0.18 n=42
+0.45 n=42
+0.52 n=44
-0.52 n=44
-0.50 n=44
-0.00 n=44
+0.08 n=44
+0.21 n=44
+0.33 n=44
+0.06 n=44
+0.00 n=44
-0.07 n=44
+0.40 n=44
-0.35 n=44
+0.18 n=44
-0.23 n=44
+0.05 n=44
-0.04 n=44
-0.01 n=44
-0.23 n=44
-0.25 n=38
+0.21 n=38
-0.28 n=38
+0.05 n=38
+0.07 n=38
+0.01 n=38
-0.25 n=38
+0.03 n=44
-0.08 n=44
-0.06 n=44
+0.39 n=28
-0.39 n=28
-0.39 n=28
-0.25 n=28
-0.13 n=28
-0.39 n=28
+0.40 n=28
+0.31 n=22
+0.04 n=28
+0.23 n=28
+0.39 n=28
-0.39 n=28
-0.39 n=28
-0.18 n=28
-0.01 n=28
-0.17 n=28
+0.16 n=28
-0.29 n=28
+0.15 n=28
+0.37 n=28
+0.14 n=28
-0.09 n=28
+0.18 n=28
-0.04 n=28
-0.07 n=28
-0.03 n=28
-0.01 n=28
-0.04 n=28
-0.08 n=24
+0.22 n=24
-0.07 n=24
+0.23 n=24
-0.35 n=24
-0.23 n=24
-0.03 n=24
+0.02 n=28
-0.13 n=28
+0.03 n=28
-0.33 n=28
+0.33 n=28
+0.38 n=28
+0.34 n=28
+0.25 n=28
+0.33 n=28
-0.36 n=28
-0.15 n=22
-0.21 n=28
-0.27 n=28
-0.33 n=28
+0.33 n=28
+0.37 n=28
-0.19 n=28
-0.25 n=28
-0.11 n=28
-0.32 n=28
+0.12 n=28
-0.27 n=28
-0.06 n=28
-0.27 n=28
+0.25 n=28
-0.30 n=28
+0.23 n=28
+0.23 n=28
-0.21 n=28
-0.27 n=28
+0.23 n=28
+0.28 n=24
+0.07 n=24
+0.29 n=24
+0.11 n=24
-0.14 n=24
-0.10 n=24
+0.27 n=24
+0.16 n=28
-0.22 n=28
-0.15 n=28
+0.07 n=44
-0.07 n=44
-0.14 n=42
-0.03 n=44
+0.16 n=42
-0.12 n=42
+0.13 n=42
+0.05 n=34
+0.03 n=42
-0.12 n=42
+0.13 n=44
-0.13 n=44
-0.13 n=44
-0.07 n=44
+0.06 n=44
+0.04 n=44
+0.00 n=44
-0.00 n=44
+0.03 n=44
-0.07 n=44
-0.12 n=44
+0.00 n=44
+0.09 n=44
-0.07 n=44
-0.04 n=44
+0.16 n=44
+0.13 n=44
-0.07 n=44
-0.01 n=38
-0.08 n=38
+0.05 n=38
+0.06 n=38
+0.03 n=38
-0.09 n=38
+0.01 n=44
+0.01 n=44
+0.04 n=44
-0.00 n=44
+0.00 n=44
-0.00 n=44
+0.04 n=42
+0.04 n=44
+0.16 n=42
+0.07 n=42
-0.07 n=42
-0.16 n=34
+0.06 n=42
+0.05 n=42
-0.17 n=44
+0.17 n=44
+0.16 n=44
+0.01 n=44
+0.06 n=44
-0.28 n=44
-0.03 n=44
-0.21 n=44
+0.19 n=44
+0.24 n=44
+0.02 n=44
+0.10 n=44
+0.09 n=44
+0.05 n=44
-0.15 n=44
+0.12 n=44
+0.11 n=44
+0.05 n=44
-0.09 n=38
+0.13 n=38
-0.12 n=38
-0.12 n=38
+0.13 n=38
+0.10 n=38
-0.05 n=38
-0.01 n=44
+0.21 n=44
+0.16 n=44
ICR
Collision rate
p95 collision group size
G_max
CUR_Total
Code gini
Code entropy
Intra-code similarity
Prefix coherence@1
Prefix coherence@2
Singleton rate
Collision item rate
Pair collision probability
Intra-code similarity v2
Adjusted sve@1
Normalized ce@1
Pair refinement@1
Load balance p25@1
Load balance p75@1
Load balance p90@1
Adjusted sve@2
Normalized ce@2
Pair refinement@2
Mean active branch@2
Load balance p25@2
Load balance p75@2
Load balance p90@2
Codebook coverage@2
Normalized ce@3
Pair refinement@3
Mean active branch@3
Load balance p25@3
Load balance p75@3
Load balance p90@3
Codebook coverage@3
Load balance p25 mean
Load balance p75 mean
Load balance p90 mean
SID metrics
Correlation coefficient
0.589
0.000
−0.688
Cells show coefficient and complete-pair count; colors span the observed min-max.