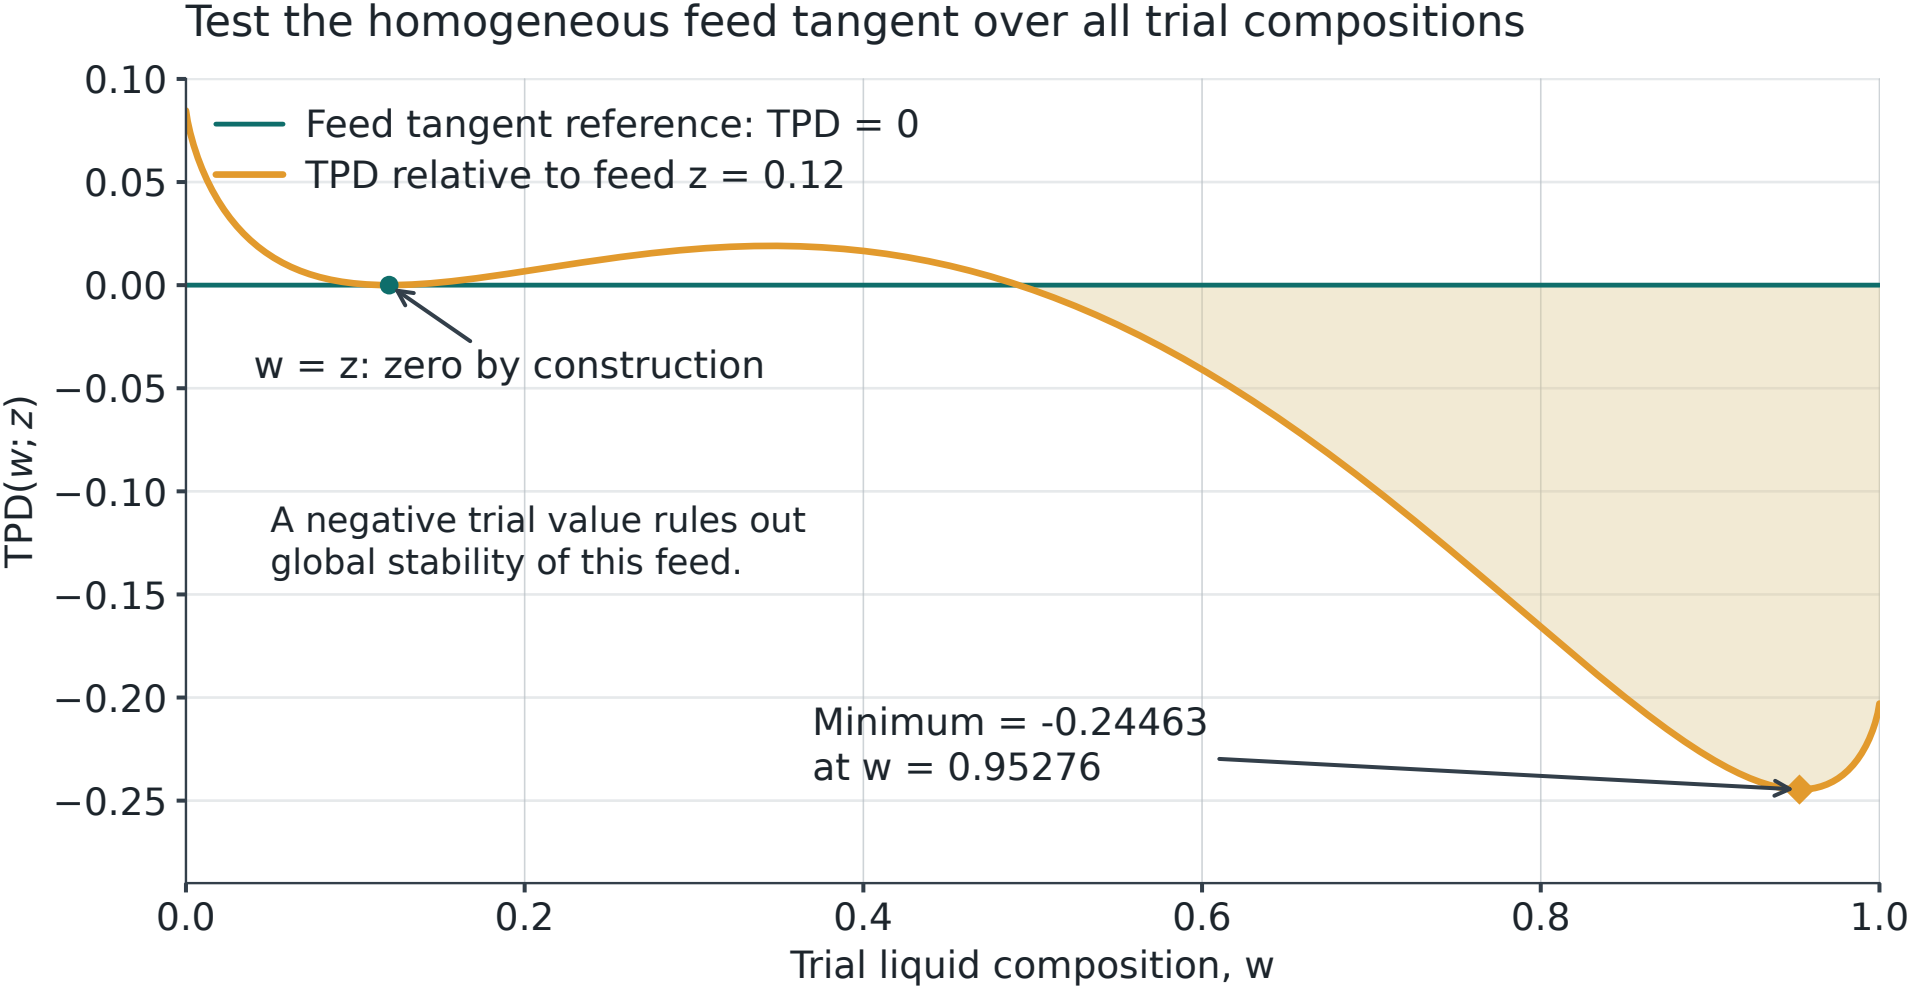
Test the homogeneous feed tangent over all trial compositions
Feed tangent reference: TPD = 0
TPD relative to feed z = 0.12
w = z: zero by construction
A negative trial value rules out
global stability of this feed.
Minimum = -0.24463
at w = 0.95276
TPD(w; z)
Trial liquid composition, w
0.10
0.05
0.00
−0.05
−0.10
−0.15
−0.20
−0.25
0.0
0.2
0.4
0.6
0.8
1.0