



[I-21/48/2026-W&M Section]

GOVERNMENT OF INDIA/भारत सरकार
MINISTRY OF CONSUMER AFFAIRS, FOOD AND PUBLIC DISTRIBUTION
उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय
DEPARTMENT OF CONSUMER AFFAIRS/ उपभोक्ता मामले विभाग
LEGAL METROLOGY DIVISION/ विधिक मापविज्ञान प्रभाग

Krishi Bhawan, New Delhi/कृषि भवन, नई दिल्ली

Dated/दिनांक:- 27.03.2026

Certificate of Approval of Model/ मॉडल का अनुमोदन प्रमाणपत्र

Whereas the Central Government, after considering the report submitted to it by the prescribed authority along with the OIML certificate No: R137/2012-A-NL1-25.03 revision 0 issued by NMI, Netherland, is satisfied that the model described in the said report (see the figure given below), is in conformity with the provisions of the Legal Metrology Act 2009(1 of 2010) and the Legal Metrology (Approval of Models) Rules, 2011 and the said model is likely to maintain its accuracy over periods of sustained use and to render accurate service under varied conditions;

Now, therefore, in exercise of the powers conferred by section 22 of the Legal Metrology Act, 2009 (1 of 2010) read with sub-rule (6) of rule 8 and sub-rule (4) of rule 11 of the Legal Metrology (Approval of Models) Rules, 2011, the Central Government hereby issues the certificate of approval of the model of Turbine Gas meter, Type: "FMT-L"; "FMT-S"; "FMT-Lx" & "FMT-Dc" with brand name "Flow Meter Group B.V." of accuracy class: 1.0 (hereinafter referred to as the said model), manufactured by M/s Flow Meter Group B.V. Innovatieweg 32, 7007 CD Doetinchem, The Netherlands and imported & marketed in India without any alteration before or after sale by M/s Flow Metering Technology Pvt Ltd, 96, Tulsi Industrial Estate and Plaza, Opp. Bhagyoday Hotel, Beside Changodar, Ahmedabad, Gujarat-382213 and which is assigned the approval mark IND/09/26/ 138 (the picture of the model is given below as Figure 1);

Figure 1



Technical Data:

Accuracy class	1.0
Destined for the measurement of	Gas volume
Mechanical class	M1
Electromagnetic class	Not applicable (the meter has no electronics)
Ambient temperature range	-40 °C / +70 °C
Gas temperature range	-40 °C / +70 °C
Orientation	Horizontal / Vertical up / Vertical down (all orientations)
Flow direction	Uni-directional (indicated with arrow)



General characteristics of the family of instruments:

Main characteristics				Essential characteristics				
Type	DN body	DN cartr.	G-value	Qmax	Qt	Qmin		
						MR 1:20 0..101 bar(g)	MR 1:30 3..101 bar(g)	MR 1:50 8..101 bar(g)
-	mm	mm	-	m ³ /h	m ³ /h	m ³ /h	m ³ /h	m ³ /h
FMT-Lx or FMT-Dc	50	80	100	160	32	8	5	3
			160	250	50	12,5	8	5
			250	400	80	20	12,5	8
FMT-L, FMT-S, FMT-Lx or FMT-Dc	80	80	100	160	32	8	5	3
			160	250	50	12,5	8	5
			250	400	80	20	12,5	8
FMT-Lx or FMT-Dc	80	100	160	250	50	12,5	8	5
			250	400	80	20	12,5	8
			400	650	130	32,5	20	12,5
FMT-Lx or FMT-Dc	100	80	100	160	32	8	5	3
			160	250	50	12,5	8	5
			250	400	80	20	12,5	8
FMT-L, FMT-S, FMT-Lx or FMT-Dc	100	100	160	250	50	12 5	8	5
			250	400	80	20	12,5	8
			400	650	130	32,5	20	12,5
FMT-Lx or FMT-Dc	100	150	400	650	130	32,5	20	12,5
			650	1000	200	50	32	20
			1000	1600	320	80	50	32
FMT-Lx or FMT-Dc	150	100	160	250	50	12,5	8	5
			250	400	80	20	12,5	8
			400	650	130	32,5	20	12,5
FMT-L, FMT-S, FMT-Lx or FMT-Dc	150	150	400	650	130	32,5	20	12,5
			650	1000	200	50	32	20
			1000	1600	320	80	50	32
FMT-Lx or FMT-Dc	150	200	650	1000	200	50	32	20
			1000	1600	320	80	50	32
			1600	2500	500	125	80	50
FMT-Lx or FMT-Dc	200	150	400	650	130	32 5	20	12 5
			650	1000	200	50	32	20
			1000	1600	320	80	50	32
FMT-L, FMT-S, FMT-Lx or FMT-Dc	200	200	650	1000	200	50	32	20
			1000	1600	320	80	50	32
			1600	2500	500	125	80	50
FMT-Lx or FMT-Dc	250	200	650	1000	200	50	32	20
			1000	1600	320	80	50	32
			1600	2500	500	125	80	50



Continuation of General characteristics of family of instruments:

Main characteristics				Essential characteristics			
Type	DN body	DN cartr.	G-value	Qmax	Qt	Qmin	
						0..101 bar(g) MR 1:30	4..101 bar(g) MR 1:50
-	mm	mm	-	m ³ /h	m ³ /h	m ³ /h	m ³ /h
FMT-Lx or FMT-Dc	200	250	1000	1600	320	50	32
			1600	2500	500	80	50
			2500	4000	800	125	80
FMT-S, FMT-Lx or FMT-Dc	250	250	1000	1600	320	50	32
			1600	2500	500	80	50
			2500	4000	800	125	80
FMT-Lx or FMT-Dc	250	300	1600	2500	500	80	50
			2500	4000	800	125	80
			4000	6500	1300	216	130
FMT-Lx or FMT-Dc	300	250	1000	1600	320	50	32
			1600	2500	500	80	50
			2500	4000	800	125	80
FMT-S, FMT-Lx or FMT-Dc	300	300	1600	2500	500	80	50
			2500	4000	800	125	80
			4000	6500	1300	216	130
FMT-Lx or FMT-Dc	300	400	2500	4000	800	133	80
			4000	6500	1300	216	130
			6500	10000	2000	333	200
FMT-Lx or FMT-Dc	400	300	1600	2500	500	80	50
			2500	4000	800	125	80
			4000	6500	1300	216	130
FMT-S, FMT-Lx or FMT-Dc	400	400	2500	4000	800	133	80
			4000	6500	1300	216	130
			6500	10000	2000	333	200
FMT-Lx or FMT-Dc	400	500	4000	6500	1300	216	130
			6500	10000	2000	333	200
			10000	16000	3200	533	320
FMT-Lx or FMT-Dc	500	400	2500	4000	800	133	80
			4000	6500	1300	216	130
			6500	10000	2000	333	200
FMT-S, FMT-Lx or FMT-Dc	500	500	4000	6500	1300	216	130
			6500	10000	2000	333	200
			10000	16000	3200	533	320
FMT-Lx or FMT-Dc	500	600	6500	10000	2000	333	200
			10000	16000	3200	533	320
			16000	25000	5000	800	400
FMT-Lx or FMT-Dc	600	500	4000	6500	1300	216	130
			6500	10000	2000	333	200
			10000	16000	3200	533	320
FMT-S, FMT-Lx or FMT-Dc	600	600	6500	10000	2000	333	200
			10000	16000	3200	533	320
			16000	25000	5000	800	400

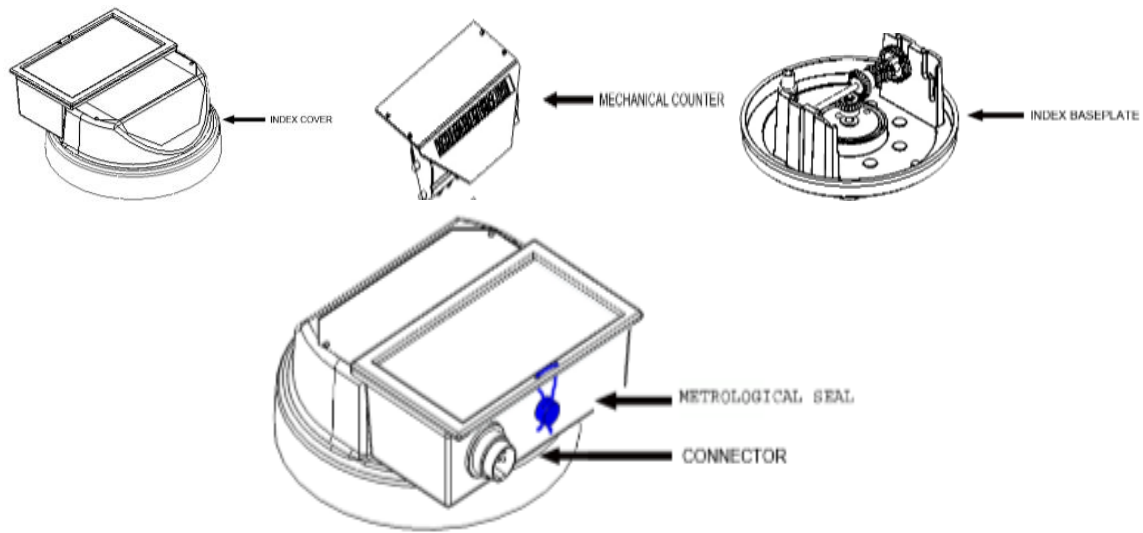


Figure-2

A typical schematic diagram of sealing provision to prevent the fraudulent practices of the model is given above as Figure 2.

[F.No.I-21/48/2026-W&M Section]



ASHUTOSH AGARWAL Digitally signed by
ASHUTOSH AGARWAL
Date: 2026.03.27
15:19:47 +05'30'

(Ashutosh Agarwal/आशुतोष अग्रवाल)
Director (Legal Metrology) to Govt. of India/ निदेशक (विधिक माप विज्ञान) भारत सरकार
Phone/दूरभाष 01123389489
Email/ई-मेल: dirwm-ca@nic.in

Online application no. 23331