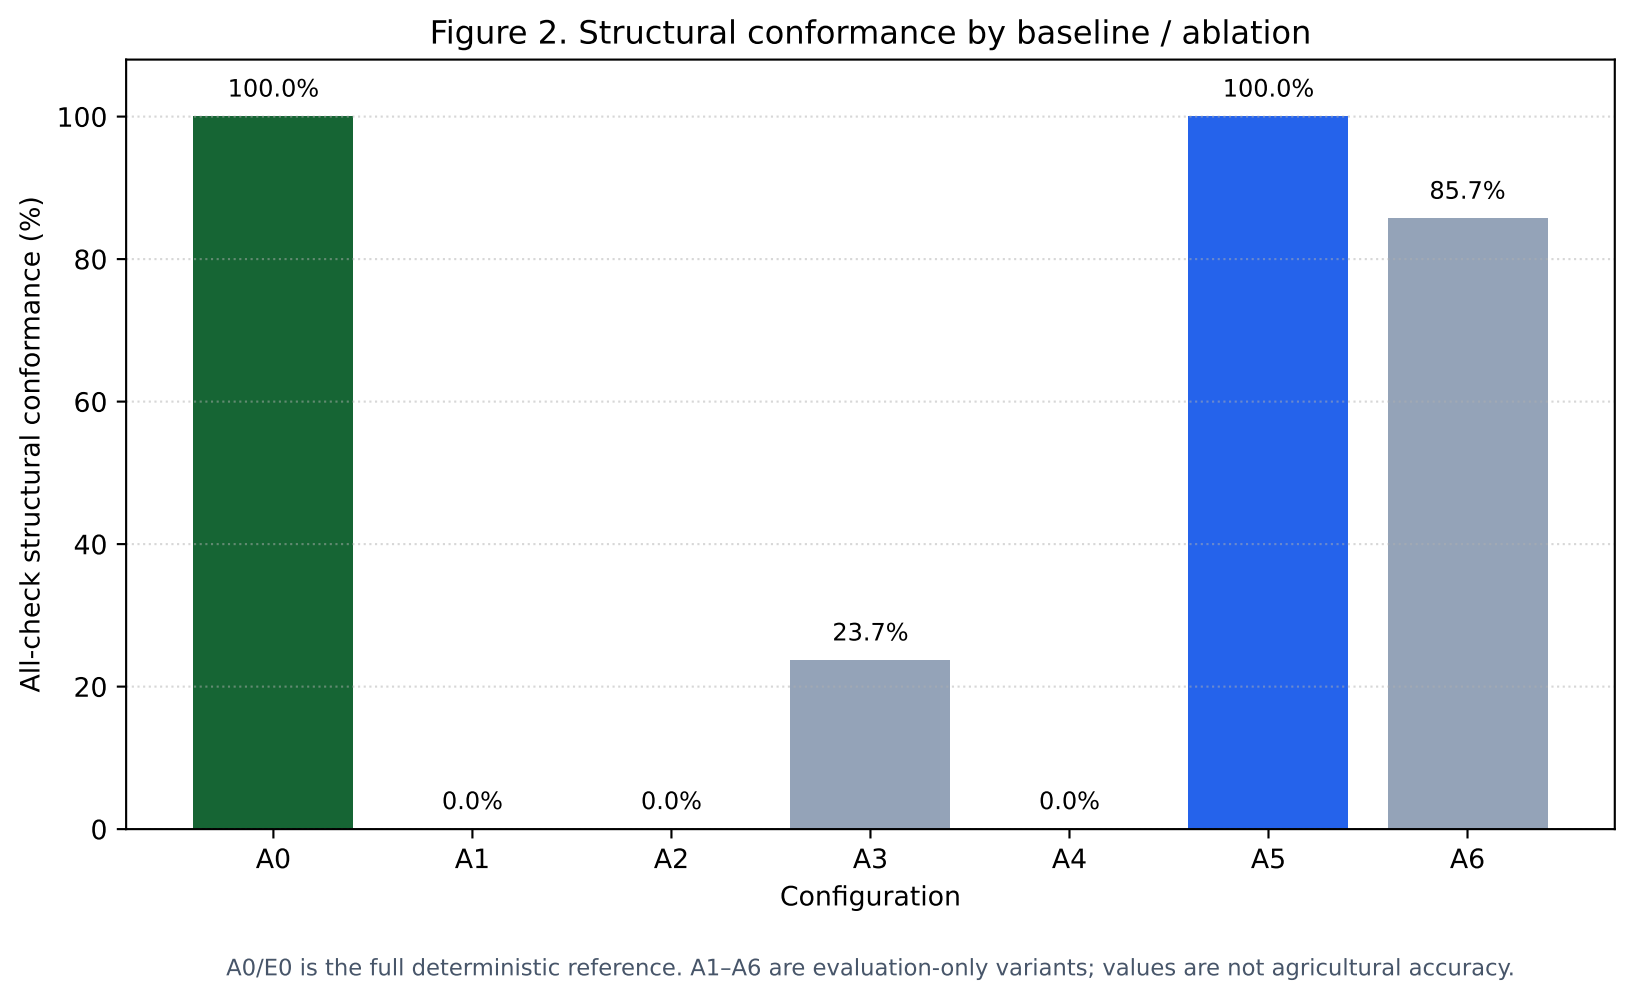
Figure 2. Structural conformance by baseline / ablation
All-check structural conformance (%)
0
20
40
60
80
100
100.0%
0.0%
0.0%
23.7%
0.0%
100.0%
85.7%
A0
A1
A2
A3
A4
A5
A6
Configuration
A0/E0 is the full deterministic reference. A1–A6 are evaluation-only variants; values are not agricultural accuracy.