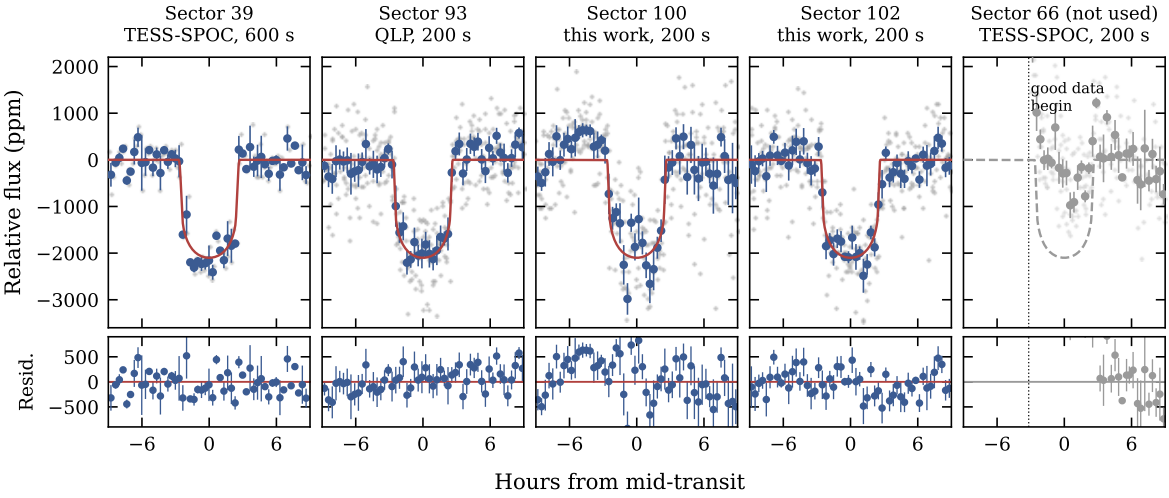

Sector 39
TESS-SPOC, 600 s
Sector 93
QLP, 200 s
Sector 100
this work, 200 s
Sector 102
this work, 200 s
Sector 66 (not used)
TESS-SPOC, 200 s
good data
begin
Relative flux (ppm)
2000
1000
0
−1000
−2000
−3000
Resid.
500
0
−500
−6
0
6
Hours from mid-transit