

TEST ONLY - SYNTHETIC ASSET DATA

Cooling Water Booster Project Basis and Acceptance

Project CW-01 | Revision 1 | North Utility Test Cell

This fixture validates document ingestion, retrieval, citations, OCR, and safe failure behavior. It is not an approved plant record and must not be used to operate or maintain equipment.

1. Project identity

Field	Controlled test value
Project	Cooling Water Booster Reliability Review
Location	North Utility Test Cell / Booster Skid
System	Synthetic clean-water booster loop CW-01
Included Equipment	P-101 pump, VFD-101 drive, PT-101 pressure transmitter
Revision	1 - initial acceptance fixture

2. Purpose and evidence boundary

The project investigates a synthetic low-discharge-pressure observation after a planned restart. P.A.T.C.H. should relate current approved sources, return traceable citations, and expose any evidence gap.

- No source in this packet authorizes physical energization, isolation, or maintenance.
- General references do not replace an employer-approved machine-specific energy-control procedure.
- The Project Owner reviews every draft and controls approval/publication.

3. Test operating basis

Parameter	Expected test value	Evidence interpretation
Discharge pressure target	4.2 bar(g)	Synthetic Project target
Low-pressure event	Below 3.6 bar(g) for 20 seconds	Creates observation code CW-17
Flow test point	42 m3/h	Nominal synthetic duty
Feedback device	PT-101	4-20 mA signal to VFD-101
Controlled Equipment	P-101	Pump speed command from VFD-101

3.1 Acceptance observations

- Record pressure, flow indication, vibration observation, leakage observation, and active alarm code.
- Treat a handwritten or scanned value as an observation requiring human comparison with its original.
- Do not convert missing evidence into a troubleshooting step.

3.2 Evidence conflict rule

If a generic source and this Project packet differ, P.A.T.C.H. must expose the difference. No model may merge conflicting limits into a new operating instruction.

4. System relationship

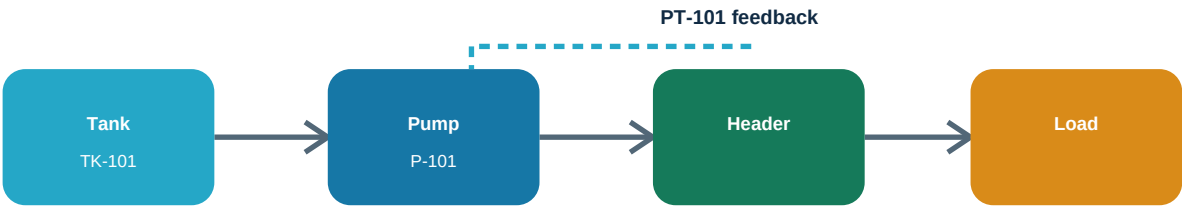


Figure 1. Test flow path and control relationship. PT-101 reports discharge pressure to VFD-101, which issues the speed command for P-101. The figure is explanatory and not a wiring diagram.

5. Review responsibilities

Role	Responsibility
Project Owner	Approve access, inspect sources, review drafts, decide controlled publication
Project Member	Read current Project evidence and history
Equipment manager	Mutate only the specifically approved Equipment record
AI service	Extract, retrieve, grade evidence, cite, and return draft data only

6. Synthetic recurring inspection candidate

Candidate interval: every 7 days in Asia/Kolkata. This is test scheduling data, not a real maintenance interval.

Topic	Required evidence before controlled publication
Pre-work state	Current machine-specific site procedure and authorized-person confirmation
Visual observation	Leakage, looseness, unusual noise, and housekeeping notes
Operating observation	Pressure and flow recorded from designated test indications
Closeout	Final wording submitted by a human; no AI-inferred completion

A missing machine-specific isolation source is a blocking evidence gap. A generated draft may remain unpublished until that evidence is supplied and reviewed.