



R134a Ref: D.P. Wilson & R.S. Ham, ASHRAE Transactions 1988, Vol. 94 part 2.


DTU, Department of Energy Engineering
s in [kJ/kg K], x in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 22-11-16

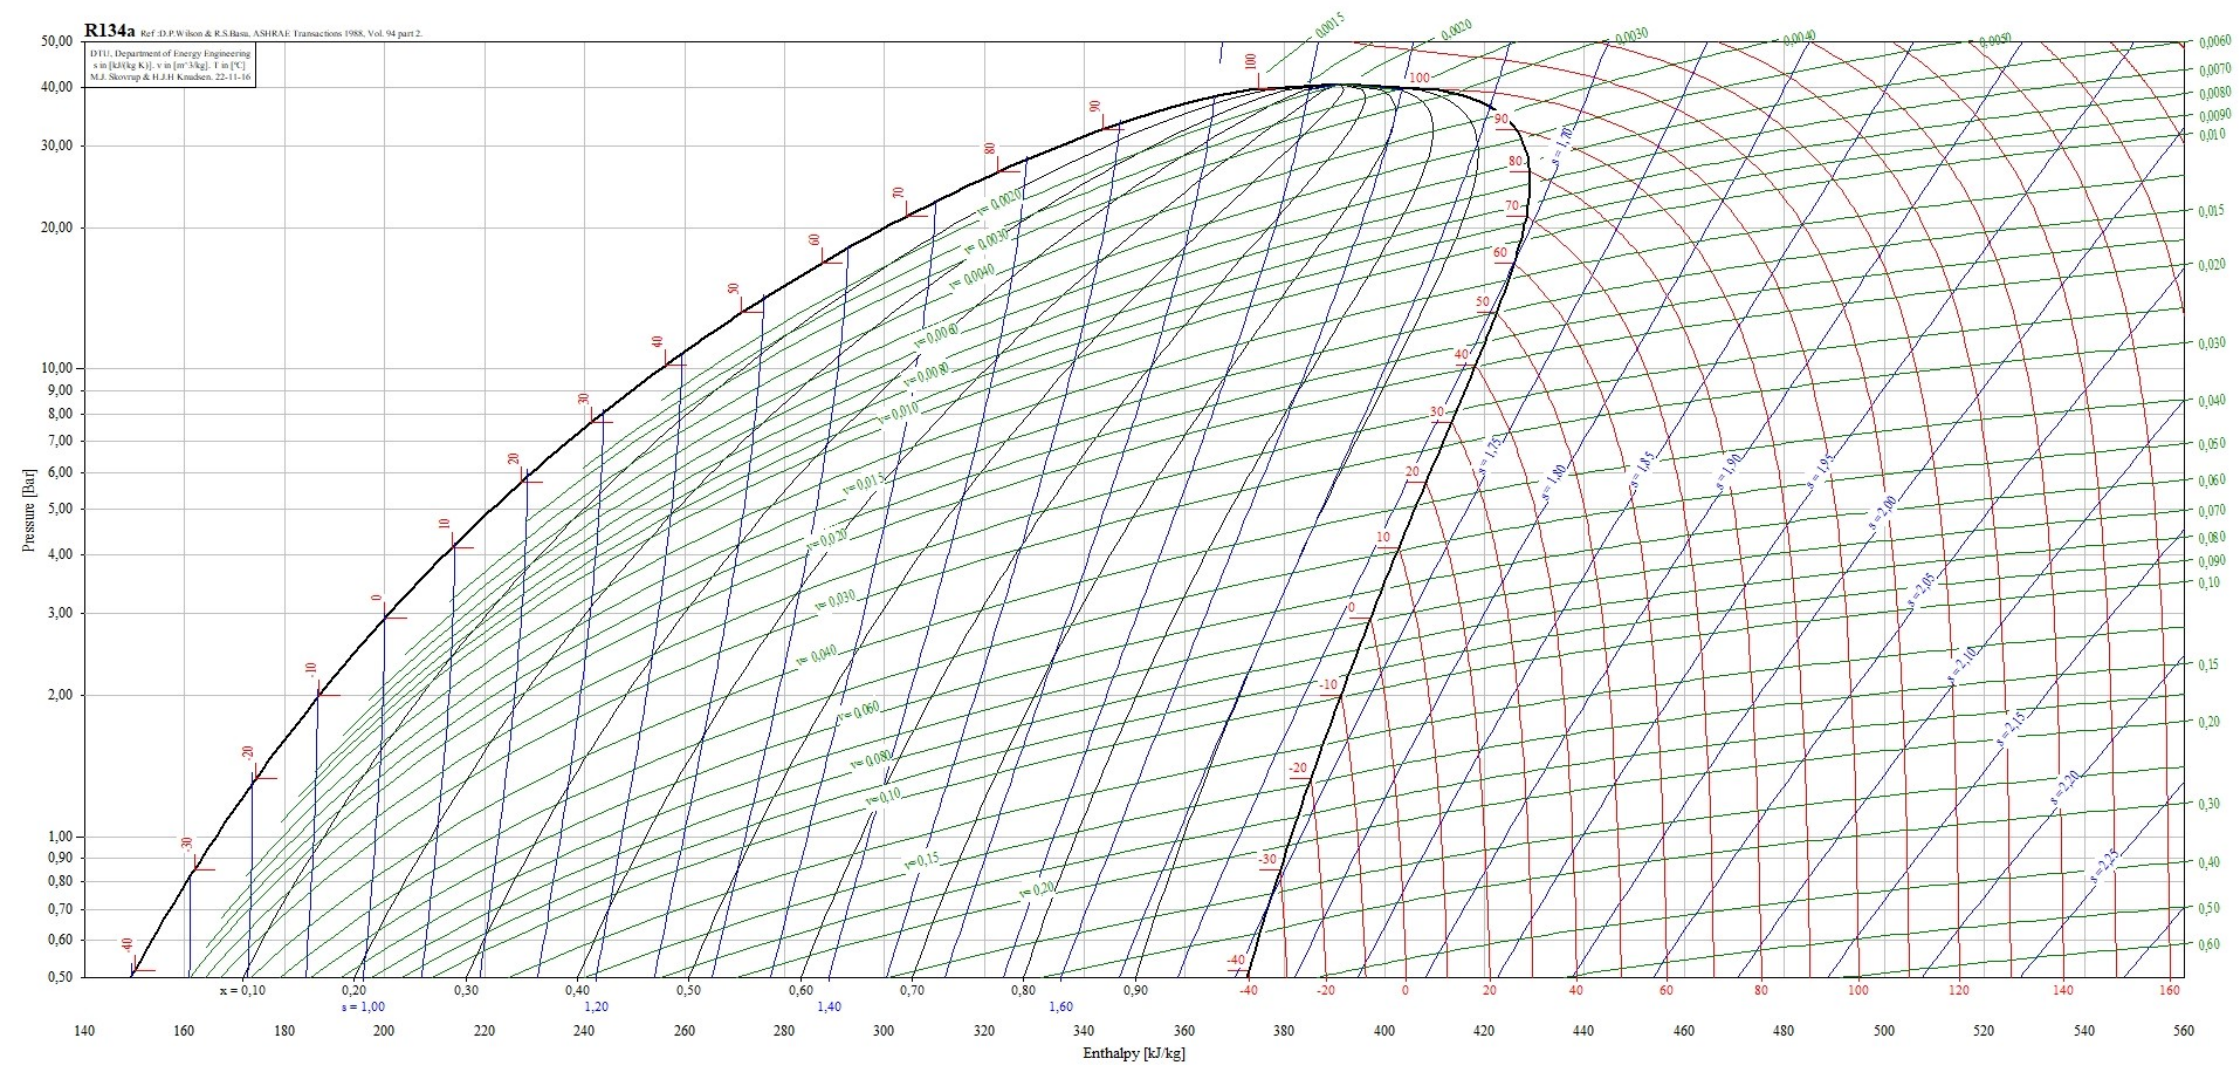

DTU, Department of Energy Engineering
 s in [kJ/kg K], v in [m³/kg], T in [°C]
 M.J. Skovrup & H.J.H. Knudsen, 20-05-24

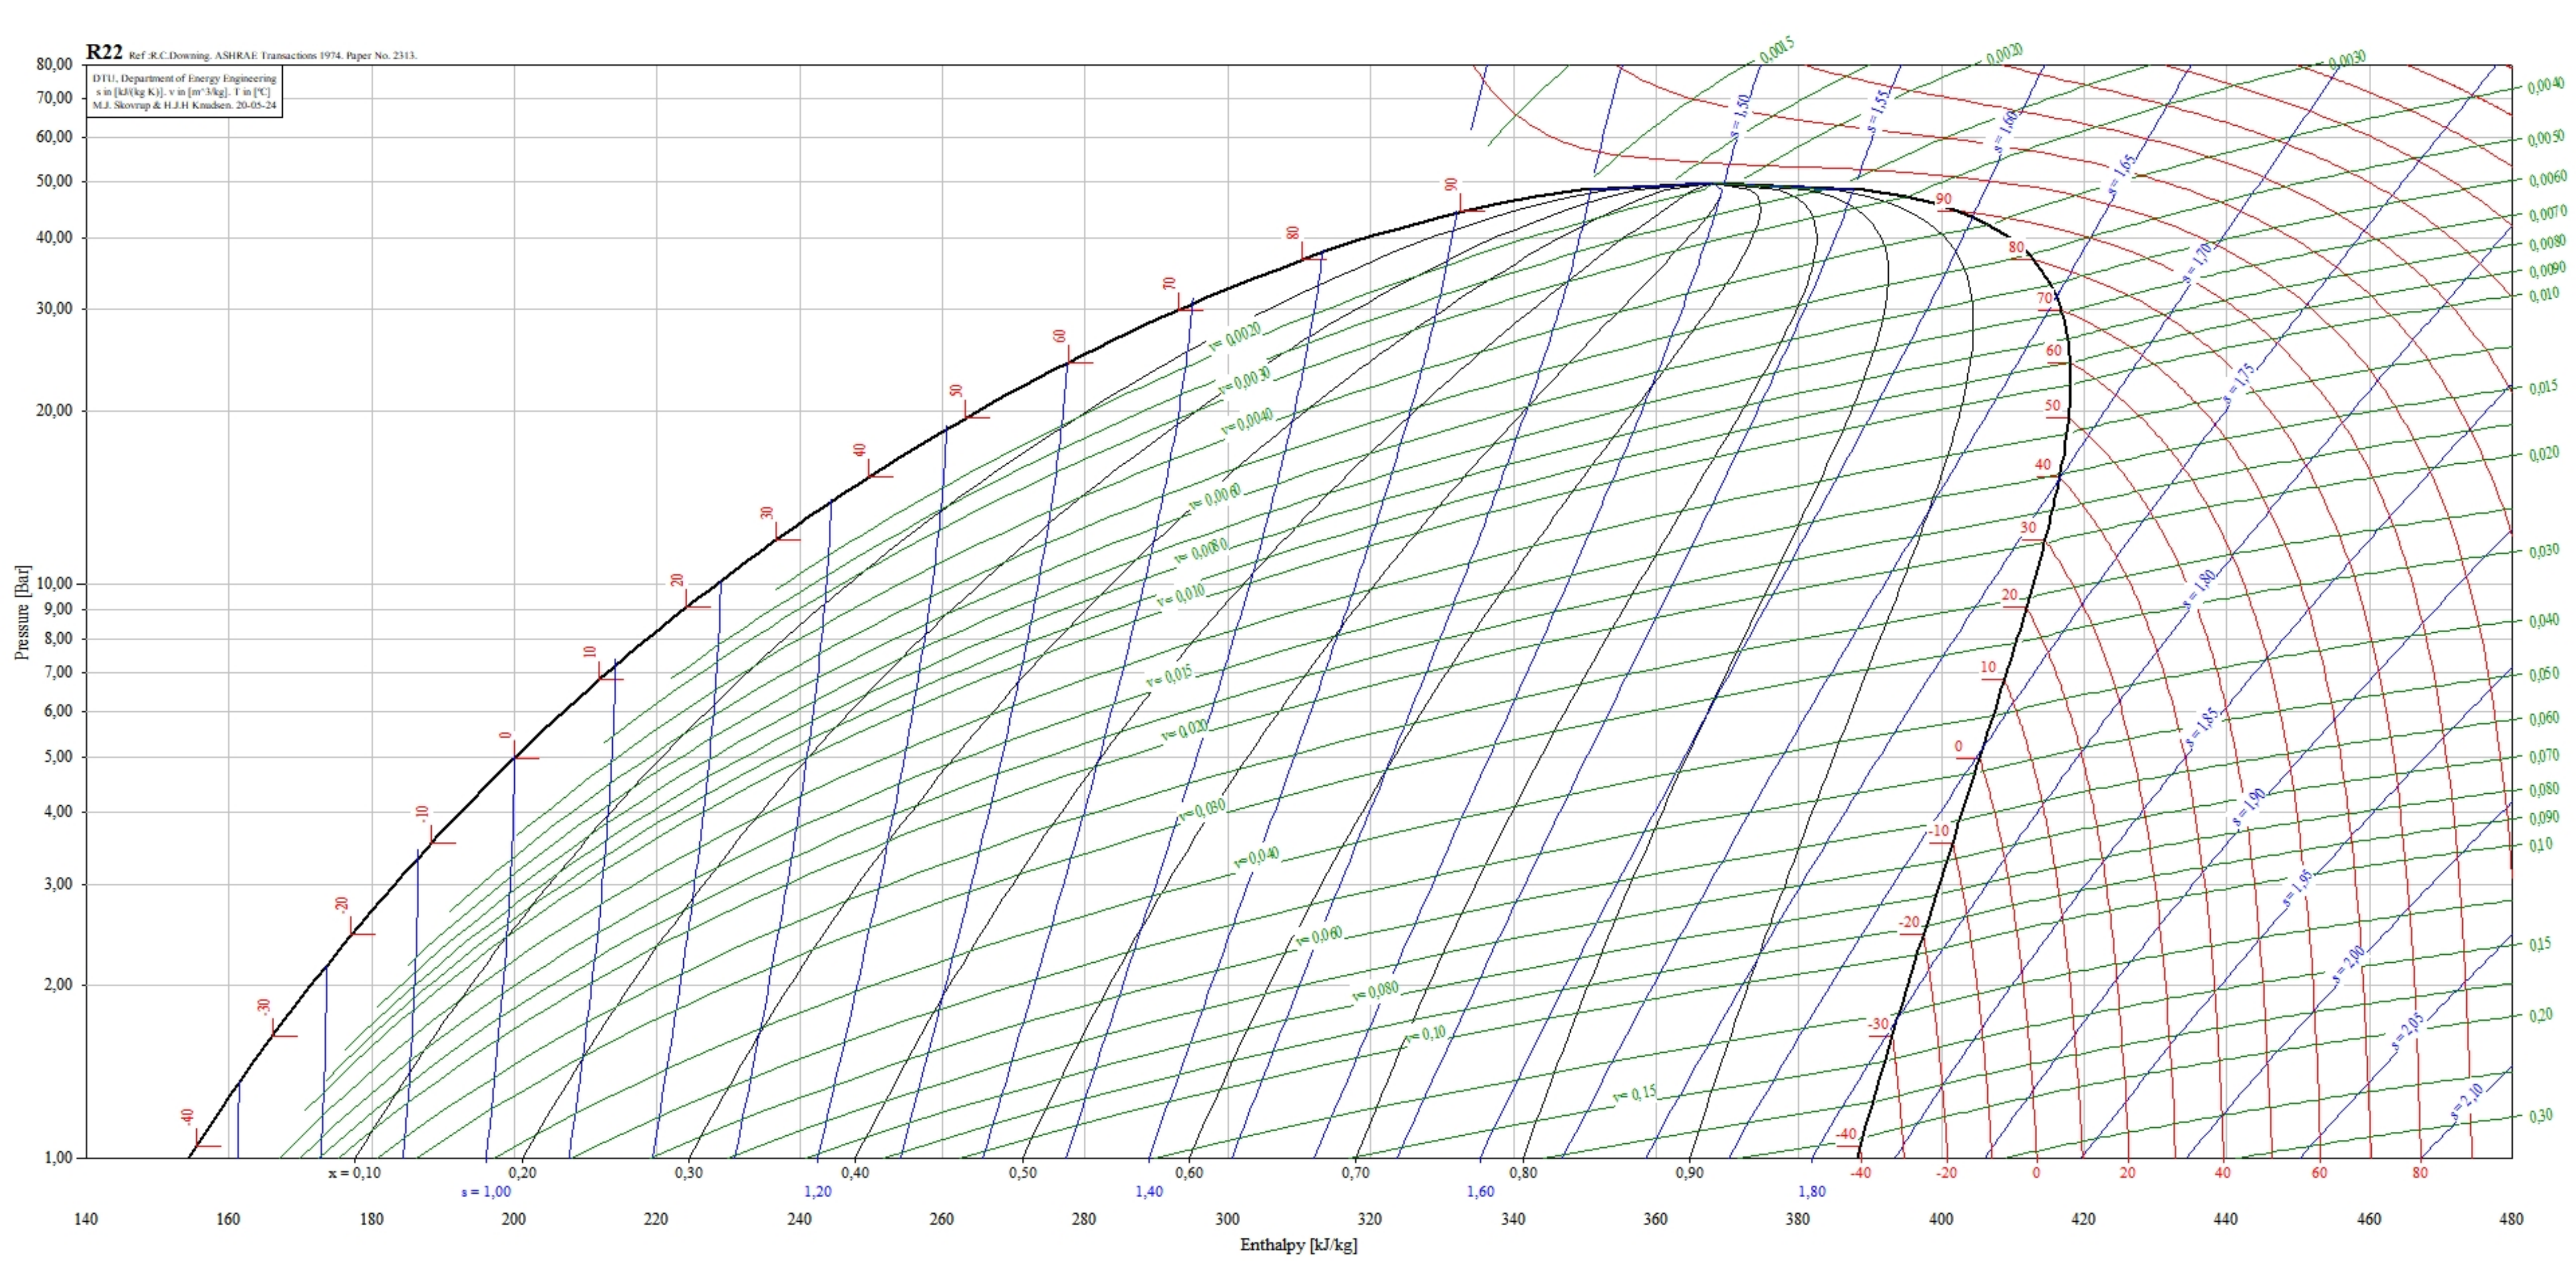


DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 20-05-24

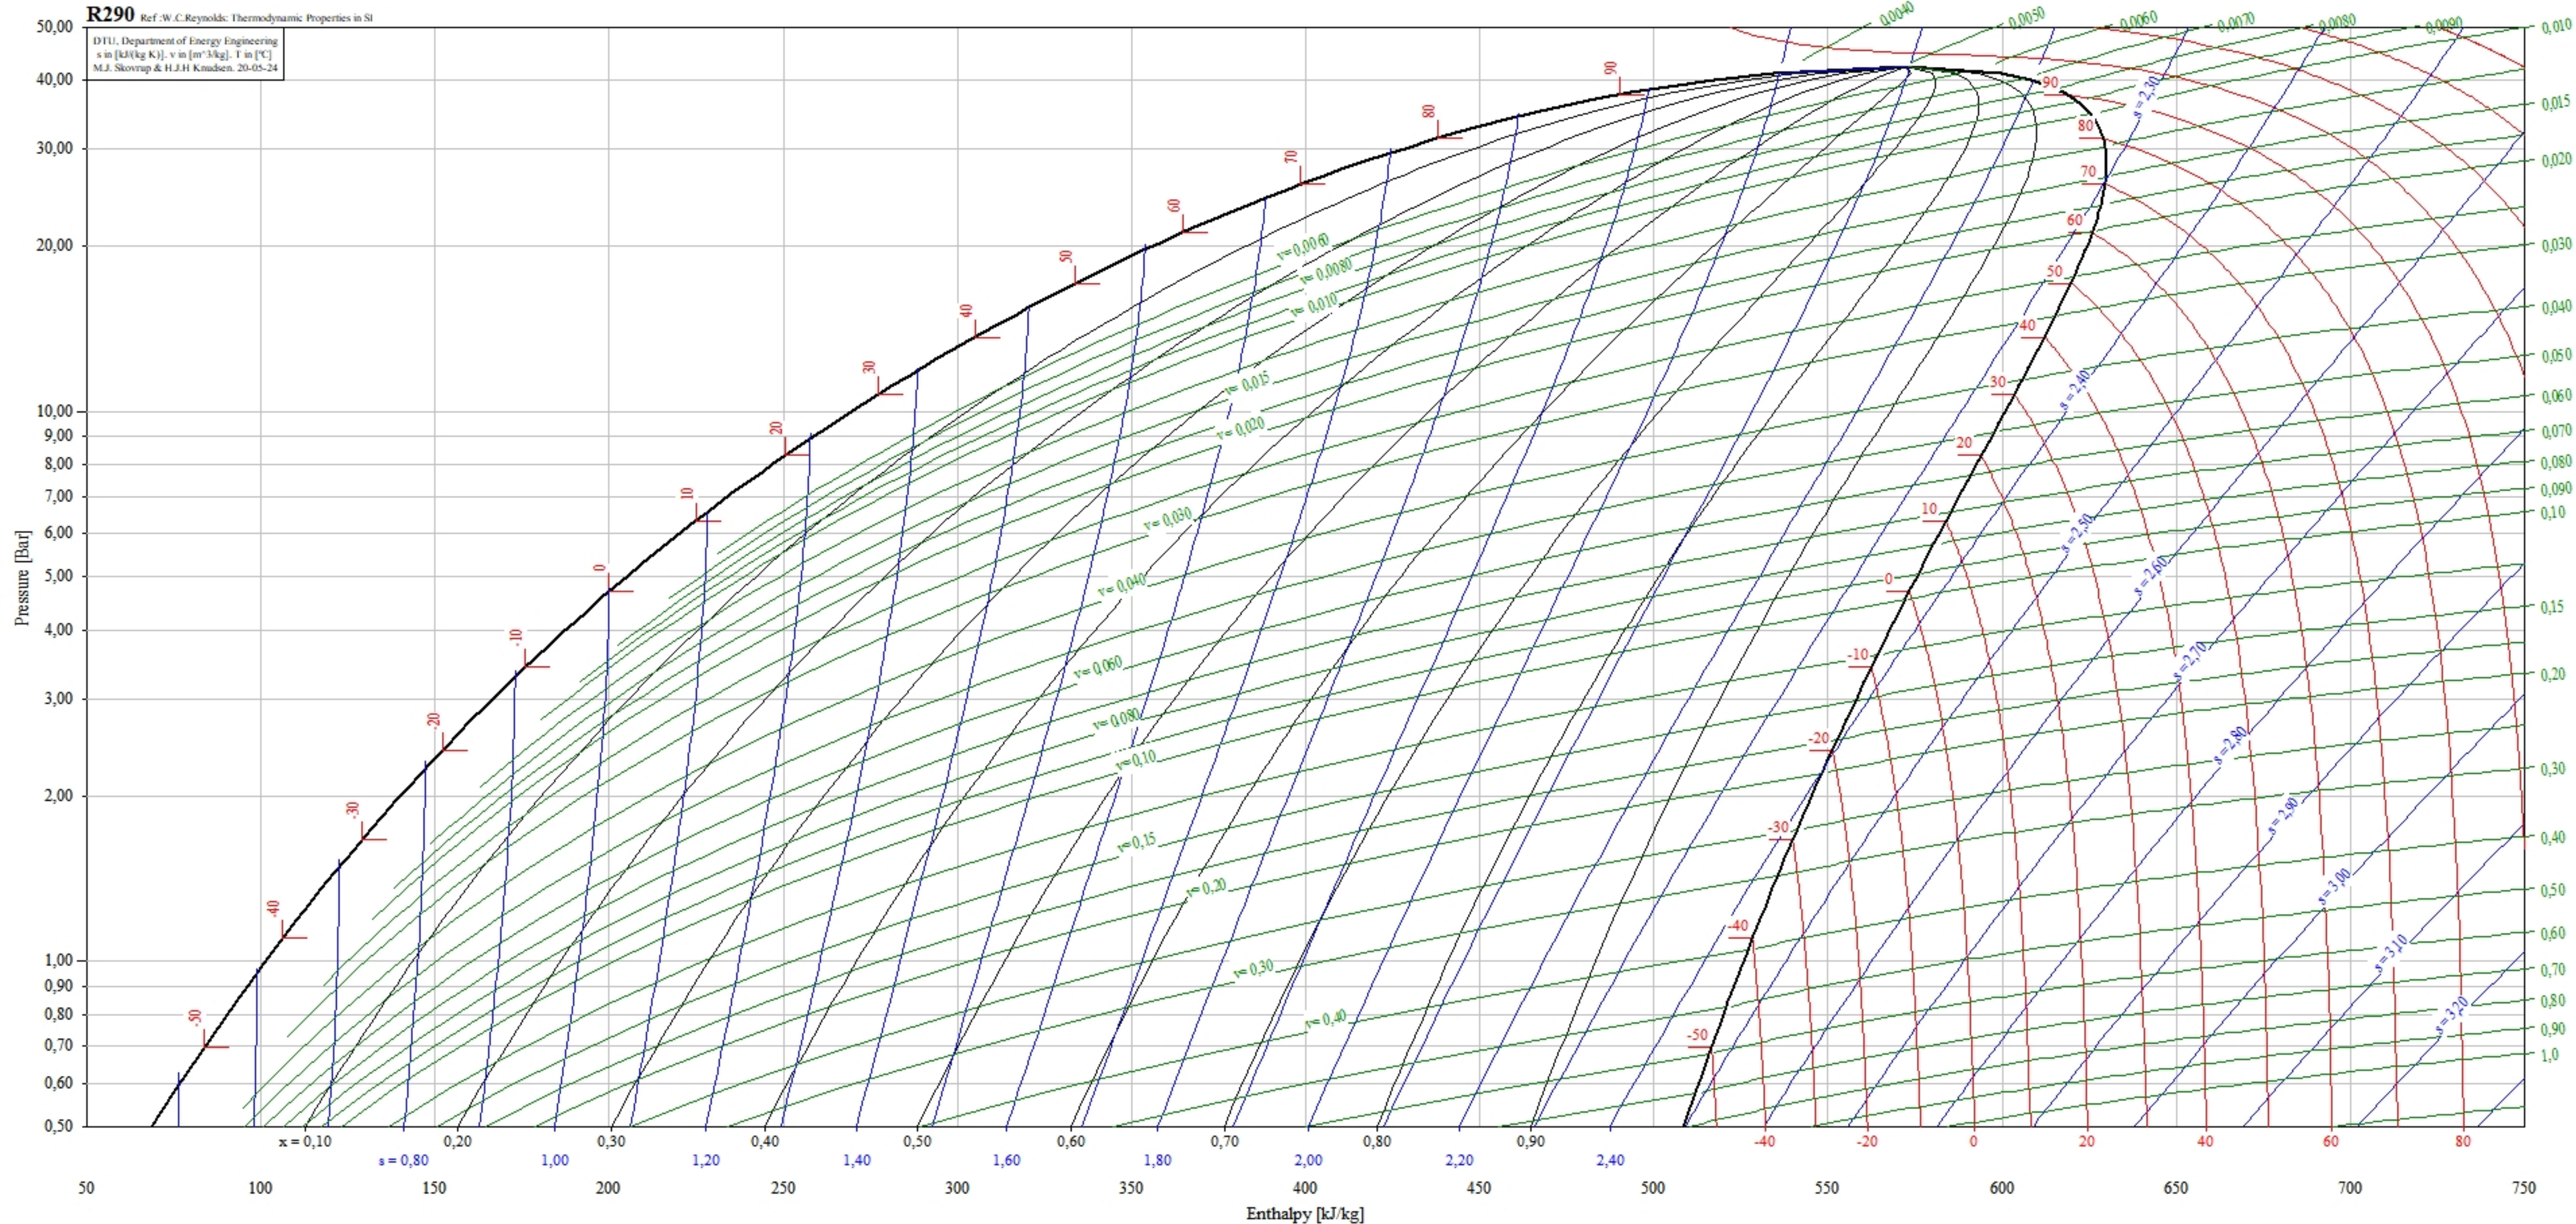


R404A Ref: DuPont SUVA HP62


DTU, Department of Energy Engineering
s in [kJ/kg K], v in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 20-05-24

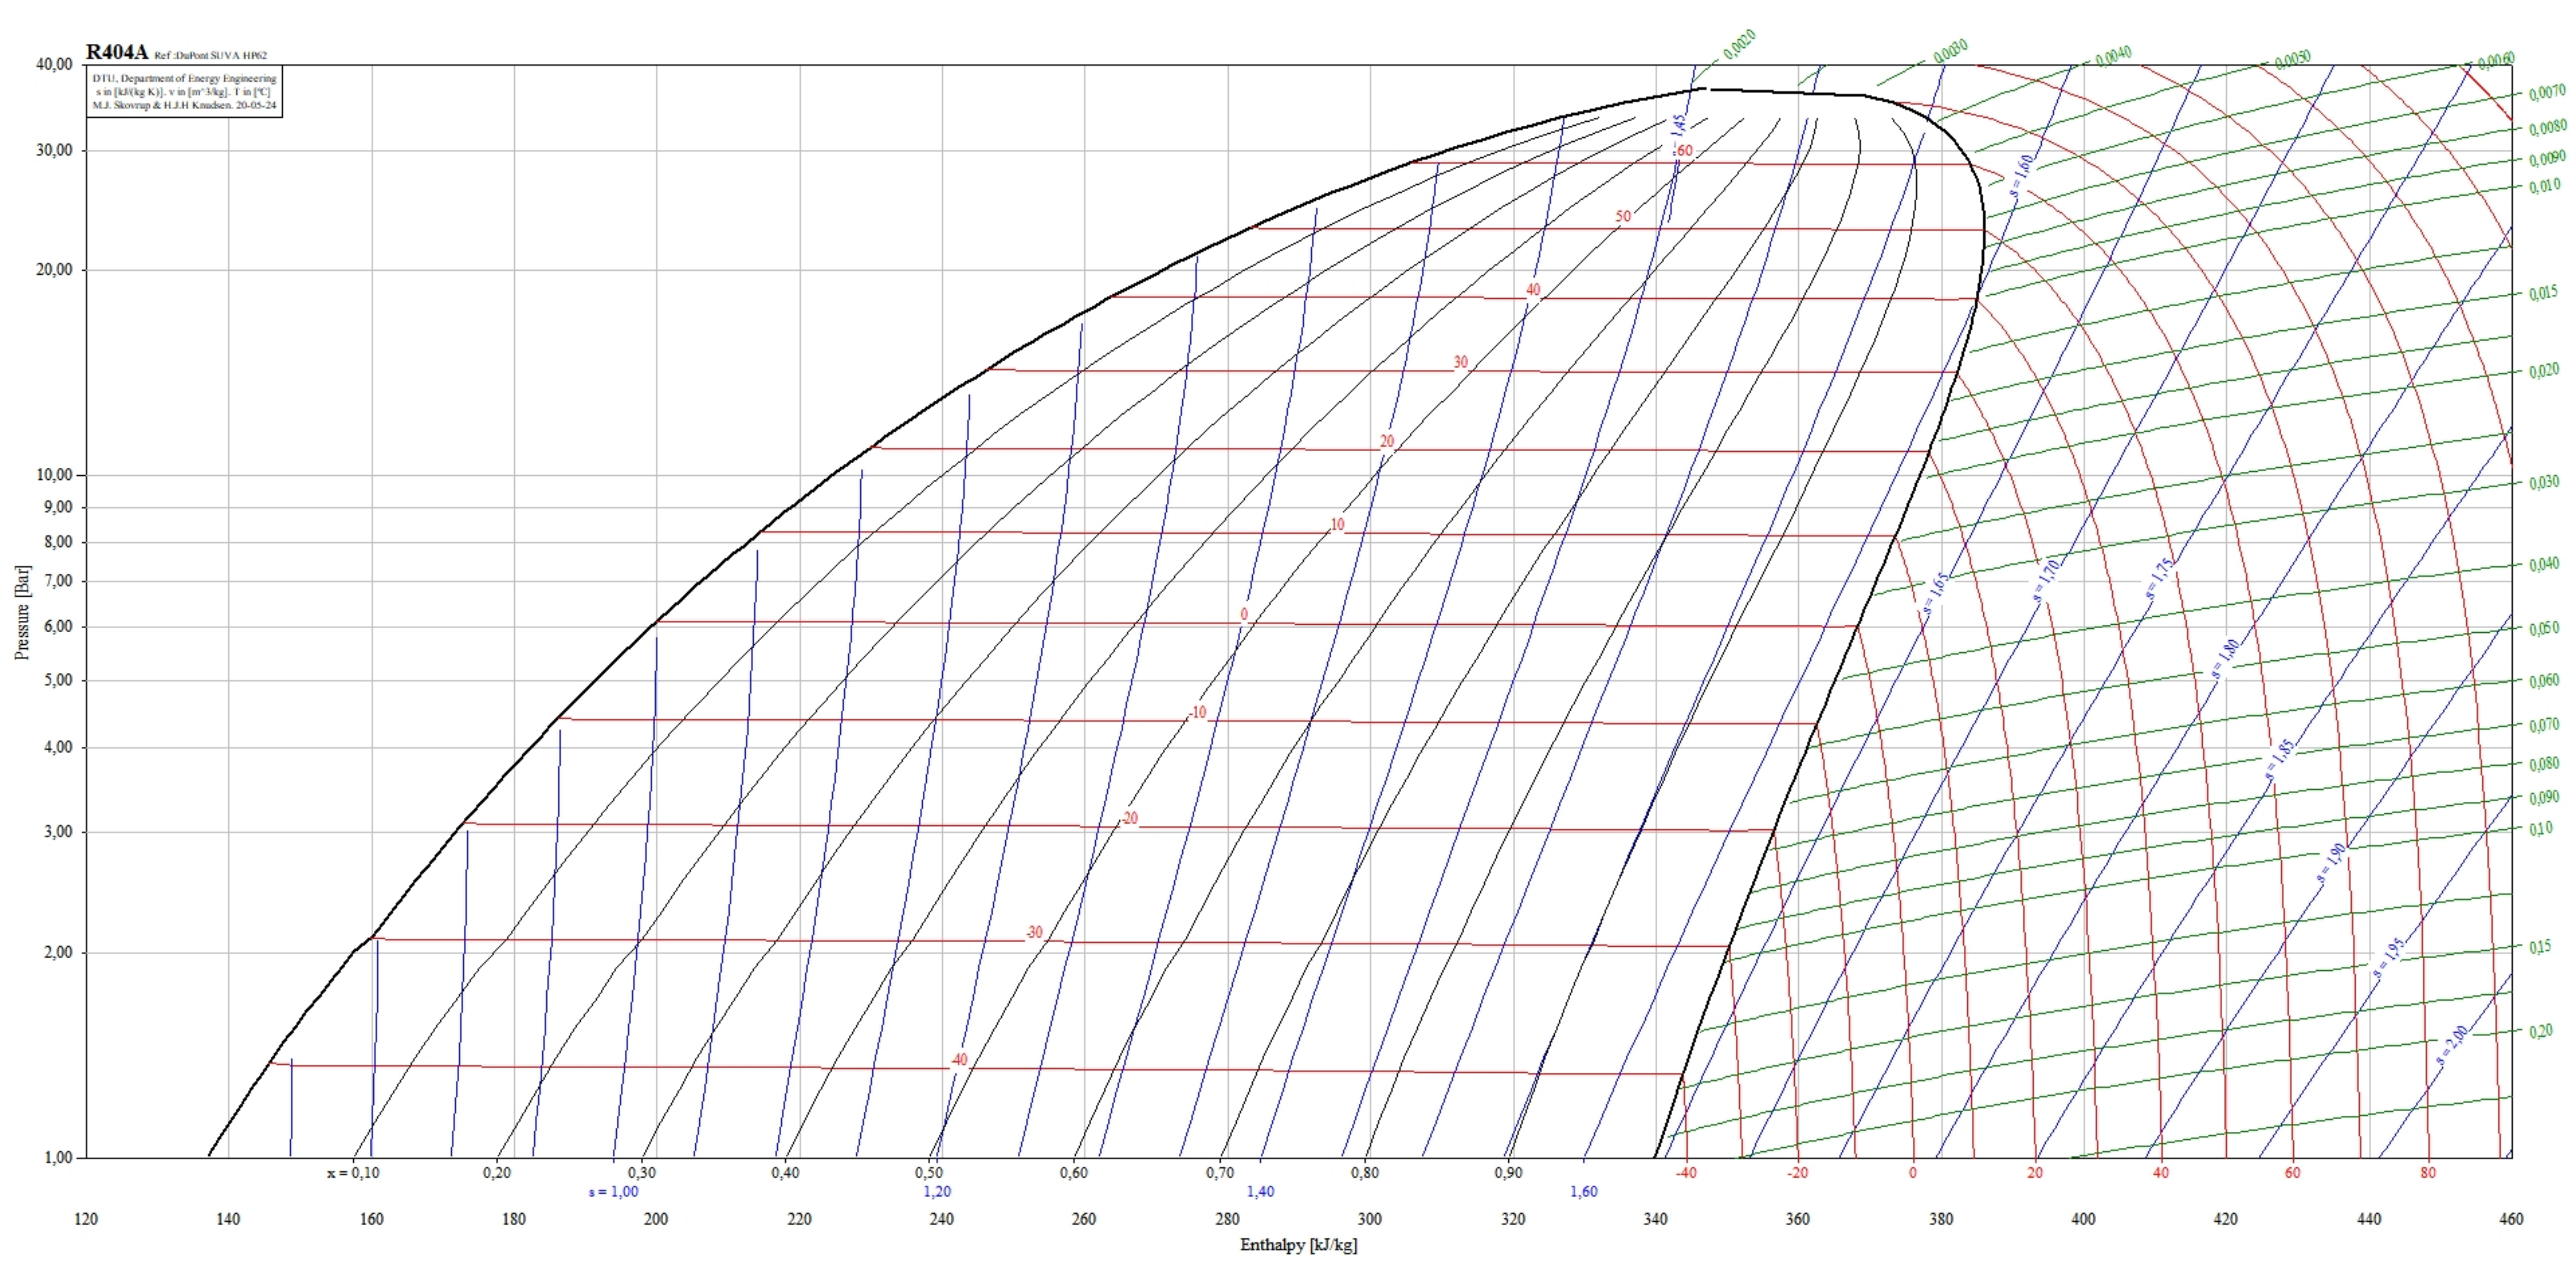

DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 20-05-24

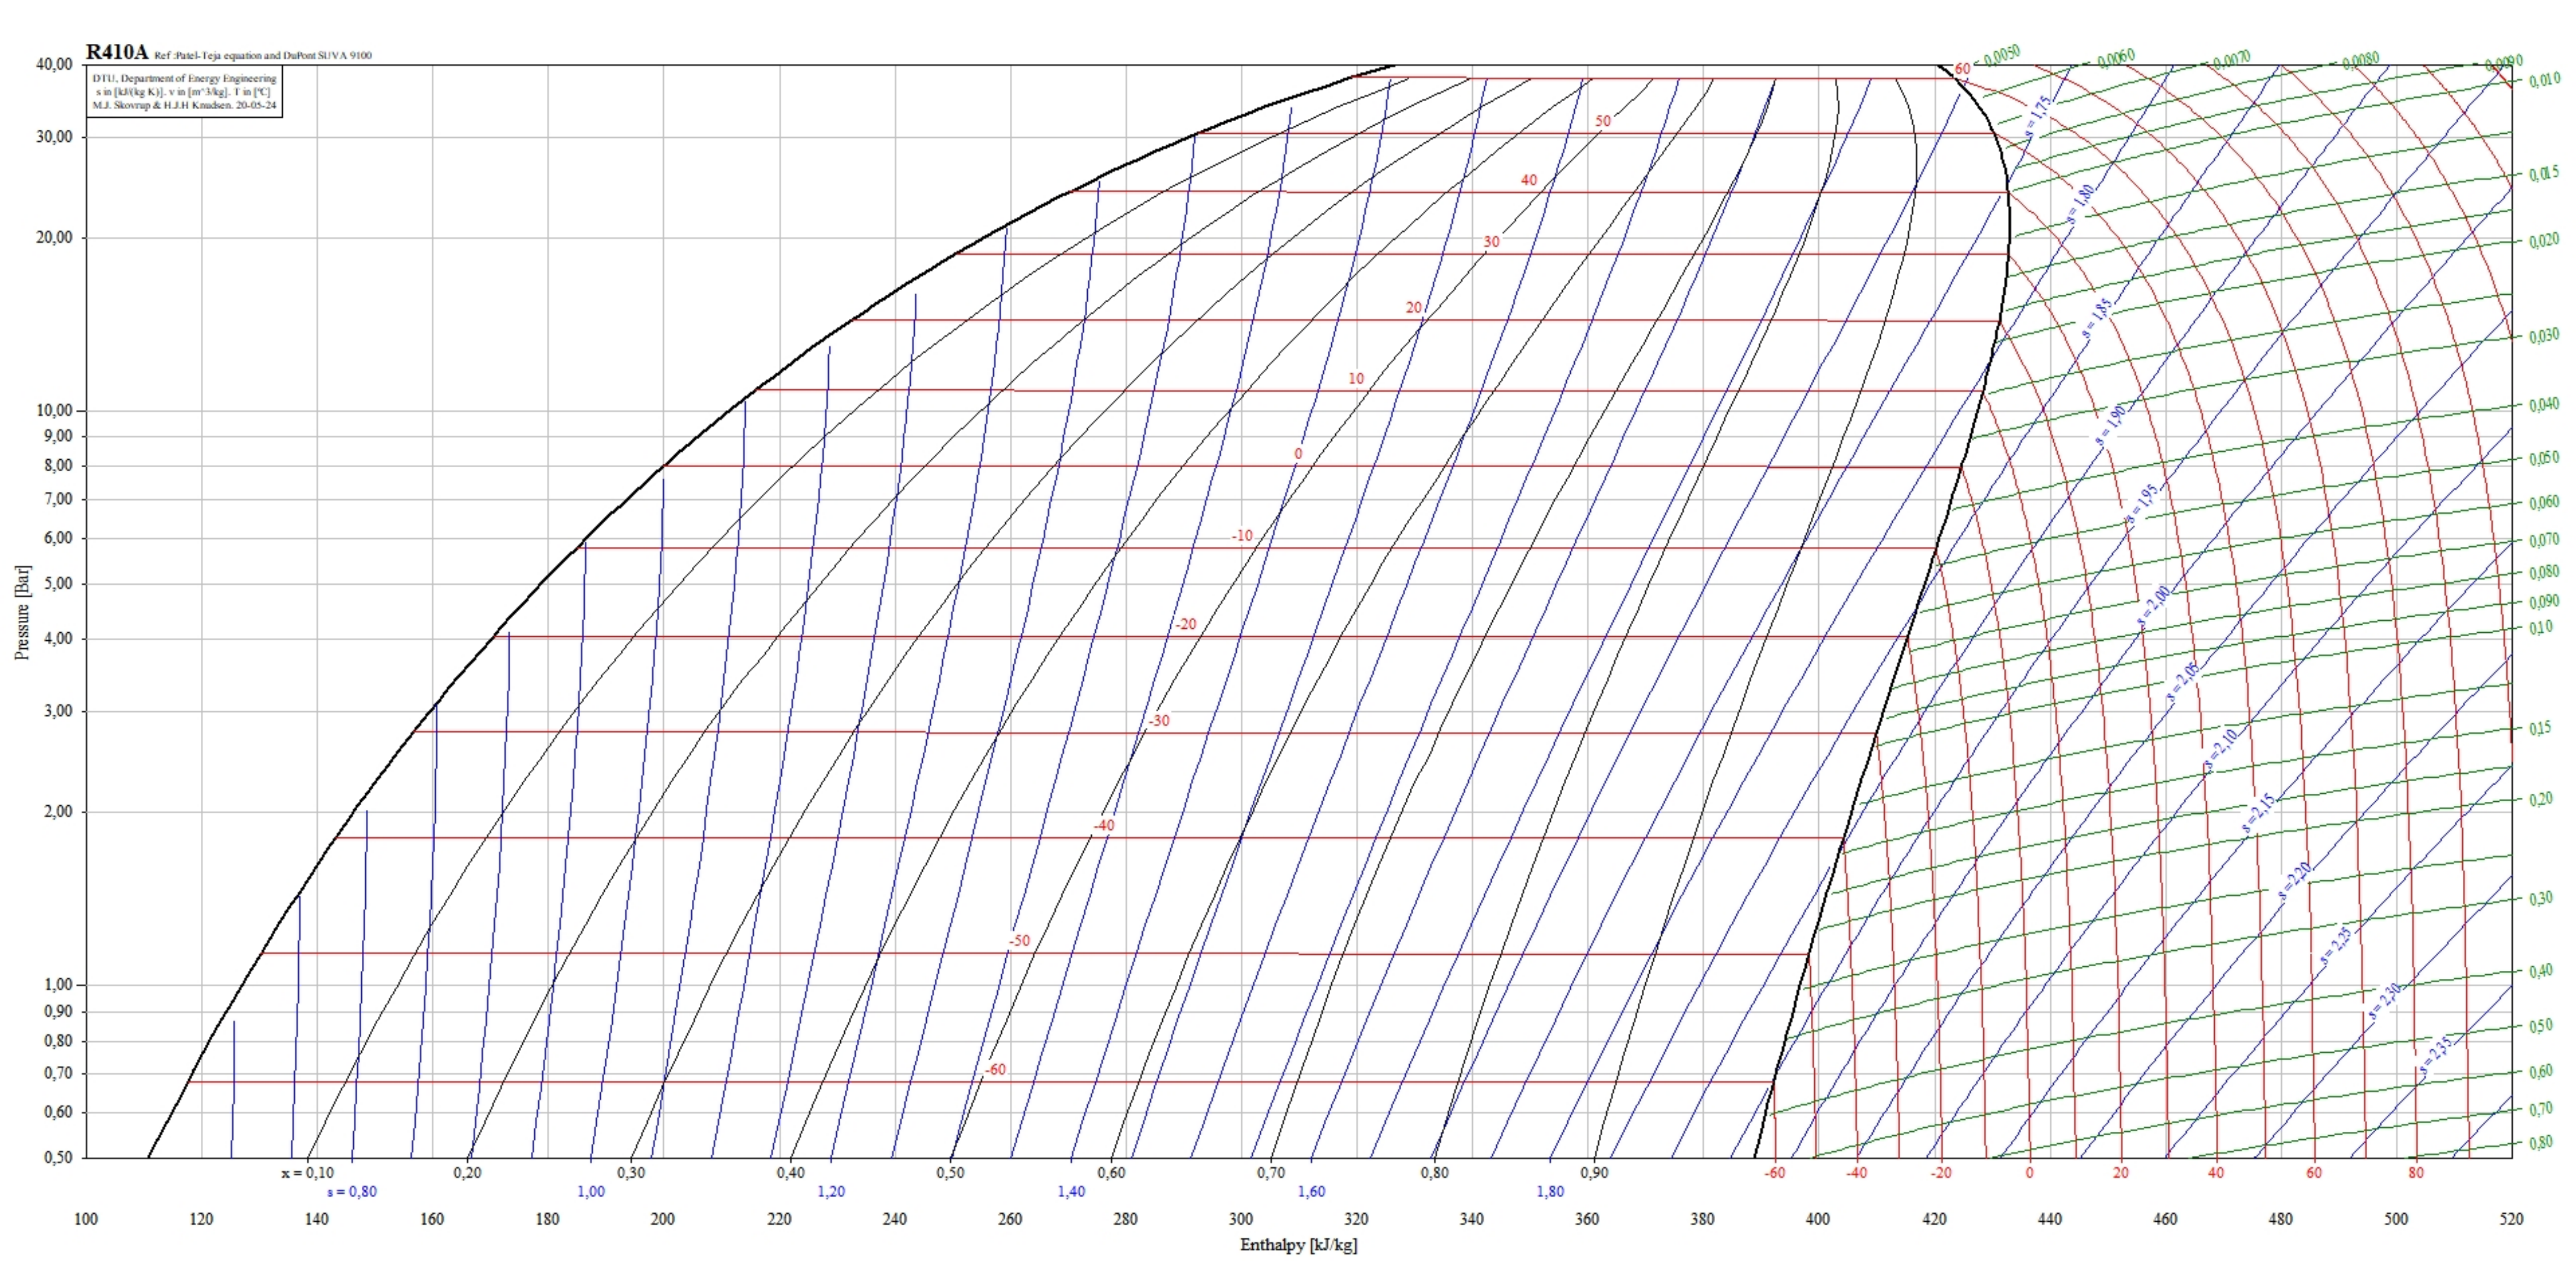

DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 20-05-24

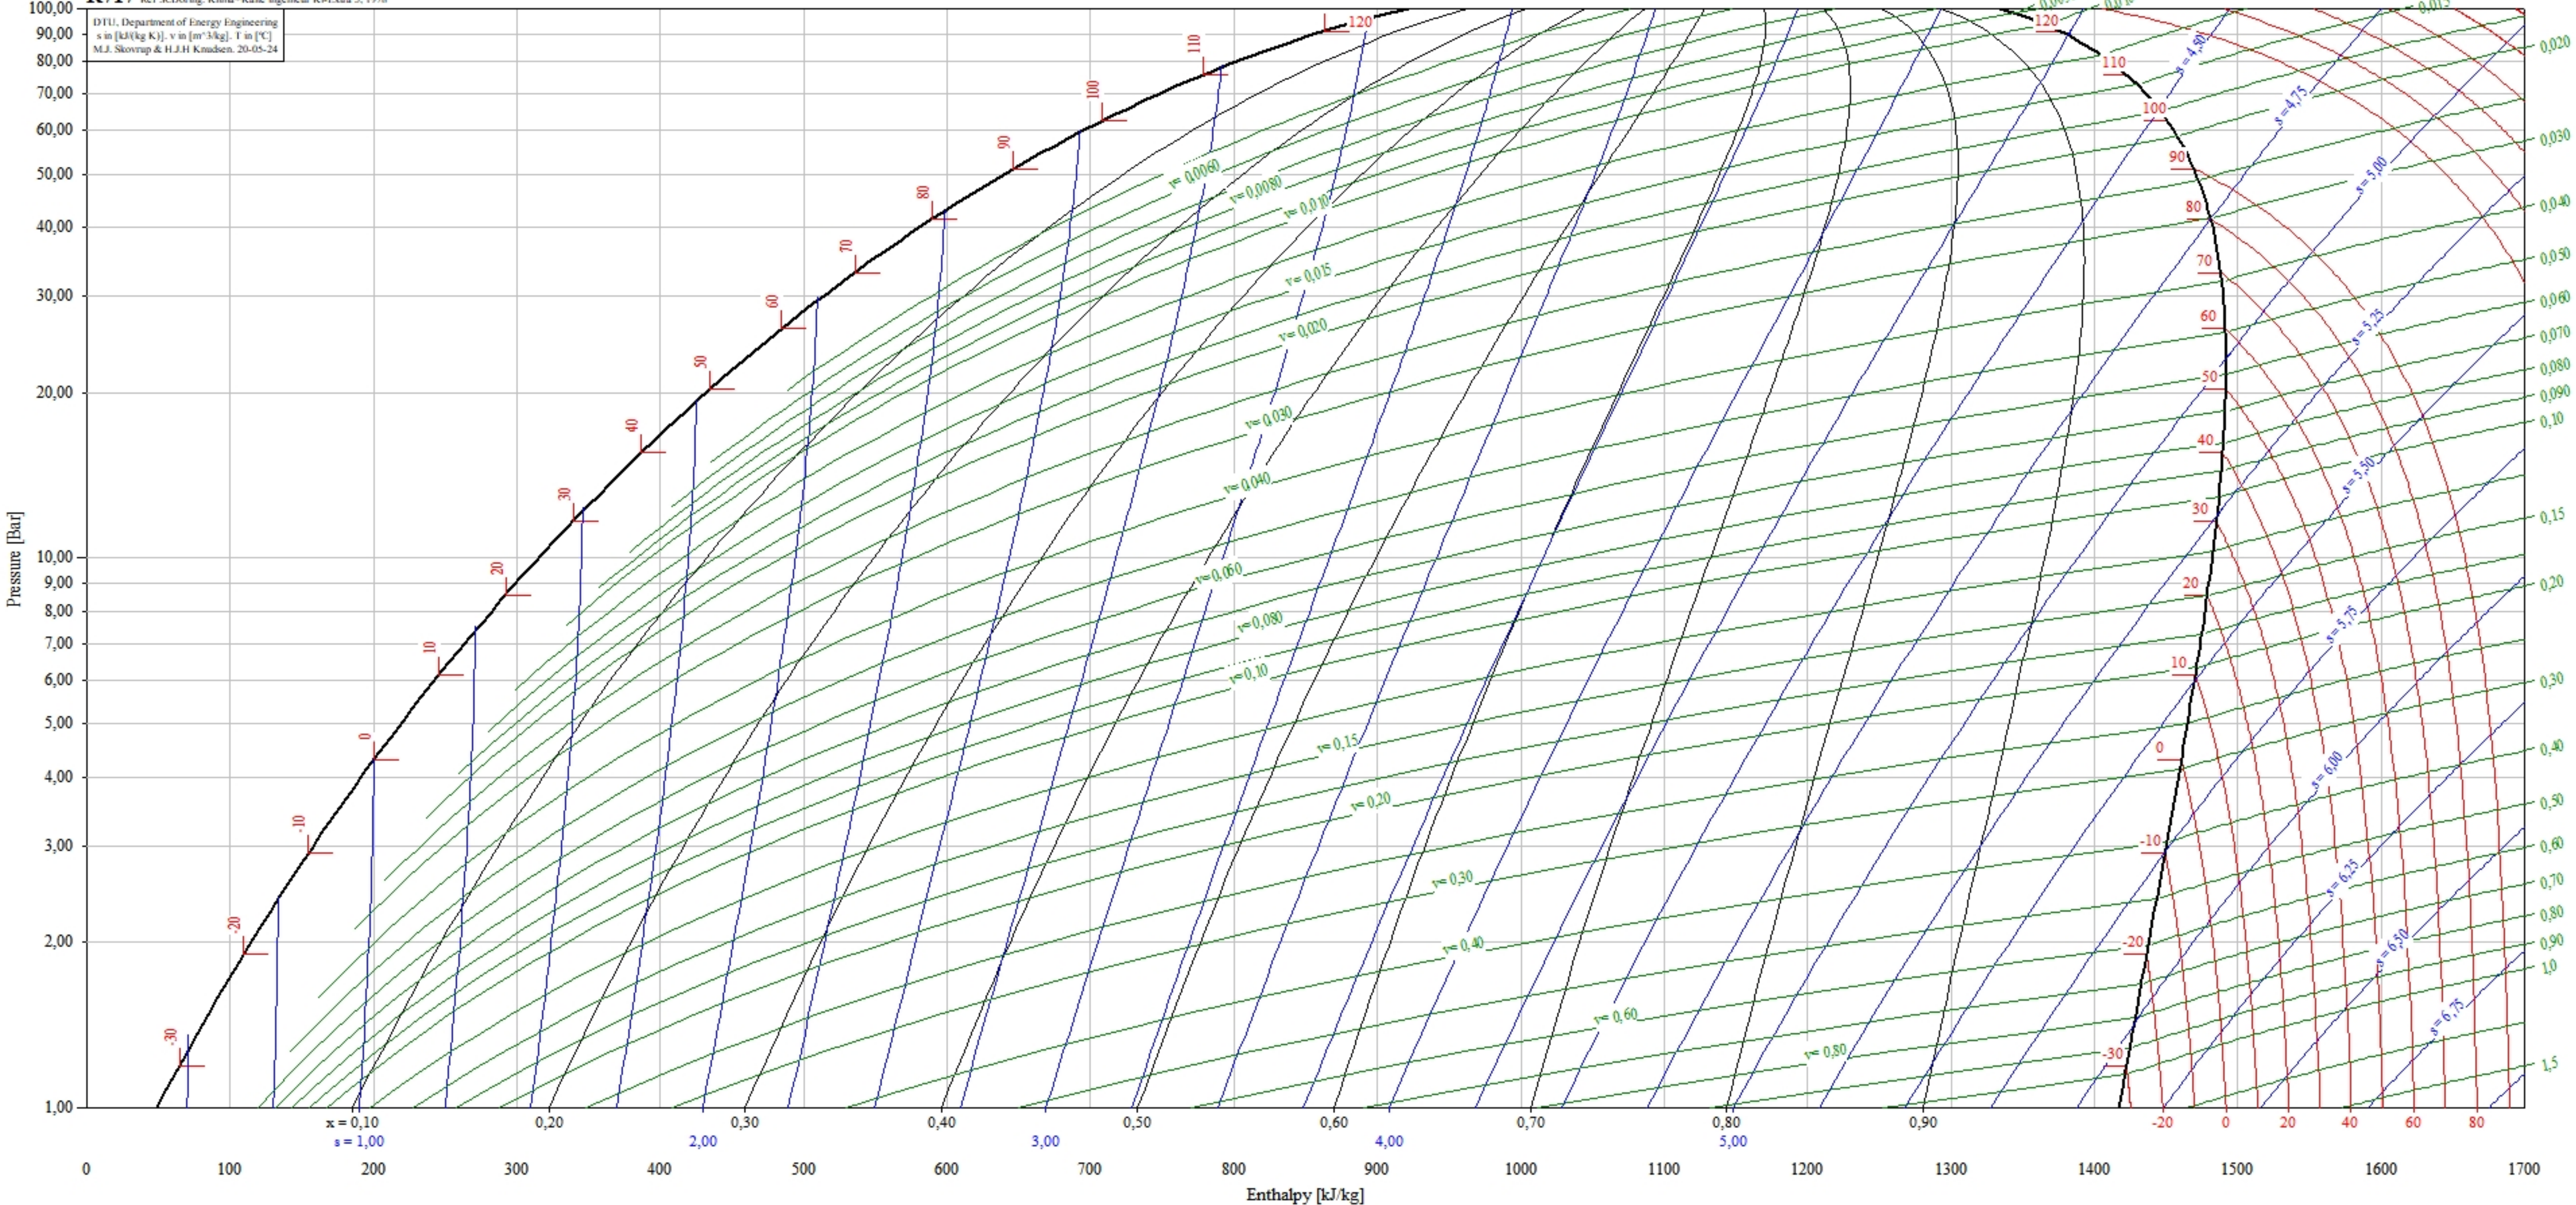

DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 20-05-24

