ELECTRODE CONFIGURATION SELECTION

DETERMINING THE APPROPRIATE TEST CONFIGURATION

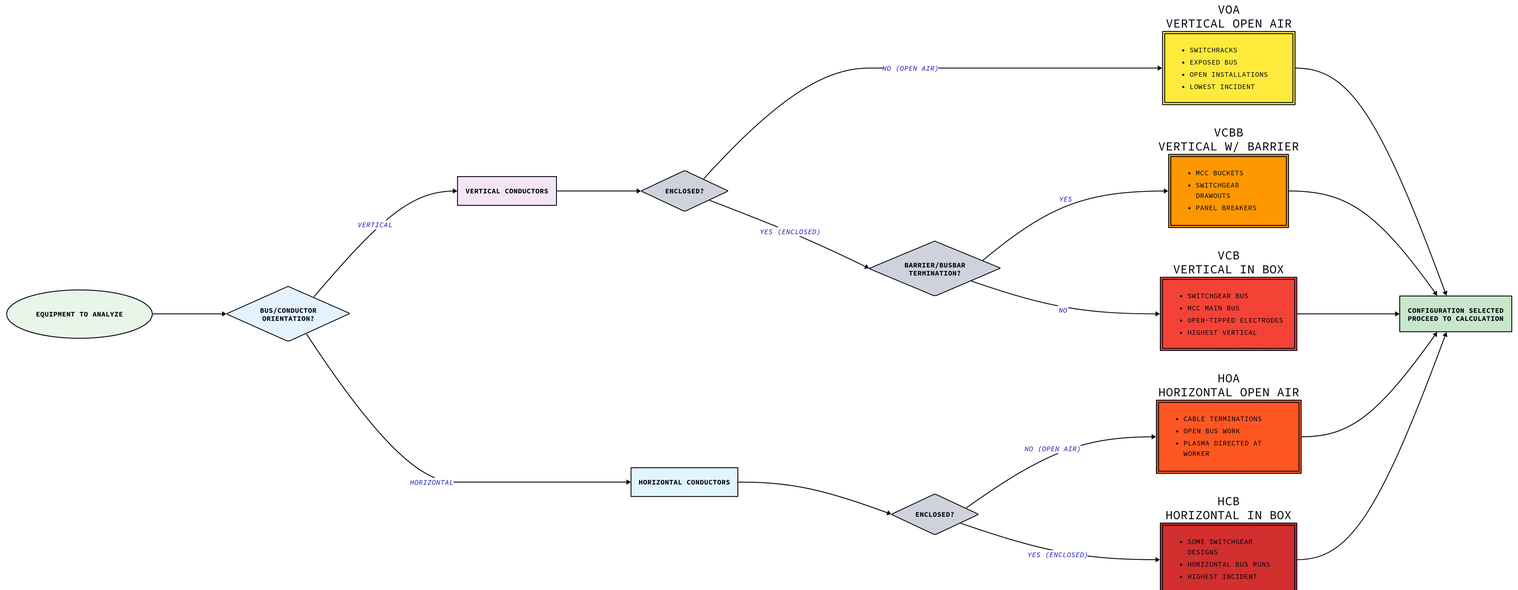

CONFIGURATION REFERENCE

SEE IEEE 1584 FIGURES:

- G.1 (VCB)
- G.2 (VCBB)
- G.3 (HCB)
- G.4 (VOA)
- G.5 (HOA)

AND TABLE 9 FOR EQUIPMENT CORRELATION

TYPICAL INCIDENT ENERGY RANKING (HIGHEST TO LOWEST)

1. HCB (HORIZONTAL IN BOX)	2. HOA (HORIZONTAL OPEN)	3. VCB (VERTICAL IN BOX)	4. VCBB (VERTICAL W/ BARRIER)	5. VOA (VERTICAL OPEN)