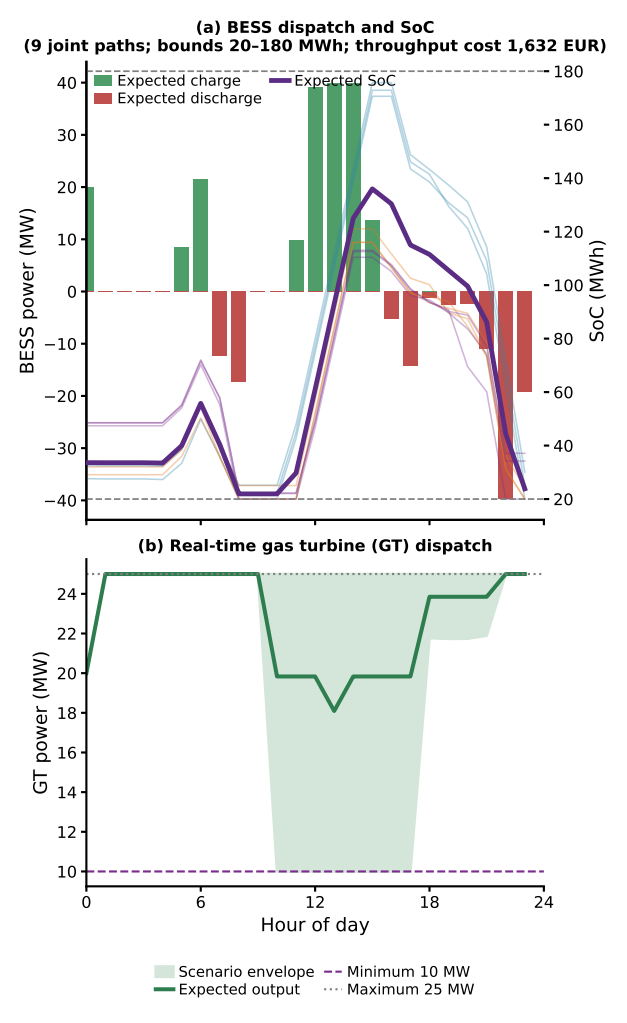
(a) BESS dispatch and SoC
(9 joint paths; bounds 20–180 MWh; throughput cost 1,632 EUR)
Expected charge
Expected discharge
Expected SoC
BESS power (MW)
SoC (MWh)
40
30
20
10
0
−10
−20
−30
−40
180
160
140
120
100
80
60
40
20
(b) Real-time gas turbine (GT) dispatch
GT power (MW)
24
22
20
18
16
14
12
10
0
6
12
18
24
Hour of day
Scenario envelope
Expected output
Minimum 10 MW
Maximum 25 MW