

A PROPOSED REMODEL FOR:
1171 NE Cleaveland
1171 NE Cleveland St, Clearwater, FL 33755

GENERAL NOTES

1. ALL WORK SHALL BE EXECUTED IN ACCORDANCE WITH THE APPLICABLE CODES LISTED
2. ALL WORK SHALL BE COMPLETED IN A NEAT AND CRAFTSMAN LIKE MANNER AND UPON COMPLETION SHALL BE INSPECTED BY THE GENERAL CONTRACTOR AND OWNER PRIOR TO FINAL PAYMENT BEING ISSUED.
3. ALL SUB-CONTRACTORS SHALL BE RESPONSIBLE FOR THE DISPOSAL OF THEIR RELATED REFUSE.
4. ALL CONDITIONS, DRAWINGS, DIMENSIONS, ETC. SHALL BE FIRST VERIFIED BY THE GENERAL BLDG CONTRACTOR AND SUB-CONTRACTORS AND OWNER PRIOR TO THE ORDERING OF MATERIALS AND CONSTRUCTION FOR DELETIONS, ERRORS, AND/OR OMISSIONS. FAILURE TO NOTIFY JAE CARBON SHALL RELIEVE JAE CARBON FOR FURTHER RESPONSIBILITY OR FURTHER COSTS.
5. THESE PLANS CONTAIN SUGGESTED FLOORING AND ROOFING LAYOUTS WHICH SHALL BE REVIEWED BY A CERTIFIED TRUSS ENGINEER OF PROFESSIONAL ENGINEER OF RECORD AND SHALL HAVE PROVISIONS MADE FOR H.V.A.C., ELECTRICAL, AND PLUMBING INSTALLATION.
6. ANY ALTERATION OR DEVIATION FROM THIS PLAN SHALL BE MADE WITH THE COMBINED APPROVAL OF THE OWNER, JAE CARBON, AND THE PROFESSIONAL ENGINEER OF RECORD. ITEMS NOT APPROVED SHALL RELIEVE THE OWNER, JAE CARBON, AND THE PROFESSIONAL ENGINEER OF RECORD OF RESPONSIBILITY, AND ANY FURTHER COSTS TO CORRECT THE ALTERATION OR DEVIATION.
7. ALL 2"x WOOD SPECIFIED SHALL BE PINE, NO 2 GRADE UNLESS SPECIFIED ELSEWHERE AND PRESSURE TREATED WHERE REQUIRED.
8. ALL STAIRS, HANDRAILS AND GUARDRAILS SHALL COMPLY WITH SECT 1012 OF THE FBC2023
9. ALL PREFABRICATED BRACKETS AND CONNECTORS TO BE SIMPSON AND INSTALLED PER THE MANUFACTURER'S SPECIFICATIONS.
10. ALL CONCRETE TO BE 3,000 PSI, DESIGN MIX SLUMP 3"8" AGGREGATE UNLESS NOTED OTHERWISE
11. ALL STRUCTURAL STEEL TO BE ASTM GRADE 40 EXCEPT GRADE 60 SHALL BE USED IN INTELS AND COLUMNS UNLESS OTHERWISE NOTED.
12. ALL WINDOWS AND DOORS TO BE INSTALLED PER MFR. INSTRUCTIONS, SPECIFICATION, AND MUST BE RATED TO SATISFY DESIGN WIND PRESSURES AND IMPACT RESISTANCE IF REQUIRED.
13. FOUNDATION AND SLAB TO BE INSTALLED ON UNDISTURBED CLEAN SOIL OR WELL COMPACTED FILL SATISFYING FBC 1803
14. UNLESS OTHERWISE NOTED AND IN THE ABSENCE OF SITE SPECIFIC SOILS INFORMATION, THE PRESUMPTIVE ALLOWABLE SOIL BEARING CAPACITY IS 2000 PSF (POUNDS PER SQ.FT.)
15. ALL WALL SHEATHING BUTT JOINTS TO BE BLOCK WITH 2" X LUMBER AND FASTENED PER EDGE FASTENING SCHEDULE
16. THE DESIGNER AND THE PROFESSIONAL ENGINEER OF RECORD ARE NOT RESPONSIBLE FOR MEANS, METHODS, AND SCHEDULE.
17. WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS.
18. THESE PLANS DO NOT CONTAIN ALL CODE REQUIREMENT INFORMATION. INDIVIDUAL SUBCONTRACTORS SHALL BE RESPONSIBLE FOR MAINTAINING CODE COMPLIANCE RELATED TO THE PERFORMANCE OF THEIR INDIVIDUAL TASKS, I.E. ELECTRICAL, MECHANICAL, PLUMBING, STUCCO ETC.
19. ANY DISCREPANCIES BETWEEN THE ENGINEERING AND DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGNER/ENGINEER FOR CLARIFICATION.
20. WATER PROOFING OF ALL DOORS AND WINDOWS TO BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR
21. ALL FLASHING SHALL ADHERE TO THE 2023 FLORIDA BUILDING CODE 8TH EDITION

DO NOT SCALE DRAWINGS!

SAFETY GLAZING

THE FOLLOWING SHALL BE CONSIDERED SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSE OF GLAZING

1. GLAZING IN SWING DOORS, FIXED AND SLIDING PANEL OF SLIDING DOOR ASSEMBLIES.
2. GLAZING IN DOORS AND ENCLOSURES FOR HOT TUBS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, AND SHOWERS AND GLAZING IN ANY PORTION OF A BUILDING WALL ENCLOSING THESE COMPARTMENTS WHERE THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 60" ABOVE THE DRAIN INLET.
3. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" RADIUS OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS LESS THAN 60" ABOVE THE FINISH FLOOR OR WALKING SURFACE.
4. GLAZING IN AN INDIVIDUAL FIXED OR OPERABLE PANEL OTHER THAN THOSE LOCATIONS DESCRIBED IN ITEMS 2 AND 3 ABOVE THAT MEETS ALL OF THE FOLLOWING:
 - A. EXPOSED AREA OF AN INDIVIDUAL PANE GREATER THAN 9 SQ. FT.
 - B. BOTTOM EDGE LESS THAN 18" ABOVE THE FLOOR
 - C. TOP EDGE GREATER THAN 36" ABOVE THE FLOOR
 - D. ONE OR MORE WALKING SURFACES WITHIN 36" HORIZONTALLY OF THE PLANE OF GLAZING. REFER TO THE 8TH EDITION, 2023 FLORIDA BUILDING CODE, RESIDENTIAL CODE FOR ADDITIONAL AREAS THAT MAY BE CONSIDERED A HAZARDOUS LOCATION FOR THE PURPOSE OF GLAZING.

DEVIATION NOTE

JAE CARBON LLC (DESIGNER) AND EOR ARE NOT RESPONSIBLE FOR MISINTERPRETATION OR UNAUTHORIZED DEVIATION FROM DOCUMENTS. IT IS CUSTOMARY AND ORDINARY TO OMIT CERTAIN DETAILS FROM THE PLANS WELL WITHIN THE COMMON KNOWLEDGE OF A LICENSED CONTRACTOR. IF HOMEOWNER ELECTS TO BUILD HOME WITHOUT A CONTRACTOR THE HOMEOWNER ASSUMES FULL RESPONSIBILITY FOR METHOD OF CONSTRUCTION, AND EOR MUST BE NOTIFIED OF ANY DETAIL OR DRAWINGS REQUIRED FOR WHICH CONTRACTOR OR HOMEOWNER MAY NEED FOR FURTHER EXPLANATION PRIOR TO CONSTRUCTION.

VICINITY MAP

NOT TO SCALE



SCOPE OF WORK

REMODEL INTERIOR FOR NEW OFFICE SPACES, ADA BATHROOM, AND EXTERIOR TO ADD NEW WINDOWS.

WIND INFORMATION

Developed by **MecaWind v2545**
www.mecawind.com, Copyright © 2024

Calculations Requested by:
Date: 10-10-2024
File: 1171 NE Cleveland St - Project Not Saved

General:
Reference: ASCE 7-16, Table 6-5, Figure 6-5, Figure 6-6, Figure 6-7, Figure 6-8, Figure 6-9, Figure 6-10, Figure 6-11, Figure 6-12, Figure 6-13, Figure 6-14, Figure 6-15, Figure 6-16, Figure 6-17, Figure 6-18, Figure 6-19, Figure 6-20, Figure 6-21, Figure 6-22, Figure 6-23, Figure 6-24, Figure 6-25, Figure 6-26, Figure 6-27, Figure 6-28, Figure 6-29, Figure 6-30, Figure 6-31, Figure 6-32, Figure 6-33, Figure 6-34, Figure 6-35, Figure 6-36, Figure 6-37, Figure 6-38, Figure 6-39, Figure 6-40, Figure 6-41, Figure 6-42, Figure 6-43, Figure 6-44, Figure 6-45, Figure 6-46, Figure 6-47, Figure 6-48, Figure 6-49, Figure 6-50, Figure 6-51, Figure 6-52, Figure 6-53, Figure 6-54, Figure 6-55, Figure 6-56, Figure 6-57, Figure 6-58, Figure 6-59, Figure 6-60, Figure 6-61, Figure 6-62, Figure 6-63, Figure 6-64, Figure 6-65, Figure 6-66, Figure 6-67, Figure 6-68, Figure 6-69, Figure 6-70, Figure 6-71, Figure 6-72, Figure 6-73, Figure 6-74, Figure 6-75, Figure 6-76, Figure 6-77, Figure 6-78, Figure 6-79, Figure 6-80, Figure 6-81, Figure 6-82, Figure 6-83, Figure 6-84, Figure 6-85, Figure 6-86, Figure 6-87, Figure 6-88, Figure 6-89, Figure 6-90, Figure 6-91, Figure 6-92, Figure 6-93, Figure 6-94, Figure 6-95, Figure 6-96, Figure 6-97, Figure 6-98, Figure 6-99, Figure 7-1, Figure 7-2, Figure 7-3, Figure 7-4, Figure 7-5, Figure 7-6, Figure 7-7, Figure 7-8, Figure 7-9, Figure 7-10, Figure 7-11, Figure 7-12, Figure 7-13, Figure 7-14, Figure 7-15, Figure 7-16, Figure 7-17, Figure 7-18, Figure 7-19, Figure 7-20, Figure 7-21, Figure 7-22, Figure 7-23, Figure 7-24, Figure 7-25, Figure 7-26, Figure 7-27, Figure 7-28, Figure 7-29, Figure 7-30, Figure 7-31, Figure 7-32, Figure 7-33, Figure 7-34, Figure 7-35, Figure 7-36, Figure 7-37, Figure 7-38, Figure 7-39, Figure 7-40, Figure 7-41, Figure 7-42, Figure 7-43, Figure 7-44, Figure 7-45, Figure 7-46, Figure 7-47, Figure 7-48, Figure 7-49, Figure 7-50, Figure 7-51, Figure 7-52, Figure 7-53, Figure 7-54, Figure 7-55, Figure 7-56, Figure 7-57, Figure 7-58, Figure 7-59, Figure 7-60, Figure 7-61, Figure 7-62, Figure 7-63, Figure 7-64, Figure 7-65, Figure 7-66, Figure 7-67, Figure 7-68, Figure 7-69, Figure 7-70, Figure 7-71, Figure 7-72, Figure 7-73, Figure 7-74, Figure 7-75, Figure 7-76, Figure 7-77, Figure 7-78, Figure 7-79, Figure 7-80, Figure 7-81, Figure 7-82, Figure 7-83, Figure 7-84, Figure 7-85, Figure 7-86, Figure 7-87, Figure 7-88, Figure 7-89, Figure 7-90, Figure 7-91, Figure 7-92, Figure 7-93, Figure 7-94, Figure 7-95, Figure 7-96, Figure 7-97, Figure 7-98, Figure 7-99, Figure 8-1, Figure 8-2, Figure 8-3, Figure 8-4, Figure 8-5, Figure 8-6, Figure 8-7, Figure 8-8, Figure 8-9, Figure 8-10, Figure 8-11, Figure 8-12, Figure 8-13, Figure 8-14, Figure 8-15, Figure 8-16, Figure 8-17, Figure 8-18, Figure 8-19, Figure 8-20, Figure 8-21, Figure 8-22, Figure 8-23, Figure 8-24, Figure 8-25, Figure 8-26, Figure 8-27, Figure 8-28, Figure 8-29, Figure 8-30, Figure 8-31, Figure 8-32, Figure 8-33, Figure 8-34, Figure 8-35, Figure 8-36, Figure 8-37, Figure 8-38, Figure 8-39, Figure 8-40, Figure 8-41, Figure 8-42, Figure 8-43, Figure 8-44, Figure 8-45, Figure 8-46, Figure 8-47, Figure 8-48, Figure 8-49, Figure 8-50, Figure 8-51, Figure 8-52, Figure 8-53, Figure 8-54, Figure 8-55, Figure 8-56, Figure 8-57, Figure 8-58, Figure 8-59, Figure 8-60, Figure 8-61, Figure 8-62, Figure 8-63, Figure 8-64, Figure 8-65, Figure 8-66, Figure 8-67, Figure 8-68, Figure 8-69, Figure 8-70, Figure 8-71, Figure 8-72, Figure 8-73, Figure 8-74, Figure 8-75, Figure 8-76, Figure 8-77, Figure 8-78, Figure 8-79, Figure 8-80, Figure 8-81, Figure 8-82, Figure 8-83, Figure 8-84, Figure 8-85, Figure 8-86, Figure 8-87, Figure 8-88, Figure 8-89, Figure 8-90, Figure 8-91, Figure 8-92, Figure 8-93, Figure 8-94, Figure 8-95, Figure 8-96, Figure 8-97, Figure 8-98, Figure 8-99, Figure 9-1, Figure 9-2, Figure 9-3, Figure 9-4, Figure 9-5, Figure 9-6, Figure 9-7, Figure 9-8, Figure 9-9, Figure 9-10, Figure 9-11, Figure 9-12, Figure 9-13, Figure 9-14, Figure 9-15, Figure 9-16, Figure 9-17, Figure 9-18, Figure 9-19, Figure 9-20, Figure 9-21, Figure 9-22, Figure 9-23, Figure 9-24, Figure 9-25, Figure 9-26, Figure 9-27, Figure 9-28, Figure 9-29, Figure 9-30, Figure 9-31, Figure 9-32, Figure 9-33, Figure 9-34, Figure 9-35, Figure 9-36, Figure 9-37, Figure 9-38, Figure 9-39, Figure 9-40, Figure 9-41, Figure 9-42, Figure 9-43, Figure 9-44, Figure 9-45, Figure 9-46, Figure 9-47, Figure 9-48, Figure 9-49, Figure 9-50, Figure 9-51, Figure 9-52, Figure 9-53, Figure 9-54, Figure 9-55, Figure 9-56, Figure 9-57, Figure 9-58, Figure 9-59, Figure 9-60, Figure 9-61, Figure 9-62, Figure 9-63, Figure 9-64, Figure 9-65, Figure 9-66, Figure 9-67, Figure 9-68, Figure 9-69, Figure 9-70, Figure 9-71, Figure 9-72, Figure 9-73, Figure 9-74, Figure 9-75, Figure 9-76, Figure 9-77, Figure 9-78, Figure 9-79, Figure 9-80, Figure 9-81, Figure 9-82, Figure 9-83, Figure 9-84, Figure 9-85, Figure 9-86, Figure 9-87, Figure 9-88, Figure 9-89, Figure 9-90, Figure 9-91, Figure 9-92, Figure 9-93, Figure 9-94, Figure 9-95, Figure 9-96, Figure 9-97, Figure 9-98, Figure 9-99, Figure 10-1, Figure 10-2, Figure 10-3, Figure 10-4, Figure 10-5, Figure 10-6, Figure 10-7, Figure 10-8, Figure 10-9, Figure 10-10, Figure 10-11, Figure 10-12, Figure 10-13, Figure 10-14, Figure 10-15, Figure 10-16, Figure 10-17, Figure 10-18, Figure 10-19, Figure 10-20, Figure 10-21, Figure 10-22, Figure 10-23, Figure 10-24, Figure 10-25, Figure 10-26, Figure 10-27, Figure 10-28, Figure 10-29, Figure 10-30, Figure 10-31, Figure 10-32, Figure 10-33, Figure 10-34, Figure 10-35, Figure 10-36, Figure 10-37, Figure 10-38, Figure 10-39, Figure 10-40, Figure 10-41, Figure 10-42, Figure 10-43, Figure 10-44, Figure 10-45, Figure 10-46, Figure 10-47, Figure 10-48, Figure 10-49, Figure 10-50, Figure 10-51, Figure 10-52, Figure 10-53, Figure 10-54, Figure 10-55, Figure 10-56, Figure 10-57, Figure 10-58, Figure 10-59, Figure 10-60, Figure 10-61, Figure 10-62, Figure 10-63, Figure 10-64, Figure 10-65, Figure 10-66, Figure 10-67, Figure 10-68, Figure 10-69, Figure 10-70, Figure 10-71, Figure 10-72, Figure 10-73, Figure 10-74, Figure 10-75, Figure 10-76, Figure 10-77, Figure 10-78, Figure 10-79, Figure 10-80, Figure 10-81, Figure 10-82, Figure 10-83, Figure 10-84, Figure 10-85, Figure 10-86, Figure 10-87, Figure 10-88, Figure 10-89, Figure 10-90, Figure 10-91, Figure 10-92, Figure 10-93, Figure 10-94, Figure 10-95, Figure 10-96, Figure 10-97, Figure 10-98, Figure 10-99, Figure 11-1, Figure 11-2, Figure 11-3, Figure 11-4, Figure 11-5, Figure 11-6, Figure 11-7, Figure 11-8, Figure 11-9, Figure 11-10, Figure 11-11, Figure 11-12, Figure 11-13, Figure 11-14, Figure 11-15, Figure 11-16, Figure 11-17, Figure 11-18, Figure 11-19, Figure 11-20, Figure 11-21, Figure 11-22, Figure 11-23, Figure 11-24, Figure 11-25, Figure 11-26, Figure 11-27, Figure 11-28, Figure 11-29, Figure 11-30, Figure 11-31, Figure 11-32, Figure 11-33, Figure 11-34, Figure 11-35, Figure 11-36, Figure 11-37, Figure 11-38, Figure 11-39, Figure 11-40, Figure 11-41, Figure 11-42, Figure 11-43, Figure 11-44, Figure 11-45, Figure 11-46, Figure 11-47, Figure 11-48, Figure 11-49, Figure 11-50, Figure 11-51, Figure 11-52, Figure 11-53, Figure 11-54, Figure 11-55, Figure 11-56, Figure 11-57, Figure 11-58, Figure 11-59, Figure 11-60, Figure 11-61, Figure 11-62, Figure 11-63, Figure 11-64, Figure 11-65, Figure 11-66, Figure 11-67, Figure 11-68, Figure 11-69, Figure 11-70, Figure 11-71, Figure 11-72, Figure 11-73, Figure 11-74, Figure 11-75, Figure 11-76, Figure 11-77, Figure 11-78, Figure 11-79, Figure 11-80, Figure 11-81, Figure 11-82, Figure 11-83, Figure 11-84, Figure 11-85, Figure 11-86, Figure 11-87, Figure 11-88, Figure 11-89, Figure 11-90, Figure 11-91, Figure 11-92, Figure 11-93, Figure 11-94, Figure 11-95, Figure 11-96, Figure 11-97, Figure 11-98, Figure 11-99, Figure 12-1, Figure 12-2, Figure 12-3, Figure 12-4, Figure 12-5, Figure 12-6, Figure 12-7, Figure 12-8, Figure 12-9, Figure 12-10, Figure 12-11, Figure 12-12, Figure 12-13, Figure 12-14, Figure 12-15, Figure 12-16, Figure 12-17, Figure 12-18, Figure 12-19, Figure 12-20, Figure 12-21, Figure 12-22, Figure 12-23, Figure 12-24, Figure 12-25, Figure 12-26, Figure 12-27, Figure 12-28, Figure 12-29, Figure 12-30, Figure 12-31, Figure 12-32, Figure 12-33, Figure 12-34, Figure 12-35, Figure 12-36, Figure 12-37, Figure 12-38, Figure 12-39, Figure 12-40, Figure 12-41, Figure 12-42, Figure 12-43, Figure 12-44, Figure 12-45, Figure 12-46, Figure 12-47, Figure 12-48, Figure 12-49, Figure 12-50, Figure 12-51, Figure 12-52, Figure 12-53, Figure 12-54, Figure 12-55, Figure 12-56, Figure 12-57, Figure 12-58, Figure 12-59, Figure 12-60, Figure 12-61, Figure 12-62, Figure 12-63, Figure 12-64, Figure 12-65, Figure 12-66, Figure 12-67, Figure 12-68, Figure 12-69, Figure 12-70, Figure 12-71, Figure 12-72, Figure 12-73, Figure 12-74, Figure 12-75, Figure 12-76, Figure 12-77, Figure 12-78, Figure 12-79, Figure 12-80, Figure 12-81, Figure 12-82, Figure 12-83, Figure 12-84, Figure 12-85, Figure 12-86, Figure 12-87, Figure 12-88, Figure 12-89, Figure 12-90, Figure 12-91, Figure 12-92, Figure 12-93, Figure 12-94, Figure 12-95, Figure 12-96, Figure 12-97, Figure 12-98, Figure 12-99, Figure 13-1, Figure 13-2, Figure 13-3, Figure 13-4, Figure 13-5, Figure 13-6, Figure 13-7, Figure 13-8, Figure 13-9, Figure 13-10, Figure 13-11, Figure 13-12, Figure 13-13, Figure 13-14, Figure 13-15, Figure 13-16, Figure 13-17, Figure 13-18, Figure 13-19, Figure 13-20, Figure 13-21, Figure 13-22, Figure 13-23, Figure 13-24, Figure 13-25, Figure 13-26, Figure 13-27, Figure 13-28, Figure 13-29, Figure 13-30, Figure 13-31, Figure 13-32, Figure 13-33, Figure 13-34, Figure 13-35, Figure 13-36, Figure 13-37, Figure 13-38, Figure 13-39, Figure 13-40, Figure 13-41, Figure 13-42, Figure 13-43, Figure 13-44, Figure 13-45, Figure 13-46, Figure 13-47, Figure 13-48, Figure 13-49, Figure 13-50, Figure 13-51, Figure 13-52, Figure 13-53, Figure 13-54, Figure 13-55, Figure 13-56, Figure 13-57, Figure 13-58, Figure 13-59, Figure 13-60, Figure 13-61, Figure 13-62, Figure 13-63, Figure 13-64, Figure 13-65, Figure 13-66, Figure 13-67, Figure 13-68, Figure 13-69, Figure 13-70, Figure 13-71, Figure 13-72, Figure 13-73, Figure 13-74, Figure 13-75, Figure 13-76, Figure 13-77, Figure 13-78, Figure 13-79, Figure 13-80, Figure 13-81, Figure 13-82, Figure 13-83, Figure 13-84, Figure 13-85, Figure 13-86, Figure 13-87, Figure 13-88, Figure 13-89, Figure 13-90, Figure 13-91, Figure 13-92, Figure 13-93, Figure 13-94, Figure 13-95, Figure 13-96, Figure 13-97, Figure 13-98, Figure 13-99, Figure 14-1, Figure 14-2, Figure 14-3, Figure 14-4, Figure 14-5, Figure 14-6, Figure 14-7, Figure 14-8, Figure 14-9, Figure 14-10, Figure 14-11, Figure 14-12, Figure 14-13, Figure 14-14, Figure 14-15, Figure 14-16, Figure 14-17, Figure 14-18, Figure 14-19, Figure 14-20, Figure 14-21, Figure 14-22, Figure 14-23, Figure 14-24, Figure 14-25, Figure 14-26, Figure 14-27, Figure 14-28, Figure 14-29, Figure 14-30, Figure 14-31, Figure 14-32, Figure 14-33, Figure 14-34, Figure 14-35, Figure 14-36, Figure 14-37, Figure 14-38, Figure 14-39, Figure 14-40, Figure 14-41, Figure 14-42, Figure 14-43, Figure 14-44, Figure 14-45, Figure 14-46, Figure 14-47, Figure 14-48, Figure 14-49, Figure 14-50, Figure 14-51, Figure 14-52, Figure 14-53, Figure 14-54, Figure 14-55, Figure 14-56, Figure 14-57, Figure 14-58, Figure 14-59, Figure 14-60, Figure 14-61, Figure 14-62, Figure 14-63, Figure 14-64, Figure 14-65, Figure 14-66, Figure 14-67, Figure 14-68, Figure 14-69, Figure 14-70, Figure 14-71, Figure 14-72, Figure 14-73, Figure 14-74, Figure 14-75, Figure 14-76, Figure 14-77, Figure 14-78, Figure 14-79, Figure 14-80, Figure 14-81, Figure 14-82, Figure 14-83, Figure 14-84, Figure 14-85, Figure 14-86, Figure 14-87, Figure 14-88, Figure 14-89, Figure 14-90, Figure 14-91, Figure 14-92, Figure 14-93, Figure 14-94, Figure 14-95, Figure 14-96, Figure 14-97, Figure 14-98, Figure 14-99, Figure 15-1, Figure 15-2, Figure 15-3, Figure 15-4, Figure 15-5, Figure 15-6, Figure 15-7, Figure 15-8, Figure 15-9, Figure 15-10, Figure 15-11, Figure 15-12, Figure 15-13, Figure 15-14, Figure 15-15, Figure 15-16, Figure 15-17, Figure 15-18, Figure 15-19, Figure 15-20, Figure 15-21, Figure 15-22, Figure 15-23, Figure 15-24, Figure 15-25, Figure 15-26, Figure 15-27, Figure 15-28, Figure 15-29, Figure 15-30, Figure 15-31, Figure 15-32, Figure 15-33, Figure 15-34, Figure 15-35, Figure 15-36, Figure 15-37, Figure 15-38, Figure 15-39, Figure 15-40, Figure 15-41, Figure 15-42, Figure 15-43, Figure 15-44, Figure 15-45, Figure 15-46, Figure 15-47, Figure 15-48, Figure 15-49, Figure 15-50, Figure 15-51, Figure 15-52, Figure 15-53, Figure 15-54, Figure 15-55, Figure 15-56, Figure 15-57, Figure 15-58, Figure 15-59, Figure 15-60, Figure 15-61, Figure 15-62, Figure 15-63, Figure 15-64, Figure 15-65, Figure 15-66, Figure 15-67, Figure 15-68, Figure 15-69, Figure 15-70, Figure 15-71, Figure 15-72, Figure 15-73, Figure 15-74, Figure 15-75, Figure 15-76, Figure 15-77, Figure 15-78, Figure 15-79, Figure 15-80, Figure 15-81, Figure 15-82, Figure 15-83, Figure 15-84, Figure 15-85, Figure 15-86, Figure 15-87, Figure 15-88, Figure 15-89, Figure 15-90, Figure 15-91, Figure 15-92, Figure 15-93, Figure 15-94, Figure 15-95, Figure 15-96, Figure 15-97, Figure 15-98, Figure 15-99, Figure 16-1, Figure 16-2, Figure 16-3, Figure 16-4, Figure 16-5, Figure 16-6, Figure 16-7, Figure 16-8, Figure 16-9, Figure 16-10, Figure 16-11, Figure 16-12, Figure 16-13, Figure 16-14, Figure 16-15, Figure 16-16, Figure 16-17, Figure 16-18, Figure 16-19, Figure 16-20, Figure 16-21, Figure 16-22, Figure 16-23, Figure 16-24, Figure 16-25, Figure 16-26, Figure 16-27, Figure 16-28, Figure 16-29, Figure 16-30, Figure 16-31, Figure 16-32, Figure 16-33, Figure 16-34, Figure 16-35, Figure 16-36, Figure 16-37, Figure 16-38, Figure 16-39, Figure 16-40, Figure 16-41, Figure 16-42, Figure 16-43, Figure 16-44, Figure 16-45, Figure 16-46, Figure 16-47, Figure 16-48, Figure 16-49, Figure 16-50, Figure 16-51, Figure 16-52, Figure 16-53, Figure 16-54, Figure 16-55, Figure 16-56, Figure 16-57, Figure 16-58, Figure 16-59, Figure 16-60, Figure 16-61, Figure 16-62, Figure 16-63, Figure 16-64, Figure 16-65, Figure 16-66, Figure 16-67, Figure 16-68, Figure 16-69, Figure 16-70, Figure 16-71, Figure 16-72, Figure 16-73, Figure 16-74, Figure 16-75, Figure 16-76, Figure 16-77, Figure 16-78, Figure 16-79, Figure 16-80, Figure 16-81, Figure 16-82, Figure 16-83, Figure 16-84, Figure 16-85, Figure 16-86, Figure 16-87, Figure 16-88, Figure 16-89, Figure 16-90, Figure 16-91, Figure 16-92, Figure 16-93, Figure 16-94, Figure 16-95, Figure 16-96, Figure 16-97, Figure 16-98, Figure 16-99, Figure 17-1, Figure 17-2, Figure 17-3, Figure 17-4, Figure 17-5, Figure 17-6, Figure 17-7, Figure 17-8, Figure 17-9, Figure 17-10, Figure 17-11, Figure 17-12, Figure 17-13, Figure 17-14, Figure 17-15, Figure 17-16, Figure 17-17, Figure 17-18, Figure 17-19, Figure 17-20, Figure 17-21, Figure 17-22, Figure 17-23, Figure 17-24, Figure 17-25, Figure 17-26, Figure 17-27, Figure 17-28, Figure 17-29, Figure 17-30, Figure 17-31, Figure 17-32, Figure 17-33, Figure 17-34, Figure 17-35, Figure 17-36, Figure 17-37, Figure 17-38, Figure 17-39, Figure 17-40, Figure 17-41, Figure 17-42, Figure 17-43, Figure 17-44, Figure 17-45, Figure 17-46, Figure 17-47, Figure 17-48, Figure 17-49, Figure 17-50, Figure 17-51, Figure 17-52, Figure 17-53, Figure 17-54, Figure 17-55, Figure 17-56, Figure 17-57, Figure 17-58, Figure 17-59, Figure 17-60, Figure 17-61, Figure 17-62, Figure 17-63, Figure 17-64, Figure 17-65, Figure 17-66, Figure 17-67, Figure 17-68, Figure 17-69, Figure 17-70, Figure 17-71, Figure 17-72, Figure 17-73, Figure 17-74, Figure 17-75, Figure 17-76, Figure 17-77, Figure 17-78, Figure 17-79, Figure 17-80, Figure 17-81, Figure 17-82, Figure 17-83, Figure 17-84, Figure 17-85, Figure 17-86, Figure 17-87, Figure 17-88, Figure 17-89, Figure 17-90, Figure 17-91, Figure 17-92, Figure 17-93, Figure 17-94, Figure 17-95, Figure 17-96, Figure 17-97, Figure 17-98, Figure 17-99, Figure 18-1, Figure 18-2, Figure 18-3, Figure 18-4, Figure 18-5, Figure 18-6, Figure 18-7, Figure 18-8, Figure 18-9, Figure 18-10, Figure 18-11, Figure 18-12, Figure 18-13, Figure 18-14, Figure 18-15, Figure 18-16, Figure 18-17, Figure 18-18, Figure 18-19, Figure 18-20, Figure 18-21, Figure 18-22, Figure 18-23, Figure 18-24, Figure 18-25, Figure 18-26, Figure 18-27, Figure 18-28, Figure 18-29, Figure 18-30, Figure 18-31, Figure 18-32, Figure 18-33, Figure 18-34, Figure 18-35, Figure 18-36, Figure 18-37, Figure 18-38, Figure 18-39, Figure 18-40, Figure 18-41, Figure 18-42, Figure 18-43, Figure 18-44, Figure 18-45, Figure 18-46, Figure 18-47, Figure 18-48, Figure 18-49, Figure 18-50, Figure 18-51, Figure 18-52, Figure 18-53, Figure 18-54, Figure 18-55, Figure 18-56, Figure 18-57, Figure 18-58, Figure 18-59, Figure 18-60, Figure 18-61, Figure 18-62, Figure 18-63, Figure 18-64, Figure 18-65, Figure 18-66, Figure 18-67, Figure 18-68, Figure 18-69, Figure 18-70, Figure 18-71, Figure 18-72, Figure 18-73, Figure 18-74, Figure 18-75, Figure 18-76, Figure 18-77, Figure 18-78, Figure 18-79, Figure 18-80, Figure 18-81, Figure 18-82, Figure 18-83, Figure 18-84, Figure 18-85, Figure 18-86, Figure 18-87, Figure 18-88, Figure 18-89, Figure 18-90, Figure 18-91, Figure 18-92, Figure 18-93, Figure 18-94, Figure 18-95, Figure 18-96, Figure 18-97, Figure 18-98, Figure 18-99, Figure 19-1, Figure 19-2, Figure 19-3, Figure 19-4, Figure 19-5, Figure 19-6, Figure 19-7, Figure 19-8, Figure 19-9, Figure 19-10, Figure 19-11, Figure 19-12, Figure 19-13, Figure 19-14, Figure 19-15, Figure 19-16, Figure 19-17, Figure 19-18, Figure 19-19, Figure 19-20, Figure 19-21, Figure 19-22, Figure 19-23, Figure 19-24, Figure 19-25, Figure 19-26, Figure 19-27, Figure 19-28, Figure 19-29, Figure 19-30, Figure 19-31, Figure 19-32, Figure 19-33, Figure 19-34, Figure 19-35, Figure 19-36, Figure 19-37, Figure 19-38, Figure 19-39, Figure 19-40, Figure 19-41

SHEET LEGEND

GENERAL NOTES	G000	FURNITURE FLOOR PLAN	A901
VICINITY MAP			
SAFETY GLAZING		PLUMBING NOTES	P000
WIND INFORMATION		PLUMBING PLAN	P101
DEVIATION NOTE		ENGINEER NOTES	S000
SCOPE OF WORK			
PROJECT INFORMATION		FOUNDATION NOTES	S101
PROJECT CONSULTANTS		TERMITE SPECIFICATIONS	
	G001	FOUNDATION PLAN	
SHEET LEGEND			
	G010		
PROJECT INFORMATION		CONVENTIONAL ROOF FRAMING NOTES	S201
APPLICABLE CODES PASCO COUNTY FLORIDA		ROOF FRAMING PLAN	
USE AND OCCUPANCY CLASSIFICATIONS			
BUILDING DATA			
FIRE RATED CONSTRUCTION REQUIREMENTS		TYP INT BEARING WALL SECTION	S421
FIRE PROTECTIONS SYSTEM REQUIREMENTS		FILLED CELL DETAIL	
OCCUPANT LOAD FACTORS		TYPICAL LINTEL/BOND BEAM CONSTRUCTION	
MEANS OF EGRESS		TYPICAL MASONRY WALL CONSTRUCTION	
PROPOSED AREAS		BLOCK INFILL DETAIL	
ALTERATION LELVEL			
OCCUPANCY LOAD			
PLUMBING LOAD			
		TYP INT NON-BEARING WALL SECTION	S422
		METAL LATH ATTACHMENT	
FLORIDA PRODUCT APPROVALS	G011	TYPICAL SHEATHING NAILING SCHEDULE	
		TYPICAL INTERIOR NON-BEARING WALL DETAIL	
ADA ACCESSIBILITY GUIDELINES	G015	TOP PLATE SPLICE DETAIL	
		TYPICAL WOOD CONNECTION DETAILS	
ADA ACCESSIBILITY GUIDELINES	G016	EXTERIOR WALL INTERSECTION DETAIL	
		LOAD BEARING HEADER DETAIL	
ADA ACCESSIBILITY GUIDELINES	G017	TYPICAL NAILING SCHEDULE	
LIFE SAFETY NOTES		ELECTRICAL LEGEND	E101
OCCUPANCY LOAD TABLE	G100	ELECTRICAL NOTES	
		ELECTRICAL FLOOR PLAN	
LIFE SAFETY PLAN			
LIFE SAFETY OCCUPANCY SCHEDULE	G101	ELECTRICAL LEGEND	E102
OCCUPANCY LOAD TABLE		ELECTRICAL NOTES	
		ELECTRICAL EMERGENCY LIGHTING	
SURVEY/SITE PLAN	A050		
DEMOLITION NOTES	A101		
EXISTING FLOOR PLAN			
RENOVATION NOTES	A201		
FILLED CELL KEY			
ADA LAVATORY LAYOUT			
RENOVATION FLOOR PLAN			
NORTH ELEVATION EXISTING	A301		
NORTH ELEVATION RENOVATION			
SOUTH ELEVATION EXISTING			
SOUTH ELEVATION RENOVATION			
WEST ELEVATION EXISTING	A302		
WEST ELEVATION RENOVATION			
EAST ELEVATION EXISTING			
EAST ELEVATION RENOVATION			
A-A TYPICAL WALL SECTION	A401		
B-B TYPICAL WALL SECTION			
FLASHING DETAIL - WINDOW	A421		
METAL LATH ATTACHMENT			
FLASHING DETAIL - DOORWAY			

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
measurements are to be
made by the contractor and
any discrepancies noted
the attention of JAE Carbon
prior to starting any
construction or fabrication.
conformance to drawings
and specifications.

TRUE

BUILDING, INC.

CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS

SHEET LEGEND

DRAWN BY
J.A.E.

DATE
05/14/2026

SCALE
1/4"= 1'-0"

JOB

SHEET

G001

OF 26 SHEETS

SIMPSON APPROVAL NUMBERS	
PRODUCT	FL. APPROVAL NUMBER
A34	10446.1
AC6RZ	10860.4
CC-ECC-ECCU SERIES	10860.8
H10A	10456.7
H2.5A	10456.7
H3	10446.16
HETA12-16-20	11473.5
HGUM5.25	13904.3
HTS16	13872.3
HU-HUC	10531.9
HUCQ412	10531.10
HUS-HUSC	10531.11
LCE4	10446.21
LGUM410	13904.4
LRU26-28-210-212	10447.7
LSC	10446.23
LSTA18-21-24-30-36	10456.15
LTS SERIES	10456.18
LU24-26-28-210	10531.14
LUZ26Z-210Z	10531.15
LUS SERIES	10531.16
MBH	13904.6
MIU SERIES	10531.18
MUS26-28	10531.19
RR	10667.29
SP1-2	10456.30
TA9Z-10Z	N/A
U SERIES	10531.21
VTCT	10447.18
IF THE FINAL SELECTIONS DIFFER PARTIALLY OR TOTALLY FROM THE TABLE, THE OWNER AND/OR GENERAL CONTRACTOR ARE RESPONSIBLE FOR PROVIDING COPIES OF THE FLORIDA PRODUCT APPROVALS AND INSTALLATION INSTRUCTIONS TO THE AUTHORITY HAVING JURISDICTION.	

FLORIDA PRODUCT APPROVAL NUMBERS				
CATEGORY	SUBCATEGORY	DESCRIPTION	MANUFACTURER	FL APPROVAL NUMBERS
EXTERIOR DOORS				
	SECTIONAL	GARAGE DOOR	WAYNE DALTON	8248.9
	SWING	PANEL	JELD-WEN	16674.1
		GLAZED	JELD-WEN	16674.2
		FRENCH	JELD-WEN	16674.8
	SLIDING	IMPACT	SIMONTON	5979.2
WINDOWS				
	SINGLE HUNG	IMPACT	CUSTOM WINDOW SYSTEM	5823.1
	FIXED	IMPACT	CUSTOM WINDOW SYSTEM	13010.1
	HORIZONTAL SLIDER	IMPACT	CUSTOM WINDOW SYSTEM	17793.1
	CASEMENT	IMPACT	CUSTOM WINDOW SYSTEM	6890.1
	AWNING	IMPACT	CUSTOM WINDOW SYSTEM	7060.1
	MULL BAR	IMPACT	CUSTOM WINDOW SYSTEM	9520.1
ROOFING				
	UNDERLAYMENT	SELF-ADHERENT	GAF	26482.1
	MODIFIED BITUMEN	ROOF SYSTEM	POLYGLASS	1654.1
	METAL	ROOF SYSTEM	DIXIELAND METALS	4149.1
	TILE	ROOF SYSTEM	STONEWORTH BUILDINGS	41594.2
	SHINGLES	ROOF SYSTEM	GAF	10124.1
PANEL WALLS				
	SOFFIT	VINYL	CERTAIN TEED	13389.1
	SIDING	VINYL	CERTAIN TEED	1573.1
	SIDING	FIBER-CEMENT	JAMES HARDIE	13192.1
	GLASS BLOCK	IMPACT	SEVES GLASS BLOCK	1363.1
STRUCTURAL COMP.				
	NEW TECHNOLOGY	FLOOD VENT	SMART VENTS	5822.1
	NEW TECHNOLOGY	LINTELS	CAST-CRETE	158.1
	WOOD CONNECTORS		SIMPSON	SEE LIST

NOTE:
THE ENGINEER ASSUMES NO LIABILITY FOR THE PERFORMANCE OF THE PRODUCTS. AS THEY WERE DESIGNED AND TESTED BY THE MANUFACTURERS, AND APPROVED AFTER MEETING THE REQUIREMENTS OF THE FLORIDA BUILDING CODE.

THE PRODUCTS LISTED IN THE PRODUCT APPROVAL TABLE ARE PROVIDED FOR PLAN REVIEW AND PERMIT PURPOSES.

IF THE FINAL SELECTIONS DIFFER PARTIALLY OR TOTALLY FROM THE TABLE, THE OWNER AND/OR GENERAL CONTRACTOR ARE RESPONSIBLE FOR PROVIDING COPIES OF THE FLORIDA PRODUCT APPROVALS AND INSTALLATION INSTRUCTIONS TO THE AUTHORITY HAVING JURISDICTION.

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O.Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
dimensions and materials
conformance to drawings
prior to starting any
work. The contractor shall
verify the dimensions and
measurements are to be
used by the manufacturer and
approved by the authority
having jurisdiction. The
attention of JAE Carbon
shall be given to the
construction of any
construction of fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS	
FLORIDA PRODUCT APPROVALS	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET	
G011	
OF 26 SHEETS	

A: SITE ACCESSIBILITY:

1. ALL ENTRANCES AND EXTERIOR GROUND-FLOOR EXIT DOORS TO BUILDINGS AND FACILITIES SHALL BE MADE ACCESSIBLE TO PERSONS WITH DISABILITIES. DOORWAYS SHALL HAVE A MINIMUM CLEAR OPENING OF 32 INCHES WITH THE DOOR OPEN 90 DEGREES, MEASURED BETWEEN THE FACE OF THE DOOR AND THE OPPOSITE STOP
2. WHERE A PAIR OF DOORS IS UTILIZED, AT LEAST ONE OF THE DOORS SHALL PROVIDE A CLEAR, UNOBSTRUCTED OPENING WIDTH OF 32 INCHES WITH THE LEAF POSITIONED AT AN ANGLE OF 90 DEGREES FROM ITS CLOSED POSITION
3. THE FLOOR OR LANDING SHALL NOT BE MORE THAN 1/2 INCH LOWER THAN THE THRESHOLD OF THE DOORWAY. CHANGE IN LEVEL BETWEEN 1/4 INCH AND 1/2 INCH SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1 UNIT VERTICAL TO 2 UNITS HORIZONTAL. CHANGE IN LEVEL GREATER THAN 1/2 INCH SHALL BE ACCOMPLISHED BY MEANS OF A RAMP
4. MINIMUM MANEUVERING CLEARANCES AT DOORS SHALL BE AS SHOWN IN ON SHEET G016 AND G017. THE FLOOR OR GROUND AREA WITHIN THE REQUIRED CLEARANCE SHALL BE LEVEL AND CLEAR.
5. MAXIMUM EFFORT TO OPERATE DOORS SHALL NOT EXCEED 5 LB. INTERIOR OR SLIDING DOORS WITH SUCH PUSH OR PULL EFFORT BEING APPLIED AT RIGHT ANGLES TO HINGED DOORS
6. HAND-ACTIVATED DOOR OPENING HARDWARE SHALL BE CENTERED BETWEEN 34 INCHES AND 48 INCHES ABOVE THE FLOOR. LATCHING AND LOCKING DOORS THAT ARE HAND-ACTIVATED AND WHICH ARE IN A PATH OF TRAVEL SHALL BE OPERABLE WITH A SINGLE EFFORT BY LEVER-TYPE HARDWARE, PANIC BARS, PUSH-PULL ACTIVATING BARS OR OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE WITHOUT REQUIRING THE ABILITY TO GRASP THE OPENING HARDWARE
7. THE BOTTOM 10 INCHES OF ALL DOORS SHALL HAVE A SMOOTH, UNINTERRUPTED SURFACE ON THE PUSH SIDE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION

B: TOILET FACILITIES:

1. PASSAGEWAYS LEADING TO SANITARY FACILITIES SHALL HAVE A CLEAR ACCESS. ALL DOORWAYS LEADING TO SUCH FACILITIES SHALL HAVE A CLEAR UNOBSTRUCTED OPENING WIDTH OF 32 INCHES. A LEVEL AND CLEAR AREA FOR A MINIMUM DEPTH OF 56 INCHES AND 60 INCHES IN WIDTH. NO FIXTURES ALLOWED WITHIN THIS SPACE. NO DOOR SWING ALLOWED WITHIN THE CLEAR FLOOR SPACE
2. A CLEAR FLOOR SPACE OF 30 INCHES BY 48 INCHES SHALL BE PROVIDED IN FRONT OF A LAVATORY TO ALLOW A FORWARD APPROACH. SUCH CLEAR FLOOR SPACE SHALL ADJOIN OR OVERLAP AN ACCESSIBLE ROUTE AND SHALL EXTEND INTO KNEE AND TOE SPACE UNDERNEATH THE LAVATORY. MIRRORS SHALL BE MOUNTED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE NO HIGHER THAN 40 INCHES FROM THE FLOOR
3. WHERE TOWEL, SANITARY NAPKINS, WASTE RECEPTACLES, AND OTHER SIMILAR DISPENSING AND DISPOSAL FIXTURES ARE PROVIDED, AT LEAST ONE OF EACH TYPE SHALL BE LOCATED WITH ALL OPERABLE PARTS, INCLUDING COIN SLOTS, WITHIN 48 INCHES FROM THE FINISHED FLOOR OR AS DESCRIBED IN REACH RANGES ON SHEET G016 AND G017.
4. TOILET TISSUE DISPENSERS SHALL BE LOCATED ON THE WALL WITHIN 7 TO 9 INCHES OF THE FRONT EDGE OF THE TOILET SEAT (MEASURED TO THE CENTER LINE OF THE DISPENSER. DISPENSERS THAT CONTROL DELIVERY OR THAT DO NOT PERMIT CONTINUOUS PAPER FLOW SHALL NOT BE USED
5. WHERE URINALS ARE PROVIDED, AT LEAST ONE SHALL HAVE A CLEAR FLOOR SPACE 30 INCHES BY 48 INCHES IN FRONT OF THE URINAL TO ALLOW FORWARD APPROACH. THE URINAL RIM HEIGHT SHALL NOT BE HIGHER THAN 17" AFF AND THE FLUSH CONTROL SHALL NOT BE ABOVE 48" AFF
6. THE FRONT OF LAVATORIES SHALL BE 34 INCHES MAX. ABOVE THE FLOOR, MEASURED TO THE HIGHER OF THE FIXTURE RIM OR COUNTER SURFACE
7. FAUCETS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 LB. MAX

C: DRINKING FOUNTAINS:

1. WHERE WATER FOUNTAINS ARE PROVIDED, THERE SHALL BE A DRINKING FOUNTAIN THAT IS ACCESSIBLE TO INDIVIDUALS WHO USE WHEELCHAIRS AND ONE ACCESSIBLE TO THOSE WHO HAVE DIFFICULTY BENDING OR STOOPING. THIS CAN BE ACCOMMODATED BY THE USE OF "HI-LOW" FOUNTAINS. WATER FOUNTAINS SHALL BE LOCATED COMPLETELY WITHIN ALCOVES OR OTHERWISE POSITIONED SO AS NOT TO ENCROACH INTO PEDESTRIAN WAYS

D: KITCHENS:

1. REFER TO KITCHEN DIAGRAMS ON SHEET G016 AND G017 FOR REQUIRED ACCESSIBILITY AT KITCHENS
2. THE WORK SURFACE SHALL BE 34 INCHES MAX. ABOVE THE FLOOR WITH NO SHARP ABRASIVE SURFACES UNDERNEATH
3. THE SINK AND SURROUNDING COUNTER SHALL BE 34 INCHES MAX. ABOVE THE FLOOR, MEASURED TO THE HIGHER OF THE FIXTURE RIM OR THE COUNTER SURFACE
4. THE DEPTH OF THE SINK BOWL SHALL BE 6 TO 9 INCHES MAX
5. FAUCETS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE THE OPERABLE PARTS SHALL BE 5 LB. MAX
6. WATER SUPPLY AND DRAIN PIPES UNDER THE SINK SHALL BE INSULATED OR OTHERWISE CONFIGURED TO PROTECT AGAINST CONTACT. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER THE SINK

E: SIGNAGE:

1. THE INTERNATIONAL SYMBOL OF ACCESSIBILITY SHALL BE THE STANDARD USED TO IDENTIFY FACILITIES THAT ARE ACCESSIBLE TO AND USABLE BY PHYSICALLY DISABLED PERSONS
2. CONTRACTED GRADE 2 BRAILLE SHALL BE USED WHEREVER BRAILLE SYMBOLS ARE SPECIFICALLY REQUIRED. DOTS SHALL HAVE A DOMED OR ROUNDED SHAPE. BRAILLE SHALL BE BELOW THE CORRESPONDING TEXT SEPARATED BY 8 MIN. FROM OTHER TACTILE CHARACTERS. BRAILLE SHALL BE CENTERED AT 60" FROM FINISH FLOOR. BRAILLE SHALL COMPLY WITH LITERARY BRAILLE
3. LETTERS AND NUMBERS ON SIGNS SHALL MEET ALL THE REQUIREMENTS OF SECTION 703
4. ALL BUILDING ENTRANCES THAT ARE ACCESSIBLE TO AND USABLE BY PERSONS WITH DISABILITIES SHALL BE IDENTIFIED WITH AT LEAST ONE STANDARD SIGN AND WITH ADDITIONAL DIRECTIONAL SIGNS, AS REQUIRED, TO BE VISIBLE TO PERSONS ALONG APPROACHING PEDESTRIAN WAYS

F: FLOORING:

1. IF CARPET IS USED IN A COMMON-USE AREA ON A GROUND OR FLOOR SURFACE, IT SHALL HAVE FIRM BACKING OR NO BACKING. THE MAXIMUM PILE HEIGHT SHALL BE 1/2 INCH. EXPOSED EDGES OF CARPET SHALL BE FASTENED TO FLOOR SURFACES AND HAVE TRIM ALONG THE ENTIRE LENGTH OF THE EXPOSED EDGE. CARPET EDGE TRIM SHALL COMPLY WITH THE REQUIREMENTS FOR CHANGES IN LEVEL. SEE SHEET G016 AND G017

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (949) 266-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
measurements and dimensions
prior to starting any
work. Any discrepancies
must be reported to the
owner immediately and
the attention of JAE Carbon
must be notified. No
commitment of any
construction or fabrication.

TRUE

BUILDING, INC.

CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS

ADA GENERAL NOTES

DRAWN BY
J.A.E.

DATE
05/14/2026


SCALE
1/4"= 1'-0"

JOB


SHEET

G015


OF 26 SHEETS

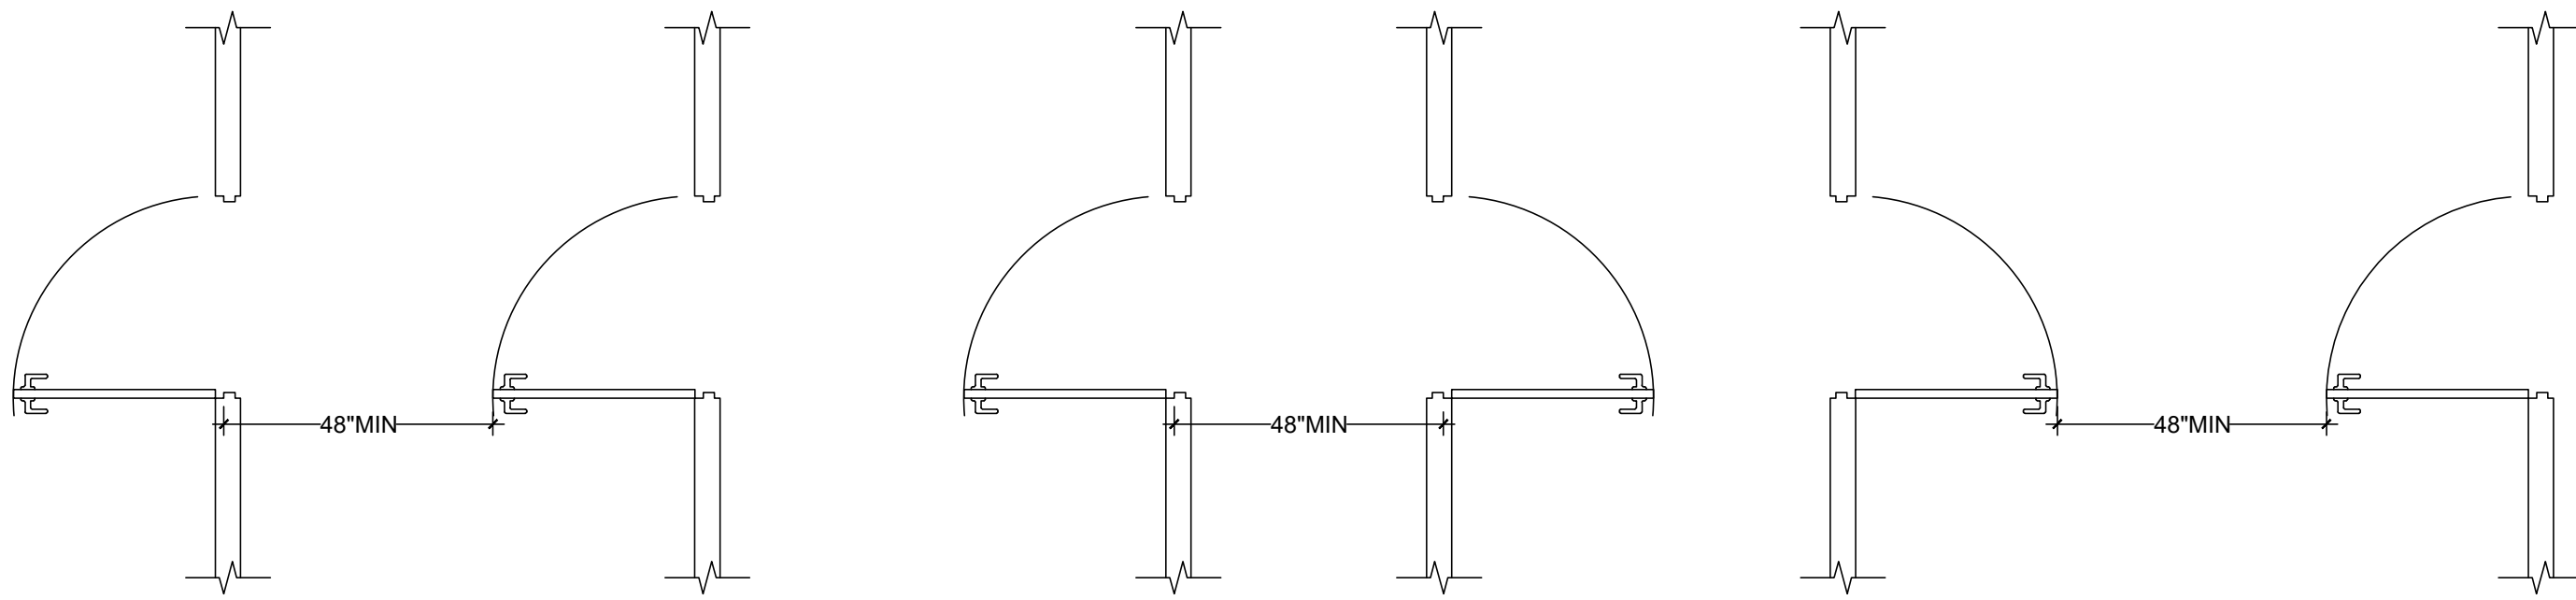



Doors in a Series
Scale: 3/8" = 1'-0"

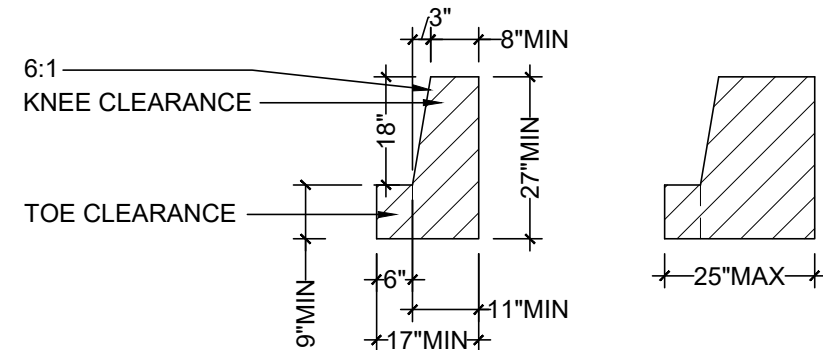


Knee/Toe Clearance
Scale: 3/8" = 1'-0"

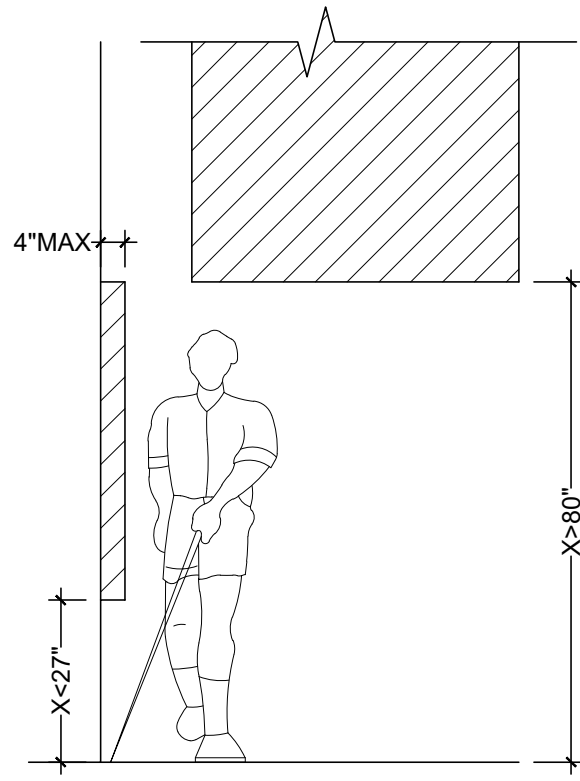


Protruding Object
Scale: 3/8" = 1'-0"

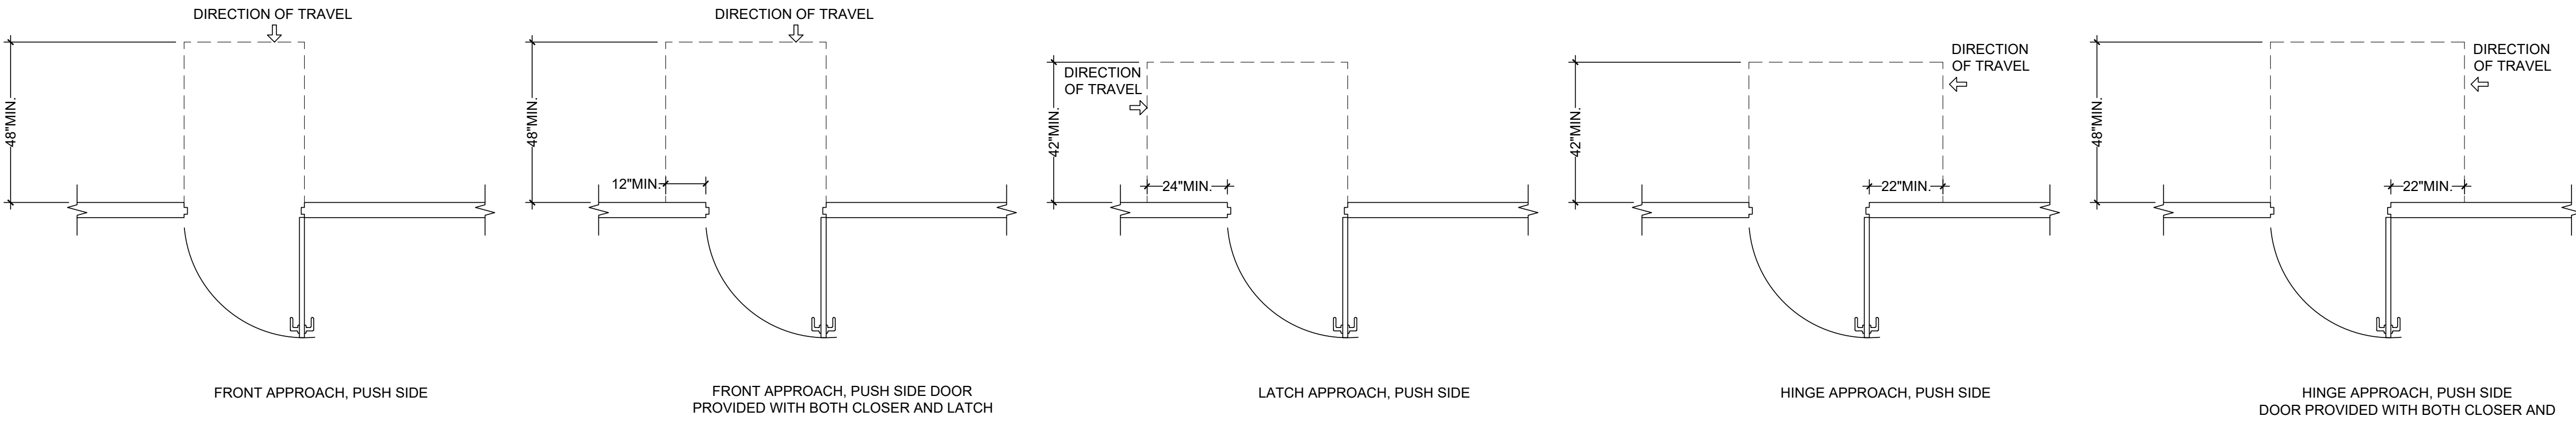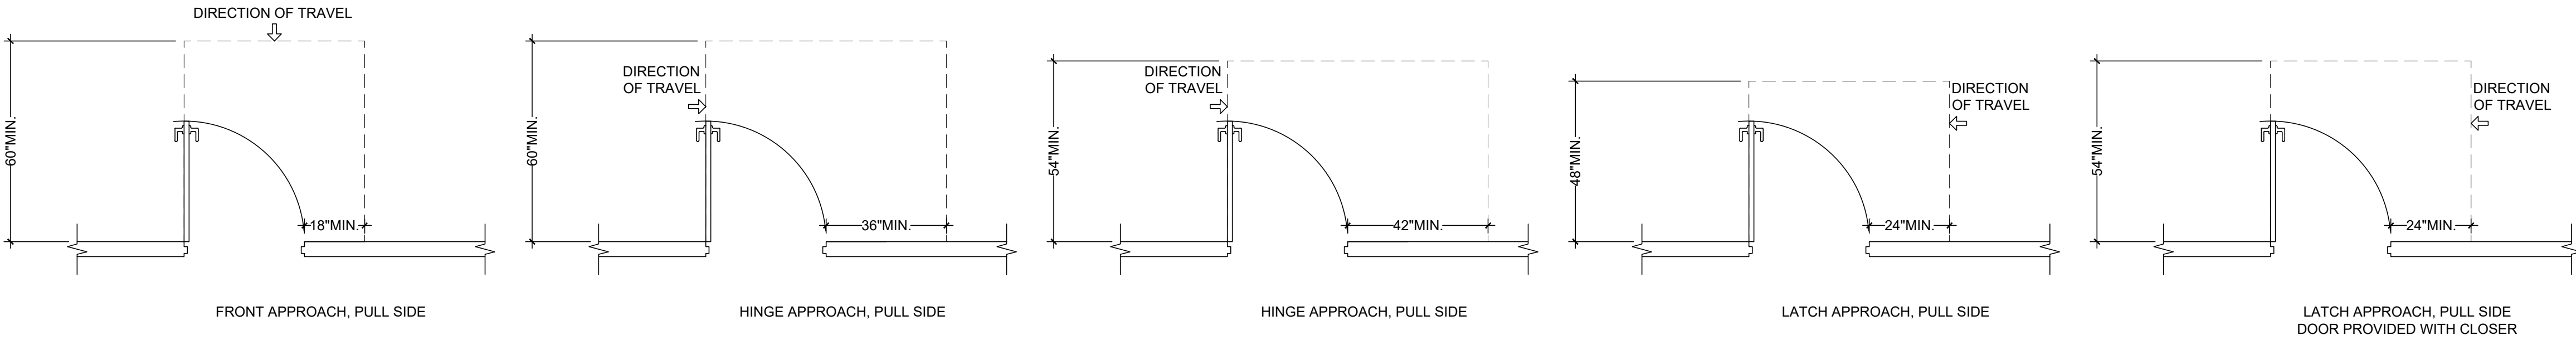


Maneuvering Clearance at Doors and Gates
Scale: 3/8" = 1'-0"

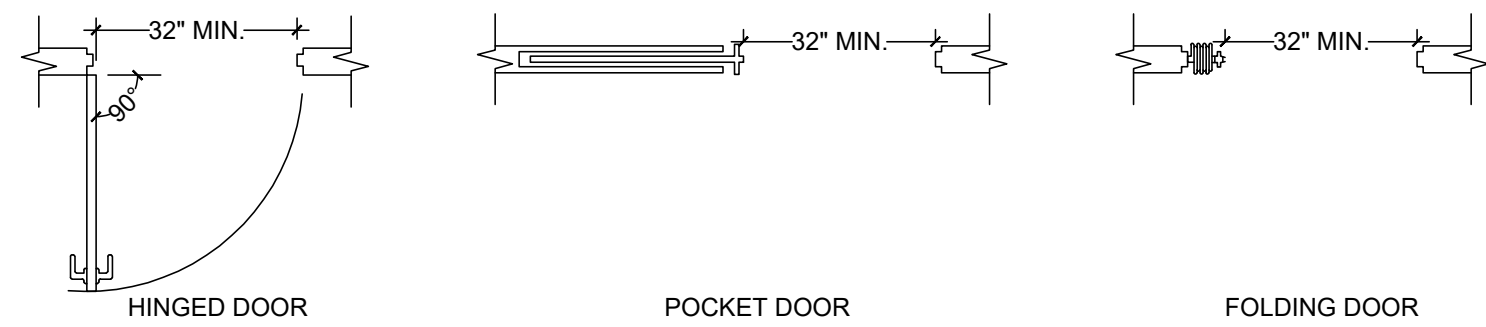

Door Clear Widths
Scale: 3/8" = 1'-0"

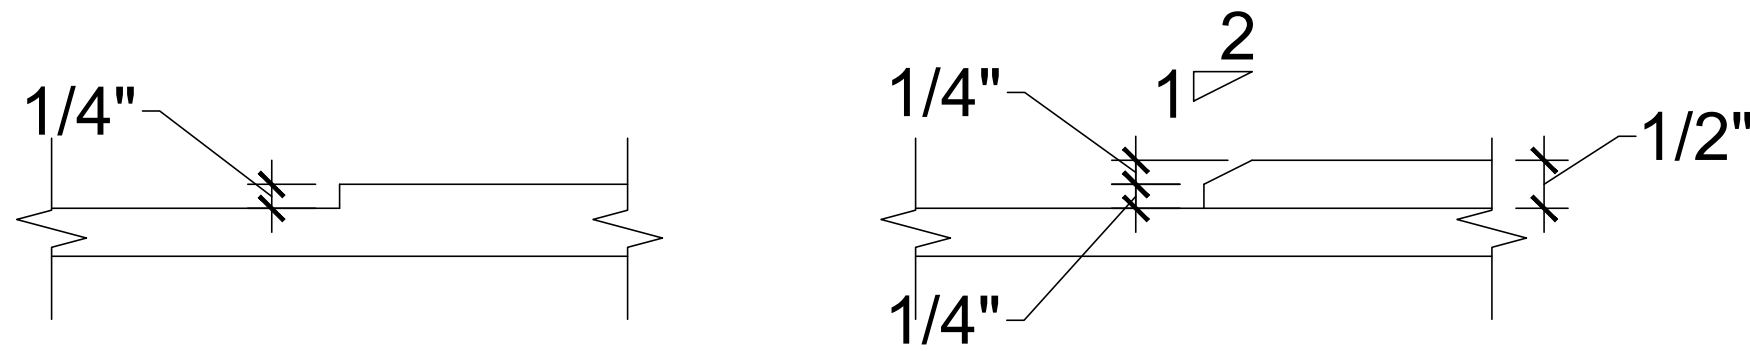

Vertical Change
Scale: 6" = 1'-0"

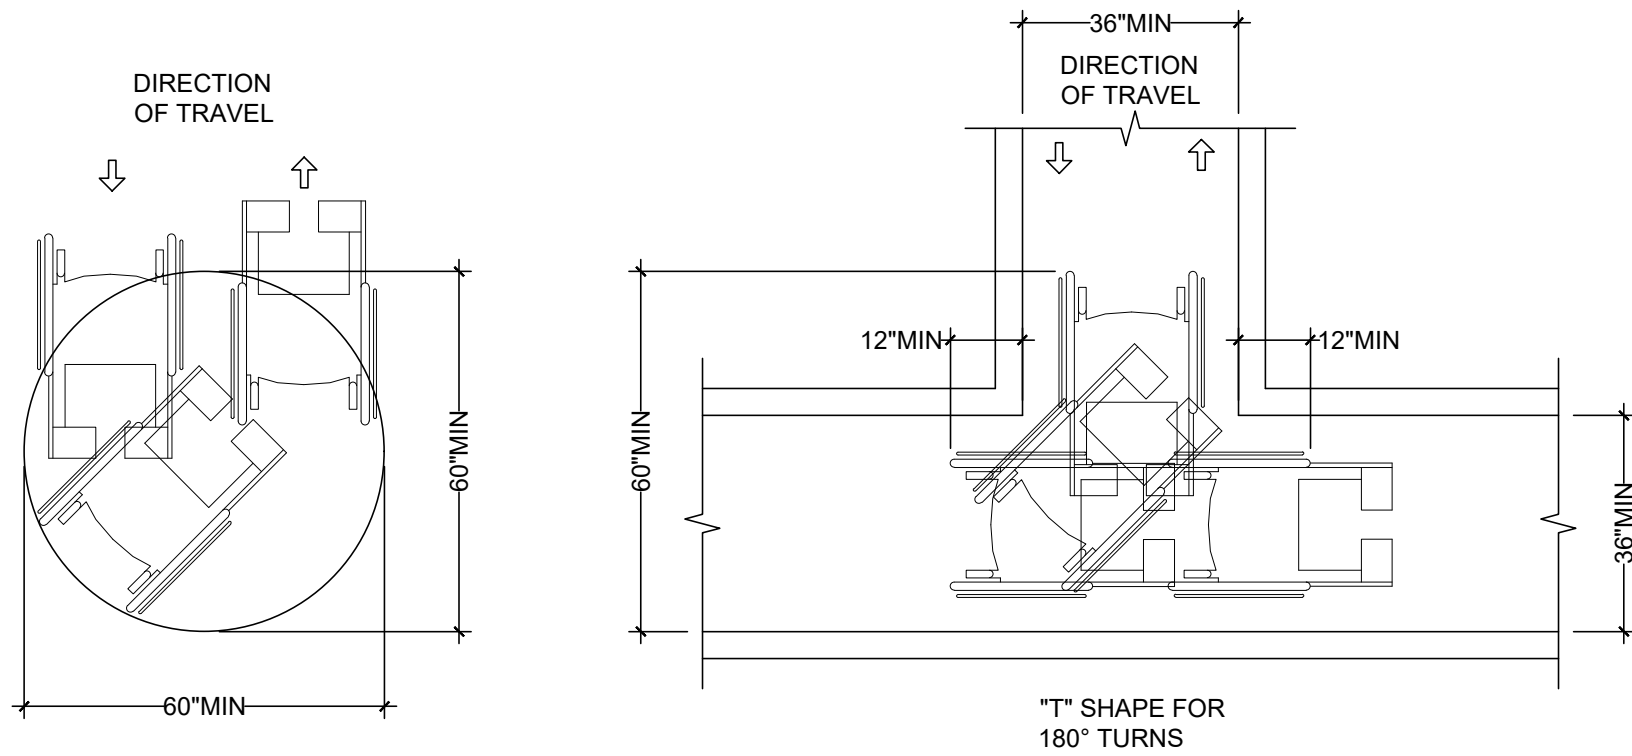

Accessible Turn Around
Scale: 3/8" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL






Contractor shall verify all dimensions and materials prior to starting any work. The contractor shall be responsible for any errors and omissions. The contractor shall be responsible for the accuracy of all information provided. The contractor shall be responsible for the accuracy of all information provided.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755


REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS	
ADA ACCESSIBILITY GUIDELINES	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4" = 1'-0"	
JOB	
SHEET	
G016	
OF 26 SHEETS	

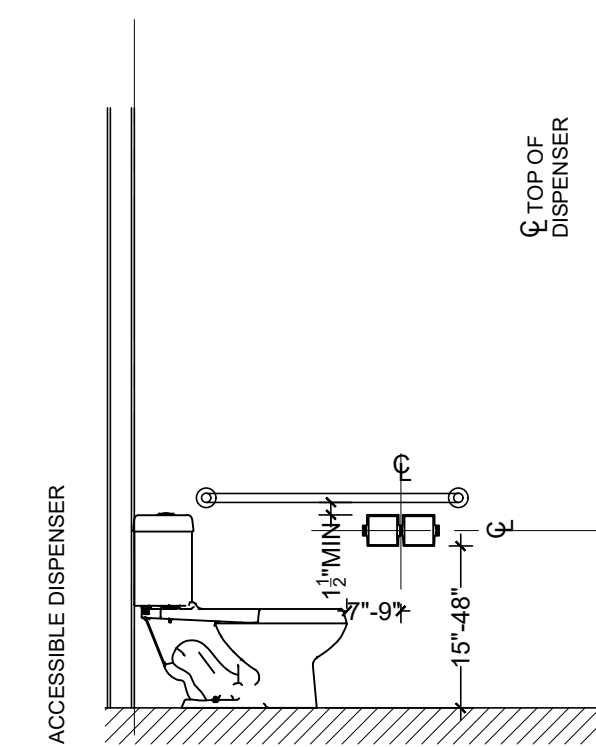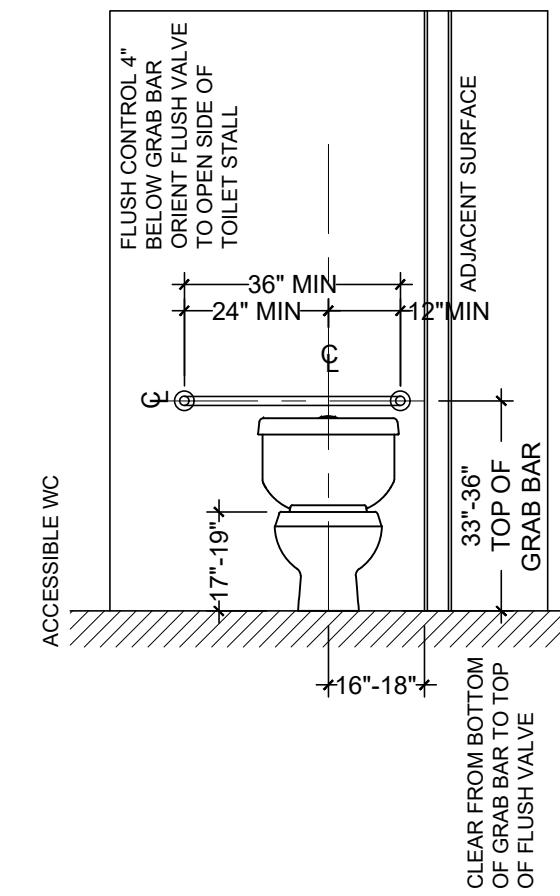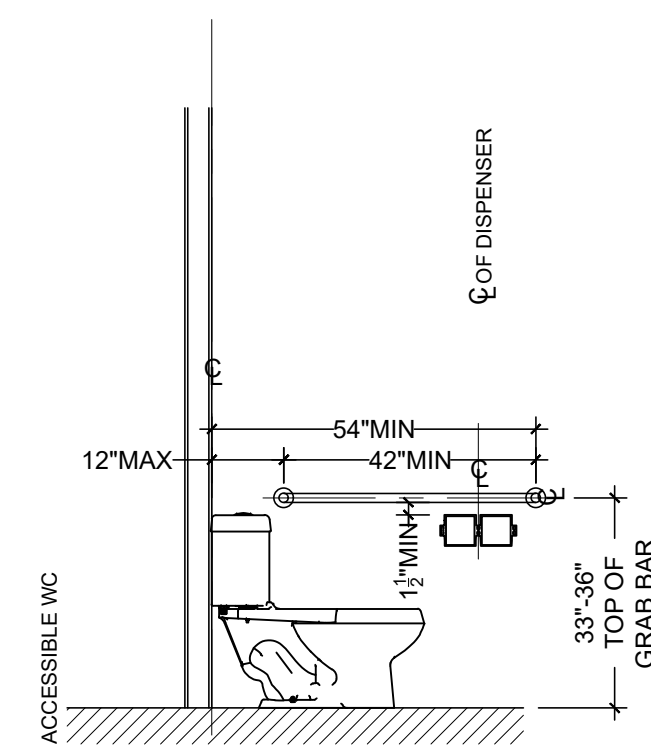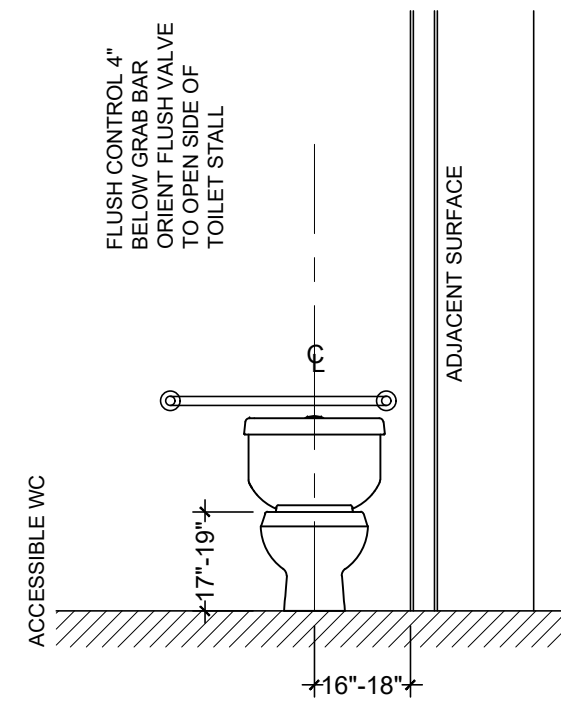
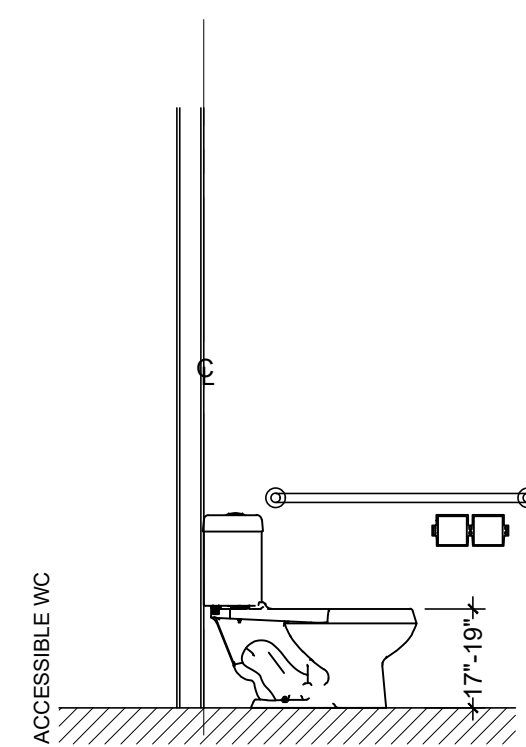


ACCESSIBLE STALL w/ 36"
GRAB BAR, 42" GRAB BAR,
TOILET TISSUE DISPENSER




Clearance at W.C.
Scale: 3/8" = 1'-0"

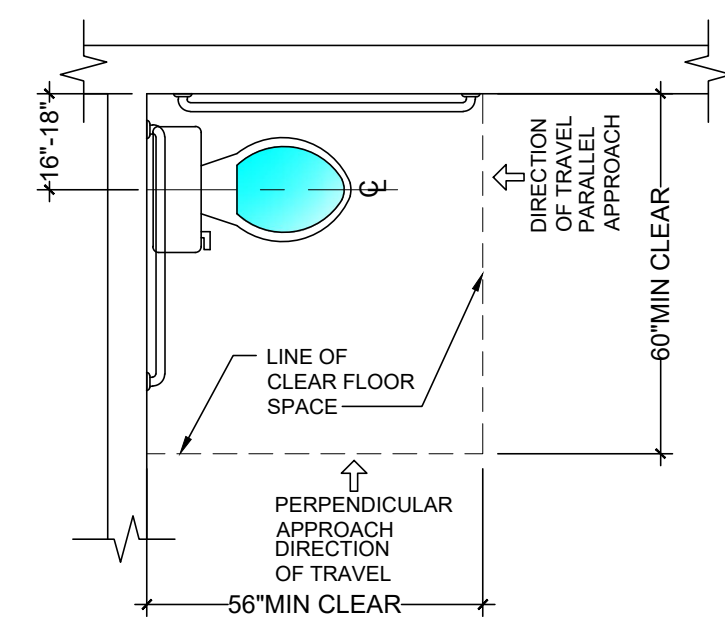


ADA Closet Clearances
Scale: $3/8" = 1'-0"$

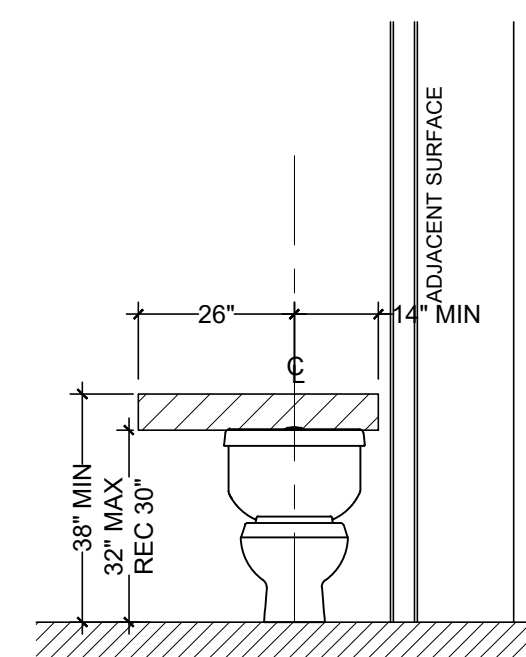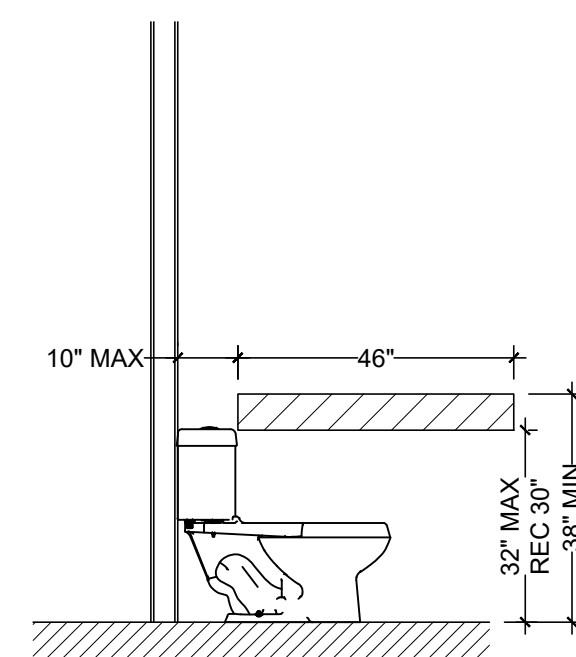


W.C. Grab Bar Blocking Location
Scale: 3/8" = 1'-0"

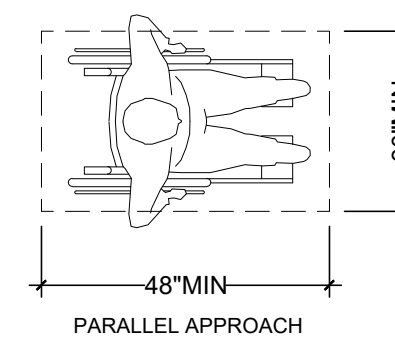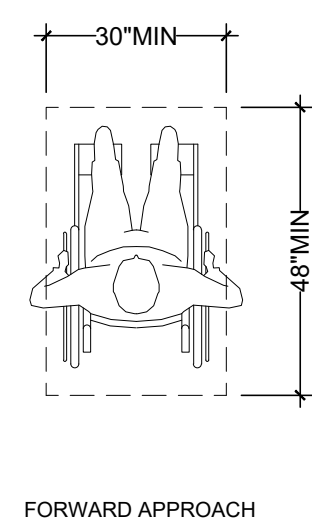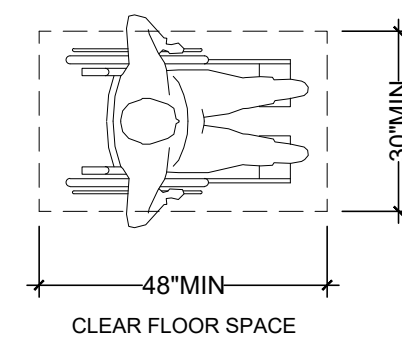



Clear Floor Space
Scale: 3/8" = 1'-0"

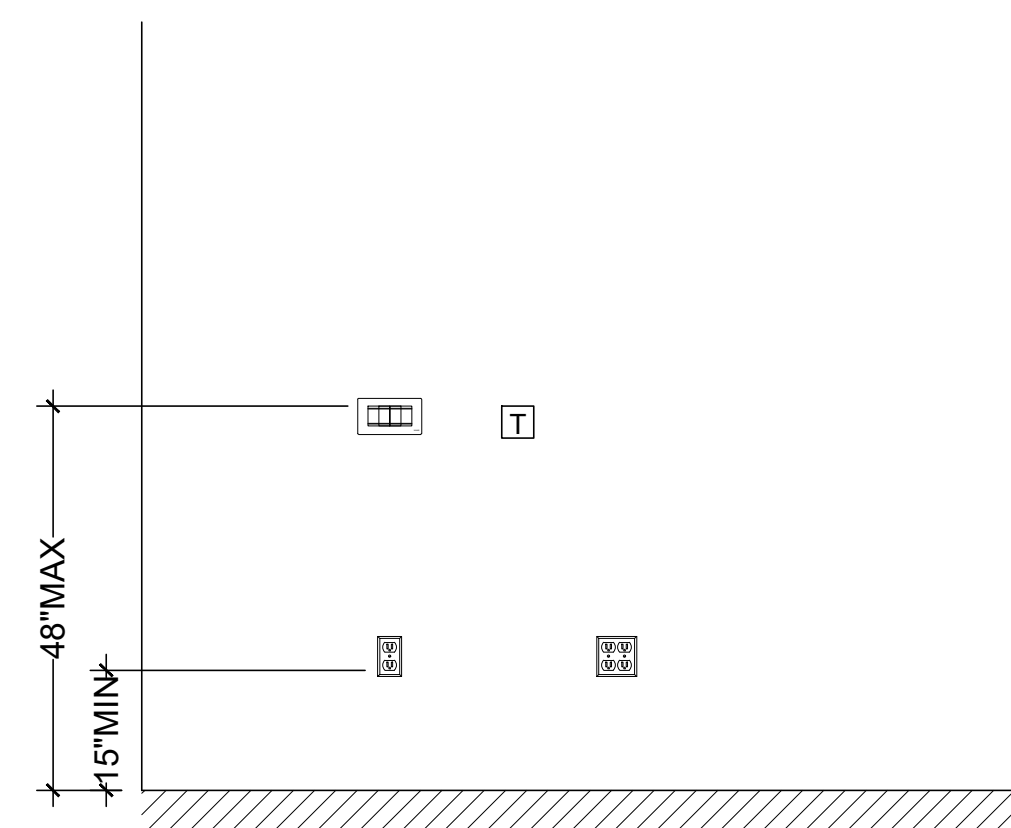



Elec Control Locations
Scale: 1/2" = 1'-0"

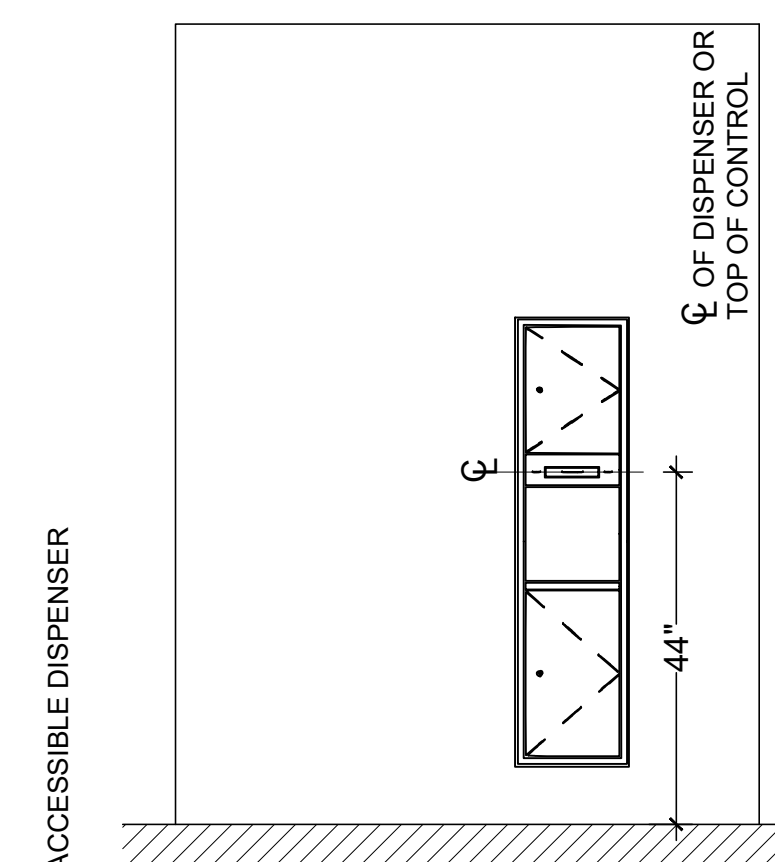

Paper Towel Dispenser and Waste Receptacle
Scale: 1/2" = 1'-0"

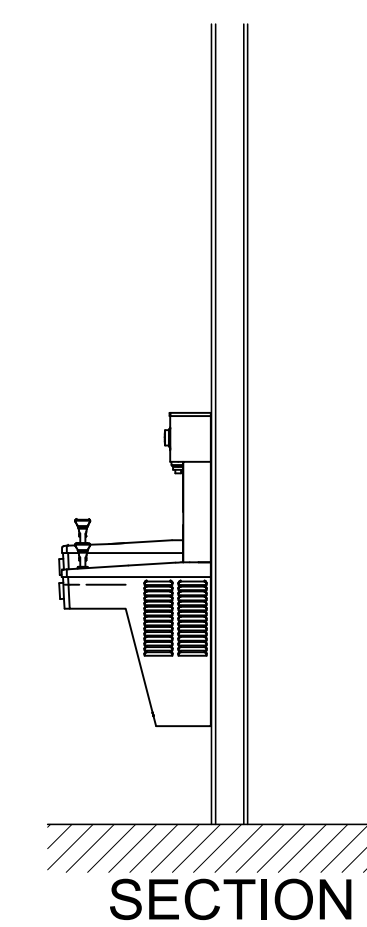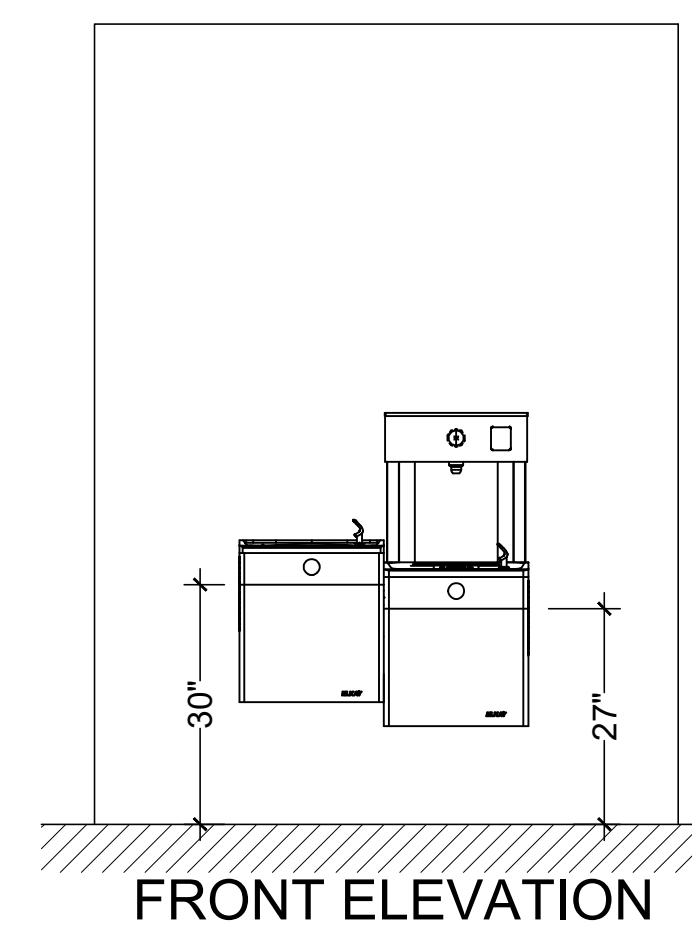

Hi-Lo Drinking Fountain
Scale: 1/2" = 1'-0"

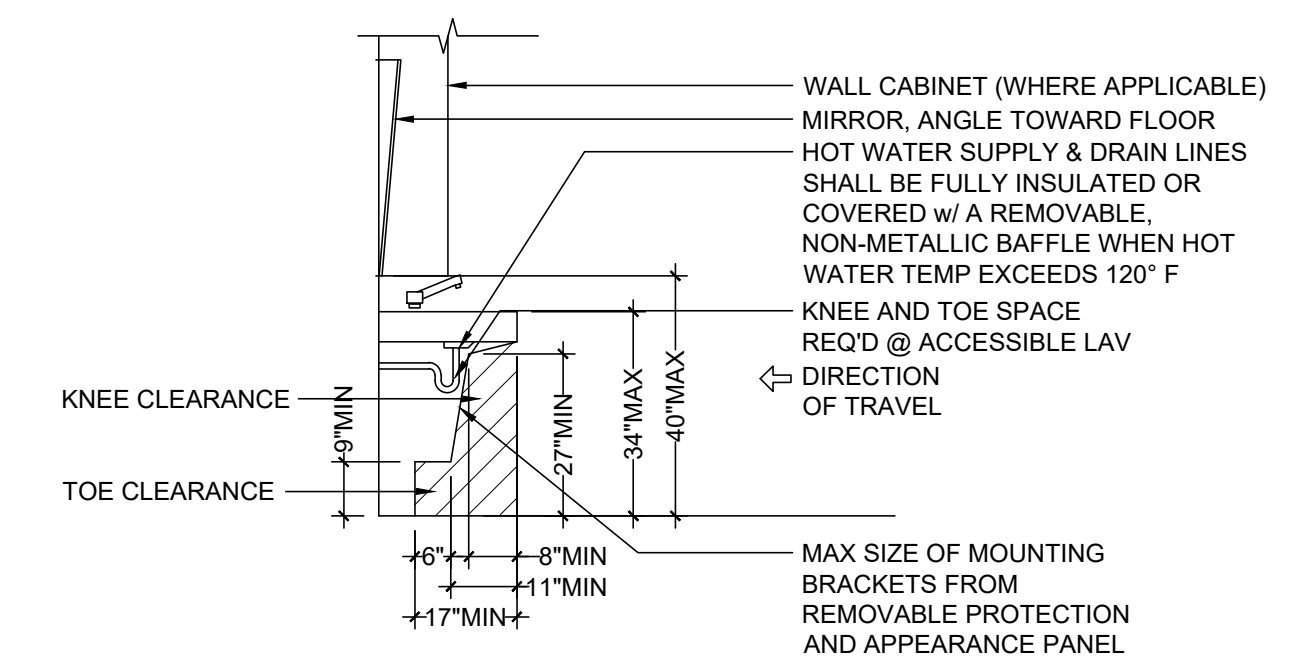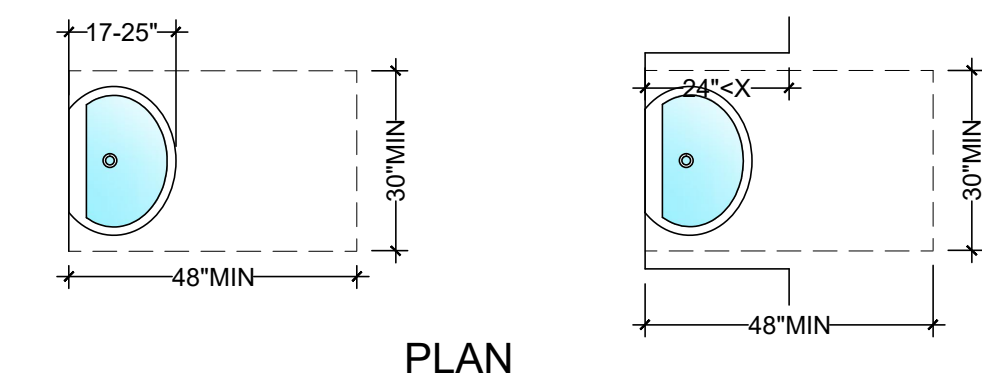

Accessible Sink
Scale: 3/8" = 1'-0"

Contractor shall verify all field conditions for conformance to drawings prior to starting any construction. All measurements are to be verified by the contractor and any discrepancies brought to the attention of JAE Carbon and Engineer prior to commencement of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
**11171 NE Cleveland St,
Clearwater, FL
33755**

REV	DATE	DESCRIPTION
1	XX.XX.XXXX	XX.XX
2		
3		
4		

SHEET CONTENTS	
ADA ACCESSIBILITY GUIDELINES	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET	

G017

CONSTRUCTION SAFEGUARDS - NFPA 241 (2019 EDITION)

- MAINTAIN FIRE DEPARTMENT ACCESS AND HYDRANTS CLEAR AT ALL TIMES
- MAINTAIN EGRESS FOR OCCUPANTS; EXISTS WILL NOT BE BLOCKED.
- PROVIDE RATED TEMPORARY SEPARATIONS (TARPS PROHIBITED).
- MAINTAIN ACTIVE FIRE PROTECTION SYSTEMS; IF IMPAIRED, PROVIDE FIRE WATCH.
- PROVIDE SITE SECURITY DURING NON-WORKING HOURS
- HOT WORK PERFORMED UNDER A PERMIT PROGRAM.
- DEBRIS AND COMBUSTIBLES REMOVED DAILY.

OCCUPANCY LOAD TABLE

Room #	Name	Area	Occupancy Type	Occupant Load Factor	Occupants	Minimum No. of Exits	Max. Common Path of Egress Travel
101	LOBBY	64.8 SF	ASSEMBLY - FIXED	1:15	4	1	30'-0"
102	MEETING	146.0 SF	ASSEMBLY - FIXED	1:15	9	1	30'-0"
103	OFFICE #1	93.0 SF	B	1:150	1	1	N/A
104	OFFICE #2	100.4 SF	B	1:150	1	1	N/A
105	OFFICE #3	100.2 SF	B	1:150	1	1	N/A
106	OFFICE #4	99.3 SF	B	1:150	1	1	N/A
107	BATH	68.1 SF	N/A	1:60	1	1	N/A
108	CIRCULATION	89.5 SF	B	1:150	1	1	N/A
109	CIRCULATION	283.4 SF	B	1:150	1	1	N/A
110	STORAGE	20.0 SF	S	1:300	1	1	N/A
					Total: 21		

Life Safety General Notes

I. GENERAL EGRESS REQUIREMENTS

- GENERAL EGRESS REQUIREMENTS SHALL APPLY TO ALL THREE ELEMENTS OF THE MEANS OF EGRESS SYSTEM (EXIT ACCESS, THE EXIT, AND THE EXIT DISCHARGE)
 - CEILING HEIGHTS: 7'-6" MINIMUM
 - PROTRUDING OBJECTS: 4" MAXIMUM PROTRUSION ABOVE 27" HEIGHT ABOVE FINISH FLOOR
 - ELEVATION CHANGES: WHERE CHANGES IN ELEVATION OF LESS THAN 12 INCHES EXIST IN THE MEANS OF EGRESS, SLOPED SURFACES SHALL BE USED WITH THE FOLLOWING EXCEPTIONS:
 - A SINGLE STEP WITH A MAXIMUM RISER OF 7 INCHES IS PERMITTED IN BUILDINGS WITH OCCUPANCIES F, H, R-2, R-3, S, AND U AT EXTERIOR DOORS NOT REQUIRED TO BE ACCESSIBLE.
 - A STAIR WITH A SINGLE RISER OR WITH TWO RISERS AND A TREAD IS PERMITTED AT LOCATIONS NOT REQUIRED TO BE ACCESSIBLE BY CHAPTER 11 (IBC/FBC) NOT LESS THAN ONE HANDRAIL MUST BE PROVIDED.
 - A STEP IS PERMITTED IN AISLES SERVING SEATING THAT HAS A DIFFERENCE IN ELEVATION LESS THAN 12" AT LOCATIONS NOT REQUIRED TO BE ACCESSIBLE BY CHAPTER 11 (IBC/FBC)
 - CONTINUOUS WIDTH: THE MINIMUM ALLOWED WIDTH FOR A MEANS OF EGRESS SHALL BE 44" UNLESS NOTED OTHERWISE. MEANS OF EGRESS WIDTH SHALL NOT BE LESS THAN THAT REQUIRED BY THE IBC/FBC (CHAPTER 10) OR NFPA 101/FFPC (CHAPTER 7) AND SHALL BE BASED ON THE OCCUPANT LOAD BEING SERVED.

- REFER TO ELECTRICAL PLANS FOR EXIT SIGNS AND EMERGENCY LIGHTING LOCATIONS. THE EXIT SIGN LOCATIONS SHOWN IN THESE PLANS IS BASED ON THE PRESCRIPTIVE CODE REQUIREMENTS. THE AUTHORITY HAVING JURISDICTION HAS THE RESPONSIBILITY TO REVIEW THE FINAL EXIT SIGN QUANTITY AND LOCATIONS BASED ON THE AS-BUILT CONDITION. THEREFORE, THE CONTRACTOR SHALL REVIEW WITH THE AUTHORITY HAVING JURISDICTION, FOR APPROVAL, THE EXIT SIGN LOCATION STRATEGY PRIOR TO INSTALLATION.

II. FIRE AND SMOKE RATED PARTITIONS

- ALL PENETRATIONS THROUGH FIRE-RATED PARTITIONS AND BARRIERS SHALL BE BUILT IN ACCORDANCE WITH THE APPLICABLE UL-LISTED FIRE RESISTANCE DIRECTORY DESIGN.
- ALL PENETRATIONS THROUGH SMOKE RATED PARTITIONS AND BARRIERS SHALL UTILIZE THE APPROPRIATE UL-LISTED PRODUCTS DESIGNED TO RESIST THE PASSAGE OF AIR AND SMOKE.
- NO DUCTS, PIPING, OR CONDUIT SHALL BE PERMITTED WITHIN AN EXIT STAIR ENCLOSURE OR EXIT PASSAGEWAY UNLESS THEY SERVE THE STAIR OR EXIT PASSAGEWAY.

III. FIRE PROTECTION

- FIRE EXTINGUISHERS HAVE BEEN SHOWN FOR GENERAL CONFORMANCE WITH NFPA 10 BASED ON A MAXIMUM TRAVEL DISTANCE TO AN EXTINGUISHER NOT TO EXCEED 75 FEET. PER NFPA 10, THE CONTRACTOR IS RESPONSIBLE FOR REVIEWING, FOR APPROVAL, THE QUANTITY AND LOCATION OF ALL EXTINGUISHERS WITH THE AUTHORITY OF JURISDICTION PRIOR TO INSTALLATION.
- PORTABLE FIRE EXTINGUISHERS SHALL BE PROVIDED IN EVERY HAZARDOUS AREAS IN ACCORDANCE WITH NFPA 10.
- PORTABLE FIRE EXTINGUISHERS SHALL BE PROVIDED IN EVERY ASSEMBLY OCCUPANCY IN ACCORDANCE WITH NFPA 10.

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all measurements and dimensions prior to starting any work. Measurements are to be taken by the contractor and any discrepancies shall be the responsibility of the contractor. The attention of JAE Carbon is drawn to the fact that the contractor is responsible for the accuracy of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS

LIFE SAFETY NOTES
CONSTRUCTION
SAFEGUARDS
OCCUPANCY SCHEDULE
MOUNTING HEIGHTS

DRAWN BY
J.A.E.

DATE
05/14/2026

SCALE
1/4"= 1'-0"

JOB

SHEET

G100


- THIS BUILDING IS NOT EQUIPPED WITH A SPRINKLER SYSTEM
- ALL EXIT SIGNS AND VISUAL NOTIFICATIONS APPLIANCES ARE TO BE MOUNTED TO MAXIMIZE VISIBILITY
- MAXIMUM TRAVEL DISTANCE TO FIRE EXTINGUISHER 75'-0"
- PROVIDE ALL NECESSARY FIREPROOFING/SAFING TO MAINTAIN REQUIRED RATINGS
- FIRE RATED WALL CONSTRUCTION TO BE EXTENDED BEHIND RECESSED OR BUILT-IN EQUIPMENT SUCH AS FIRE EXTINGUISHER CABINETS, ELECTRICAL WATER COOLERS, ELECTRICAL PANELS, ETC.

- - EXIT SIGNAGE
- - WALL MOUNTED FIRE EXTINGUISHER
- - PATH LENGTH/PATH OF TRAVEL

 = 1 HOUR FIRE RATED WALL
 = 2 HOUR FIRE RATED WALL
 = 3 HOUR FIRE RATED WALL
 = 4 HOUR FIRE RATED WALL

NAME OF AREA
XXX
OL - X
A - XX SQ FT
OLF - XX SQ FT
EXITS - X

ROOM NUMBER
OCCUPANCY LOAD
AREA IN SQ FT
OCCUPANCY LOAD FACTOR IN SQ FT
MINIMUM EXITS REQUIRED

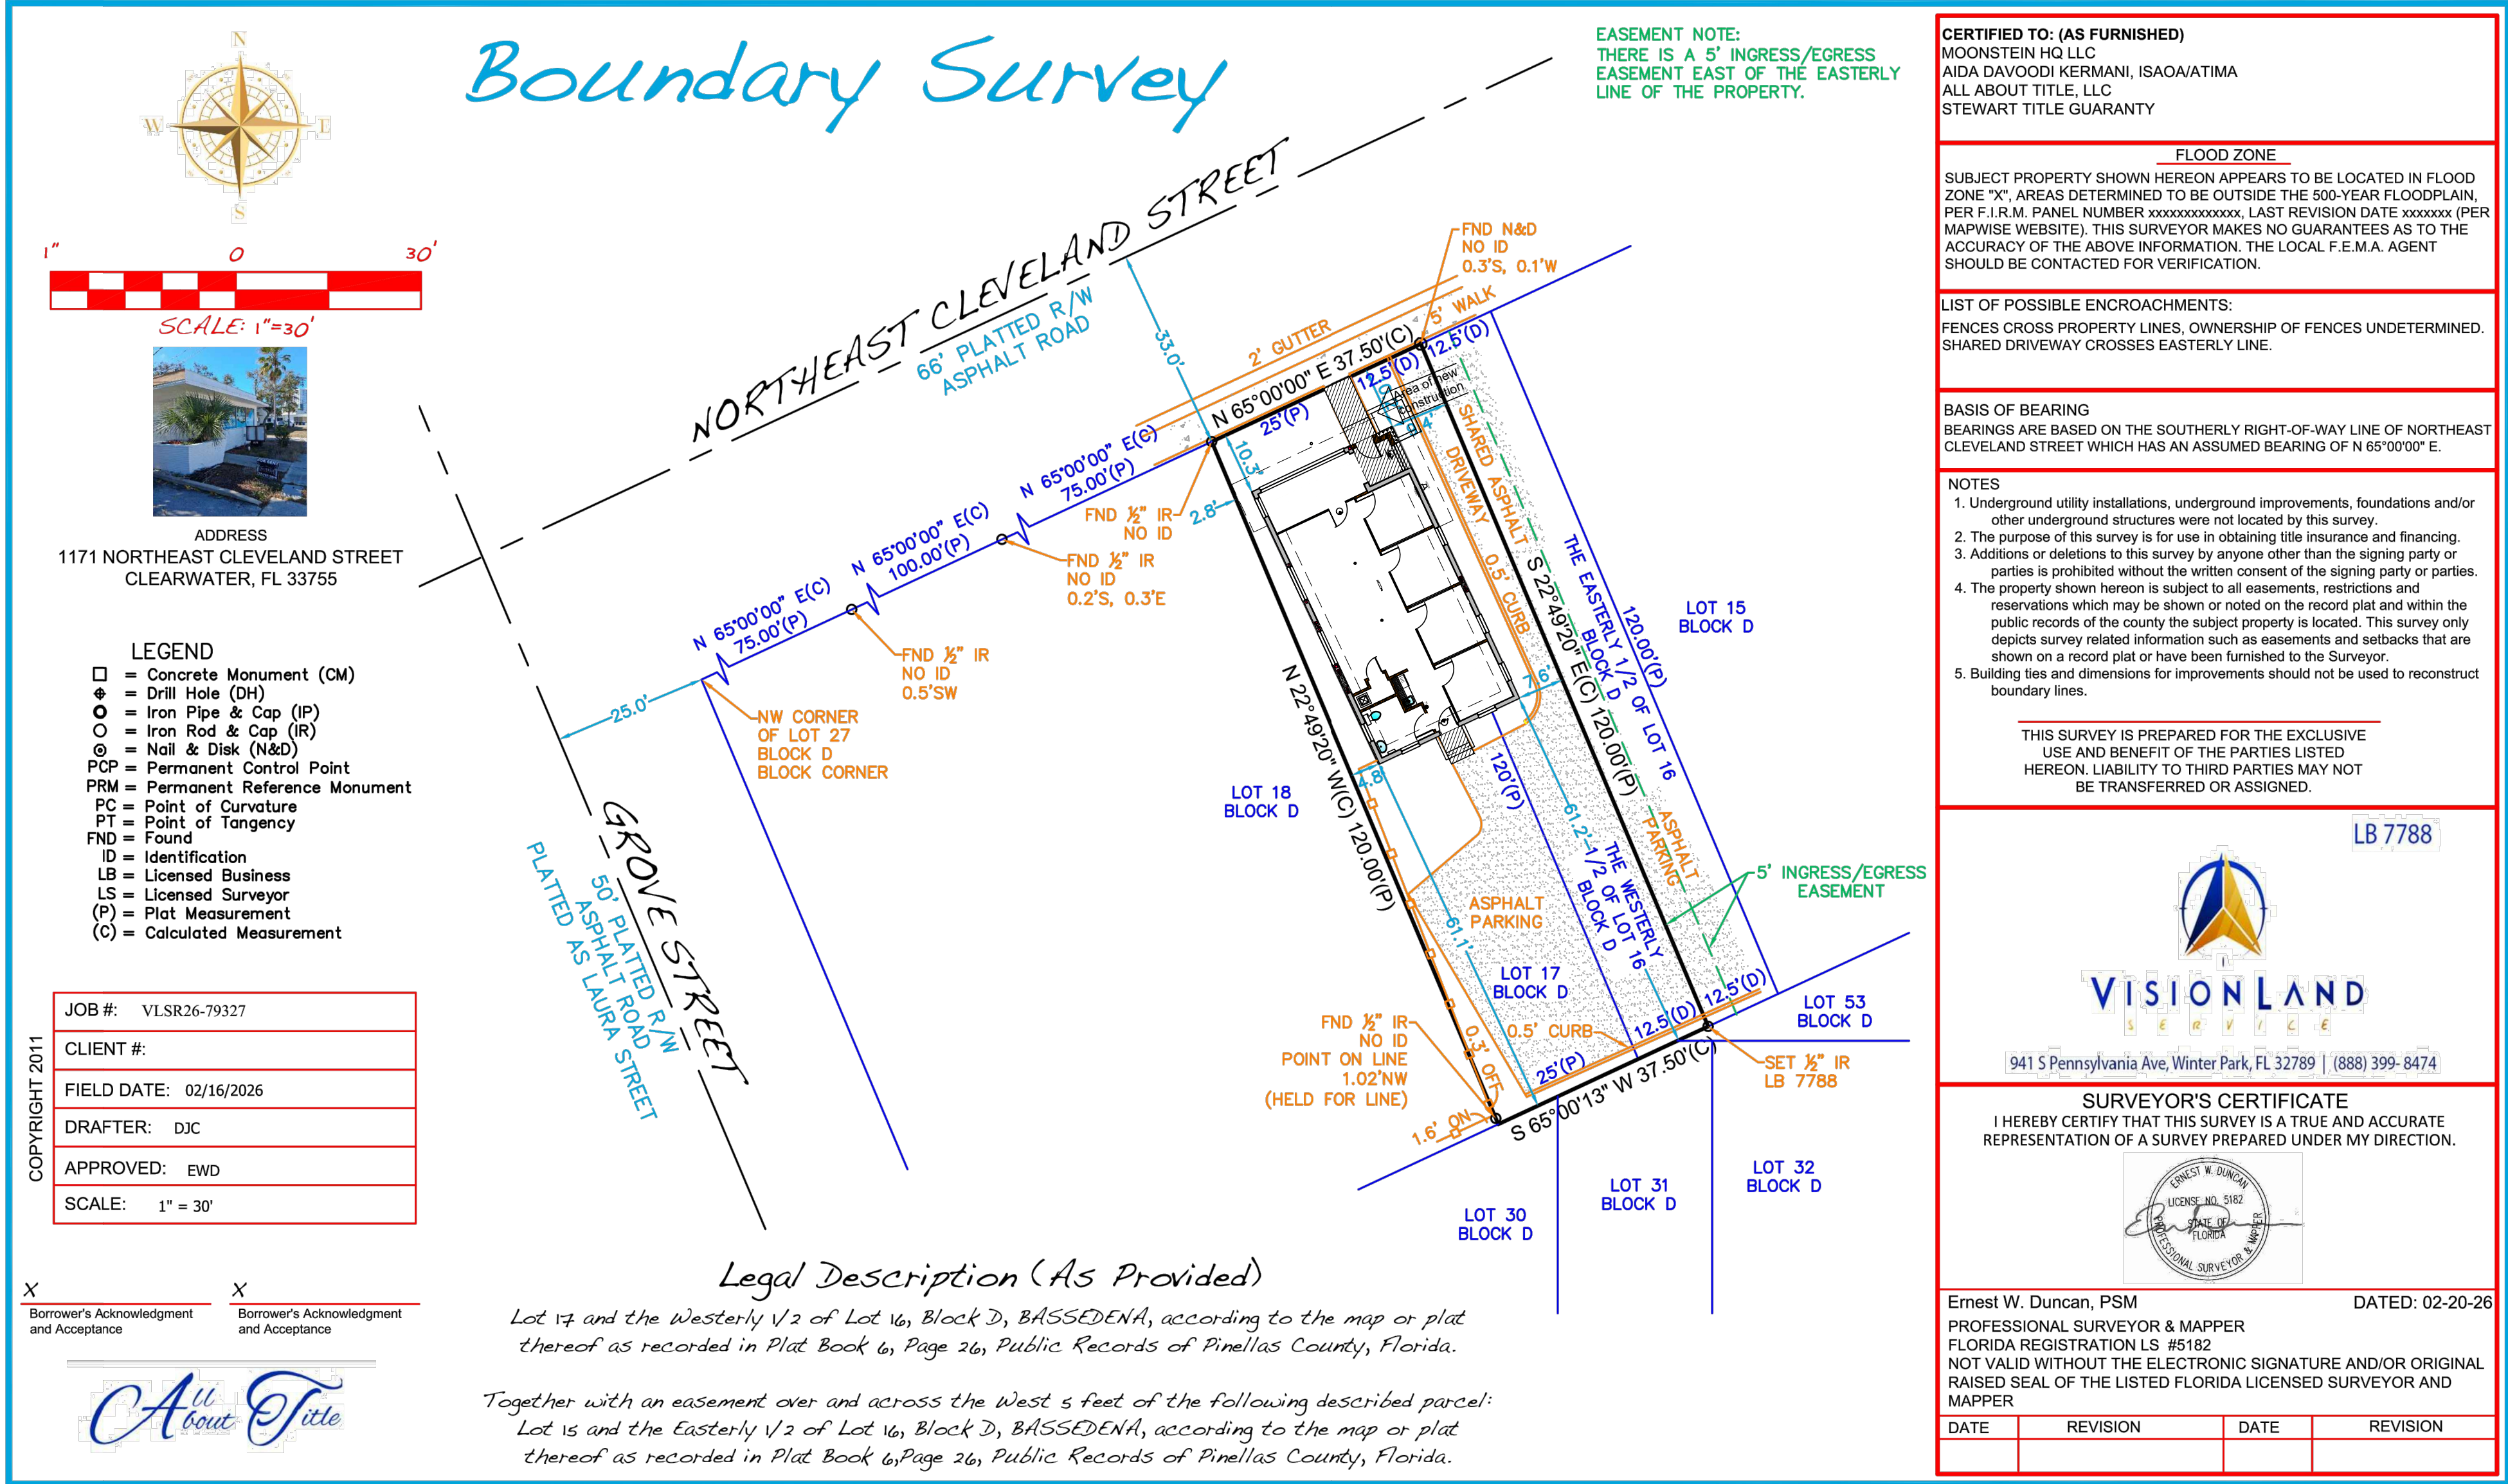

Survey/Site Plan
Scale: 1" = 20'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all measurements and dimensions prior to starting any construction to drawings and shall be responsible for any errors and omissions. Measurements are to be made by the contractor and are not to be used as a basis for any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA


Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS
DEMOLITION NOTES EXISTING FLOOR PLAN
DRAWN BY J.A.E.
DATE 05/14/2026
SCALE 1/4"= 1'-0"
JOB
SHEET
A050
OF 26 SHEETS

 = TO BE DEMOLISHED

- [illegible]



MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 266-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all field conditions for conformance to drawings prior to starting any construction. All measurements are to be verified by the contractor and any discrepancies brought to the attention of JAE Carbon and Engineer prior to commencement of any construction or fabrication.

TRUE
BUILDING, INC.

Project Title:
A Remodel For:
11171 NE Cleveland
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	xx.xx.xxxx	xx.xx
2		
3		
4		

SHEET CONTENTS

DEMOLITION NOTES
EXISTING FLOOR PLAN

DRAWN BY
J.A.E.

DATE
05/14/2026

SCALE
1/4"= 1'-0"

JOB

SHEET

A101

OF 26 SHEETS

 = NEW FRAME WALL

 = NEW BLOCK WALL


 = NEW METAL STUD WALL

- Filled Cell Key**


-  = indicates cutin filled cell w/ (1) #5 rebar epoxied into top course and slab w/ Simpson S.E.T.-3G Epoxy and filled with 3000PSI concrete
-  = indicates assumed existing filled cell or add same as cutin filled cell
-  = indicates new filled cell w/ (1) #5 rebar from footing to lintel w/ 10" bend into each and min overlap splice of 26" filled with 3000PSI concrete
-  = indicates new filled cell in 12" x 12" CMU w/ (2) #5 rebar from footing to lintel w/ 10" bend into each and min overlap splice of 26" filled with 3000PSI concrete
-  = indicates new filled cell in 16" x 16" CMU w/ (4) #5 rebar from footing to lintel w/ 10" bend into each and min overlap splice of 26" filled with 3000PSI concrete

EMERGENCY LIGHT

EXIT LIGHT w/ ILLUMINATION/LIGHTS

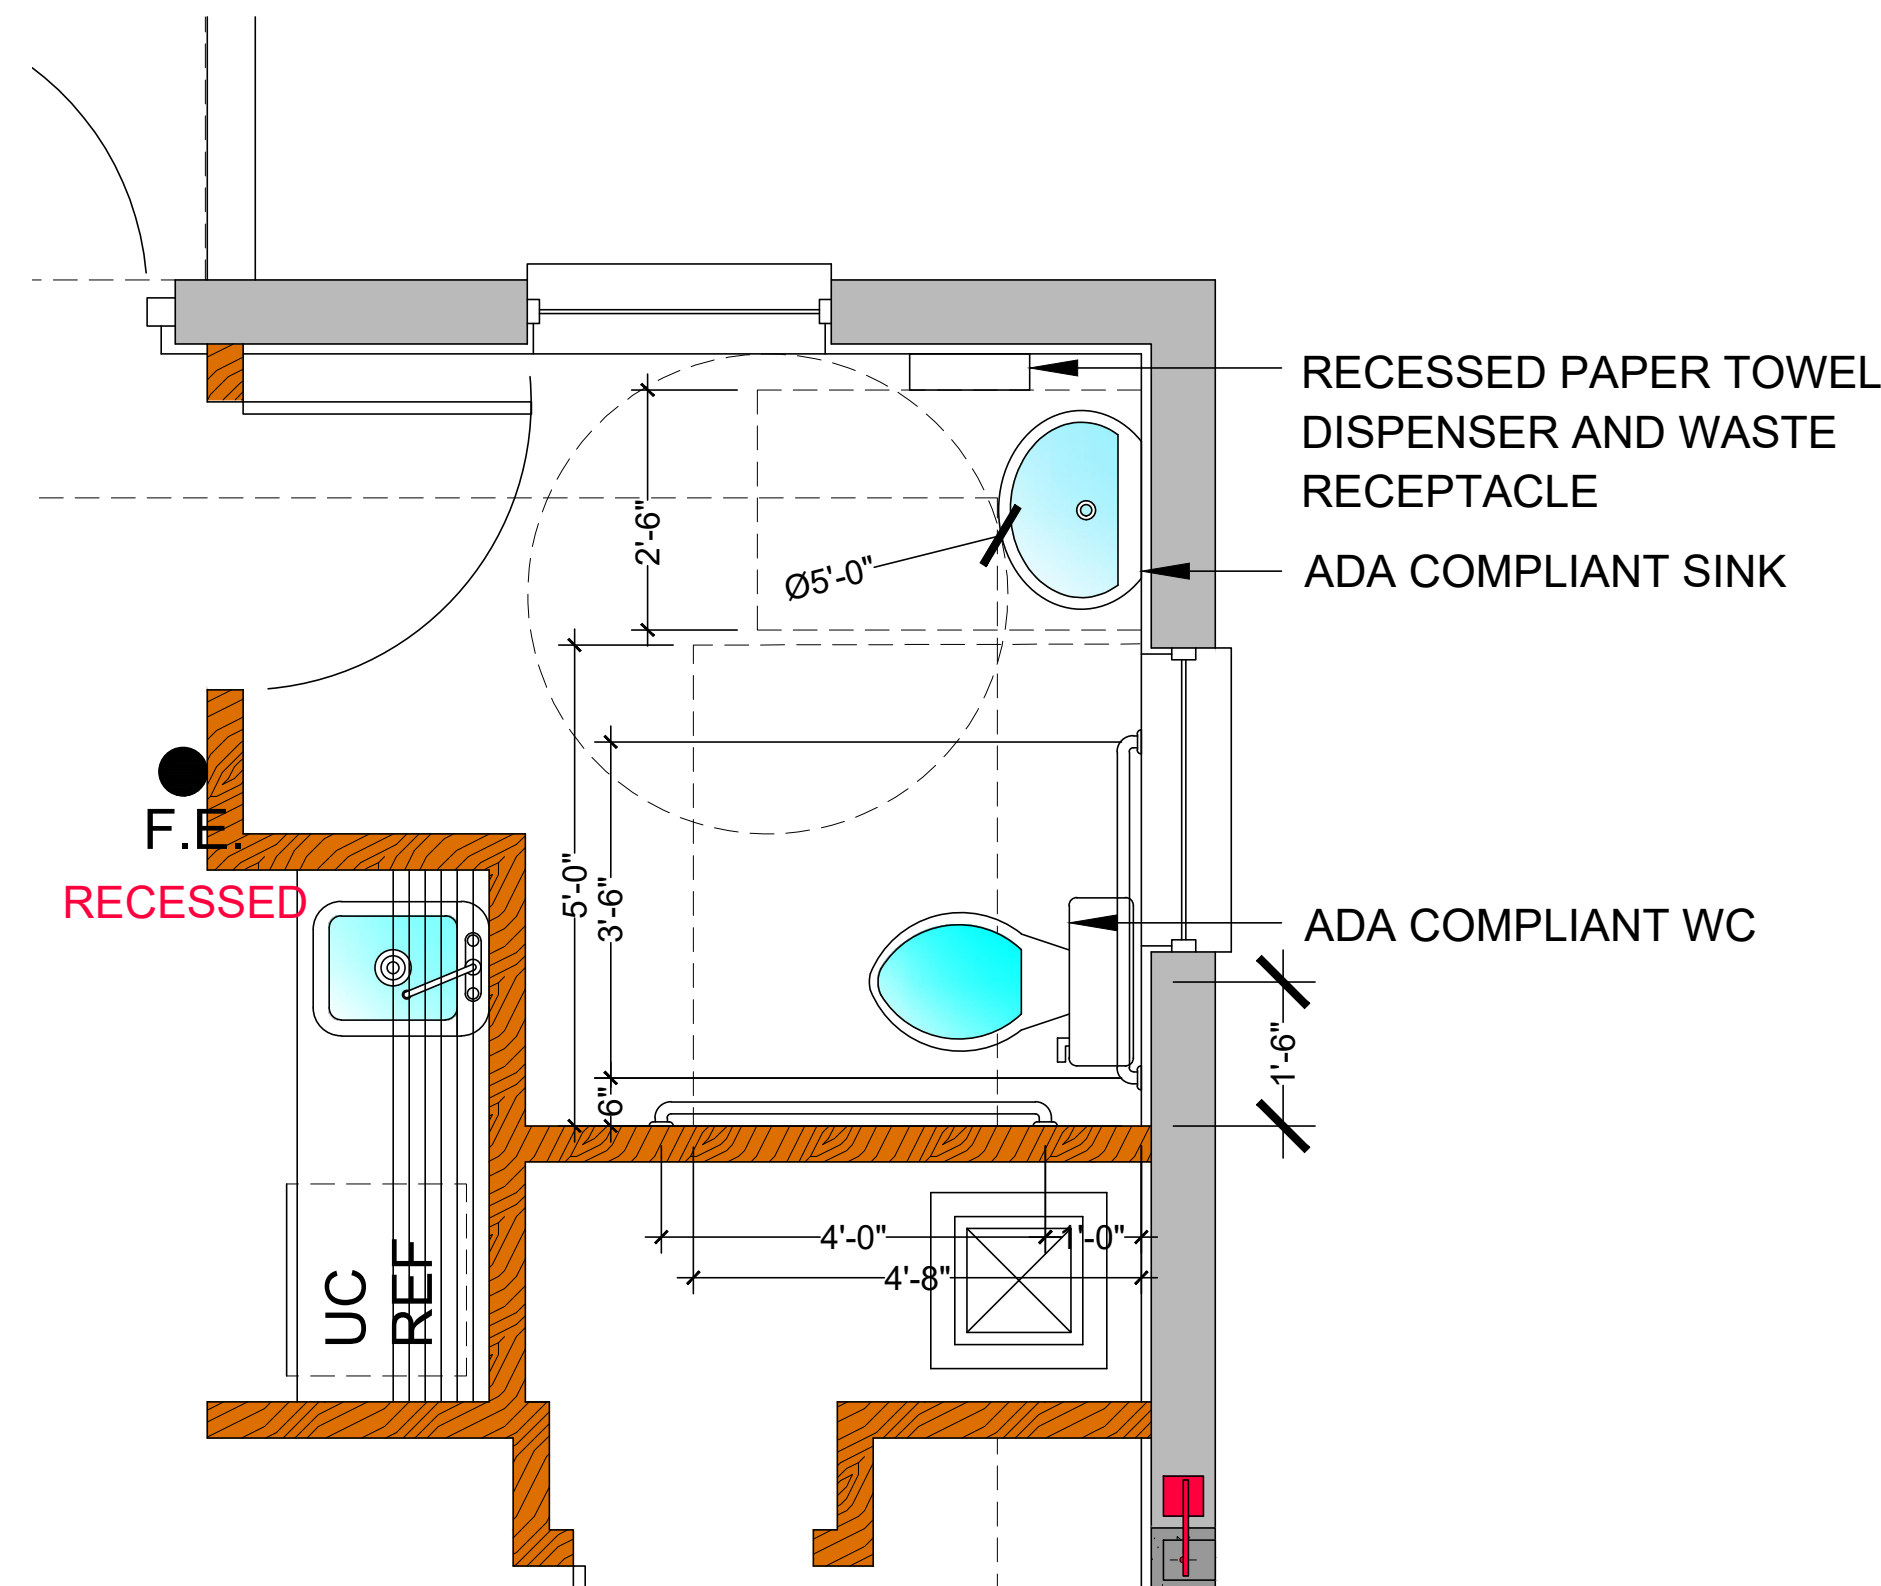

ADA Lavatory Layout
Scale: 1/2" = 1'-0"

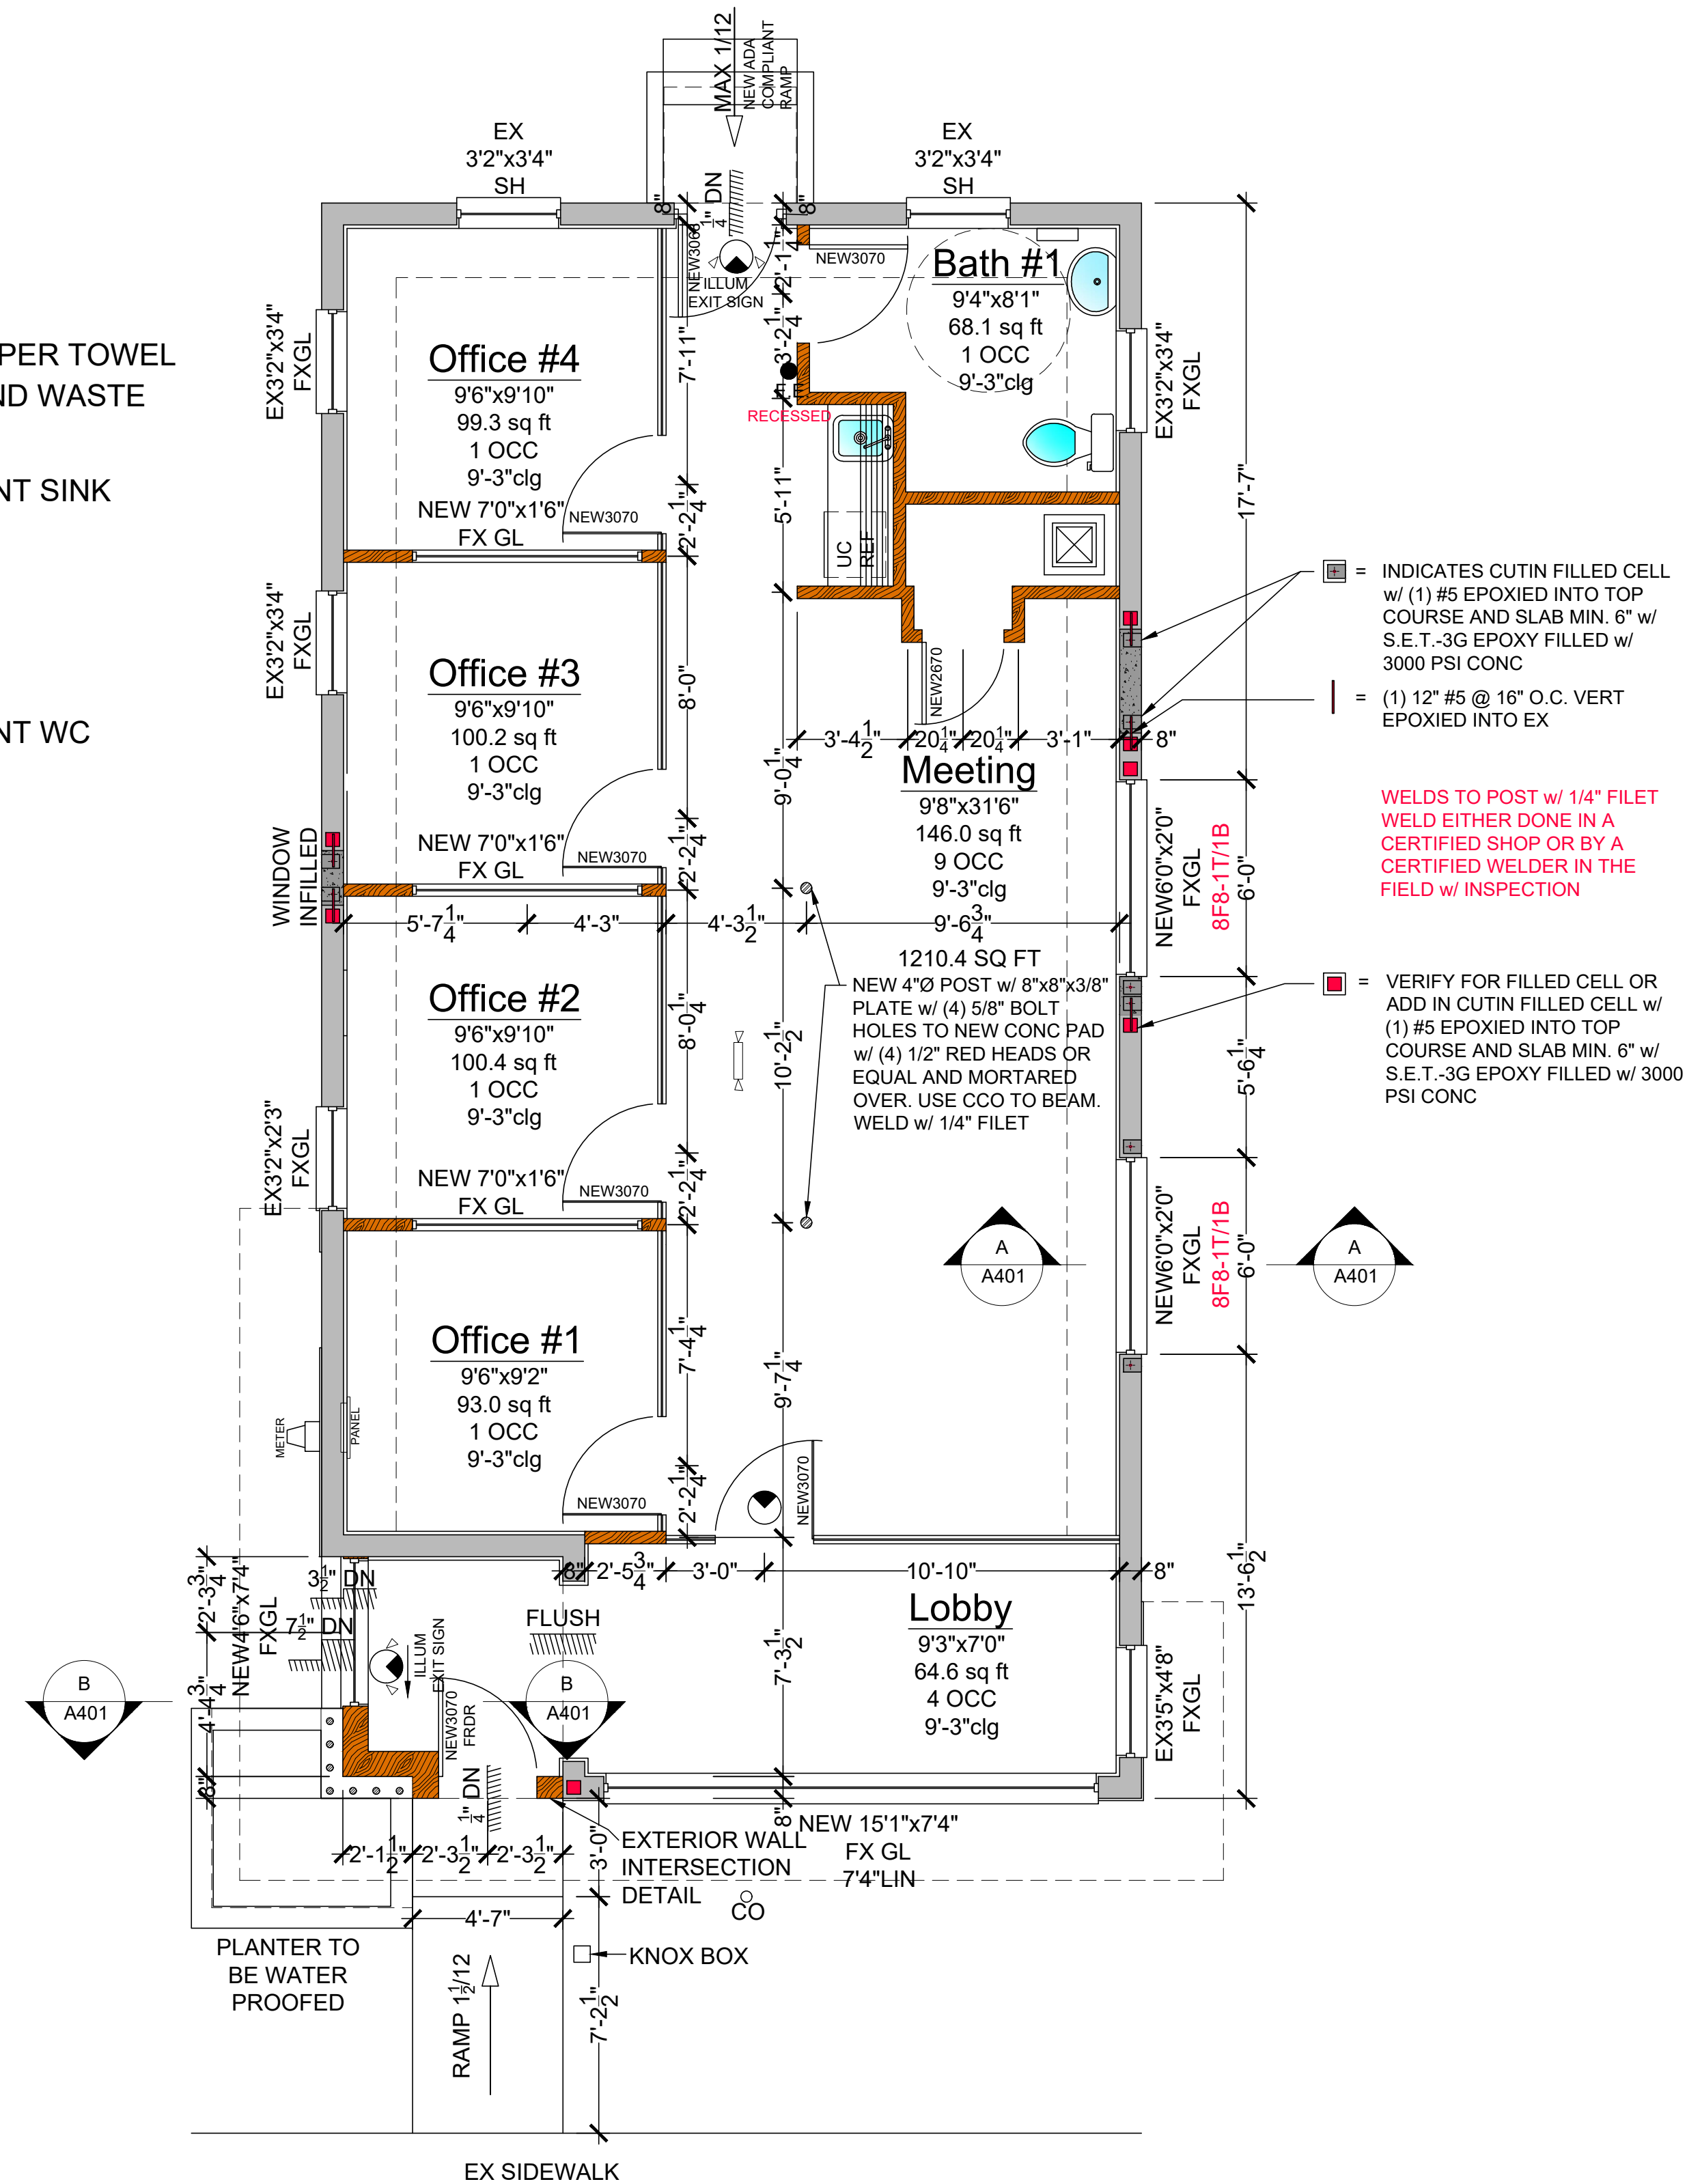

Renovation Floor Plan
Scale: 1/4" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 266-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

field conditions for conformance to drawings prior to starting any construction. All measurements are to be verified by the contractor and any discrepancies brought to the attention of JAE Carbon and Engineer prior to commencement of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

**1171 NE Cleveland
Clearwater, FL
33755**

1	xxxxxxx	xx.xx
2		
3		
4		

MEET CONTENTS

RENOVATION NOTES
RENOVATION FLOOR PLAN
A LAVATORY LAYOUT
FILLED CELL KEY

AWN BY
J.A.E.

DATE
14/2026


SCALE
4"= 1'-0"

JOB


SHEET

A201


26 SHEETS

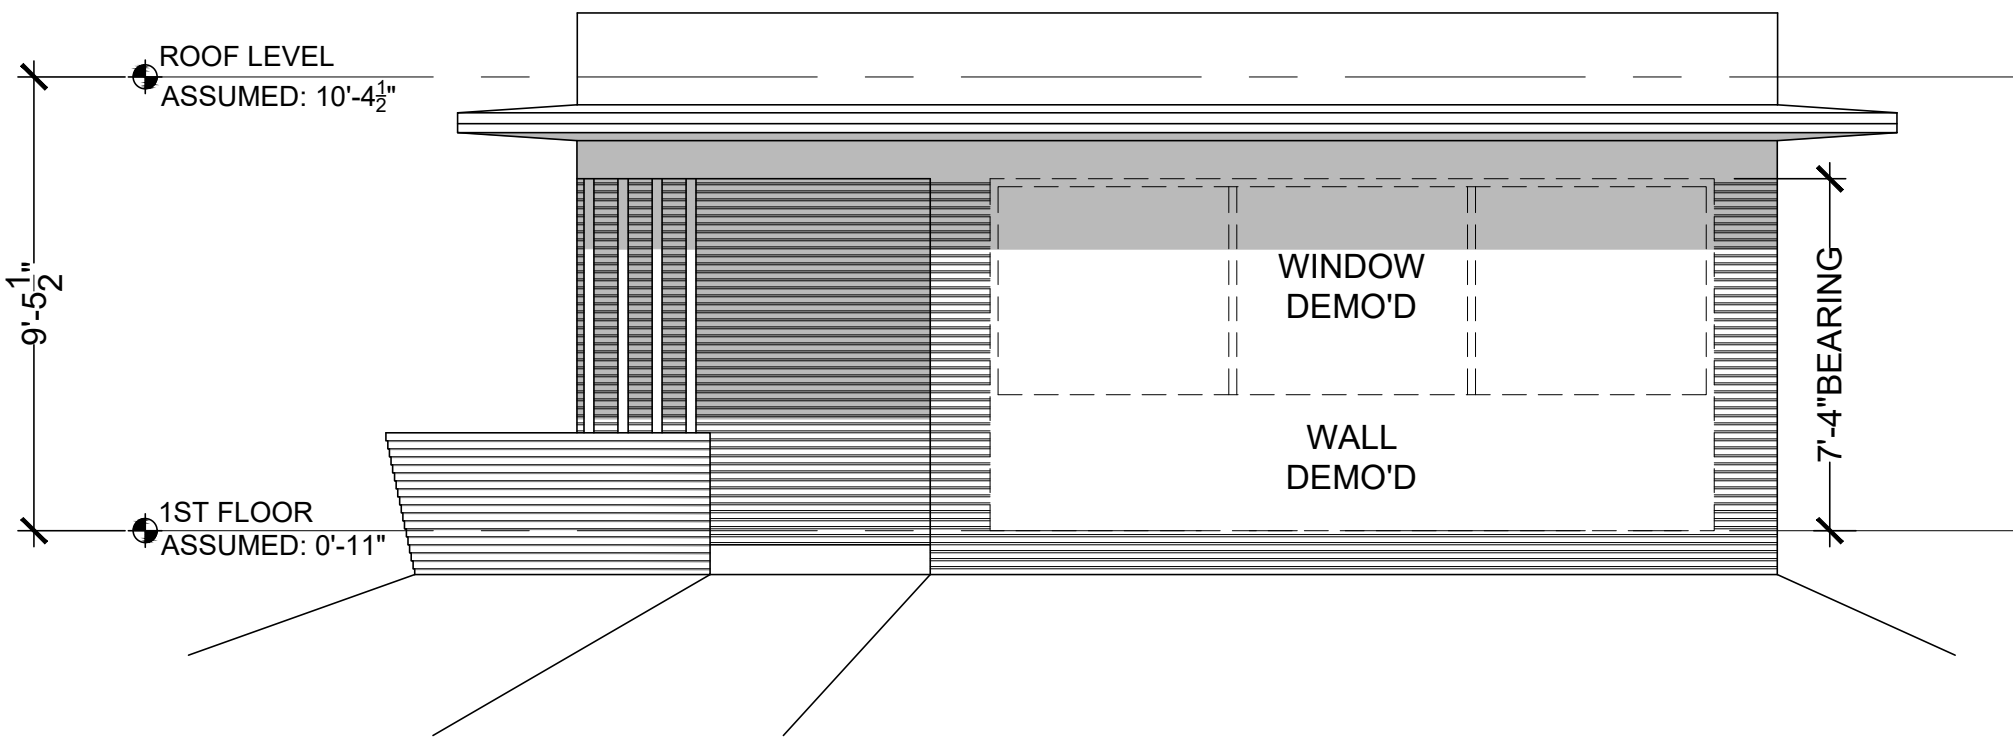


North Elevation Existing
Scale: 1/4" = 1'-0"

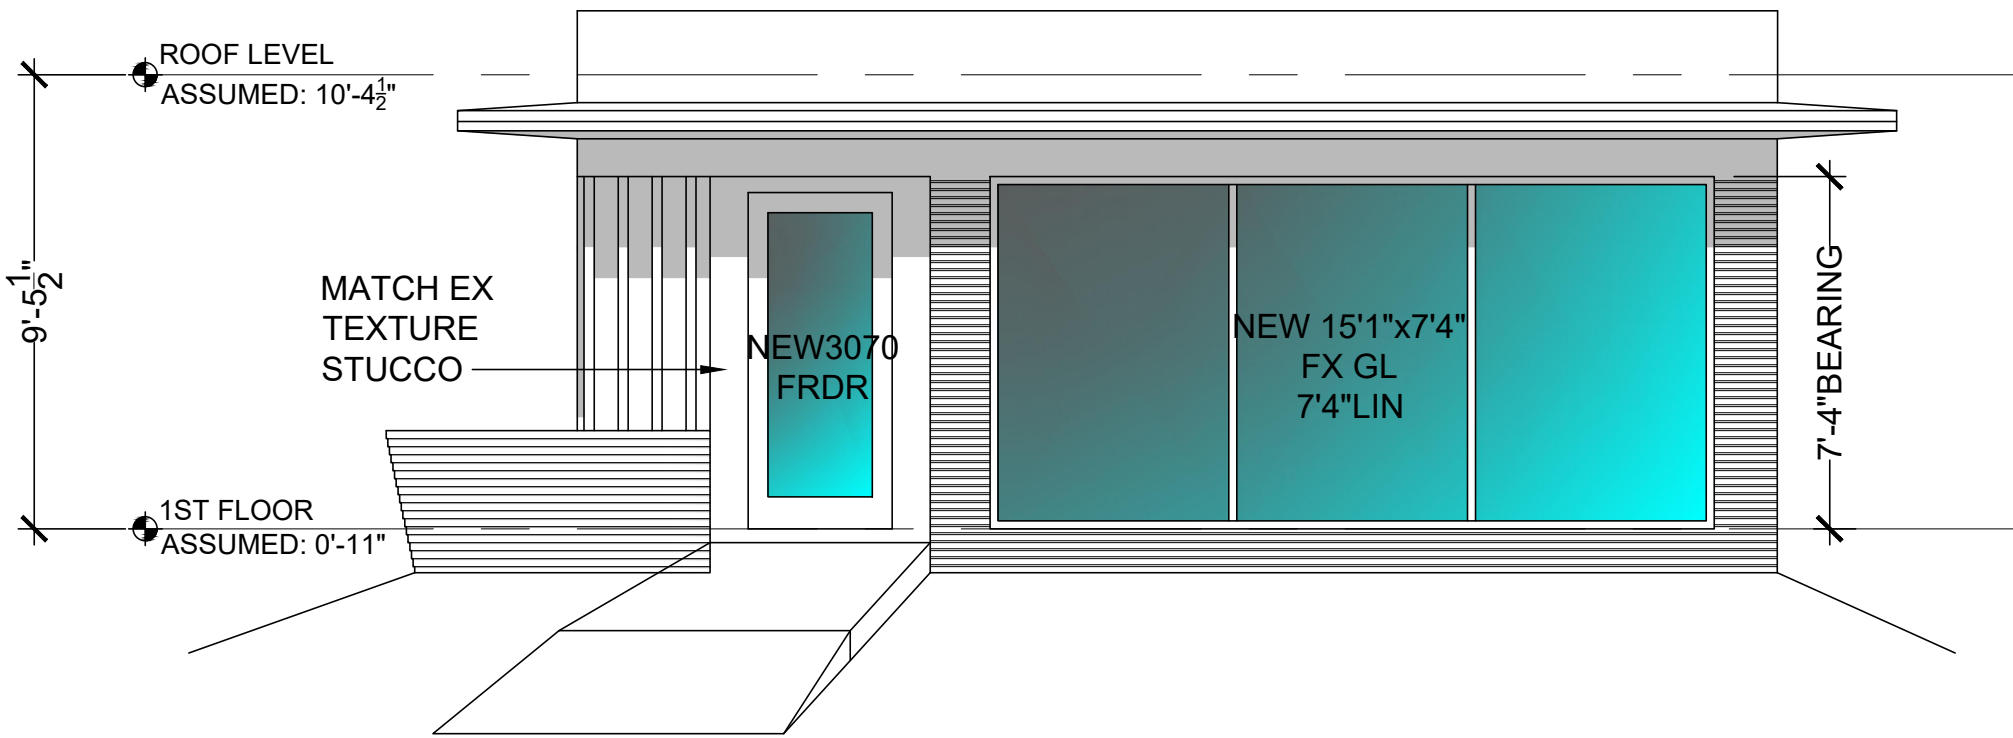

North Elevation Renovation
Scale: 1/4" = 1'-0"

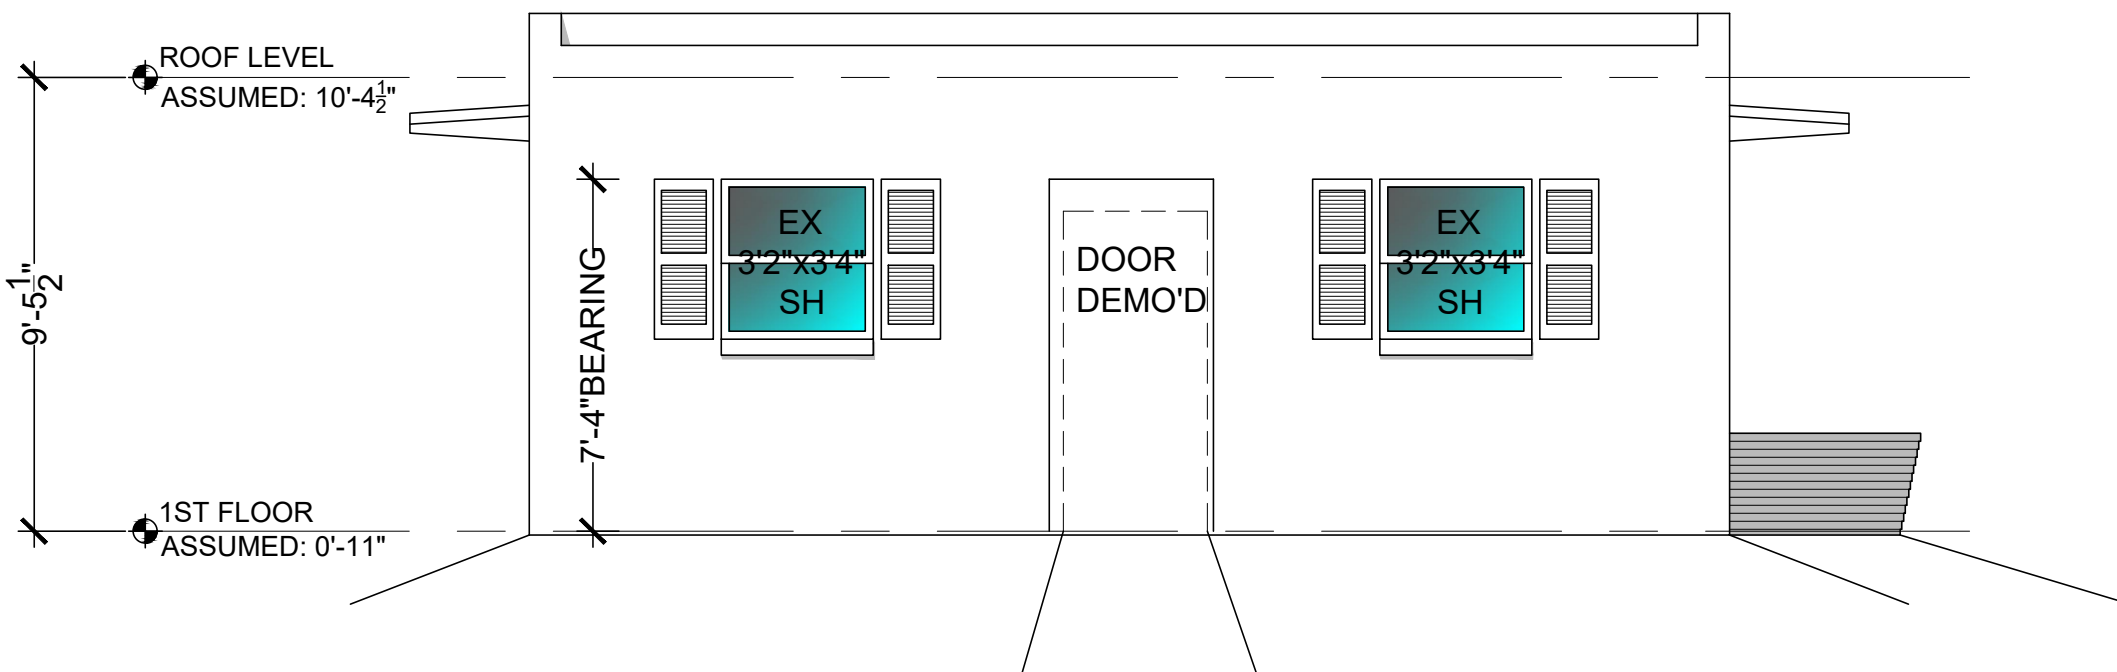

South Elevation Existing
Scale: 1/4" = 1'-0"

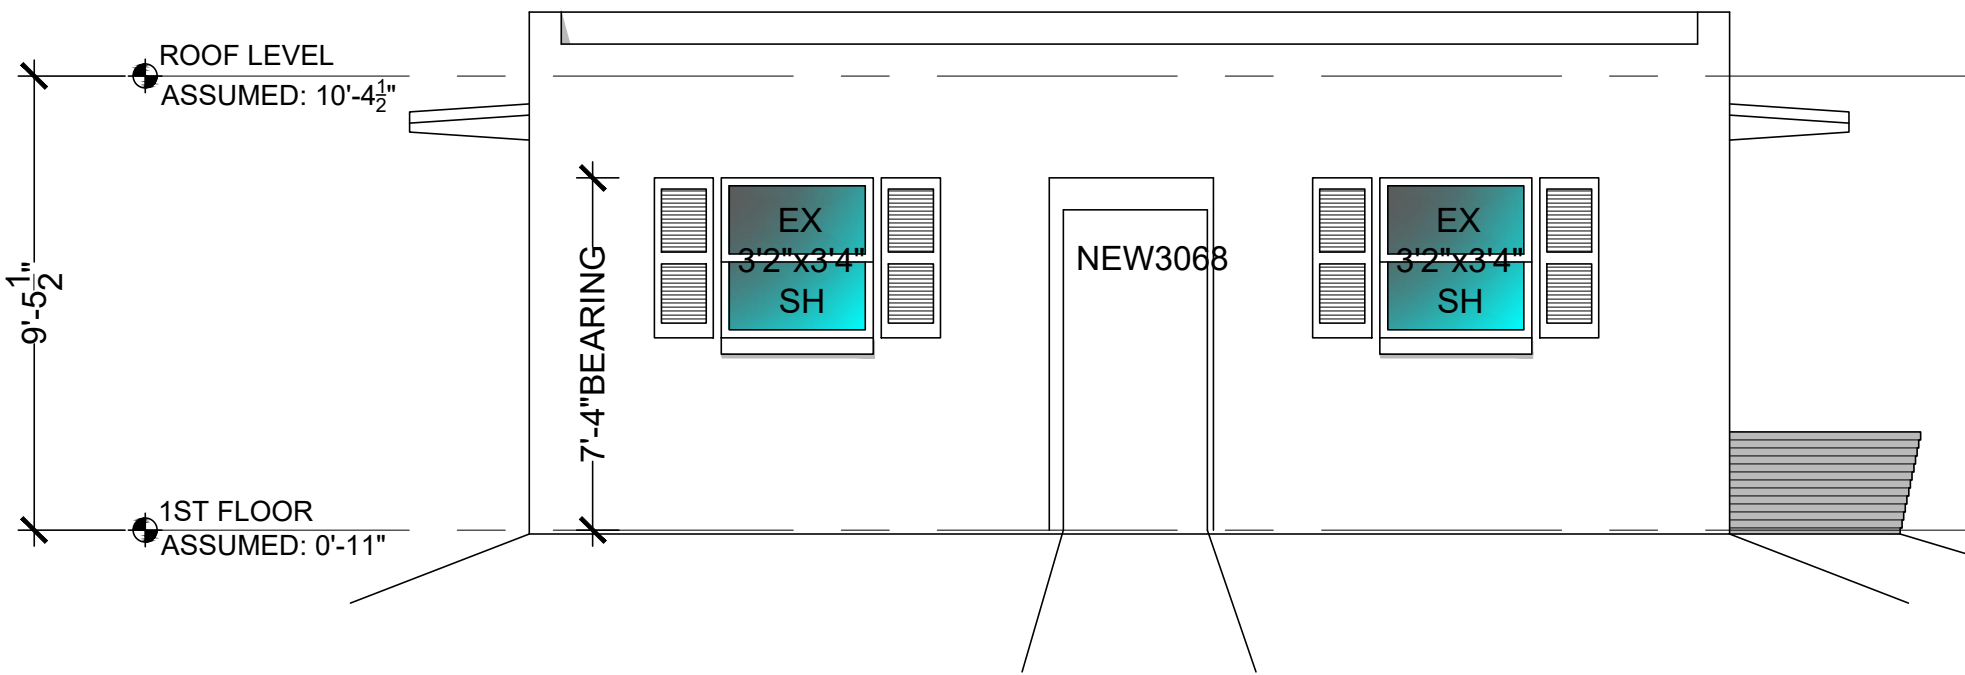

South Elevation Renovation
Scale: 1/4" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL


Contractor shall verify all
conformance to drawings
prior to starting any
work. The contractor shall
verify the specifications and
measurements are to be
conformed to by the architect
and the attention of JAE Carbon
shall be given to the
construction of any
construction of fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA


Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX.XX.XXXX	XX.XX
2		
3		
4		


SHEET CONTENTS
EXTERIOR ELEVATIONS
DRAWN BY J.A.E.
DATE 05/14/2026
SCALE 1/4"= 1'-0"
JOB
SHEET
A301
OF 26 SHEETS

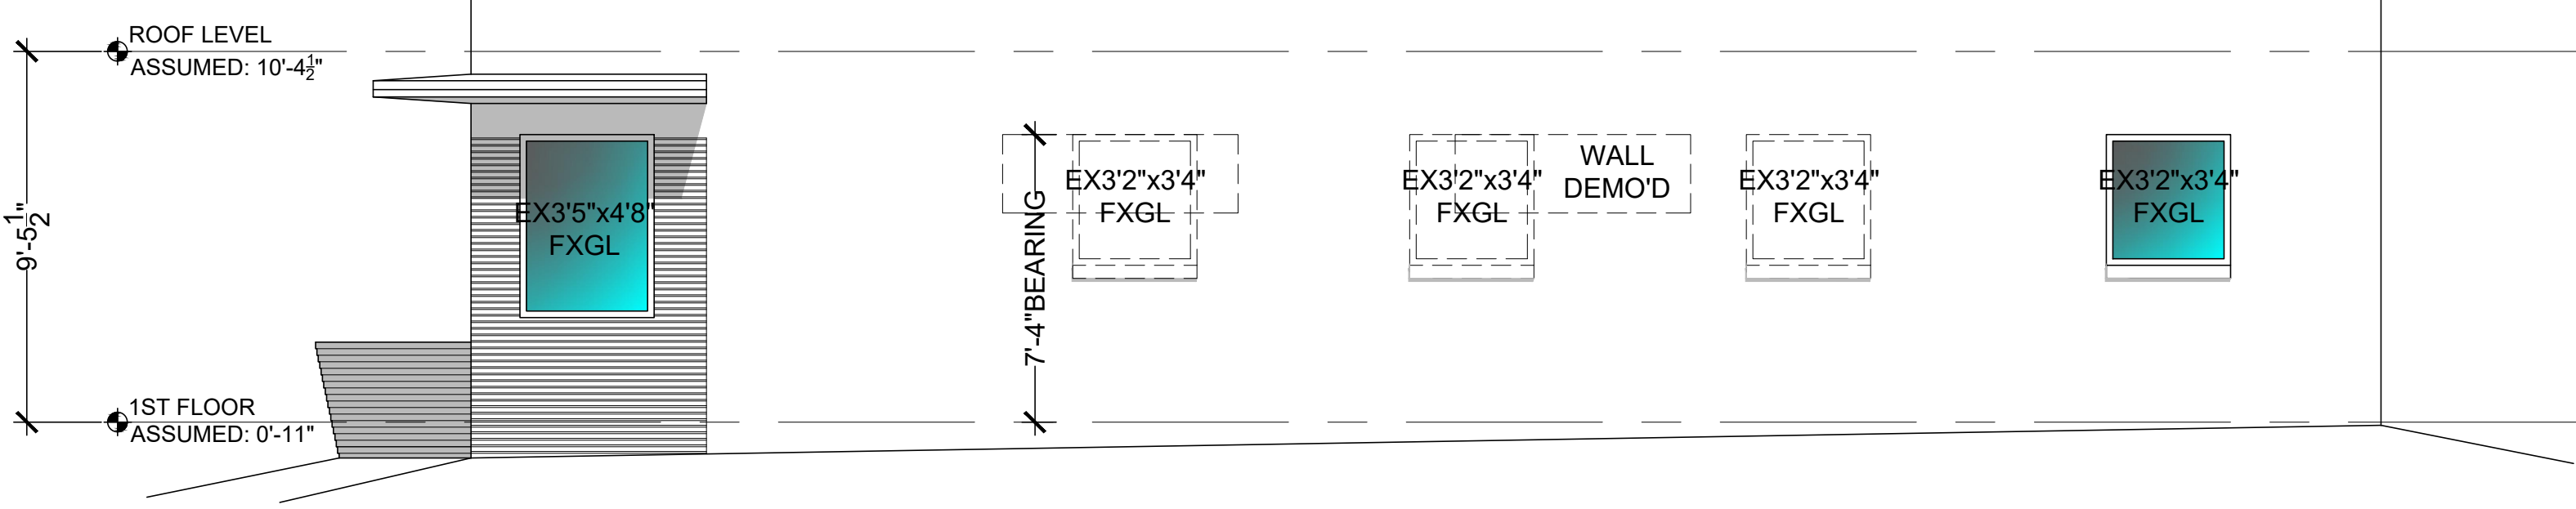


West Elevation Existing
Scale: 1/4" = 1'-0"

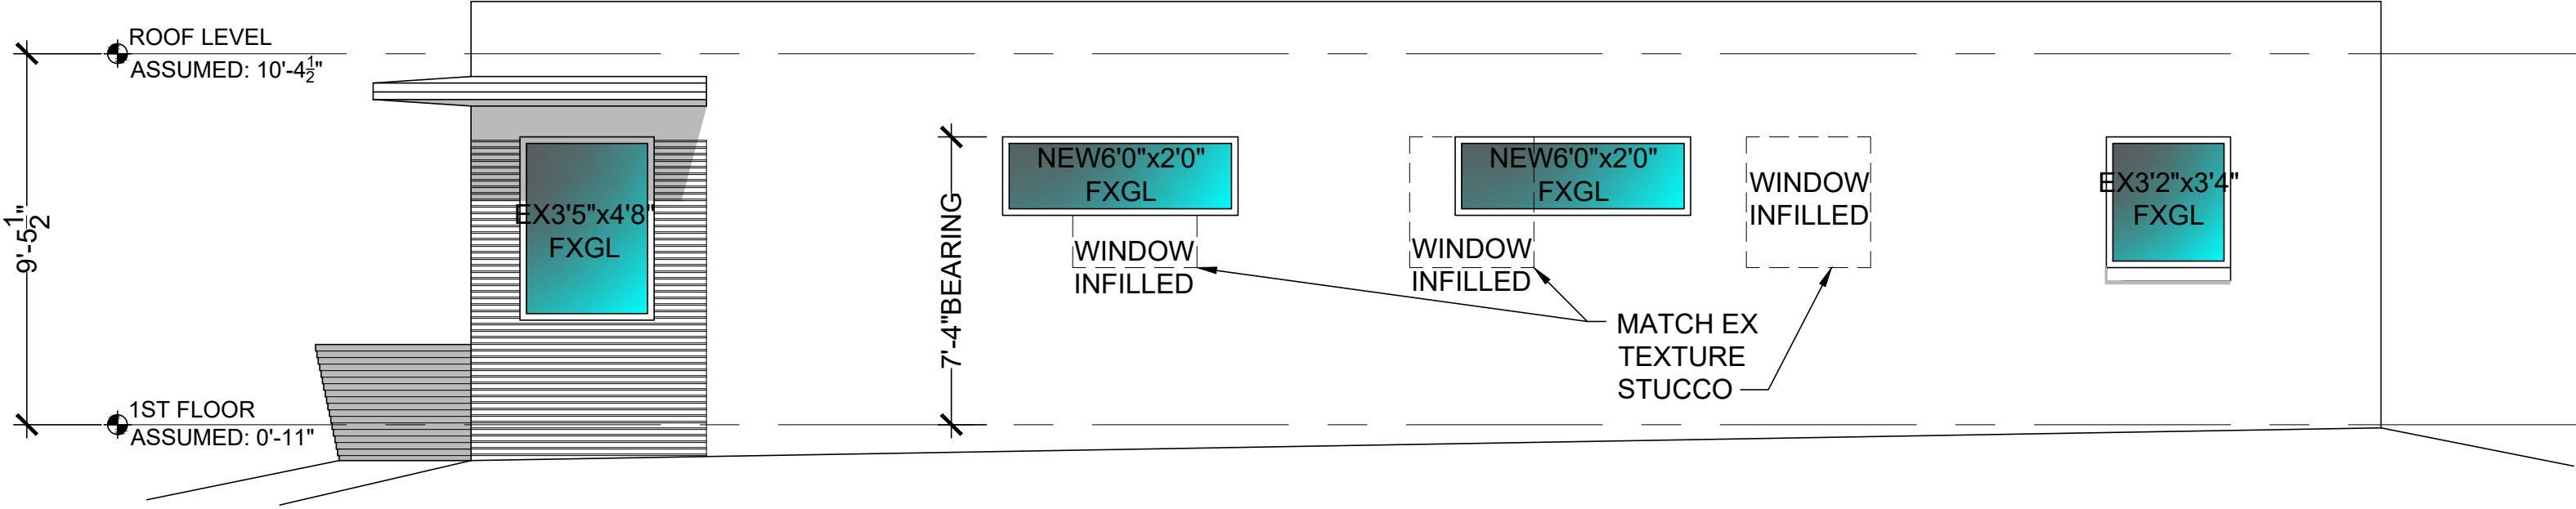

West Elevation Renovation
Scale: 1/4" = 1'-0"

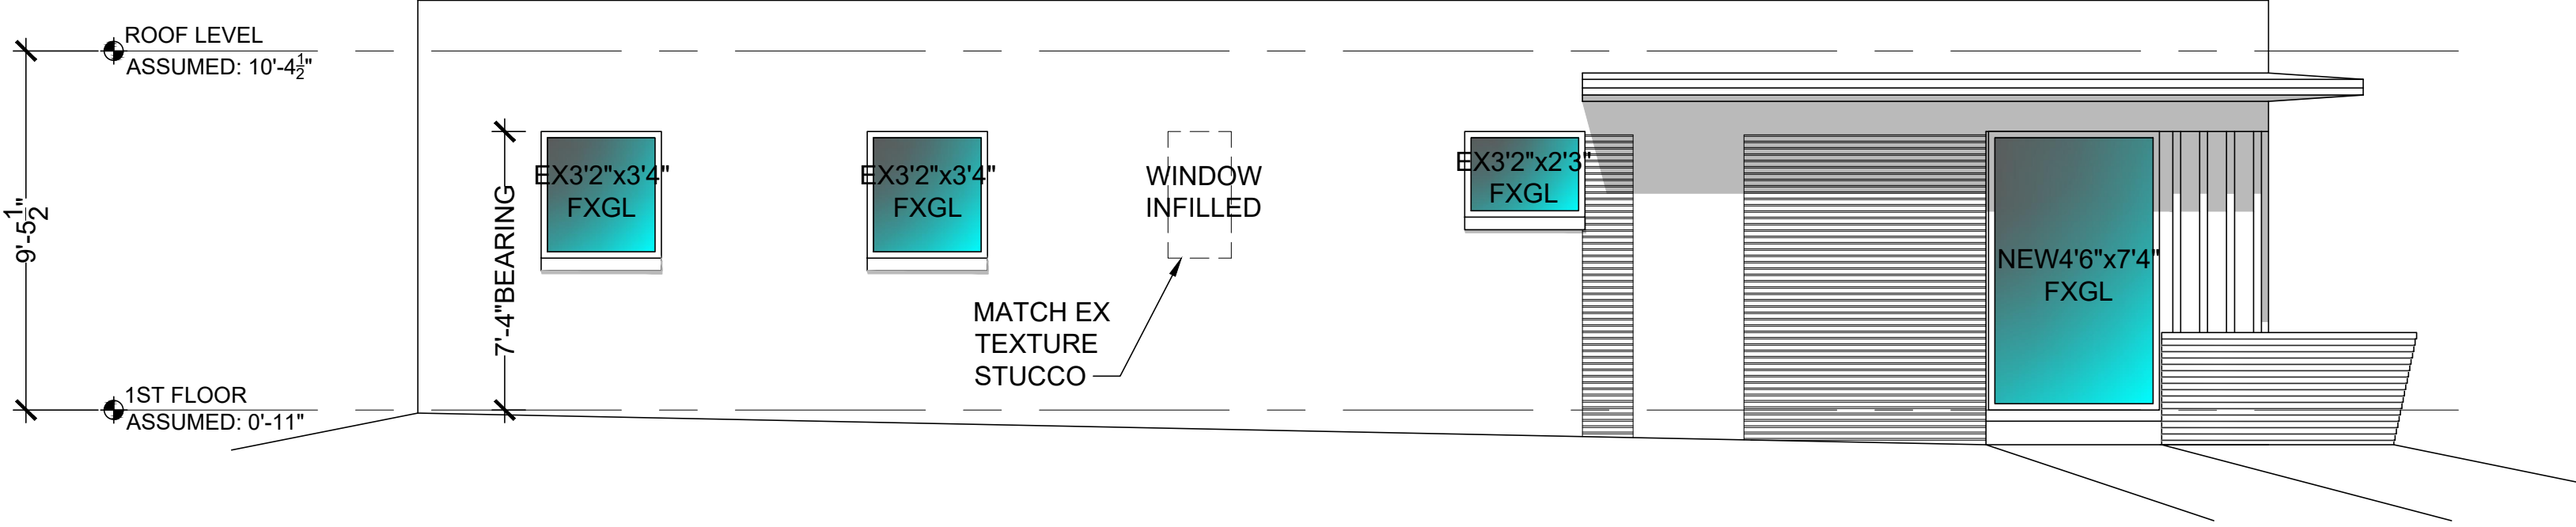

East Elevation Existing
Scale: 1/4" = 1'-0"

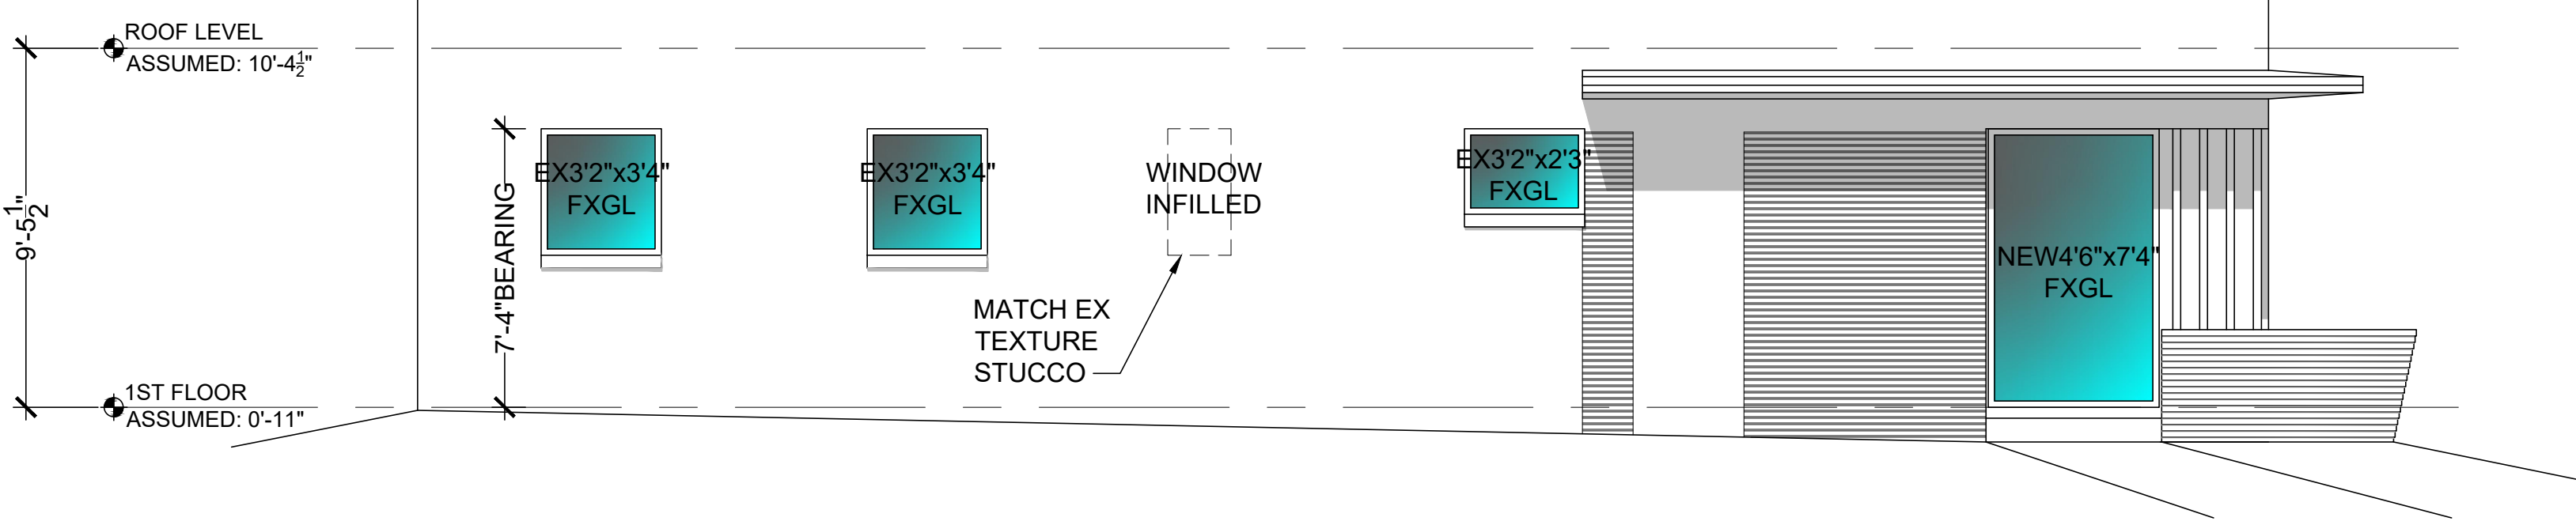

East Elevation Renovation
Scale: 1/4" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
measurements and conditions
prior to starting any
work. The contractor shall
be responsible for the accuracy
and reliability of the information
provided by the client and the
accuracy of the information
provided by the contractor. The
contractor shall be responsible
for the accuracy of the
information provided by the
contractor.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS
EXTERIOR ELEVATIONS

DRAWN BY
J.A.E.


DATE
05/14/2026

SCALE
1/4"= 1'-0"


JOB

SHEET
A302

OF 26 SHEETS

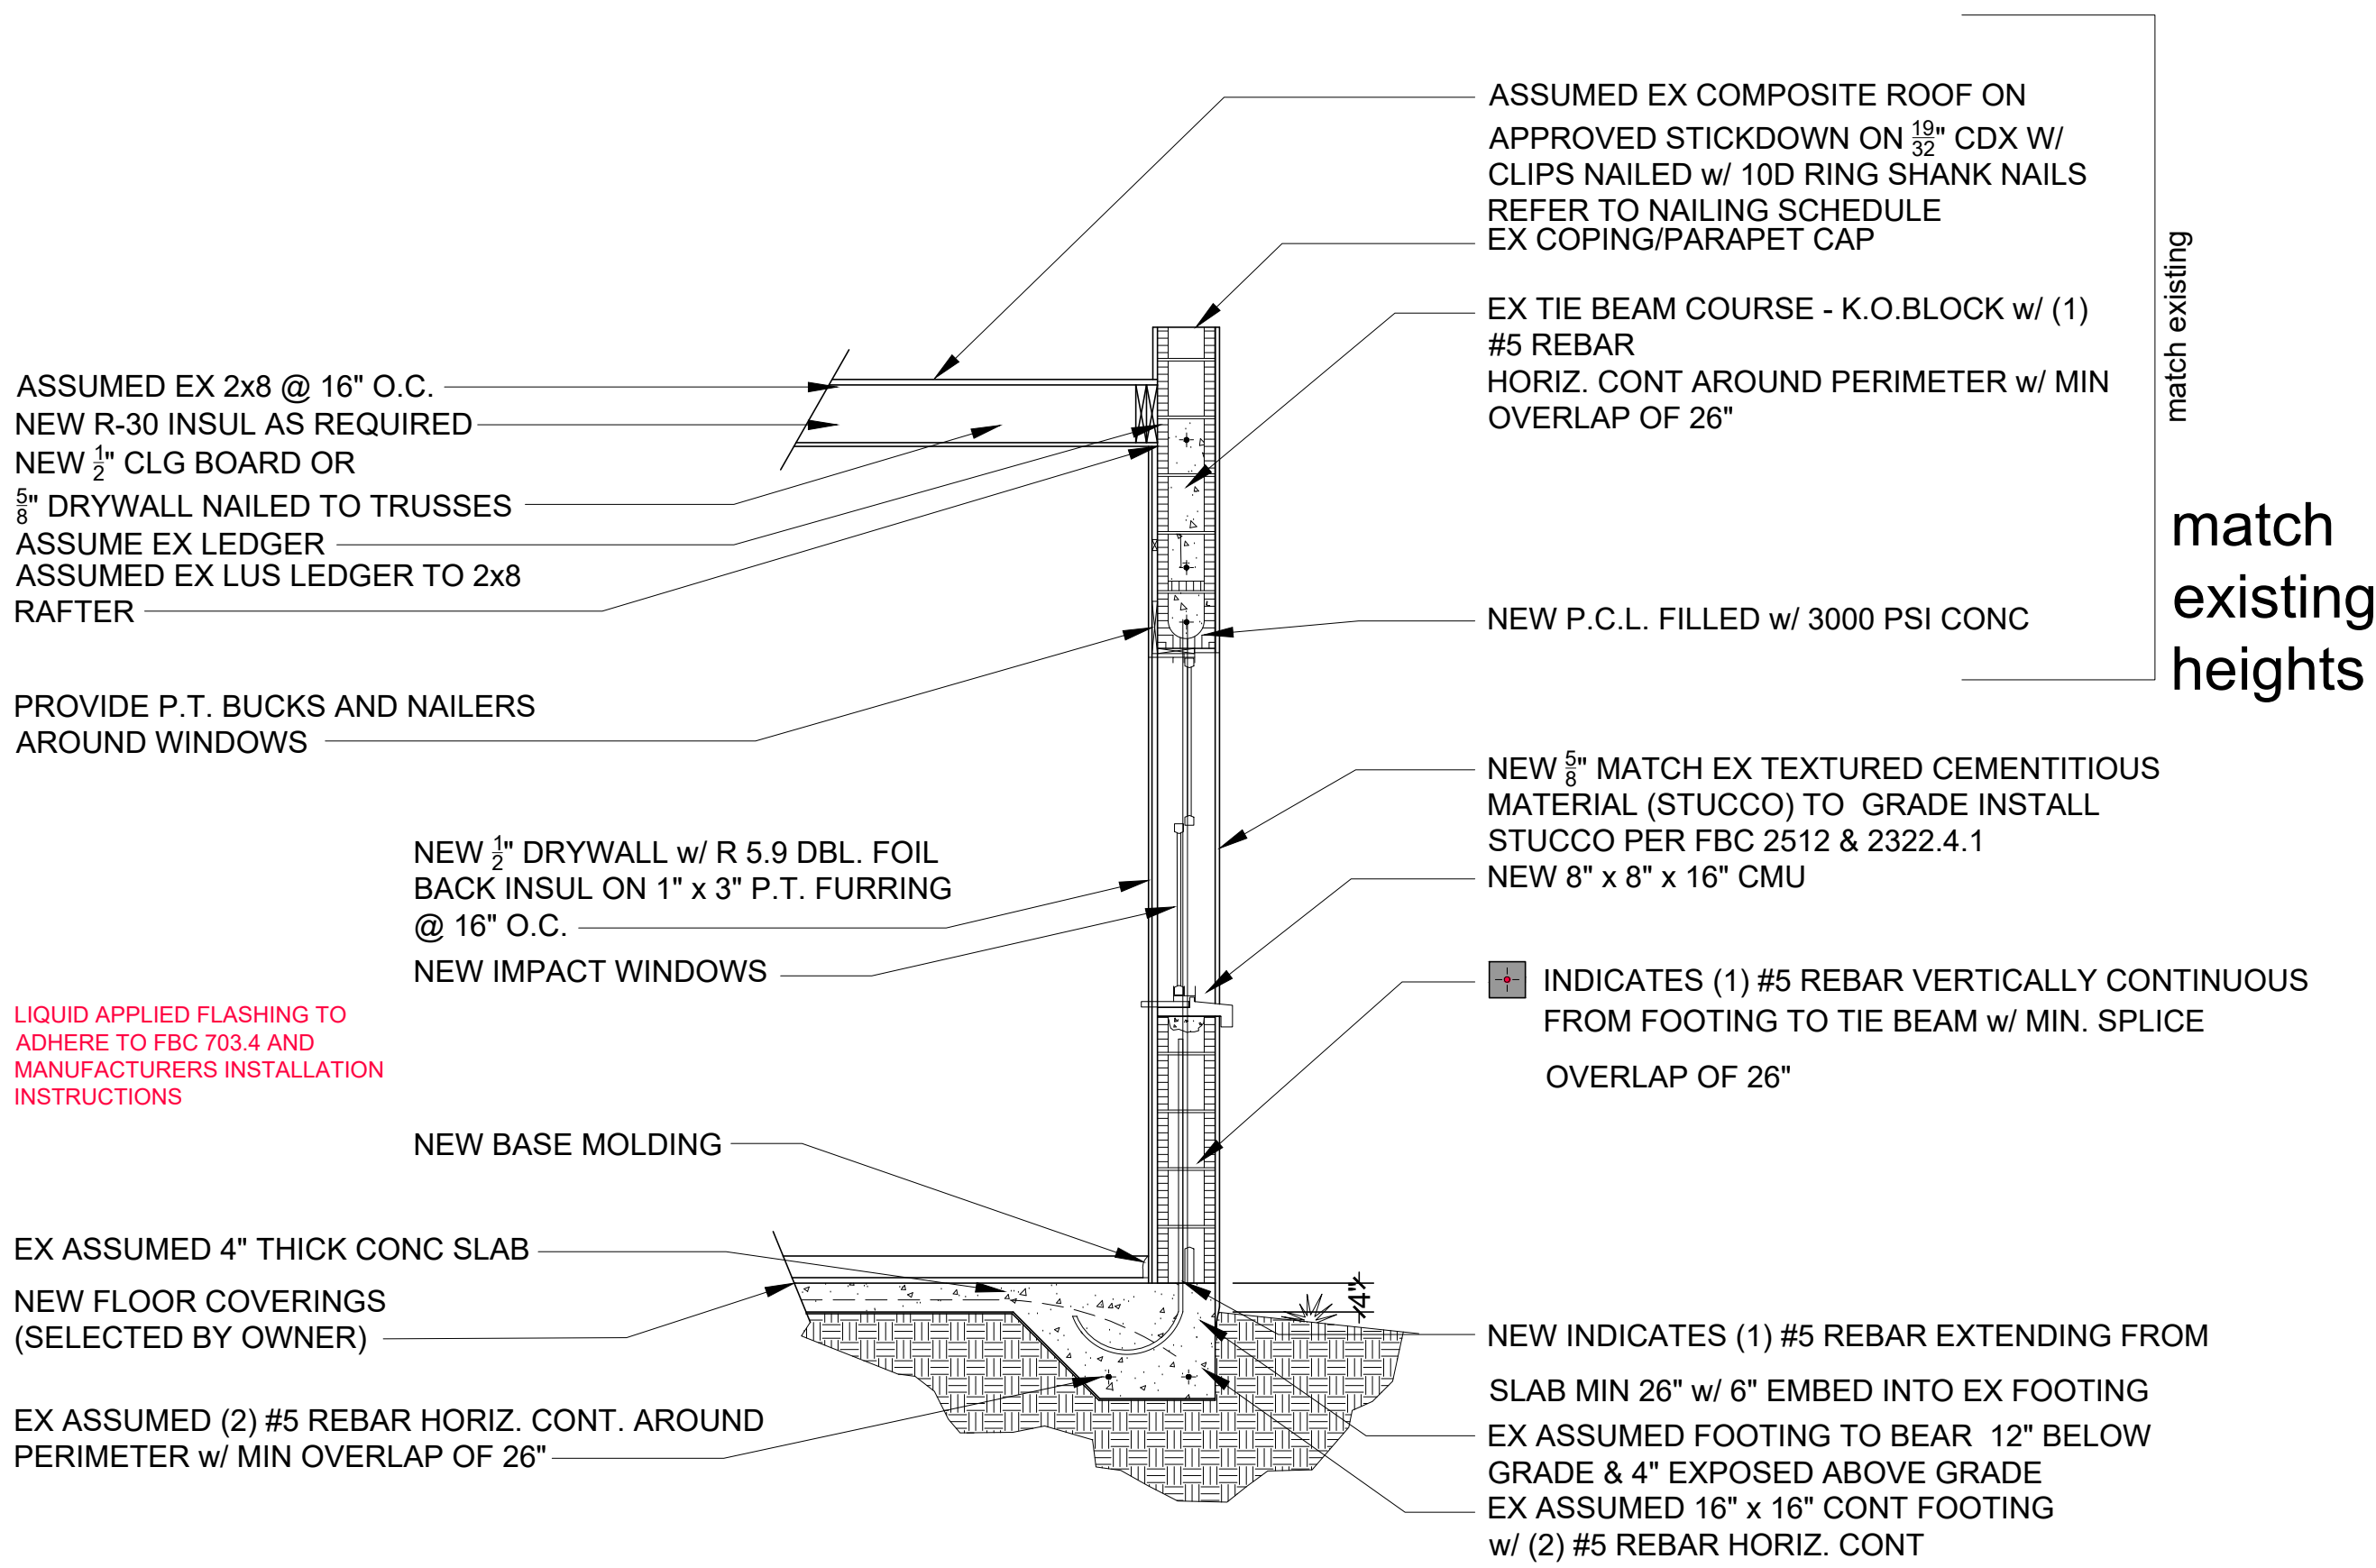

A-A Typical Wall Section
Scale: 1/2"=1'-0"

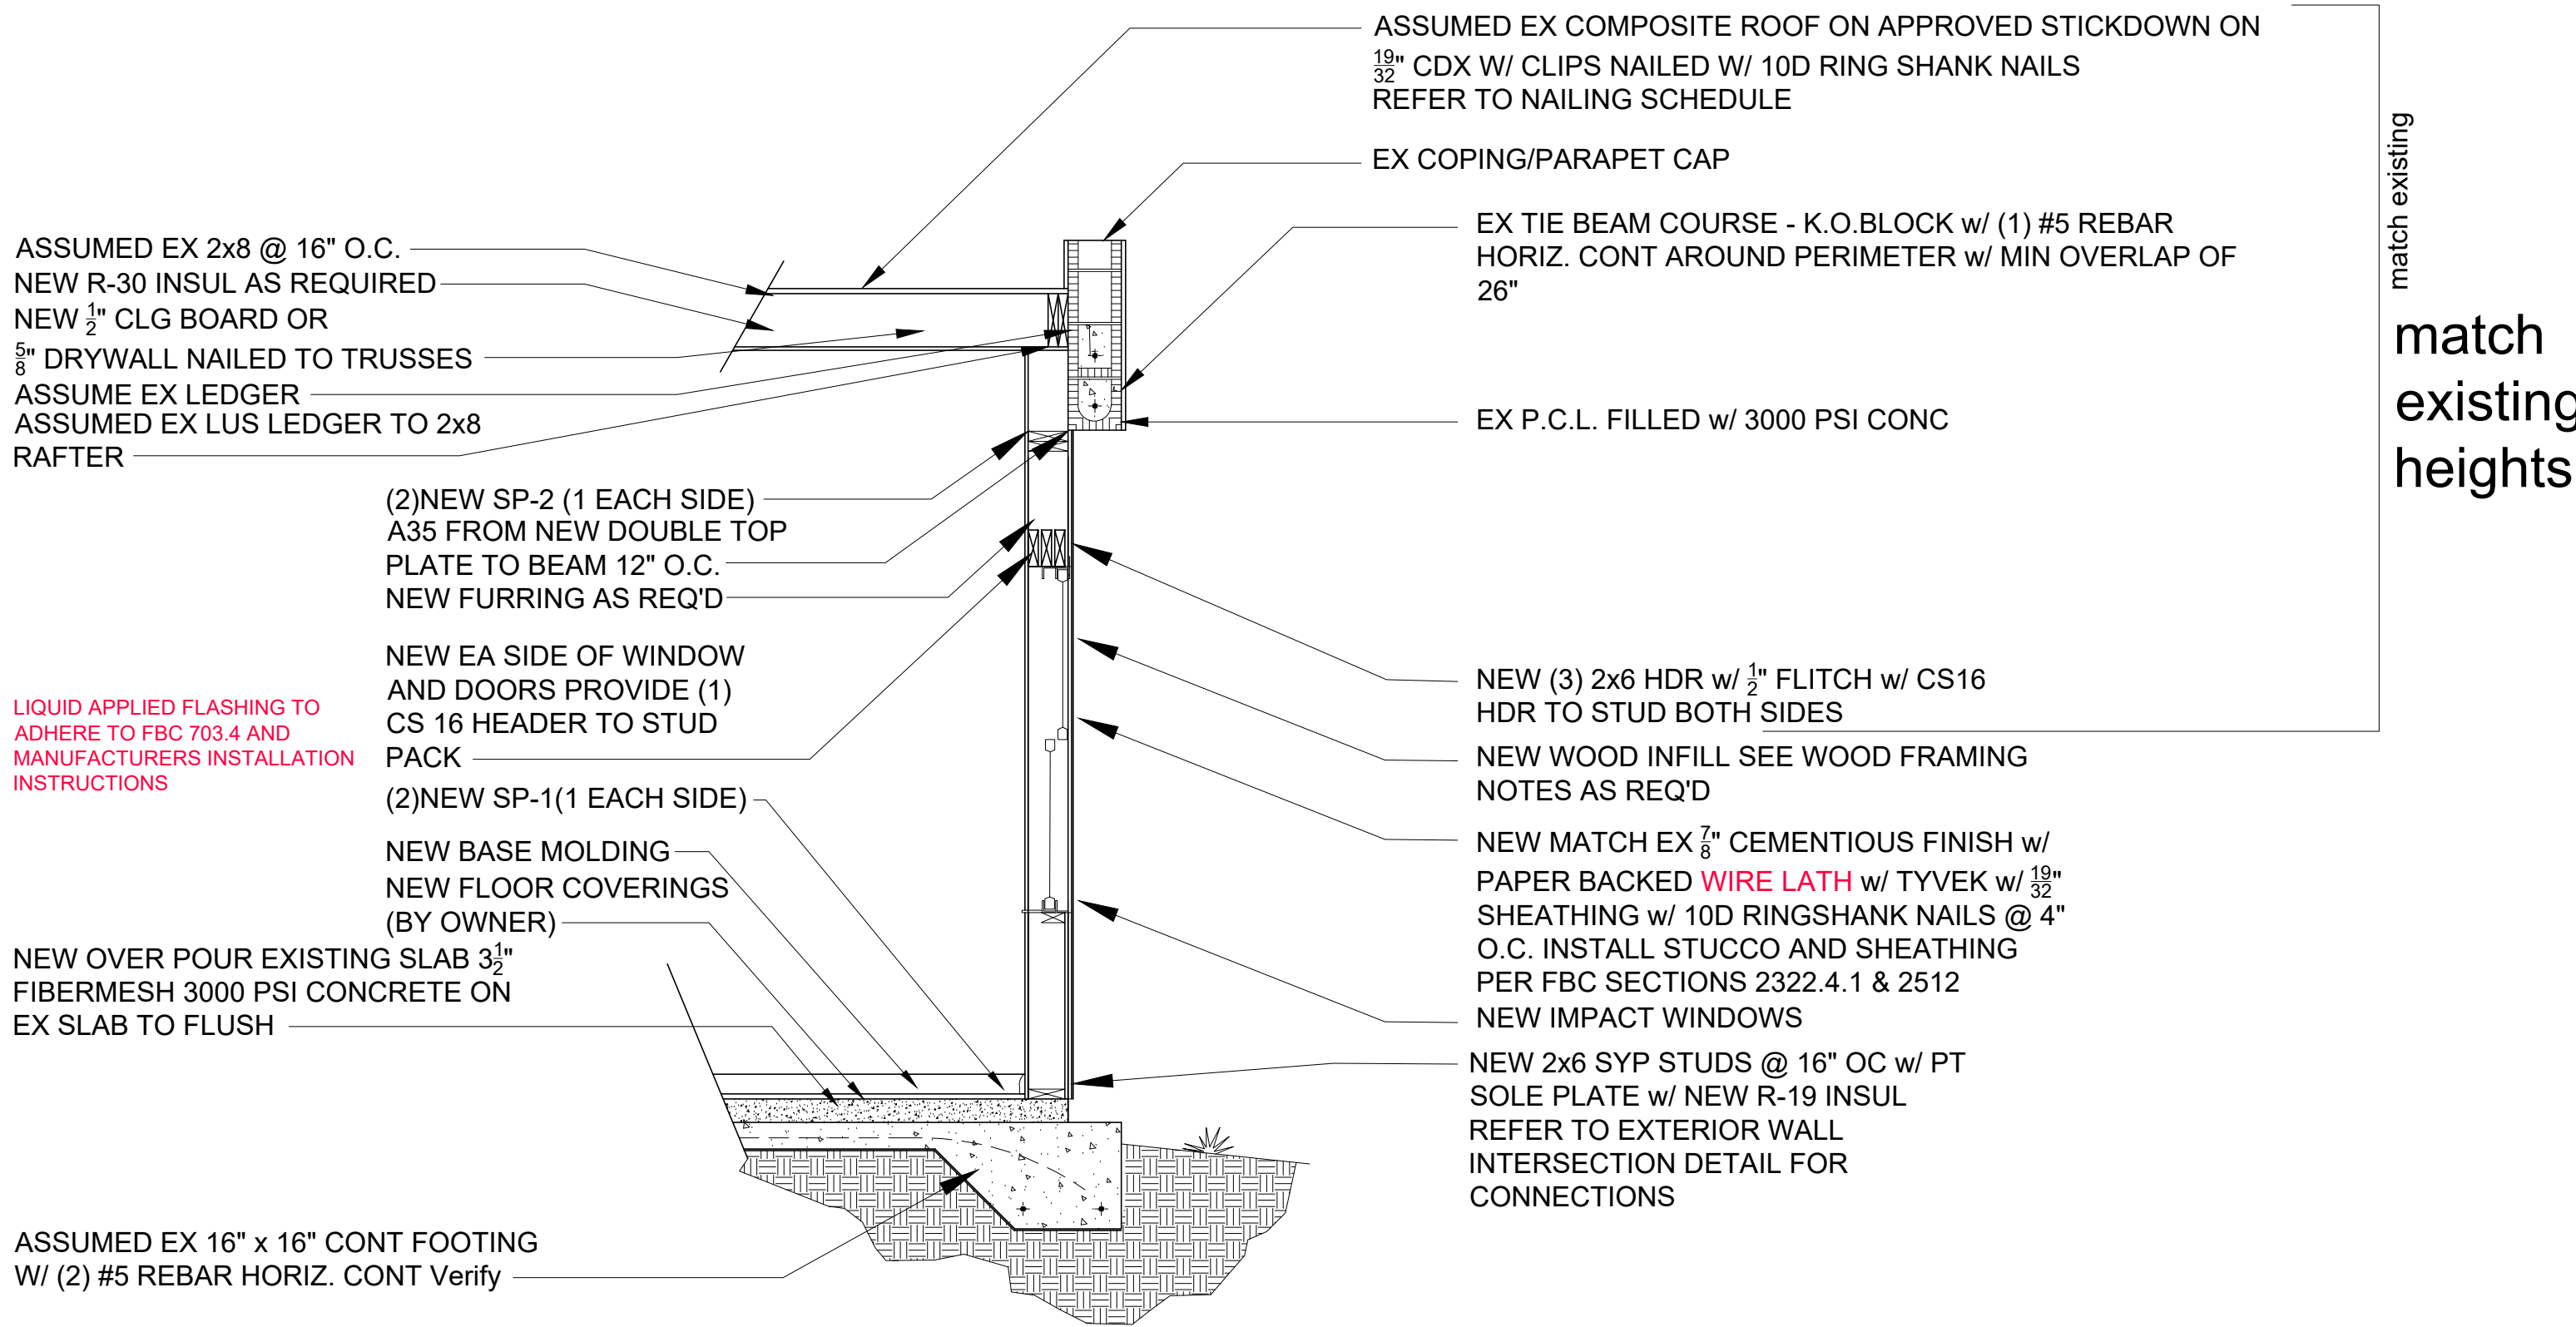

B-B Typical Wall Section
Scale: 1/2"=1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
measurements and conditions
prior to starting any
work. The contractor shall
be responsible for obtaining
all necessary permits and
compliance with all applicable
laws and regulations. The
contractor shall be responsible
for the completion of any
construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		


SHEET CONTENTS	
SECTIONS	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET A401	
OF 26 SHEETS	

R703.7
Exterior plaster (stucco). Installation of exterior plaster shall be in compliance with ASTM C926, ASTM C1063 and the provisions of this code.


R703.7.1 Lath.
Lath and lath attachments shall be of corrosion-resistant materials in accordance with ASTM C1063. Expanded metal, welded wire, or woven wire lath shall be attached to wood framing members or furring. Where the exterior plaster is serving as wall bracing in accordance with Table R602.10.4, the lath shall be attached directly to framing. The lath shall be attached with 11/2-inch-long (38 mm), 11-gage nails having a 7/16-inch (11.1 mm) head, or 7/8-inch-long (22.2 mm), 16-gage staples, spaced not more than 7 inches (178 mm) on center along framing members or furring and not more than 24 inches (610 mm) on center between framing members or furring, or as otherwise approved. Additional fastening between wood framing members shall not be prohibited. Lath attachments to cold-formed steel framing or to masonry, stone, or concrete substrates shall be in accordance with ASTM C1063. Where lath is installed directly over foam sheathing, lath connections shall also be in accordance with Section R703.15, R703.16 or R703.17. Where lath is attached to furring installed over foam sheathing, the furring connections shall be in accordance with Section R703.15, R703.16 or R703.17.

Exception: Lath is not required over masonry, cast-in-place concrete, precast concrete or stone substrates prepared in accordance with ASTM C1063.


703.7.1.1 Furring.
Where provided, furring shall consist of wood furring strips not less than 1 inch by 2 inches (25 mm by 51 mm), minimum 3/4-inch (19 mm) metal channels, or self-furring lath, and shall be installed in accordance with ASTM C1063. Furring shall be spaced not greater than 24 inches (600 mm) on center and, where installed over wood or cold-formed steel framing, shall be fastened into framing members.

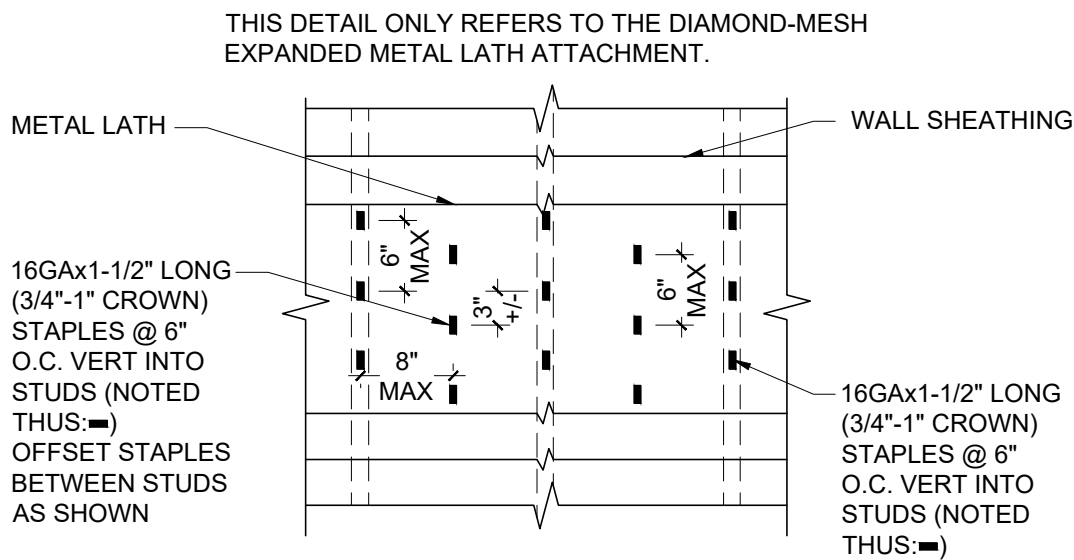

Metal Lath Attachment
Scale: 3/4"=1'-0"

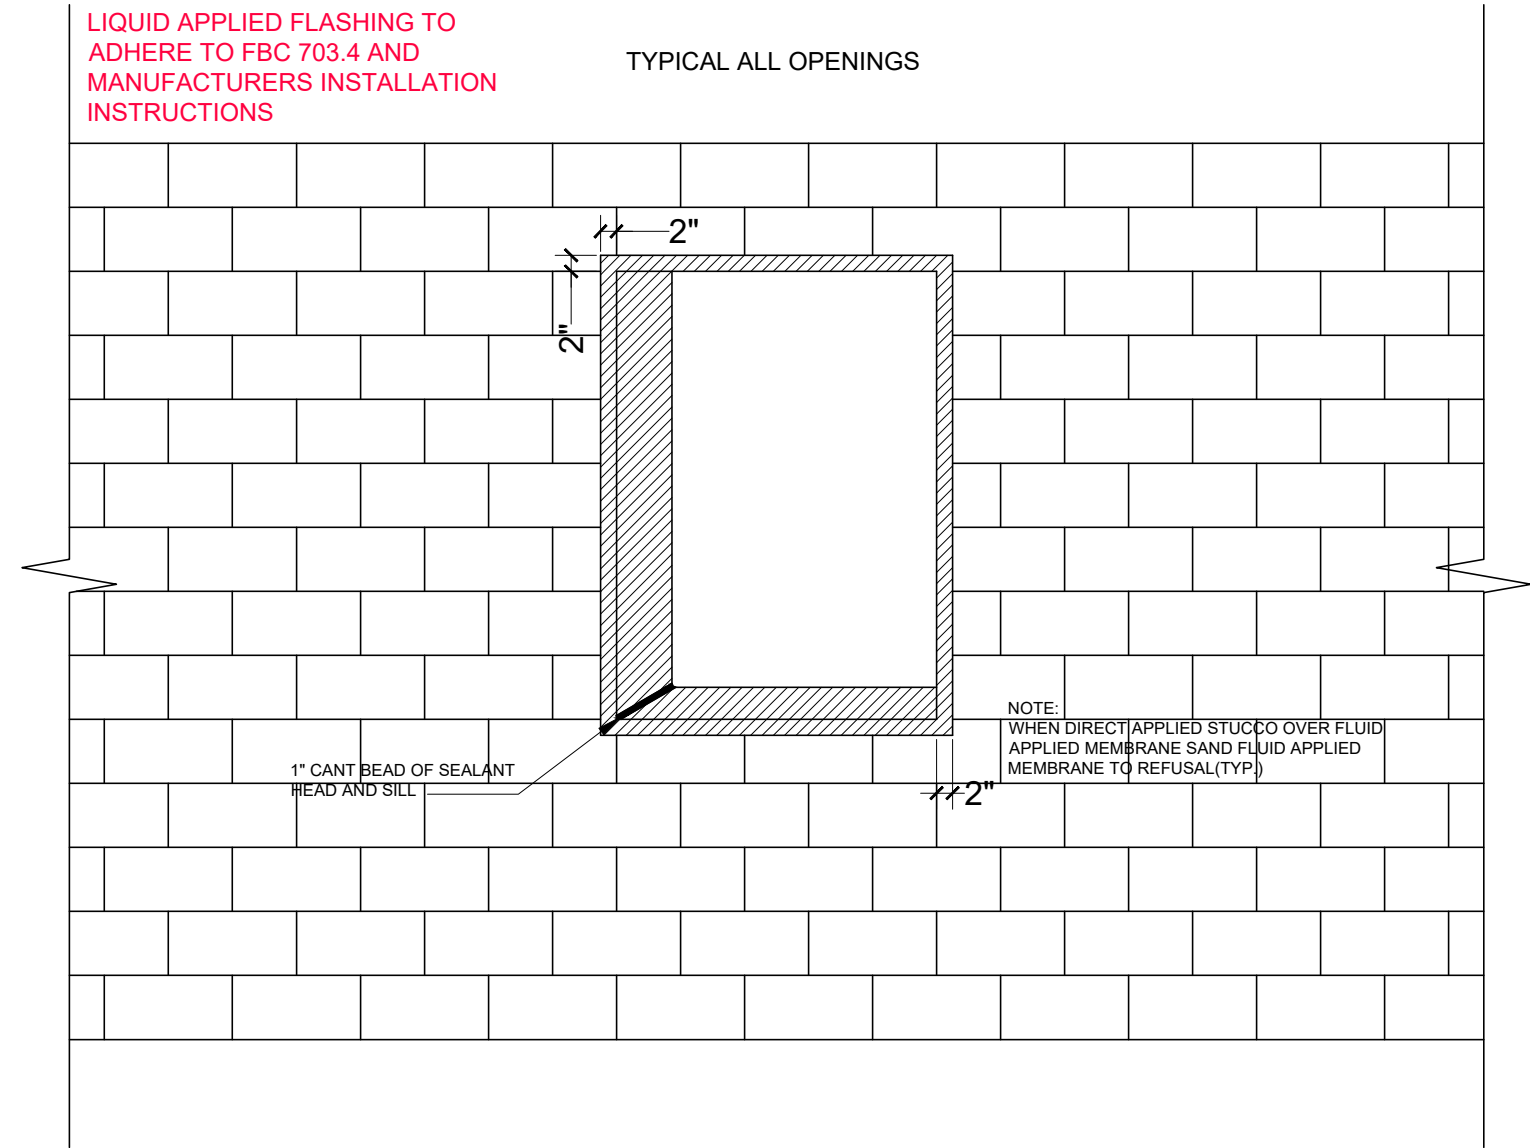

Flashing Detail - Window
Scale: 1/2"=1'-0"

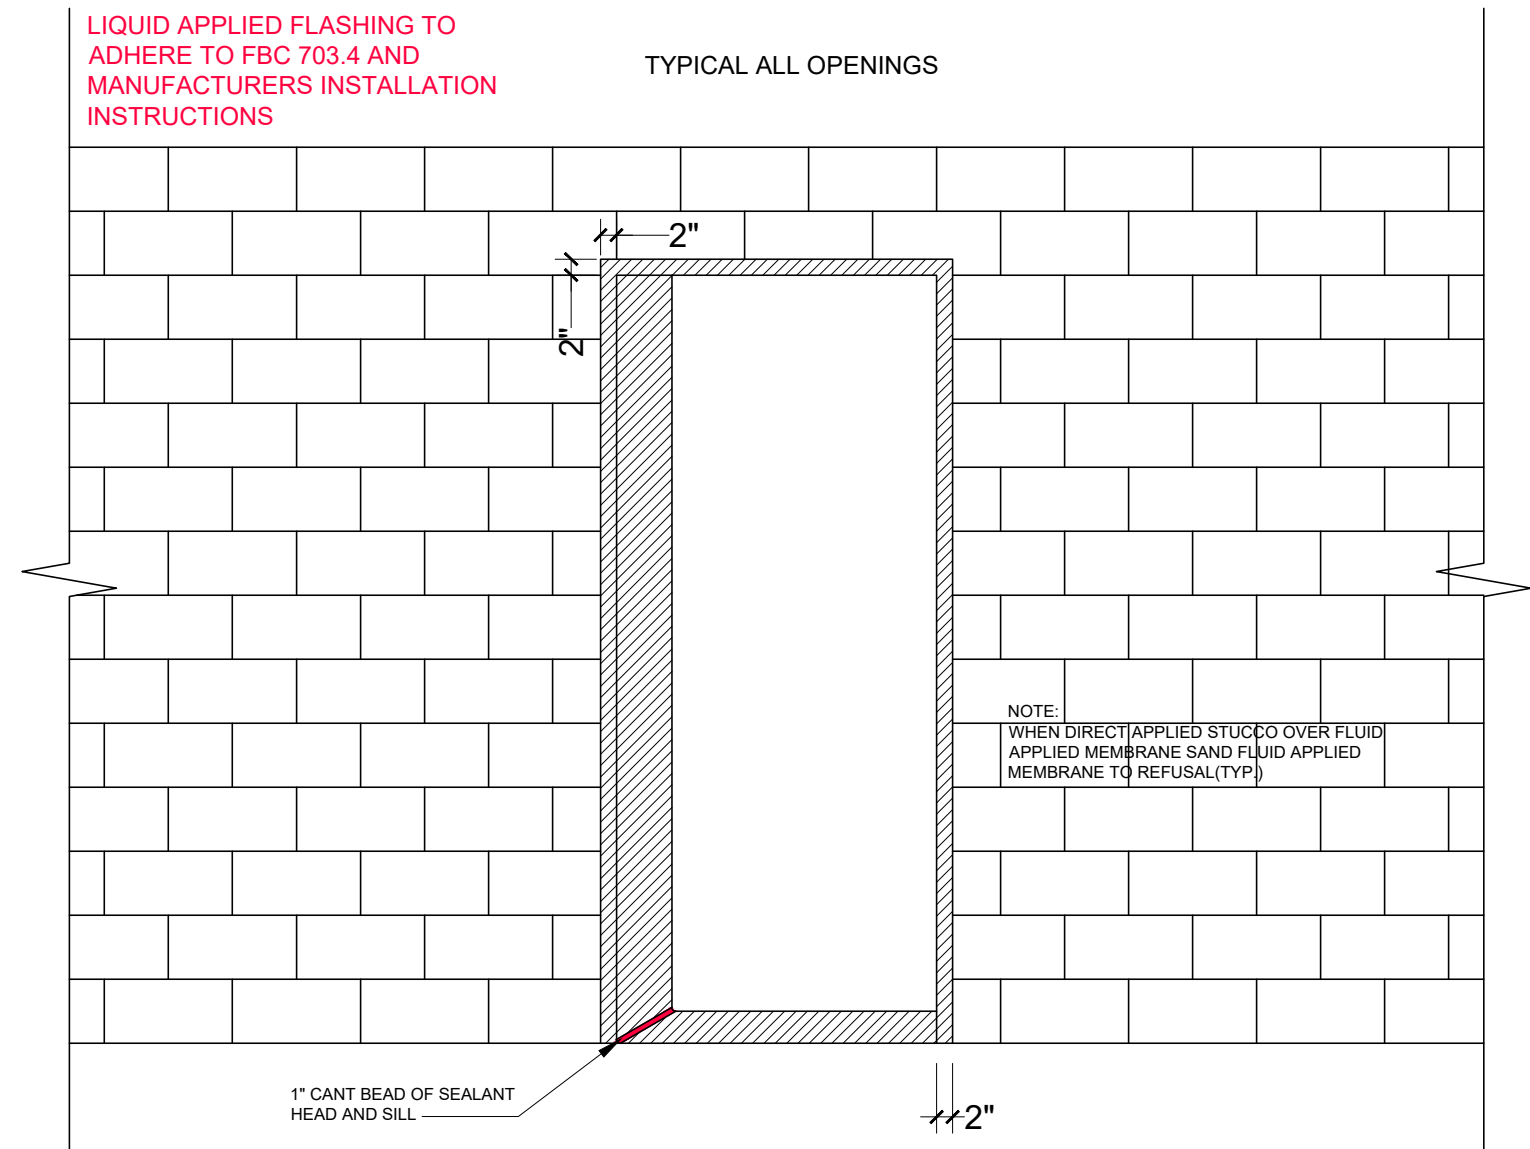

Flashing Detail - Doorway
Scale: 1/2"=1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O.Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all dimensions and materials prior to starting any work. Measurements are to be made by the contractor and any discrepancies shall be the attention of JAE. Carbon copy of this document shall be submitted at the commencement of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS
WATERPROOFING DETAILS
STUCCO DETAIL

DRAWN BY
J.A.E.

DATE
05/14/2026


SCALE
1/4"= 1'-0"

JOB


SHEET

A421

OF 26 SHEETS

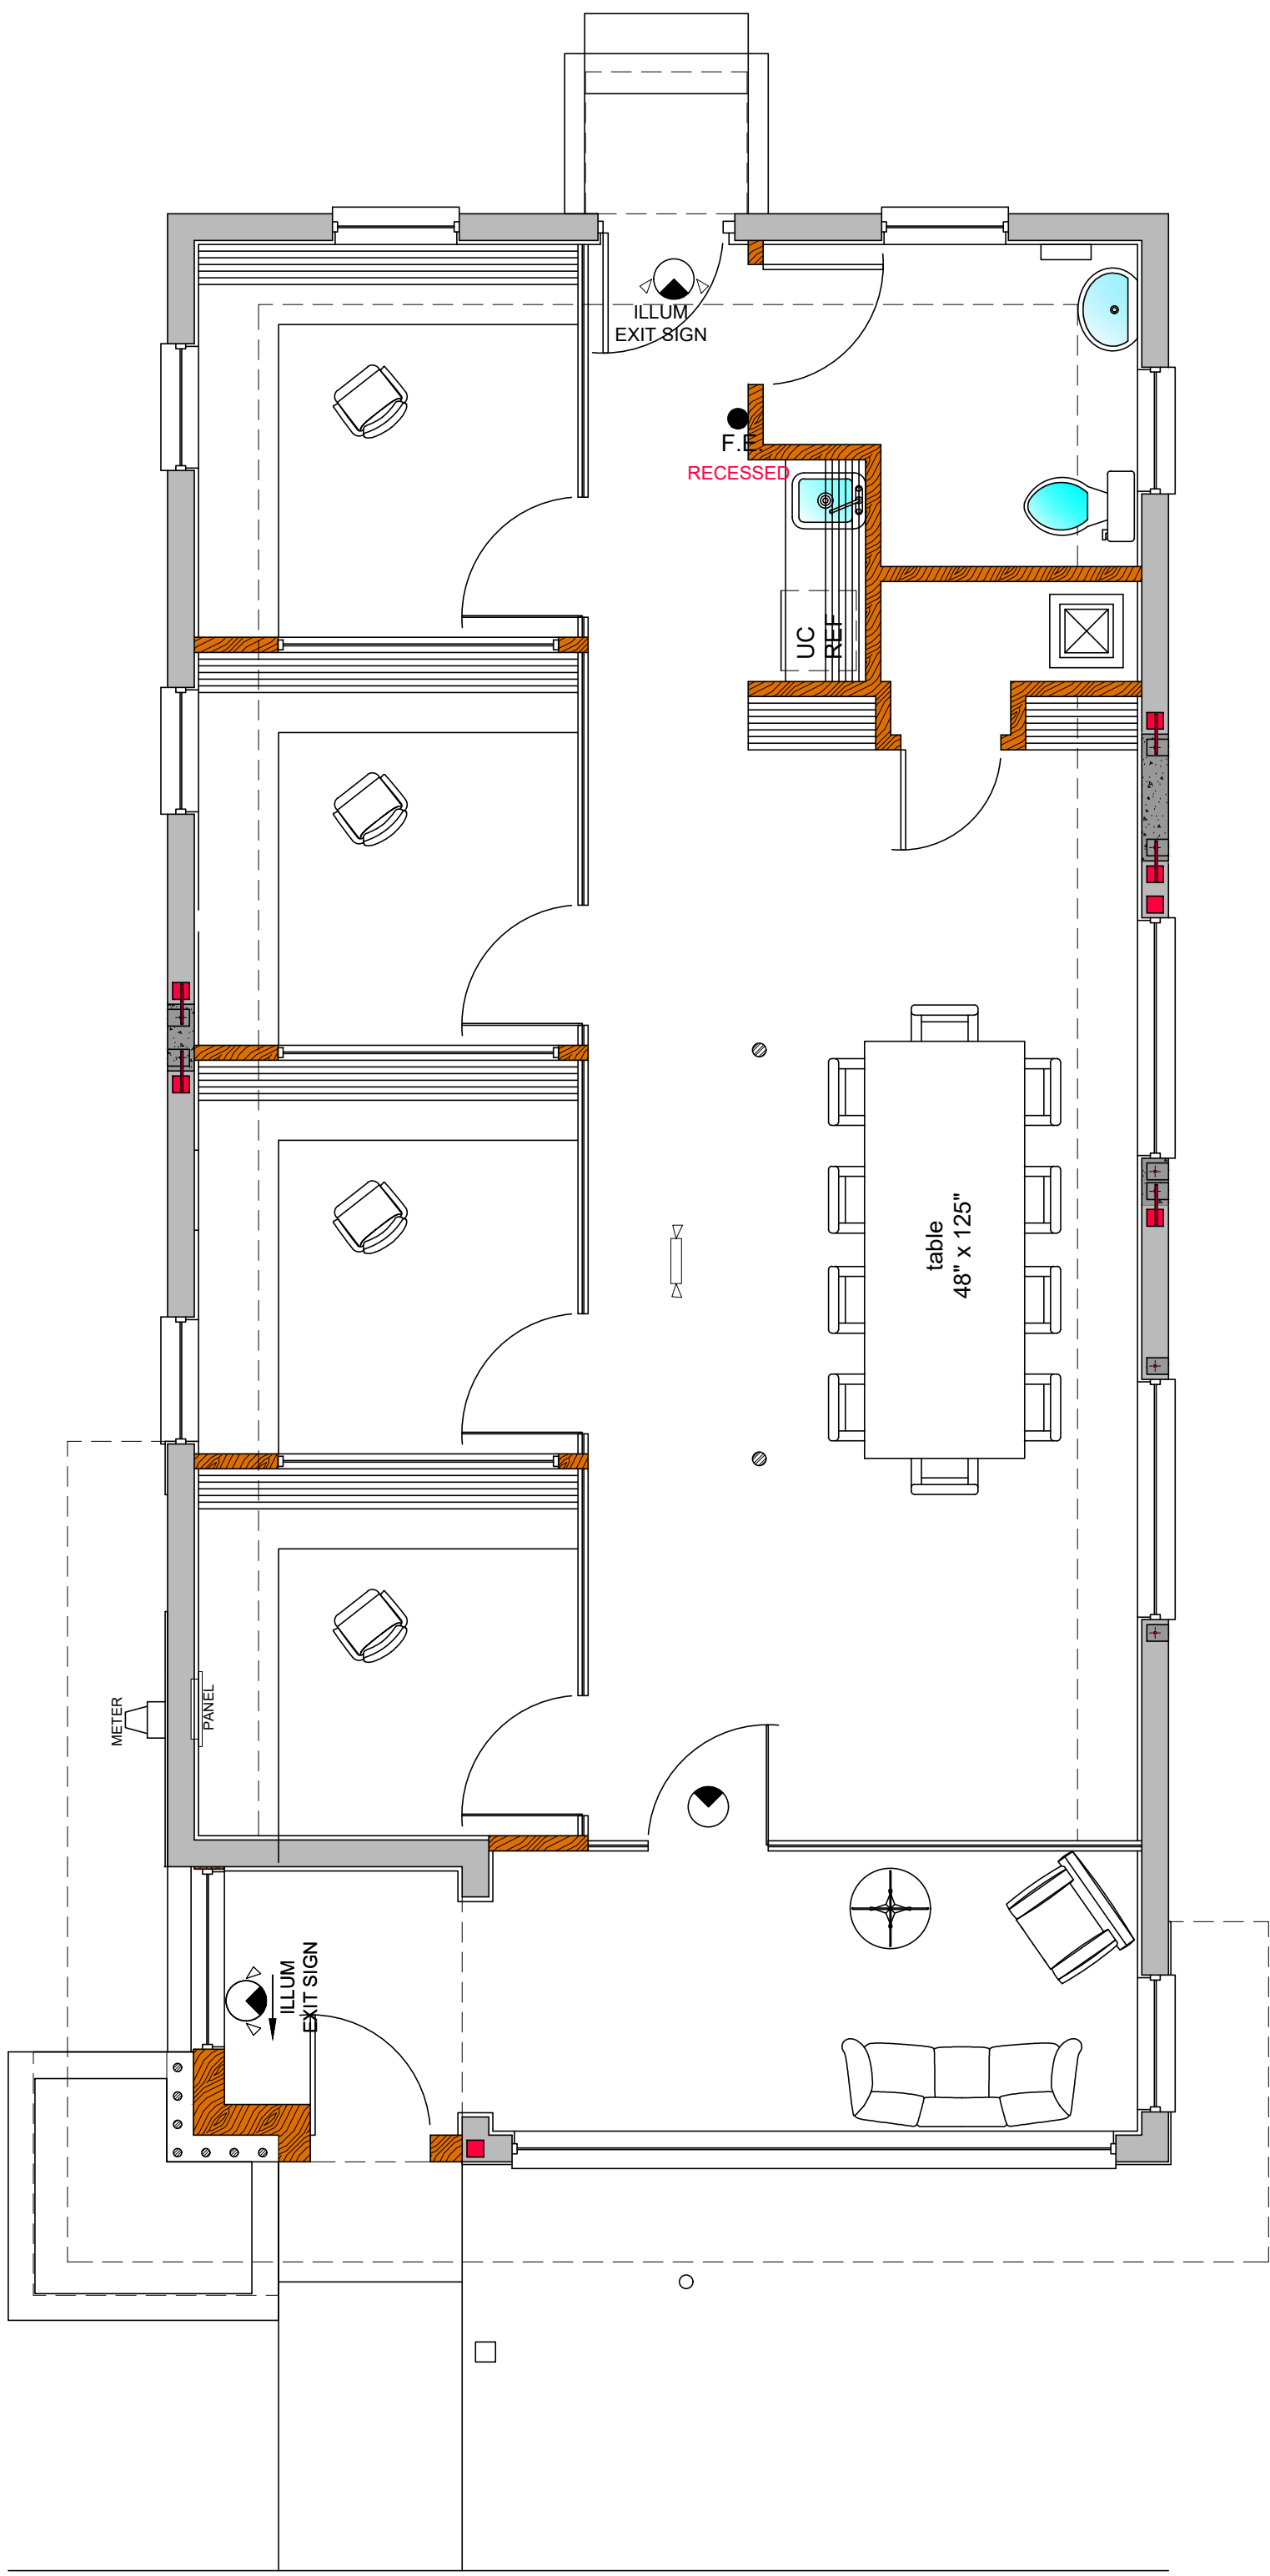

EX SIDEWALK



Furniture Floor Plan
Scale: 1/4" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all dimensions and materials prior to starting any work. All dimensions and materials shall be verified by the contractor and any discrepancies shall be the responsibility of the contractor. The attention of JAE Carbon is drawn to the fact that the contractor is responsible for the construction of any structure shown on this drawing.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
**1171 NE Cleveland St.,
Clearwater, FL
33755**

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS	
FURNITURE FLOOR PLAN	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET	
A901	
OF 26 SHEETS	

Plumbing General Notes

1.

CONTRACTOR SHALL FURNISH ALL LABOR AND MATERIALS REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM IN ACCORDANCE WITH ALL NATIONAL, STATE, AND LOCAL CODES AND HEALTH REGULATIONS HAVING JURISDICTION. CONTRACTOR SHALL PAY ALL FEES AND PERMITS REQUIRED.

2.

CONTRACTOR SHALL GUARANTEE INSTALLATION AGAINST DEFECTS IN WORKMANSHIP, EQUIPMENT, AND MATERIAL FURNISHED ON PROJECT FOR A PERIOD OF ONE YEAR FROM DATE OF FINAL ACCEPTANCE, PROVIDE EXTENDED GUARANTEES FOR EQUIPMENT SUCH AS WATER HEATERS WHEN REQUIRED.

3.

SUBMIT FOR APPROVAL THE NUMBER OF SHOP DRAWINGS AND MANUFACTURERS LITERATURE ON ALL PLUMBING FIXTURES & MATERIALS AS REQUIRED TO DESIGNER OR OWNER'S REPRESENTATIVE.

4.

CONTRACTOR SHALL VISIT THE JOB SITE AND EXAMINE PREMISES AT AND ADJACENT TO PROPOSED WORK. VERIFY EXISTING PIPE SIZES, LOCATION, AND SUITABILITY FOR CONNECTION TO THE NEW SYSTEM PRIOR TO BID.

5.

DRAWINGS ARE DIAGRAMMATIC AND INTEND TO SHOW APPROXIMATE LOCATION OF PIPING, FIXTURES, ETC. CONTRACTOR SHALL REVIEW ALL ARCHITECTURAL, CIVIL, STRUCTURAL, ELECTRICAL, AND MECHANICAL DRAWINGS AND COORDINATE WITH OTHER TRADES FOR PIPE ROUTING AND EQUIPMENT PLACEMENT. INSTALL ALL WORK WITHOUT CONFLICT WITH OTHER TRADES AND MAKE MINOR ALTERATIONS AS REQUIRED WITHOUT ADDITIONAL COST TO OWNER.

6.

CONTRACTOR SHALL COOPERATE FULLY WITH OWNER IN SCHEDULING AND MAKING CONNECTIONS TO EXISTING SERVICE LINES SO AS TO CAUSE THE LEAST POSSIBLE INCONVENIENCE AND SHORTEST POSSIBLE INTERRUPTION OF SERVICE.

7.

CONTRACTOR SHALL COORDINATE WITH ELECTRICAL CONTRACTOR ALL VOLTAGES, ELECTRICAL LOADS, ETC., OF ELECTRICALLY OPERATED EQUIPMENT PRIOR TO PURCHASING EQUIPMENT. ALL EQUIPMENT SHALL BE U.L. AND NEMA APPROVED.

8.

MAINTAIN A MINIMUM CLEARANCE OF 3'-0" IN FRONT OF ALL ELECTRICAL PANELS AND 1'-0" EITHER SIDE OF PANEL TO STRUCTURE. ALL PIPING SHALL BE ROUTED AROUND THIS AREA.

9.

CONTRACTOR SHALL FURNISH ACCESS PANELS, TO BE INSTALLED BY THE GENERAL CONTRACTOR, AS REQUIRED FOR PLUMBING INSTALLATIONS.

10.

ALL SANITARY VENT ROOF PENETRATIONS SHALL BE A MINIMUM DISTANCE OF 10'-0" AWAY FROM ALL ROOFTOP MECHANICAL EQUIPMENT OR OTHER AIR INTAKE DEVICES.

11.

ALL HORIZONTAL AND VERTICAL PIPING SHALL BE SUPPORTED IN ACCORDANCE WITH STATE AND LOCAL REQUIREMENTS. SUPPORTS SHALL SECURELY HOLD PIPING, PREVENT VIBRATION, COMPENSATE FOR STATIC AND OPERATIONAL CONDITIONS OF THE VARIOUS SYSTEMS, AND SHALL NOT BE SUBJECT TO ELECTROLYTIC ACTION.

12.

CONTRACTOR TO COORDINATE AND INSTALL, IF REQUIRED FOR THIS PROJECT, NEW WATER METER AS PER REQUIREMENTS OF LOCAL UTILITY COMPANY. CONTRACTOR SHALL INCLUDE ALL TAP FEES AND COSTS INTO BID FOR A COMPLETE INSTALLATION.

13.

DOMESTIC WATER PIPING OUTSIDE OF THE BUILDING BURIED BELOW GRADE SHALL BE TYPE "K" SOFT COPPER. WATER PIPING PASSING THROUGH OR UNDER FOOTINGS OR FOUNDATION WALLS SHALL BE SLEEVED OR OTHERWISE PROTECTED. COPPER PIPING PASSING UNDER AND THROUGH CONCRETE SLAB SHALL BE PROTECTED BY A PROTECTIVE SHEATHING OR WRAPPING TO PREVENT CORROSION TO THE COPPER PIPING.

14.

ALL DOMESTIC HOT WATER AND COLD WATER PIPING ABOVE SLAB SHALL BE TYPE "L" HARD COPPER WITH WROUGHT COPPER FITTINGS USING "NO-LEAD" SOLDER. DOMESTIC WATER PIPING BELOW CONCRETE SLAB SHALL BE TYPE "K" SOFT COPPER. NO SOLDER JOINTS ARE ALLOWED BELOW CONCRETE SLAB. COPPER PIPING PASSING UNDER AND THROUGH CONCRETE SLAB OR WALLS SHALL BE PROTECTED WITH A PROTECTIVE SHEATHING OR WRAPPING TO PREVENT CORROSION TO THE COPPER PIPING.

15.

VALVES SERVING DOMESTIC WATER SYSTEMS SHALL BE BALL VALVES OR APPROVED EQUAL. ALL VALVES SHALL BE LOCATED SO AS TO BE ACCESSIBLE BY MAINTENANCE PERSONNEL.

16.

PROVIDE 1" THICK FIBERGLASS PIPE INSULATION WITH SERVICE JACKET ON ALL DOMESTIC WATER PIPING. DOMESTIC COLD WATER PIPE INSULATION SHALL HAVE A CONTINUOUS VAPOR BARRIER.

17.

ALL WATER PIPING SHOWN ROUTED IN EXTERIOR WALLS SHALL BE LOCATED INSIDE THE BUILDING INSULATION AND FINISHED WALL TO PREVENT FREEZE DAMAGE.

18.

CONTRACTOR SHALL FIELD VERIFY THE LOCATION AND INVERT AT THE POINT OF CONNECTION TO THE SEWER SYSTEM BEFORE DETERMINING FINAL ROUTING OF SOIL, WASTE AND VENT PIPING.

19.

ALL SOIL, WASTE AND VENT PIPING SHALL BE SERVICE WEIGHT CAST IRON OR SCHEDULE 40 PVC DWV PLASTIC PIPE WHERE ALLOWED BY LOCAL AUTHORITY HAVING JURISDICTION FOR THIS INSTALLATION. PROVIDE 3M FIRE BARRIER CAULK CP-25 CAULKING, OR U.L. APPROVED EQUAL, AT ANY PENETRATION OF FIRE RATED ASSEMBLIES.

20.

ALL SOIL, WASTE AND VENT PIPING SHALL BE UNIFORMLY GRADED AND SHALL HAVE A SLOPE OF NOT LESS THAN 1/4" PER FOOT FOR PIPING 3" IN DIAMETER AND SMALLER AND 1/8" PER FOOT FOR PIPE LARGER THAN 3" IN DIA.

21.

ALL GAS PIPING SHALL BE SCHEDULE 40 BLACK STEEL PIPE, ASTM A53. FITTINGS SHALL BE STANDARD WEIGHT MALLEABLE IRON WITH THREADED FITTINGS. FITTINGS SHALL BE SEALED WITH APPROVED THREAD COMPOUND.

22.

COMPRESSED AIR PIPING SHALL BE TYPE "L" HARD COPPER CONFORMING TO ASTM B88 WITH WROUGHT COPPER FITTINGS CONFORMING TO ASME B16.22/MSS SP-73. JOINTS SHALL BE BRAZED WITH A FILLER METAL CONFORMING TO AWS A5.8. AN APPROVED FLUX SHALL BE APPLIED AS REQUIRED

MARK ACCIANI

FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
conformance to drawings
prior to starting any
work. Any discrepancies
and measurements are to be
verified by the contractor and
any discrepancies noted
the attention of JAE Carbon
prior to commencement of any
construction or fabrication.

TRUE

BUILDING, INC.

CLEARWATER, FLORIDA

Project Title:
A Remodel For:

1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS

FOUNDATION NOTES
FOUNDATION PLAN
TERMITE SPECIFICATIONS

DRAWN BY
J.A.E.

DATE
05/14/2026

SCALE
1/4"= 1'-0"

JOB

SHEET

P000

OF 26 SHEETS



SIGNATURE & SEAL

Contractor shall verify all field conditions for conformance to drawings prior to starting any construction. All measurements are to be verified by the contractor and any discrepancies brought to the attention of JAE Carbon and Engineer prior to commencement of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
**1171 NE Cleveland St,
Clearwater, FL
33755**

REV	DATE	DESCRIPTION
1	xxxx-xxxx	XX-XX
2		
3		
4		

SHEET CONTENTS	
PLUMBING PLAN	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4" = 1'-0"	
JOB	
SHEET	
P101	
OF 26 SHEETS	

GENERAL NOTES

A. GENERAL:

- 1.ALL CONSTRUCTION SHALL CONFORM TO THE 2023 FLORIDA BUILDING CODE UNLESS MORE STRINGENT REQUIREMENTS ARE REQUIRED IN THE PLANS AND SPECIFICATIONS
- 2.THE CONTRACTOR SHALL VERIFY IN THE FIELD ALL CONDITIONS, ELEVATIONS AND DIMENSIONS BEFORE STARTING WORK. THE ARCHITECT AND STRUCTURAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY IF ANY DISCREPANCIES ARE FOUND.
- 3.THE CONTRACTOR SHALL INFORM THE ENGINEER IN WRITING OF ANY DISCREPANCIES OR OMISSIONS IN THE DRAWINGS OR IN THE SPECIFICATIONS OR OF ANY VARIATIONS NEEDED IN ORDER TO CONFORM TO CODES, RULES AND REGULATIONS. UPON RECEIPT OF SUCH INFORMATION, THE ENGINEER WILL SEND WRITTEN INSTRUCTIONS TO ALL CONCERNED, AND WORK SHALL BE PERFORMED IN A MANNER AS DIRECTED BY THE ENGINEER. ANY SUCH DISCREPANCY, OMISSION, OR VARIATION NOT REPORTED, SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- 4.IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PROVIDE TEMPORARY BRACES, SHORES AND GUYS, WHEREVER NECESSARY TO SUPPORT ALL LOADS TO WHICH THE STRUCTURE MAY BE SUBJECTED DURING CONSTRUCTION, INCLUDING ERECTION EQUIPMENT AND ITS OPERATION. THIS TEMPORARY SUPPORT SYSTEM SHALL HOLD ALL ELEMENTS AND MEMBERS IN THEIR FINAL POSITION UNTIL TOTALLY AND FINALLY CONNECTED TO THE PERMANENT BRACING ELEMENTS.
- 5.CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLIANCE WITH THE FLORIDA CONSTRUCTION SAFETY ORDERS.
- 6.REVIEW OF SHOP DRAWINGS BY STRUCTURAL ENGINEER SHALL NOT BE CONSTRUED AS ACCEPTING RESPONSIBILITY FOR SAFE CONSTRUCTION PRACTICES.
- 7.SHOP DRAWINGS ARE AN AID FOR FIELD PLACEMENT AND ARE SUPERSEDED BY THE STRUCTURAL DRAWINGS. IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO MAKE CERTAIN THAT ALL CONSTRUCTION IS IN FULL AGREEMENT WITH THE LATEST STRUCTURAL DRAWINGS. THE STRUCTURAL ENGINEER SHALL BE NOTIFIED IF ANY DISCREPANCIES ARE FOUND.
- 8.THE TYPICAL NOTES AND DETAILS SHALL APPLY IN ALL CASES UNLESS SPECIFIC DETAILS OCCUR ELSEWHERE. WHERE NO DETAIL IS SHOWN, CONSTRUCTION SHALL BE AS FOR SIMILAR WORK.
- 9.REFER TO ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS FOR LOCATION OF OPENINGS OR SUPPORTS FOR THEIR RESPECTIVE ITEMS. NOTIFY ARCHITECT, PRIOR TO CONSTRUCTION, OF ANY INTERFERENCE OR INCOMPATIBILITY.

B.CONCRETE:

- 1.CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH IN 28 DAYS EQUAL TO:
- a) PSI FOR CONC. DECK ON GRADE
- b) PSI FOR GRADE BEAM AND CONC. PILE
- c) PSI FOR CONC. WALL AND BEAM
- 2.CONTINUOUS DEPUTY INSPECTION REQUIRED FOR ALL CONCRETE STRENGTHS EXCEEDING 2500 PSI.
- 3.ALL CONCRETE SHALL BE NORMAL WEIGHT (145 PCF) UNLESS NOTED AS LIGHT-WEIGHT CONCRETE.
- 4.PORTLAND CEMENT: ASTM C150.
- 5.EXPOSED CONCRETE FORMING AND FINISH SHALL BE AS NOTED ON ARCHITECTURAL DRAWINGS. SEE ARCHITECT DRAWINGS FOR DETAILS.
- 6.PROJECTING CORNERS OF BEAMS, COLUMNS, ETC. SHALL BE FORMED WITH 3/4"CHAMFER UNLESS OTHERWISE DETAILED.

C.REINFORCING STEEL FOR CONCRETE:


- 1.REINFORCING BARS: ASTM A615 GRADE 60, GRADE 40 FOR #3 BARS. ALL REINFORCING STEEL THAT IS TO BE WELDED SHALL CONFORM TO ASTM A706, UNLESS OTHERWISE NOTED ON PLANS.
- 2.FIELD WELDING OF REINFORCING STEEL SHALL BE DONE BY CITY CERTIFIED WELDERS. CONTINUOUS DEPUTY INSPECTION REQUIRED.
- 3.WELDED WIRE FABRIC: ASTM A185
- 4.WELDING ELECTRODES: ASTM A233, CLASS E90, LOW HYDROGEN.
- 5.MINIMUM SPLICE LENGTHS, UNLESS DETAILED OTHERWISE.
- a) CONCRETE-36 DIAMETERS.
- b) MASONRY-40 DIAMETERS.
- c) WELDED WIRE FABRIC SHALL BE SPLICED WITH A MINIMUM LAP OF 12 INCHES.
- 6.MINIMUM CLEARANCE BETWEEN REINFORCING AND FACE OF CONCRETE SHALL BE AS FOLLOWS (UNLESS SHOWN OTHERWISE):
- a) CONCRETE BELOW GRADE (CAST AGAINST SOIL)=3"
- b) CONCRETE BELOW GRADE (FORMED)=2".
- c) CONCRETE WALLS EXPOSED TO WEATHER: NUMBER 5 BARS AND SMALLER=1-1/2". NUMBER 6 BARS AND LARGER =2".
- 7.MINIMUM CLEARANCE BETWEEN REBAR AND MASONRY SHALL BE 3/4".
- 8.SPLICES IN CONTINUOUS GRADE BEAMS SHALL OCCUR AT MIDSPAN. CONTACT THE STRUCTURAL ENGINEER IF CLARIFICATION IS NEEDED.
- 9.ALL REINFORCING SHALL BE ACCURATELY PLACED AND ADEQUATELY SUPPORTED BEFORE CONCRETE IS PLACED. AND SHALL BE SECURED AGAINST DISPLACEMENT WITHIN PERMITTED TOLERANCE. CLEARANCE FOR REBAR SHALL BE SHOWN IN DETAIL OR CALLED IN NOTES. TOLERANCE SHALL BE PER ACI 318-19.

D.MASONRY:

- 1.CONCRETE BLOCK MASONRY UNITS-ASTM C90, GRADE N,F"m=1500 PSI,MEDIUM WEIGHT. MASONRY UNIT COLOR AND FACE TEXTURED AS NOTED ON ARCHITECTURAL DRAWINGS. MASONRY UNIT SHALL BE CLIMATIZED TO SITE.
- 2.CONTINUOUS INSPECTION IS REQUIRED,UNLESS NOTED OTHERWISE,FOR:
- a) PREPARATION AND FORMING OF WALL PRISMS.
- b) SAMPLING AND PLACING OF MASONRY UNITS.
- c) PLACEMENT OF REINFORCEMENT.
- d) GROUT SPACE IMMEDIATELY PRIOR TO CLOSING OF CLEANOUTS AND DURING ALL GROUTING OPERATIONS.
- 3.ALL MORTAR AND GROUT SHALL HAVE A MINIMUM 28 DAYS COMPRESSIVE STRENGTH EQUAL TO 1800 PSI AND 2000 PSI,RESPECTIVELY.
- 4.PORTLAND CEMENT -ASTM C150,TYPE II,LOW ALKALI.
- 5.MORTAR MIX-1:3 WITH 1/4 PART LIME PUTTY,TYPE S.
- 6.GROUT MIX-1:3 WITH 2 PARTS PEA GRAVEL.
- 7.GROUT ALL CELLS, UNLESS OTHERWISE NOTED.
- 8.LOCATE REBARS ABOUT CENTERLINE OF MASONRY WALL UNLESS DETAILED OTHERWISE.
- 9.ALL WALLS SHALL BE CONSTRUCTED USING 1/2 RUNNING BOND BETWEEN MASONRY UNITS, UNLESS OTHERWISE NOTED.


E.LUMBER:

- 1.ALL LUMBER SHALL BE DOUGLAS FIR-LARCH UNLESS NOTED OTHERWISE.
- 2.ALL FRAMING LUMBER SHALL BE VISUALLY GRADE DIMENSION LUMBER UNO.
- a) JOISTS AND RAFTERS #2 GRADE.
- b) BEAMS #1 GRADE.
- c) STUDS #2 GRADE.
- 3.PLYWOOD SHEATHING PRODUCT STANDARD PS 1-95, DOUGLAS FIR-LARCH, CDX.
- 4.NAILING OF ROOF AND FLOOR SHEATHING SHALL BE INSPECTED AND APPROVED BY THE BUILDING DEPARTMENT BEFORE COVERING.
- 5.ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY NEAR GRADE SHALL BE WOLMANIZED.
- 6.MACHINE APPLIED NAILING SHALL NOT BE USED UNLESS SATISFACTORY INSTALLATION IS DEMONSTRATED ON THE JOB AND ITS USE IS APPROVED BY THE GOVERNING CODE INSPECTORS. APPROVAL IS SUBJECT TO CONTINUED SATISFACTORY PERFORMANCE.
- 7.BOLT HOLES IN WOOD SHALL BE 1/32"TO 1/16" OVERSIZE. HOLES OVER 1/16"LARGER SHALL REQUIRE REPLACEMENT OF LUMBER PIECE.
- 8.ALL BOLTS BEARING ON WOOD SHALL HAVE WASHERS.
- 9.APPROVED PLATE WASHERS TO BE USED FOR PLYWOOD SHEAR WALL SILL PLATE ANCHOR BOLTS AND HOLDOWN CONNECTOR BOLTS AT SHEAR WALL.
- MINIMUM SIZE FOR SQUARE PLATE WASHERS
- | BOLT SIZE | PLATE WASHERS |
|-----------|------------------------|
| 1/2" ø | 1/4" x 3" x 3" |
| 5/8" ø | 1/4" x 3" x 3" |
| 3/4" ø | 5/16" x 3" x 3" |
| 7/8" ø | 3/8" x 3" x 3" |
| 1" ø | 3/8" x 3 1/2" x 3 1/2" |
- 10.ANCHORAGE OF WOOD TO CONCRETE, MASONRY OR STEEL:
- a) ALL SILL PLATE BOLTS SHALL BE 5/8"DIAMETER, MINIMUM EMBEDMENT 9", LOCATED AT 4'-0"ON CENTER MAXIMUM, UNLESS OTHERWISE NOTED.
- b) SECURE WOOD LEDGER WITH 3/4" DIAMETER BOLTS AT 4'-0" ON CENTER UNLESS OTHERWISE NOTED.
- c) THE END STUD OF ALL PARTITIONS ABUTTING MASONRY OR CONCRETE SHALL BE ANCHORED WITH 1/2" DIAMETER BOLTS AT TOP, BOTTOM AND 4'-0"ON CENTER.
- d) ALL WOOD MEMBERS SHALL HAVE AN ANCHOR BOLT BETWEEN 6 TO 9 INCHES FROM EACH END. LENGTH OF ANCHOR BOLTS SHALL BE SUFFICIENT TO GRIP FULL NUT AND BE ANCHORED AT LEAST 6" PLUS HOOK INTO MASONRY OR CONCRETE.
- e) USE 1/2" DIAMETER STUD BOLTS AT 2'-0" ON CENTER TO STRUCTURAL STEEL UNLESS OTHERWISE NOTED.
- f) INTERIOR NON-BEARING WALL SILL PLATES MAY BE ANCHORED TO CONCRETE WITH 7/32" DIAMETER POWER DRIVEN PINS AT 30" ON CENTER UNLESS DETAILED OTHERWISE.
- 11.CONNECTOR DESIGNATIONS REFER TO STRONG - TIE CONNECTORS BY SIMPSON COMPANY, BREA, CALIFORNIA. UNLESS NOTED OTHERWISE. SPECIAL NAILS OF THE SAME DIAMETER AND PENETRATING INTO THE SUPPORT ONE HALF OF THE LENGTH CALLED FOR, MAY BE USED WITH SIMPSON METAL CONNECTORS.
- 12.NAIL ALL 2X DOUBLE JOIST WITH 16d NAILS @ 9" ON CENTER.
- 13.PROVIDE DOUBLE JOIST UNDER ALL PARALLEL PARTITIONS.
- 14.PROVIDE 2" FIRE BLOCKING IN STUD WALLS AT MAXIMUM VERTICAL SPACING PERMITTED BY GOVERNING CODE AND AT ALL CEILING LINES.
- 15.FOR SIZE AND LOCATION OF ROOF, FLOOR AND WALL OPENING, SEE ARCHITECTURAL MECHANICAL AND ELECTRICAL DRAWINGS. FRAME ALL FOUR SIDES OF OPENINGS WITH ADEQUATE MEMBERS AND CONNECTORS.
- 16.NON-BEARING WOOD STUD WALLS SHALL BE BRACED ALONG THEIR LENGTH AT LEAST ONCE IN EVERY 25 FEET OF LENGTH. THE BRACING SHALL BE A 1"x4" CONTINUOUS LET-IN BOARD, NAILED TO JOIST AND TO TOP AND BOTTOM PLATES FOR SIMPSON 16 GAUGE WB STRAPS IN EACH DIRECTION (X-BRACING).RUN BRACE DIAGONALLY FROM BOTTOM PLATE TO UPPER TOP PLATE AT AN ANGLE SUFFICIENT TO INCLUDE FOUR NORMAL STUD SPACES FOR EVERY 12 FOOT INCREMENT OF HEIGHT.
- 17.ALL RAFTERS AND FLOOR JOISTS WITH DEPTH TO THICKNESS RATIO OF 6 OR GREATER SHALL BE SOLID BLOCKED @ 8'-0" O.C.
- 18.STRUCTURAL WOOD PANEL SHEAR WALLS SHALL BE COVERED WITH MIN. 2 LAYERS 15# FELT UNDERLAYMENT PRIOR TO PLACING FINISH MATERIAL.
- 20.LAG BOLTS: PROVIDE LEAD HOLE 70% OF THREADED SHANK DIAMETER, AND FULL DIAMETER FOR SMOOTH SHANK PORTION. SOAP, PARAFFIN OR OTHER APPROVED LUBRICANT SHALL BE USED ON THREADS. INSTALLATION SHALL BE BY SCREWING NOT HAMMERING. CARE SHALL BE TAKEN TO AVOID OVER TORQUING BOLT.
- 21.ALL NAILING SHALL BE IN ACCORDANCE WITH 2023 FLORIDA BUILDING CODE REQUIREMENTS UNLESS NOTED OTHERWISE ON THE DRAWINGS. USE COMMON WIRE NAILS.
- NAILING SCHEDULE
- | | |
|---|----------------------------------|
| 1. JOIST TO SILL OR GIRDER, TOENAIL | 3-8d |
| 2. BRIDGING TO JOIST, TOENAIL EACH END | 2-8d |
| 3. 1"x6" SUBFLOOR OR LESS TO EACH JOIST, FACE NAIL | 2-8d |
| 4. WIDER THAN 1"x6" SUBFLOOR TO EACH JOIST, FACE NAIL | 3-8d |
| 5. 2" SUBFLOOR TO JOIST OR GIRDER, BLIND AND FACE NAIL | 2-16d |
| 6. SOLE PLATE TO JOIST OR BLOCKING, TYPICAL FACE NAIL | 16d @ 16" O.C. |
| 7. TOP PLATE TO JOIST OR BLOCKING, AT BRACED WALL PANELS | 3-16d per 16" |
| 8. STUD TO SOLE PLATE | 2-16d |
| 9. DOUBLE STUDS, FACE NAIL | 4-8d, toenail or |
| 10. DOUBLED TOP PLATES, TYPICAL FACE NAIL | 16d @ 24" O.C. |
| 11. BLOCKING BETWEEN JOISTS | 16d @ 8" O.C. |
| 12. RIM JOIST TO TOP PLATE, TOENAIL | 3-8d |
| 13. TOP PLATES, LAPS AND INTERSECTIONS, FACE NAIL | 8d @ 6" O.C. |
| 14. CONTINUOUS HEADER, TWO PIECES | 2-16d @ 16" O.C. along each edge |
| 15. CEILING JOISTS TO PLATE, TOENAIL | 3-8d |
| 16. CONTINUOUS HEADER TO STUD, TOENAIL | 4-8d |
| 17. CEILING JOISTS, LAP OVER PARTITIONS, FACE NAIL | 3-16d |
| 18. CEILING JOISTS TO PARALLEL RAFTERS, FACE NAIL | 3-16d |
| 19. RAFTER TO PLATE, TOENAIL | 3-8d |
| 20. 1" BRACE TO EACH STUD AND PLATE, FACE NAIL | 2-8d |
| 21. 1"x8" SHEATHING OR LESS TO EACH BEARING, FACE NAIL | 2-8d |
| 22. WIDER THAN 1"x8" SHEATHING TO EACH BEARING, FACE NAIL | 3-8d |
| 23. BUILT-UP CORNER STUDS | 16d @ 24" O.C. |
| 24. 2" PLANKS | 2-16d at each bearing |
- 22.GLUE LAMINATED MEMBERS:
- a) MANUFACTURED IN ACCORDANCE WITH LATEST AITC 117 SPECIFICATIONS.
- b) DOUGLAS FIR,NORTH REGION LUMBER.
- c) COMBINATION 24F-V4,STRESS GRADE (Fb=2400 PSI). COMBINATION 24F-V8,STRESS GRADE (Fb=2400 PSI) AT BEAMS WITH CANTILEVER.
- d) AITC APPEARANCE GRADE - SEE ARCH. DRAWINGS OR SPECIFICATIONS.
- e) WATERPROOF GLUE:PHENOL RESORCINOL GLUE,MIL-A397B.
- f) MOISTURE CONTENT - 15 PERCENT MAXIMUM 4" MAXIMUM VARIATION IN BEAM.
- g) SEALER - TWO COATS OF WOODLIFE, REZ, OR EQUAL (HEAVY COATS ON AND GRAIN).
- h) WRAPPING - (WATER RESISTANT, NON-STAINING PAPER),BULKWRAP UP TO FOUR MEMBERS).
- i) INSPECTION - AITC CERTIFICATE.
- j) ALL GLU-LAMINATED MEMBERS FABRICATION SHALL BE CITY BLDG. DEPT. CITY LICENSED FABRICATOR.

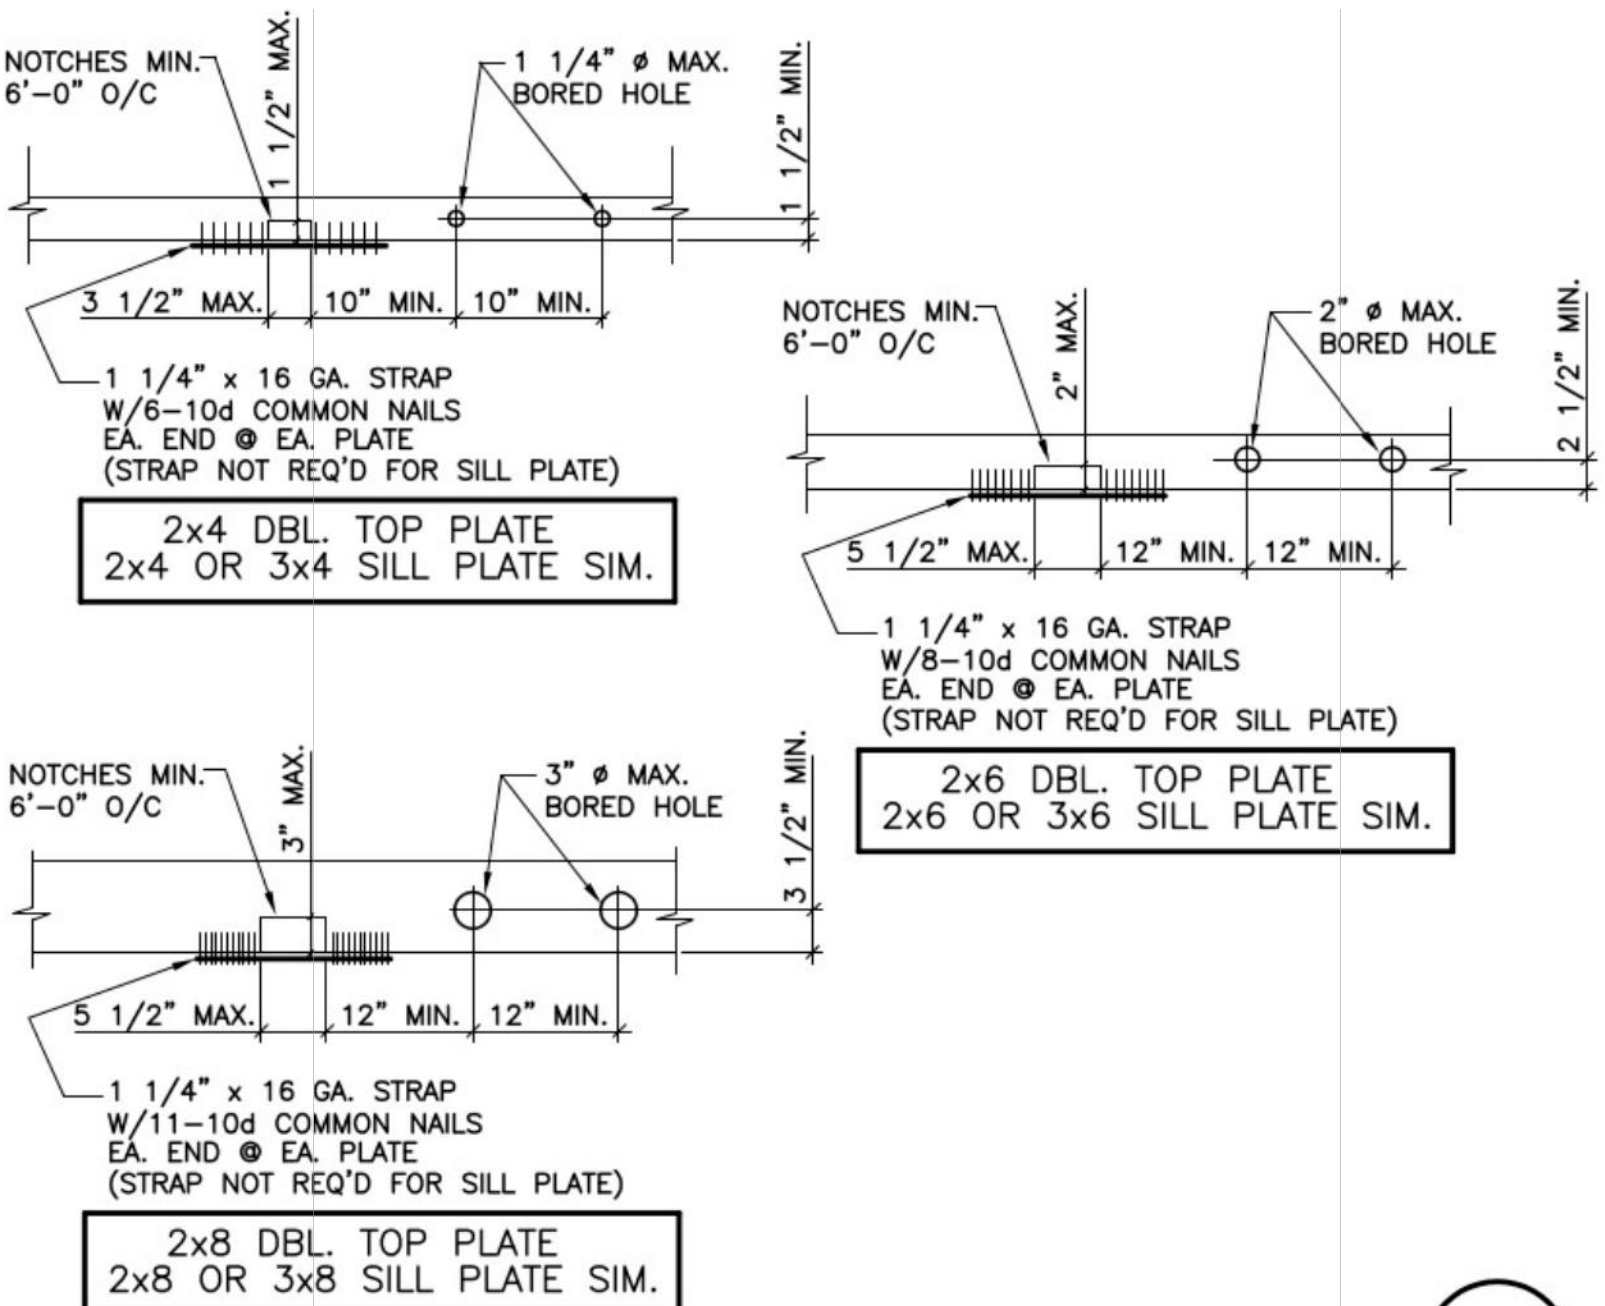

TYPICAL NOTCH & BORED TOP PLATE

2

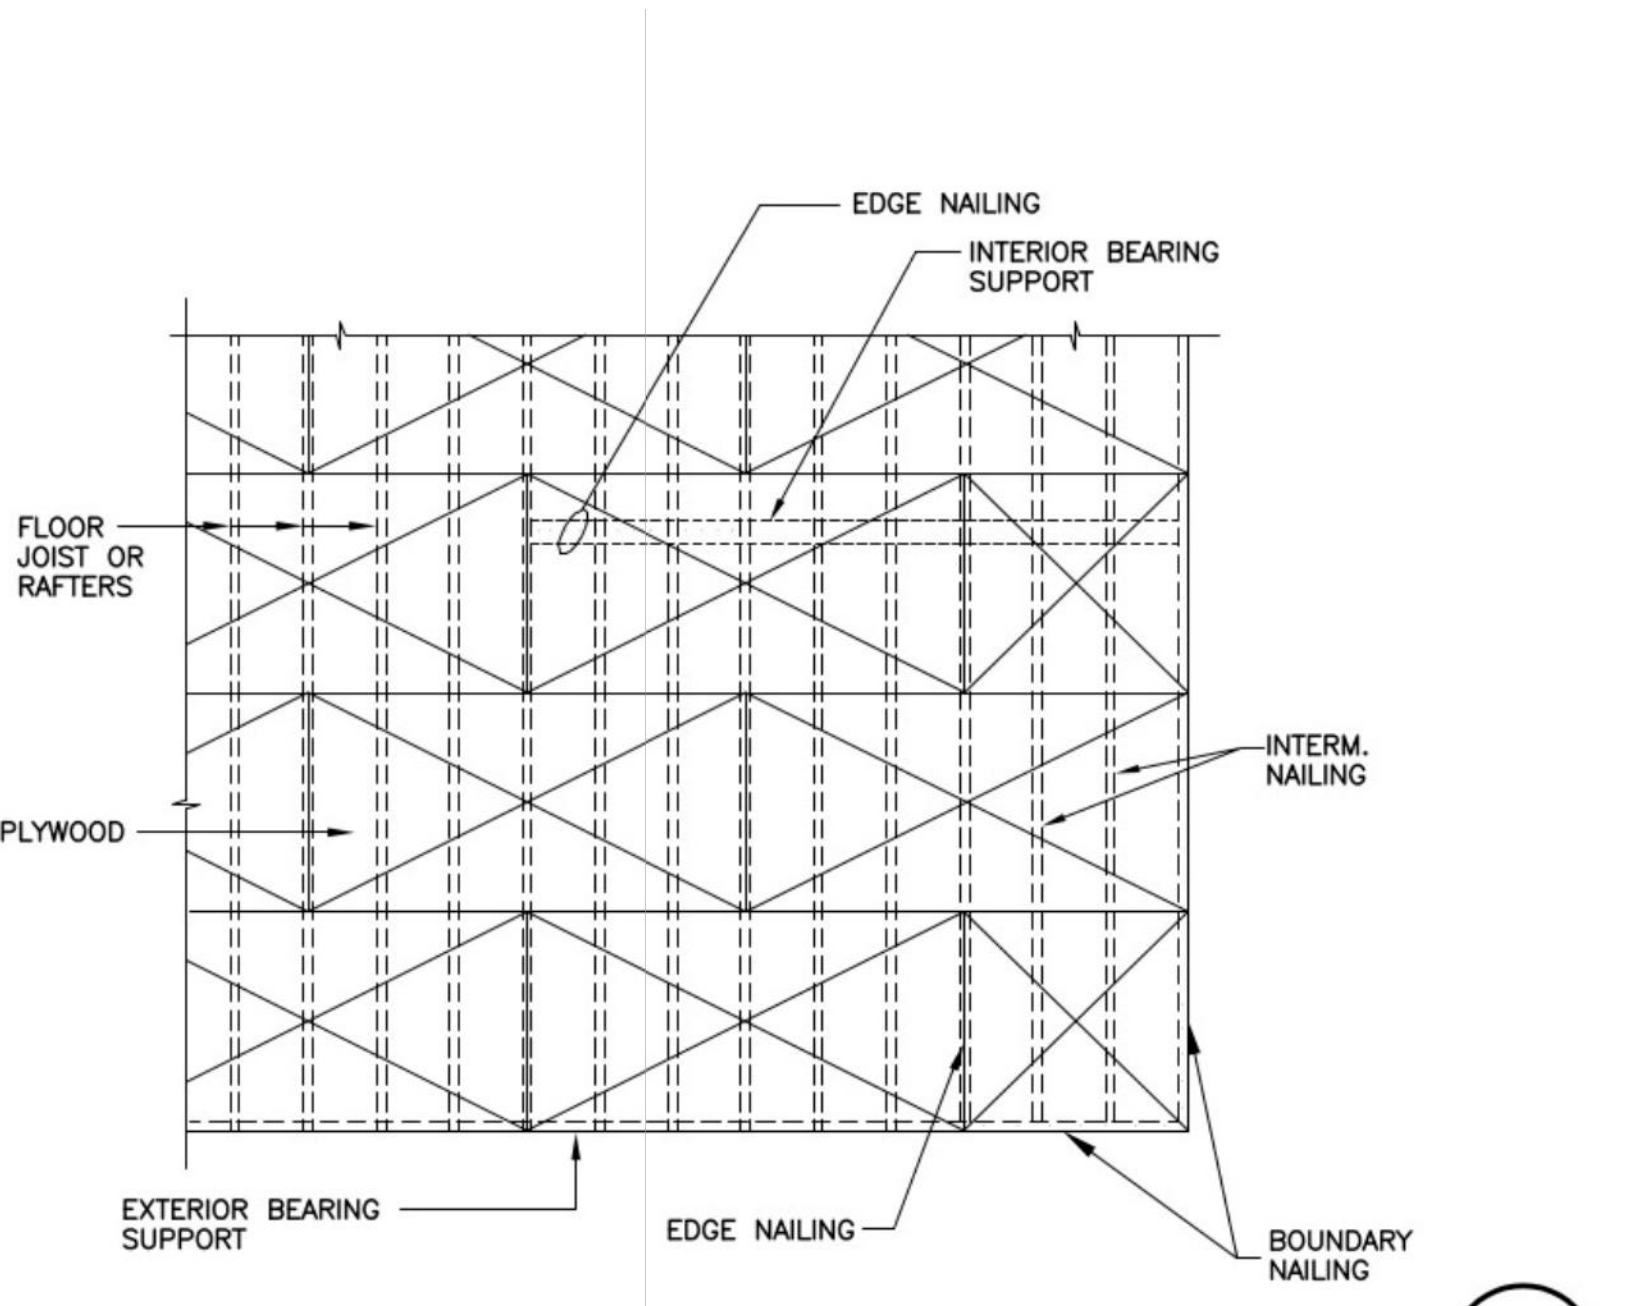

ROOF & FLOOR DIAPHRAGM

1

STRUCTURAL OBSERVATION PROGRAM
AND DESIGNATION OF THE
STRUCTURAL OBSERVER

PROJECT ADDRESS: PERMIT APPL. NO.:

Description of Work :

Owner: Architect: Engineer: Mark Acciani
PE

STRUCTURAL OBSERVATION (only checked items are required)			
Firm or Individual to be responsible for the Structural Observation: Name: Phone: Calif. Registration:			
FOUNDATION	WALL	FRAME	DIAPHRAGM
☐ Footing, Stem Walls, Piers	☐ Concrete	☐ Steel Moment Frame	☐ Concrete
☐ Mat Foundation	☐ Masonry	☐ Steel Brace Frame	☐ Masonry
☐ Caisson, Piles, Grade Beams	☐ Wood	☐ Concrete Moment Frame	☒ Wood
☐ Stepp'g/Retain'g Foundation, Hillside Special Anchor	☐ Others:	☐ Masonry wall frame	☐ Others:
☐ Others:		☐ Others:	

DECLARATION BY OWNER

I, the owner of the project, declare that the above listed firm or individual is hired by me to be the Structural Observer.

Signature Date

DECLARATION BY ARCHITECT OR ENGINEER OF RECORD (required if the Structural observer is different from the Architect or Engineer of Record)

I, the Architect or Engineer of the project, declare that the above listed firm or individual is designated by to be responsible for the Structural Observation.

Signature License No. Date

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O.Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 266-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all
conformance to drawings
prior to starting any
work. If any discrepancy
is found, the contractor
shall notify the architect
and engineer immediately
and the architect and
engineer shall be responsible
for the correction of any
error. The contractor shall
be responsible for the
construction of fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2	XX-XX-XXXX	
3	XX-XX-XXXX	
4	XX-XX-XXXX	

SHEET CONTENTS
ENGINEERING NOTES

DRAWN BY
J.A.E.

DATE
05/14/2026
SCALE
1/4"= 1'-0"
JOB

SHEET

S000

OF 26 SHEETS

Foundation Notes

- CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS FOR CONFORMANCE TO DRAWINGS PRIOR TO STARTING ANY CONSTRUCTION. ALL MEASUREMENTS ARE TO BE VERIFIED BY THE CONTRACTOR AND ANY DISCREPANCIES BROUGHT TO THE ATTENTION OF JAE CARBON AND ENGINEER PRIOR TO COMMENCEMENT OF ANY CONSTRUCTION OR FABRICATION.
- ALL WOOD IN CONTACT WITH CONCRETE/CMU TO BE SEPARATED BY FELT, FLORIDA PRODUCT APPROVED METHODS, OR BE MADE OF PT.
- PROVIDE SHORING WHERE NECESSARY
- V.I.F. - VERIFY IN FIELD

— = (1) 12" #5 @ 24" o.c. horz epoxied into ex

-  = indicates 3/4" recess sloped to drain
-  = indicates sub-woofer pre-wire
-  = indicates floor outlet
-  = indicates stem wall

 = new over pour existing slab 3 1/2" fibermesh 3000 PSI concrete on ex slab to flush OR self level all wood in contact with concrete to be pt or separated via fpa methods


Filled Cell Key

-  = indicates cutin filled cell w/ (1) #5 rebar epoxied w/ Simpson S.E.T.-3G Epoxy into top course and slab and filled with 3000PSI concrete
-  = indicates assumed existing filled cell or add same as cutin filled cell
-  = indicates (1) #5 extending from slab min. 26" for later filled cell
-  = indicates (1) #5 extending from slab min. 26" for later filled cell
-  = indicates (4) #5 extending from slab min. 26" for later filled cell

TERMITE SPECIFICATIONS

SECTION R318 PROTECTION AGAINST TERMITES
TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITES INCLUDING SOIL APPLIED PESTICIDES, BAITING SYSTEMS, AND PESTICIDES APPLIED TO WOOD, OR OTHER APPROVED METHODS OR TERMITE PROTECTION LABEL FOR USE AS PREVENTIVE TREATMENT TO NEW CONSTRUCTION (SEE SECTION 202, REGISTERED TERMITES). UPON COMPLETION OF THE APPLICATION OF THE TERMITE PROTECTIVE TREATMENT, A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES."

- NOTES:**
1. METHOD OF TREATMENT SHALL BE APPROVED BY THE GOVERNING JURISDICTION "LIQUID BORATE OR BORLA-COR" PRODUCT METHODS MUST BE DETERMINED AT PERMIT STAGE AND PRODUCT APPROVAL DATA MUST BE ON FILE WITH THE BUILDING DEPARTMENT.
 2. PRESSURE TREATED LUMBER THAT HAS BEEN CUT OR DRILLED THAT EXPOSES UNTREATED PORTIONS OF WOOD ARE REQUIRED TO BE FIELD TREATED TO PREVENT INSECT INFESTATION.
 3. OPTIONAL BORATE APPLIED TO ALL FRAME MEMBERS WITHIN 24" A.F.F.
 4. A PERMANENT SIGN WHICH IDENTIFIES THE TERMITE TREATMENT PROVIDER AND NEED FOR RE-INSPECTION AND TREATMENT CONTRACT RENEWAL SHALL BE PROVIDED. THE SIGN SHALL BE POSTED NEAR THE WATER HEATER OR ELECTRIC PANEL. FBC 105.11
 5. CONDENSATE AND ROOF DOWNSPOUTS SHALL DISCHARGE AT LEAST 1'-0" AWAY FROM BUILDING SIDE WALLS FBC 1503.7
 6. IRRIGATION/SPRINKLER SYSTEM INCLUDING ALL RISERS AND SPRAY HEADS SHALL NOT BE INSTALLED WITHIN 1'-0" OF THE BUILDING SIDE WALLS.
 7. TO PROVIDE FOR INSPECTOR FOR TERMITE INFESTATION BETWEEN WALL COVERING AND FINAL EARTH GRADE SHALL NOT BE LESS THAN 6". EXCEPTION: PAINT OR DECORATIVE CEMENTITIOUS FINISH LESS THAN 5/8" THICK ADHERED DIRECTLY TO THE FOUNDATION WALL. FBC 1403.8
 8. INITIAL TREATMENT SHALL BE DONE AFTER ALL EXCAVATION AND BACKFILL IS COMPLETE. FBC 1816.1.1
 9. SOIL DISTURBED AFTER THE INITIAL TREATMENT SHALL BE RETREATED INCLUDING SPACES BOXED OR FORMED. FBC 1816.1.2
 10. BOXED AREAS IN CONCRETE FLOORS FOR SUBSEQUENT INSTALLATION OF TRAPS, ETC., SHALL BE MADE WITH PERMANENT METAL OR PLASTIC FORMS. PERMANENT FORMS MUST BE OF A SIZE AND DEPTH THAT WILL ELIMINATE THE DISTURBANCE OF SOIL AFTER THE INITIAL APPLICATION FBC 1816.1.3
 11. MINIMUM 6 MIL VAPOR RETARDER MUST BE INSTALLED TO PROTECT AGAINST RAINFALL DILUTION. IF RAINFALL OCCURS BEFORE VAPOR RETARDER PLACEMENT, RETREATMENT IS REQUIRED. FBC 1816.1.4
 12. CONCRETE OVERPOUR AND MORTAR ALONG THE FOUNDATION PERIMETER MUST BE REMOVED BEFORE EXTERIOR SOIL TREATMENT. FBC 1816.1.5
 13. SOIL TREATMENT MUST BE APPLIED UNDER ALL EXTERIOR CONCRETE OR GRADE WITHIN 1'-0" OF THE STRUCTURE SIDEWALLS. FBC 1816.1.6
 14. AN EXTERIOR CHEMICAL BARRIER MUST BE INSTALLED AFTER CONSTRUCTION IS COMPLETE INCLUDING LANDSCAPING AND IRRIGATION. ANY SOIL DISTURBED AFTER THE VERTICAL BARRIER IS APPLIED, SHALL BE RETREATED. FBC 1816.1.8
 15. ALL BUILDINGS ARE REQUIRED TO HAVE PRE-CONSTRUCTION TREATMENT. FBC 1816.1.7
 16. A CERTIFICATE OF COMPLIANCE MUST BE ISSUED TO THE BUILDING DEPARTMENT BY A LICENSED PEST CONTROL COMPANY BEFORE A CERTIFICATE OF OCCUPANCY IS ISSUED. THE CERTIFICATE OF COMPLIANCE SHALL STATE "THE BUILDING HAS RECEIVED COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. THE TREATMENT IS IN ACCORDANCE WITH THE RULES AND THE LAWS OF THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES" FBC 1816.1
 17. AFTER ALL WORK IS COMPLETED, LOOSE WOOD AND FILL MUST BE REMOVED FROM BELOW AND WITHIN 1'-0" OF THE BUILDING. THIS INCLUDES ALL GRADE STAKES, TUB TRAP BOXES, FORMS, SHORING, OR OTHER CELLULOSE CONTAINING MATERIAL. FBC 2304.12.3.3
 18. NO WOOD, VEGETATION, STUMPS, CARDBOARD, TRASH, ETC., SHALL BE BURIED WITHIN 15'-0" OF ANY BUILDING OR PROPOSED BUILDING. FBC 2304.12.8.1

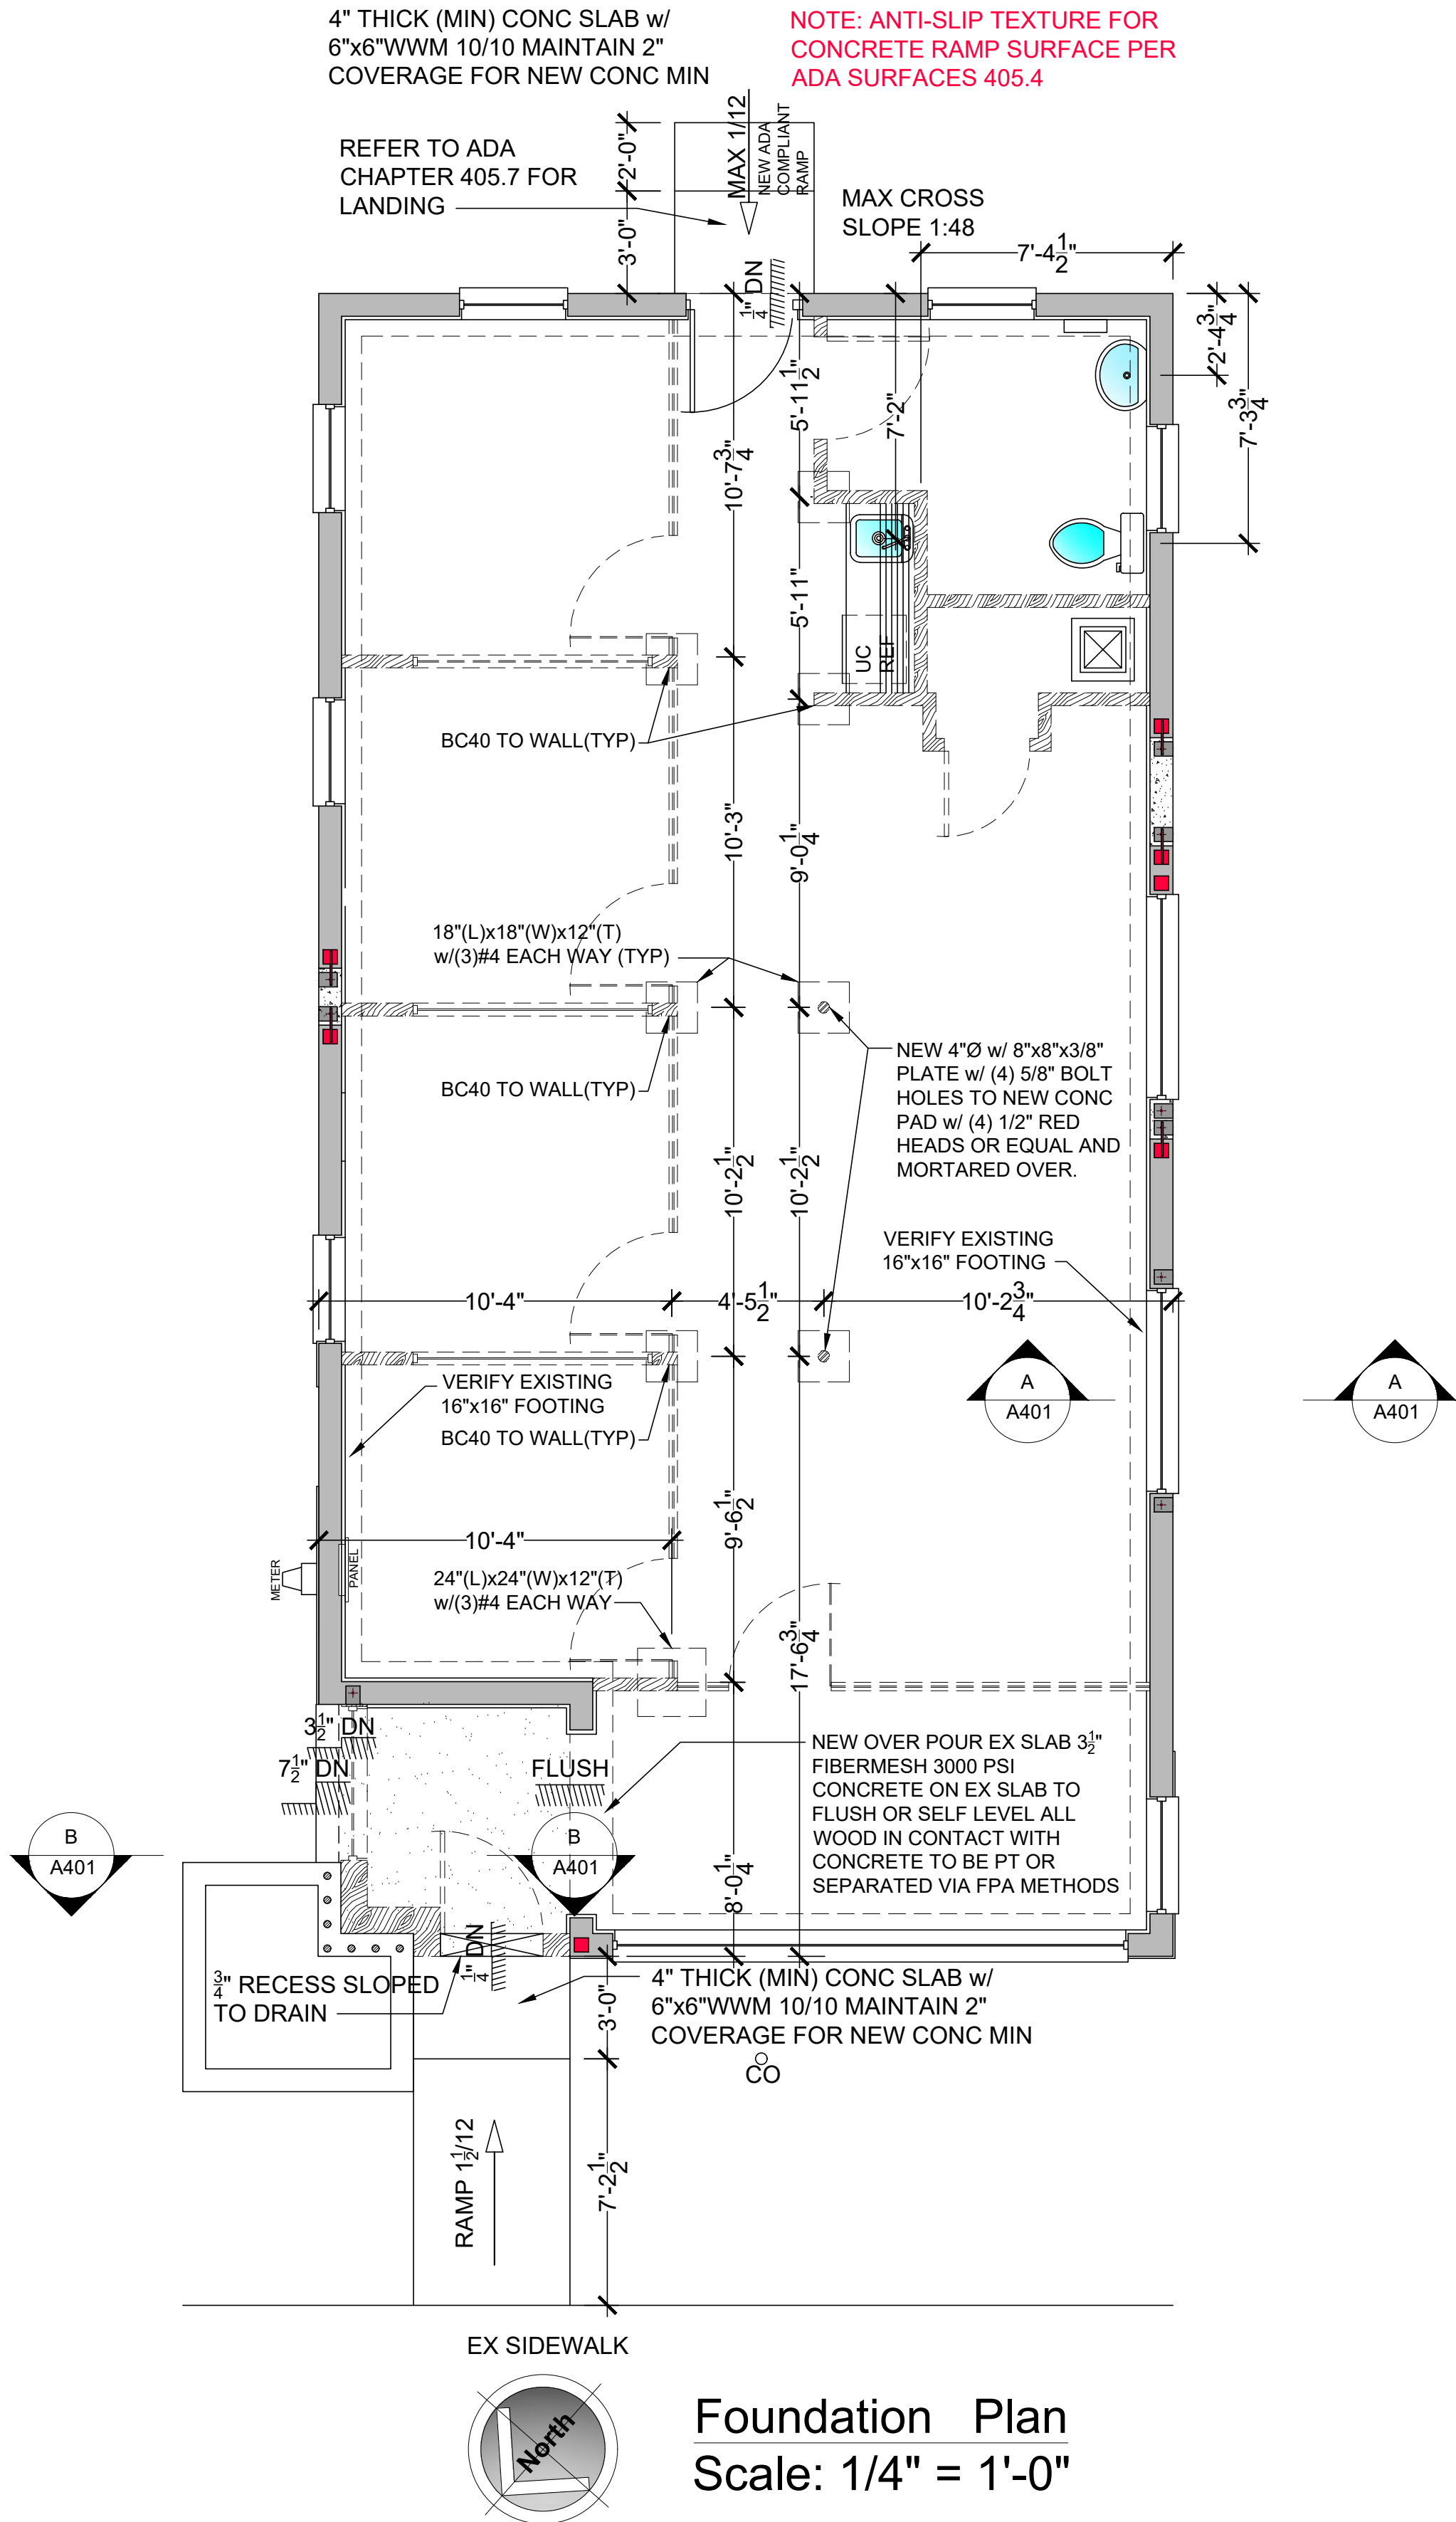

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all construction and materials prior to starting any work. Measurements are to be taken by the inspector and any discrepancies brought to the attention of JAE Carbon prior to commencement of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2	XX-XX-XXXX	
3	XX-XX-XXXX	
4	XX-XX-XXXX	

SHEET CONTENTS
FOUNDATION NOTES
FOUNDATION PLAN
TERMITE SPECIFICATIONS

DRAWN BY
J.A.E.

DATE
05/14/2026

SCALE
1/4" = 1'-0"


JOB

SHEET
S101
OF 26 SHEETS

Bearing Height	-	9'-4" AFF UNO MATCH EXISTING
Roof Pitch	-	1/12
Framing	-	2x8 @ 16" o.c.
Fascia	-	Match Existing
Overhang	-	Match Existing
Cut Type	-	Match Existing

1) ASSUMED LUS FROM 2x8 ROOF JOISTS TO LEDGER

Match existing bearing height, roof pitch, fascia, and overhang
UNO - (Unless Noted Otherwise)



Roof Framing Plan
Scale: 1/4" = 1'-0"

ROOF SLOPES TO BE
MAINTAINED BEAMS TO NOT
ALTER ROOF SLOPE OR
CHANGE DRAINAGE

SIGNATURE & SEAL


construction or fabrication.

CLEARWATER, FLORIDA


CC/CC

4


OF 26 SHEET

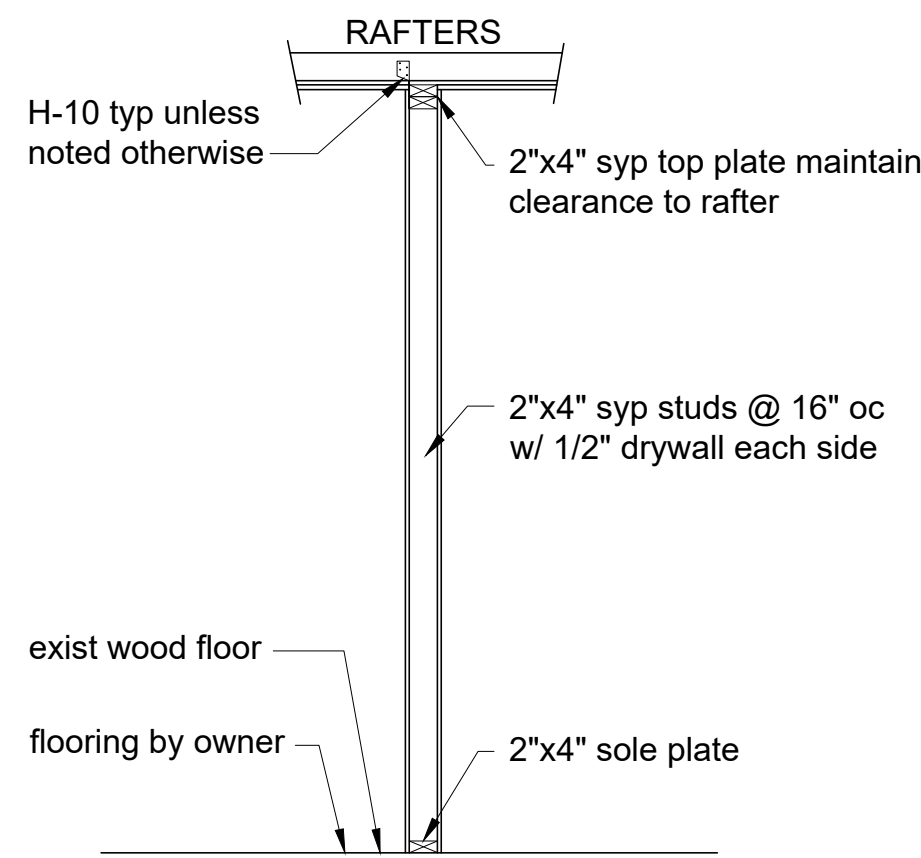


Typ. Interior Bearing Wall Section
Scale: 1/2"=1'-0"

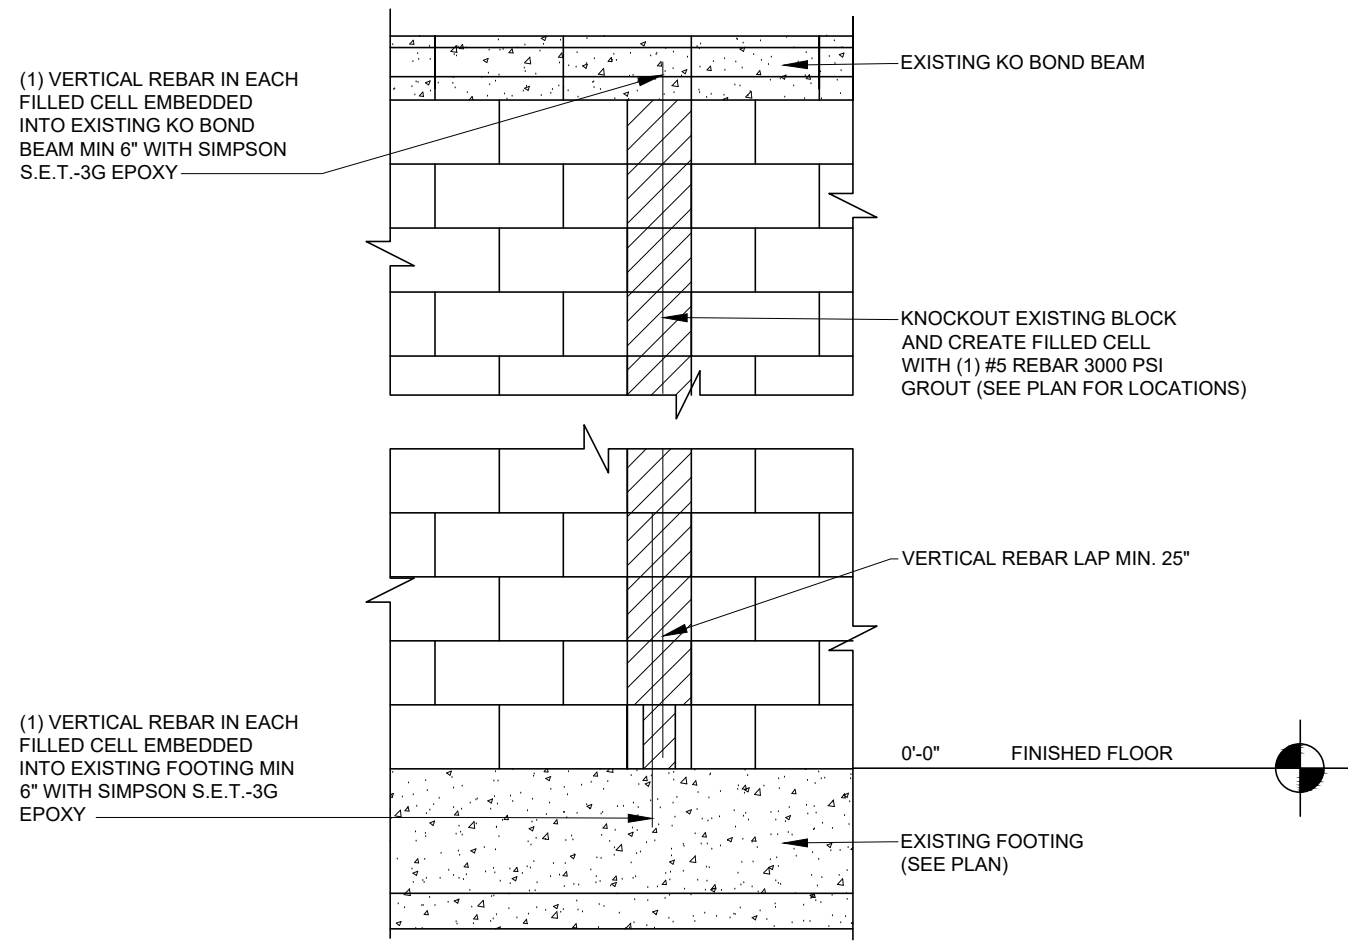


Filled Cell Detail
Scale: 1/2"=1'-0"

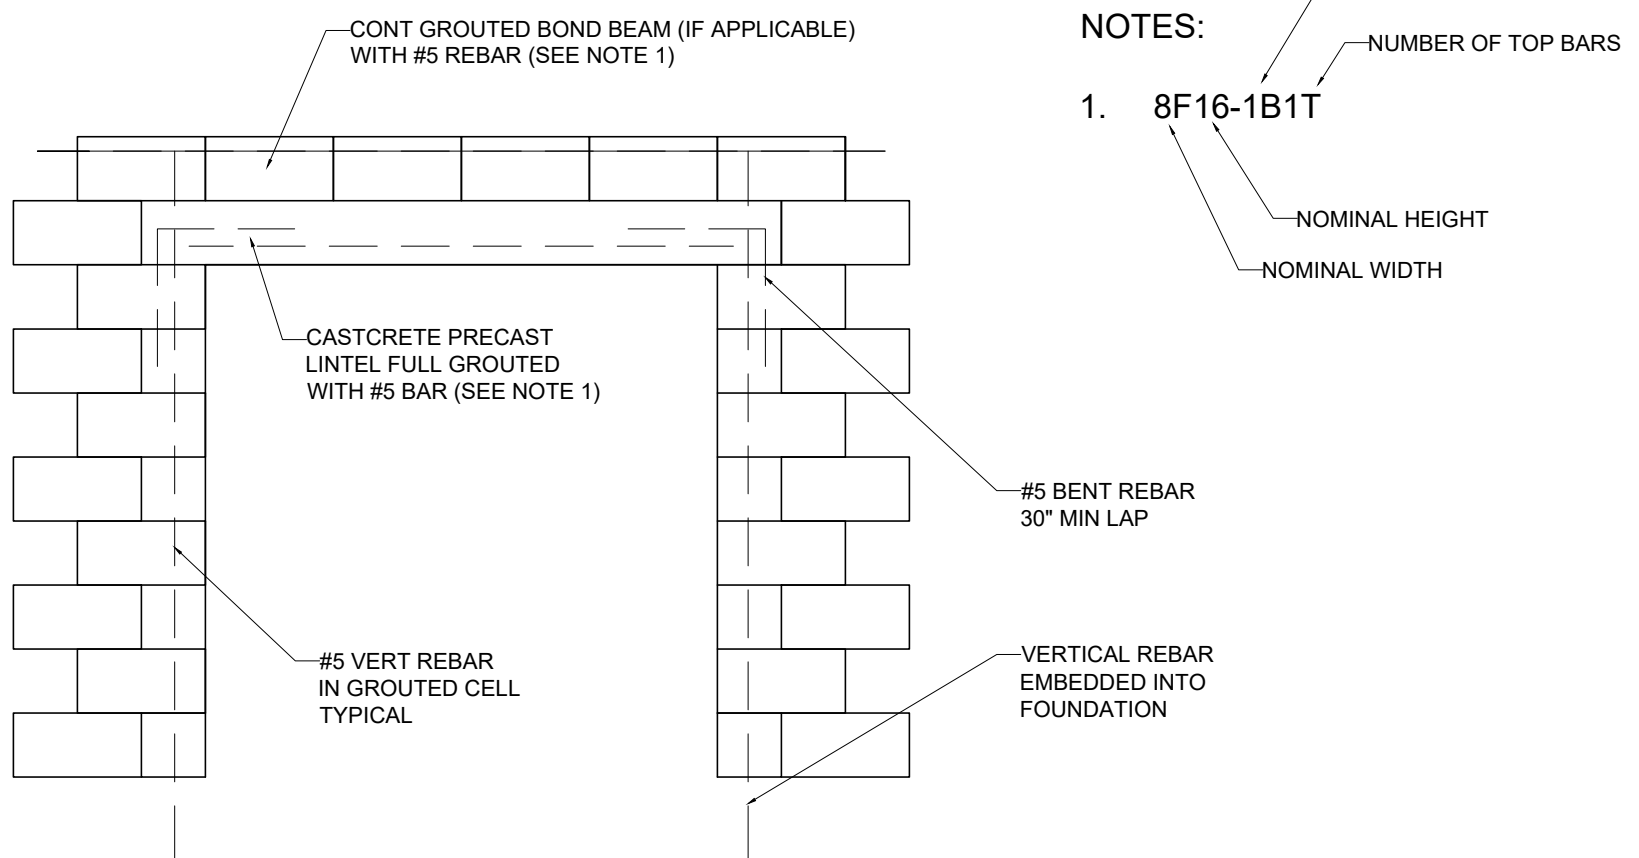

Typical Lintel/Bond Beam Construction
Scale: 1/2"=1'-0"

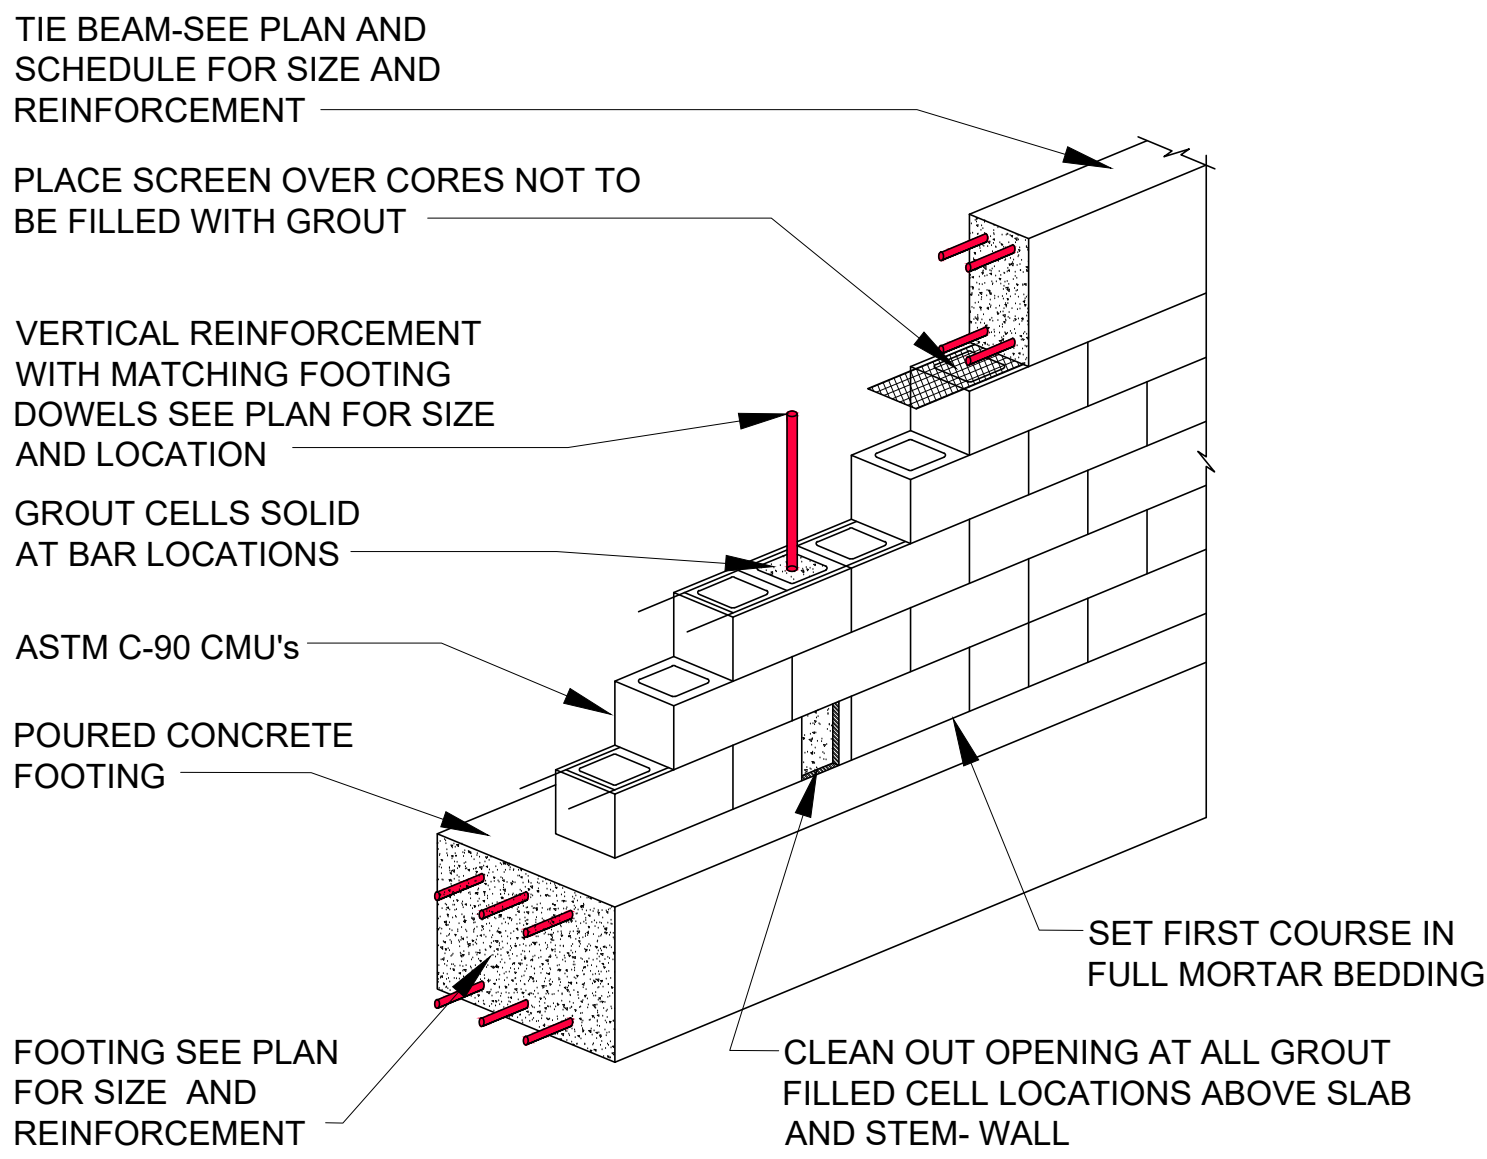

Typical Masonry Wall Construction
Scale: 1/2"=1'-0"

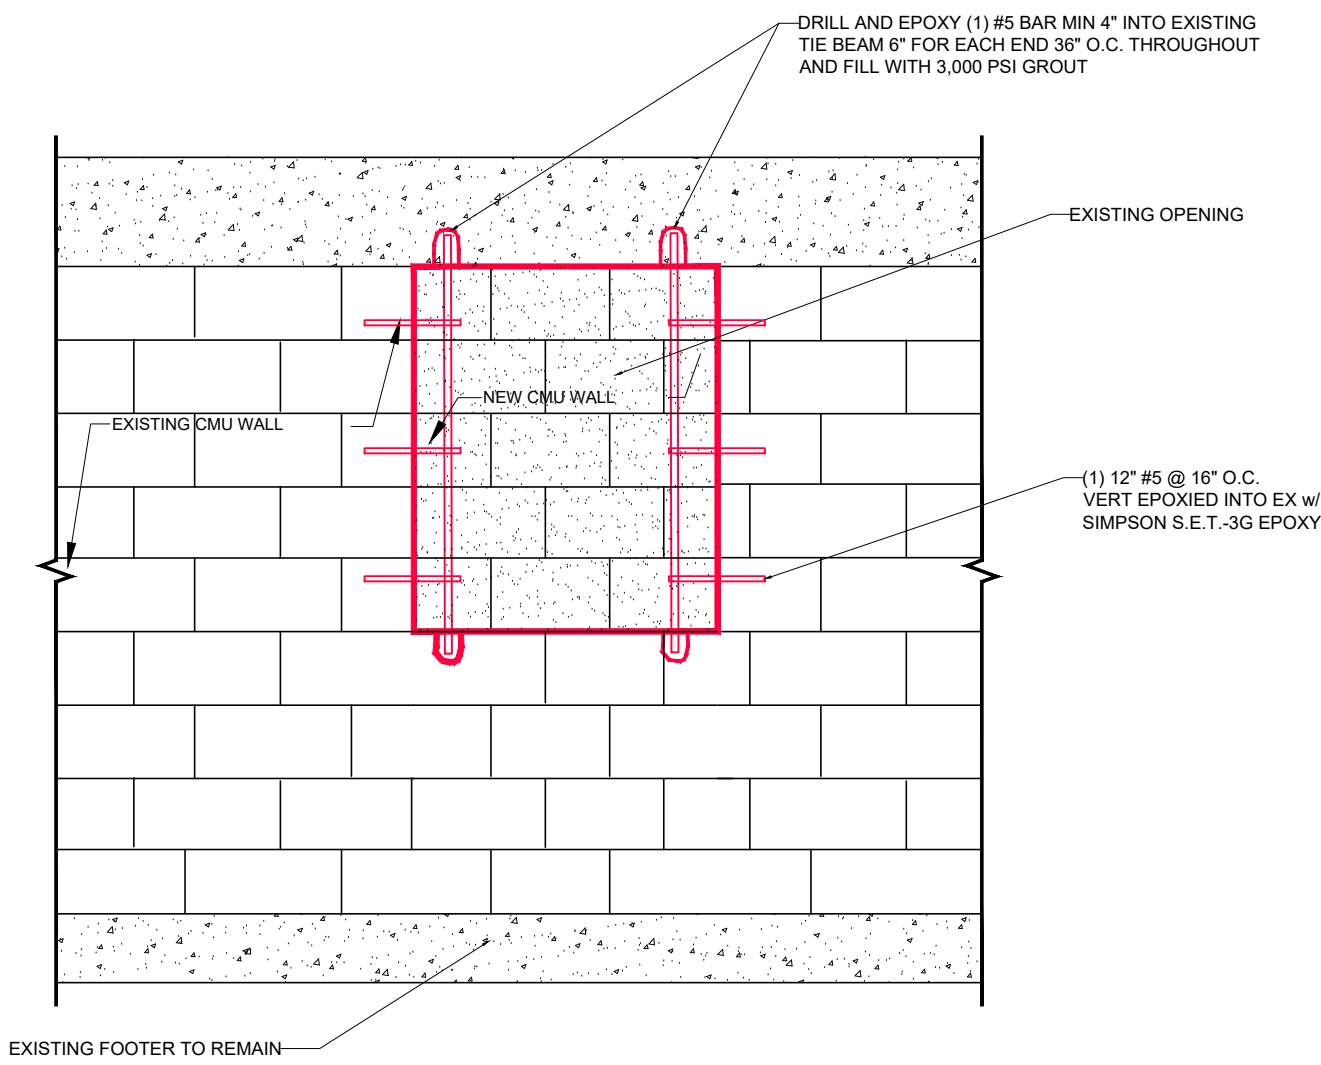

Block Infill Detail
Scale: 1/2"=1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all dimensions and materials prior to starting any work. Measurements are to be taken by the contractor and any discrepancies noted and the attention of JAE Carbon is to be given immediately upon commencement of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755


REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS	
MASONRY DETAILS	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET	
S421	
OF 26 SHEETS	




Metal Lath Attachment Detail

Scale: 3/4"=1'-0"

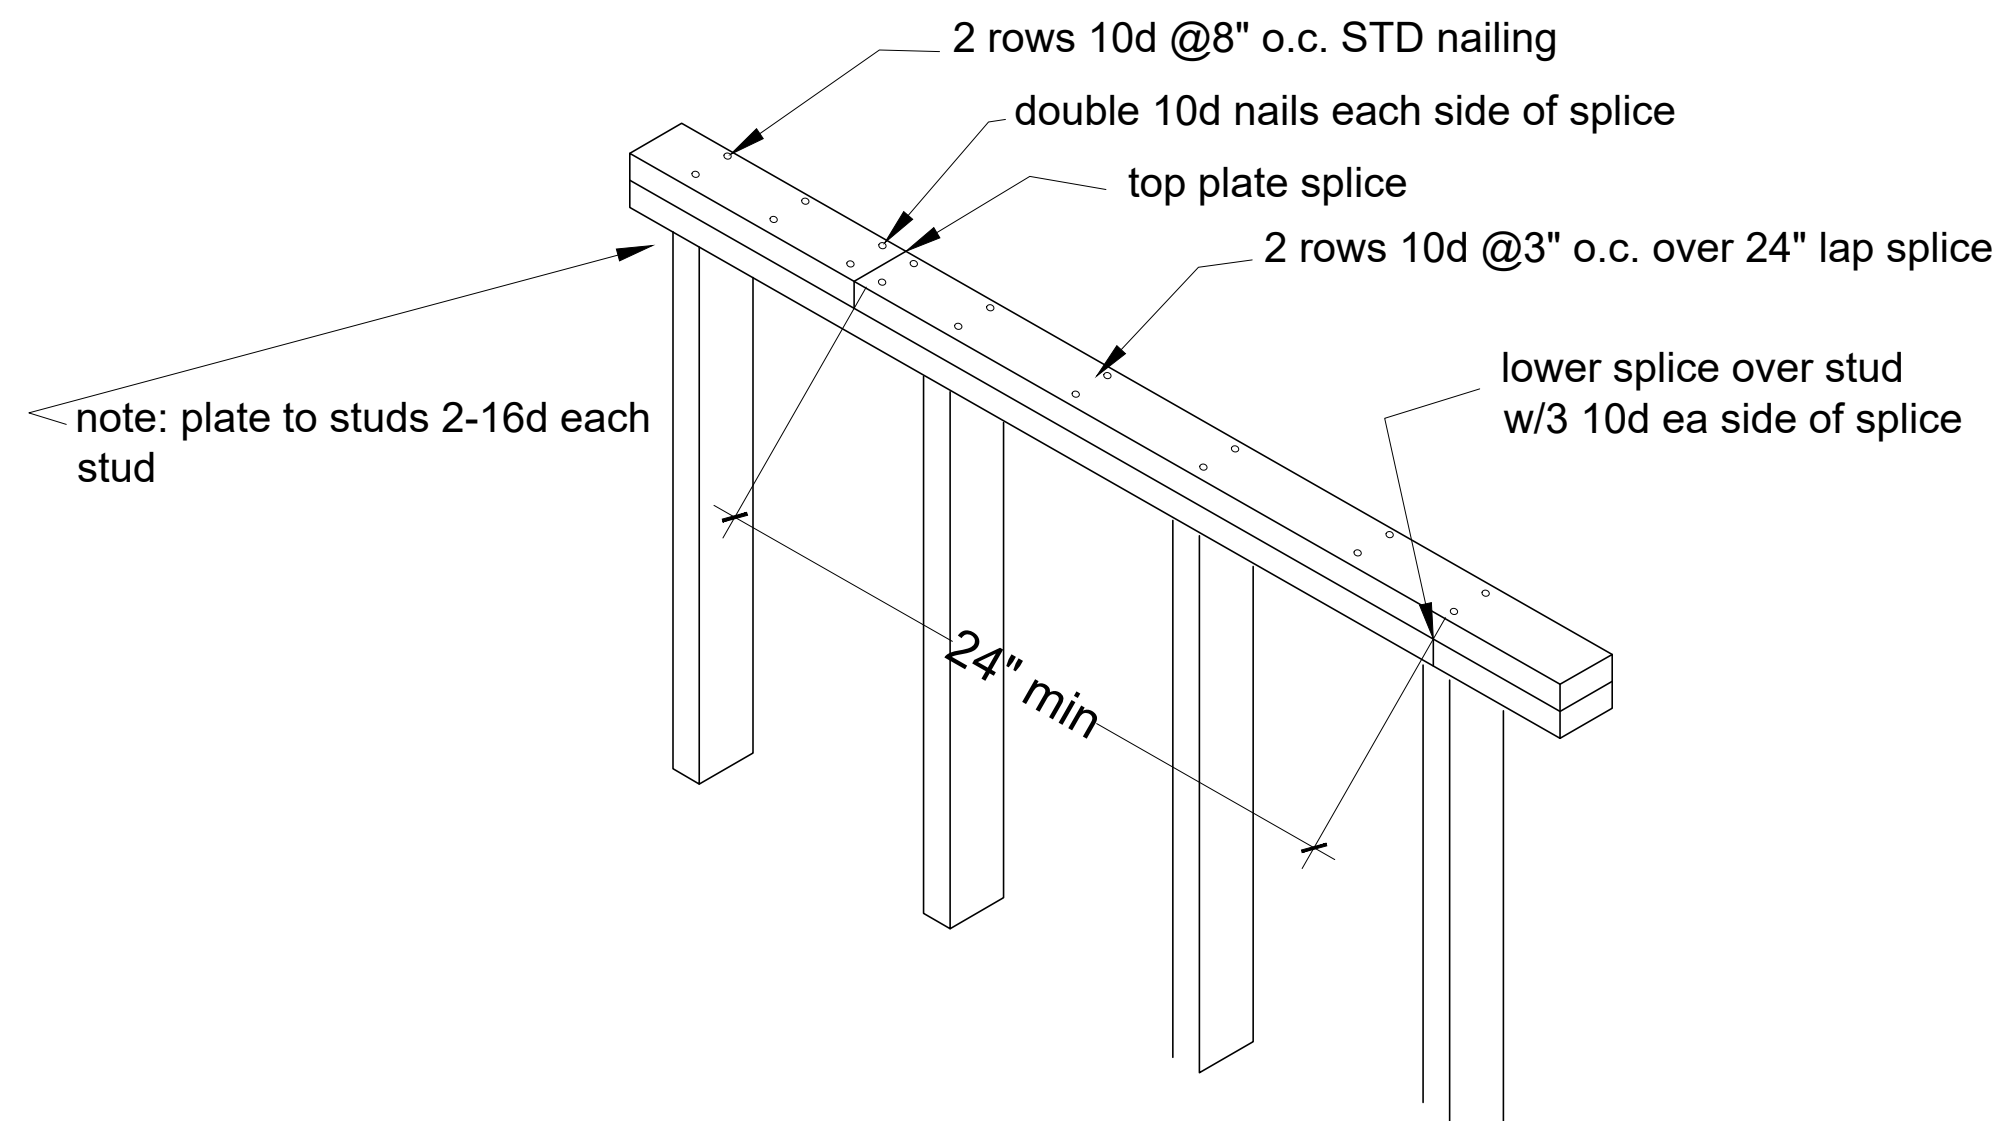

Top Plate Splice Detail
Scale: N.T.S.

Load Bearing Header Detail
Scale: 1/2"=1'-0"

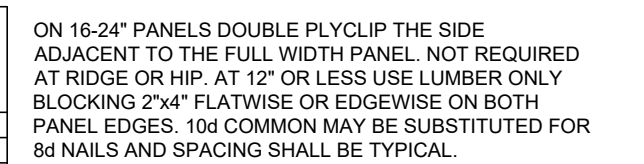

Typical Sheathing Nailing Schedule
Scale: N.T.S.





SHEET
S422
OF 26 SHEETS

Electrical Legend	
	4" RECESSED HE LED LIGHT FIXTURE
	4" RECESSED HE LED LIGHT FIXTURE (VAPOR PROOF)
	LIGHT FIXTURE
	RECESSED LIGHT FIXTURE
	WALL MOUNTED LIGHT FIXTURE
	MOTION ACTIVATED LIGHT FIXTURE
	FLOOD LIGHT FIXTURE
	WALL SCONCE FIXTURE
	CORNER WALL SCONCE FIXTURE
	WALL MOUNTED STRIP FIXTURE
	EYEBALL LIGHT FIXTURE
	UNDER CABINET LIGHTING
	HANGING LIGHT FIXTURE
	COVE LIGHTING
	FLUORESCENT LIGHT FIXTURE
	LED LIGHT FIXTURE
	WALL WASH LIGHT
	FLOOR UPLIGHT
	SMOKE/CO DETECTOR interconnected w/ BATTERY BACK-UP SMOKE ALARM SHALL BE INTERCONNECTED HARD-WIRED WITH BATTERY BACKUP AND SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72
	110 V. OUTLET
	QUAD 110 V. OUTLET
	IN FLOOR OUTLET
	1/2 HOT TO SWITCH 110 V. OUTLET
	GROUND FAULT INTERCEPT
	220 V. OUTLET
	WEATHER PROOF 110V. OUTLET
	FLOOR OUTLET
	SINGLE POLE SWITCH
	2 WAY SWITCH
	3 WAY SWITCH
	MULTI WAY SWITCH
	AIR SWITCH
	OCCUPANCY SENSOR
	HUMIDSTAT SWITCH
	SWITCH W/ DIMMER
	PHOTOCONTROL AND AUTOMATIC TIME SWITCH CONTROL
	PUSH BUTTON
	EXHAUST FAN-CAPABLE OF 50 CFM MINIMUM, MAX 3 SONES
	RANGE HOOD - 10" Ø DUCT FROM KITCHEN HOOD. KITCHEN HOOD DIRECT VENT TO OUTDOOR
	CEILING FAN W/ LIGHTS
	CEILING FAN W/ OUT LIGHTS
	GAS STUB
	HOSE BIB
	GARAGE DOOR OPENER
	DISH WASHER SPECIAL CONNECTION
	TELEVISION CONNECTION
	CAT 5 CONNECTION (COMPUTER)
	PHONE CONNECTION
	PUSH BUTTON
	ELECTRIC SERVICE PANEL
	A/C DISCONNECT
	THERMOSTAT
	SPEAKER PRE-WIRE
	CAMERA PRE-WIRE
	EMERGENCY LIGHT
	EXIT LIGHT w/ ILLUMINATION/LIGHTS

Electrical Notes

- ANY NEW CIRCUITS TO BE APPLIED TO EXISTING ELECTRICAL PANEL
- ALL EXISTING ELECTRICAL TO REMAIN ALL ELECTRICAL SHOWN IS NEW
- VERIFY THAT SMOKE/CO DETECTORS MEET CURRENT CODE OR REPLACE WITH SMOKE/CO DETECTOR INTERCONNECTED THAT MEET UL1217
- ALL CIRCUITS TO BE GFI ON KITCHEN COUNTERS
- ALL RECEPTACLES MUST BE TAMPER-RESISTANT PER NEC 406.12(4)

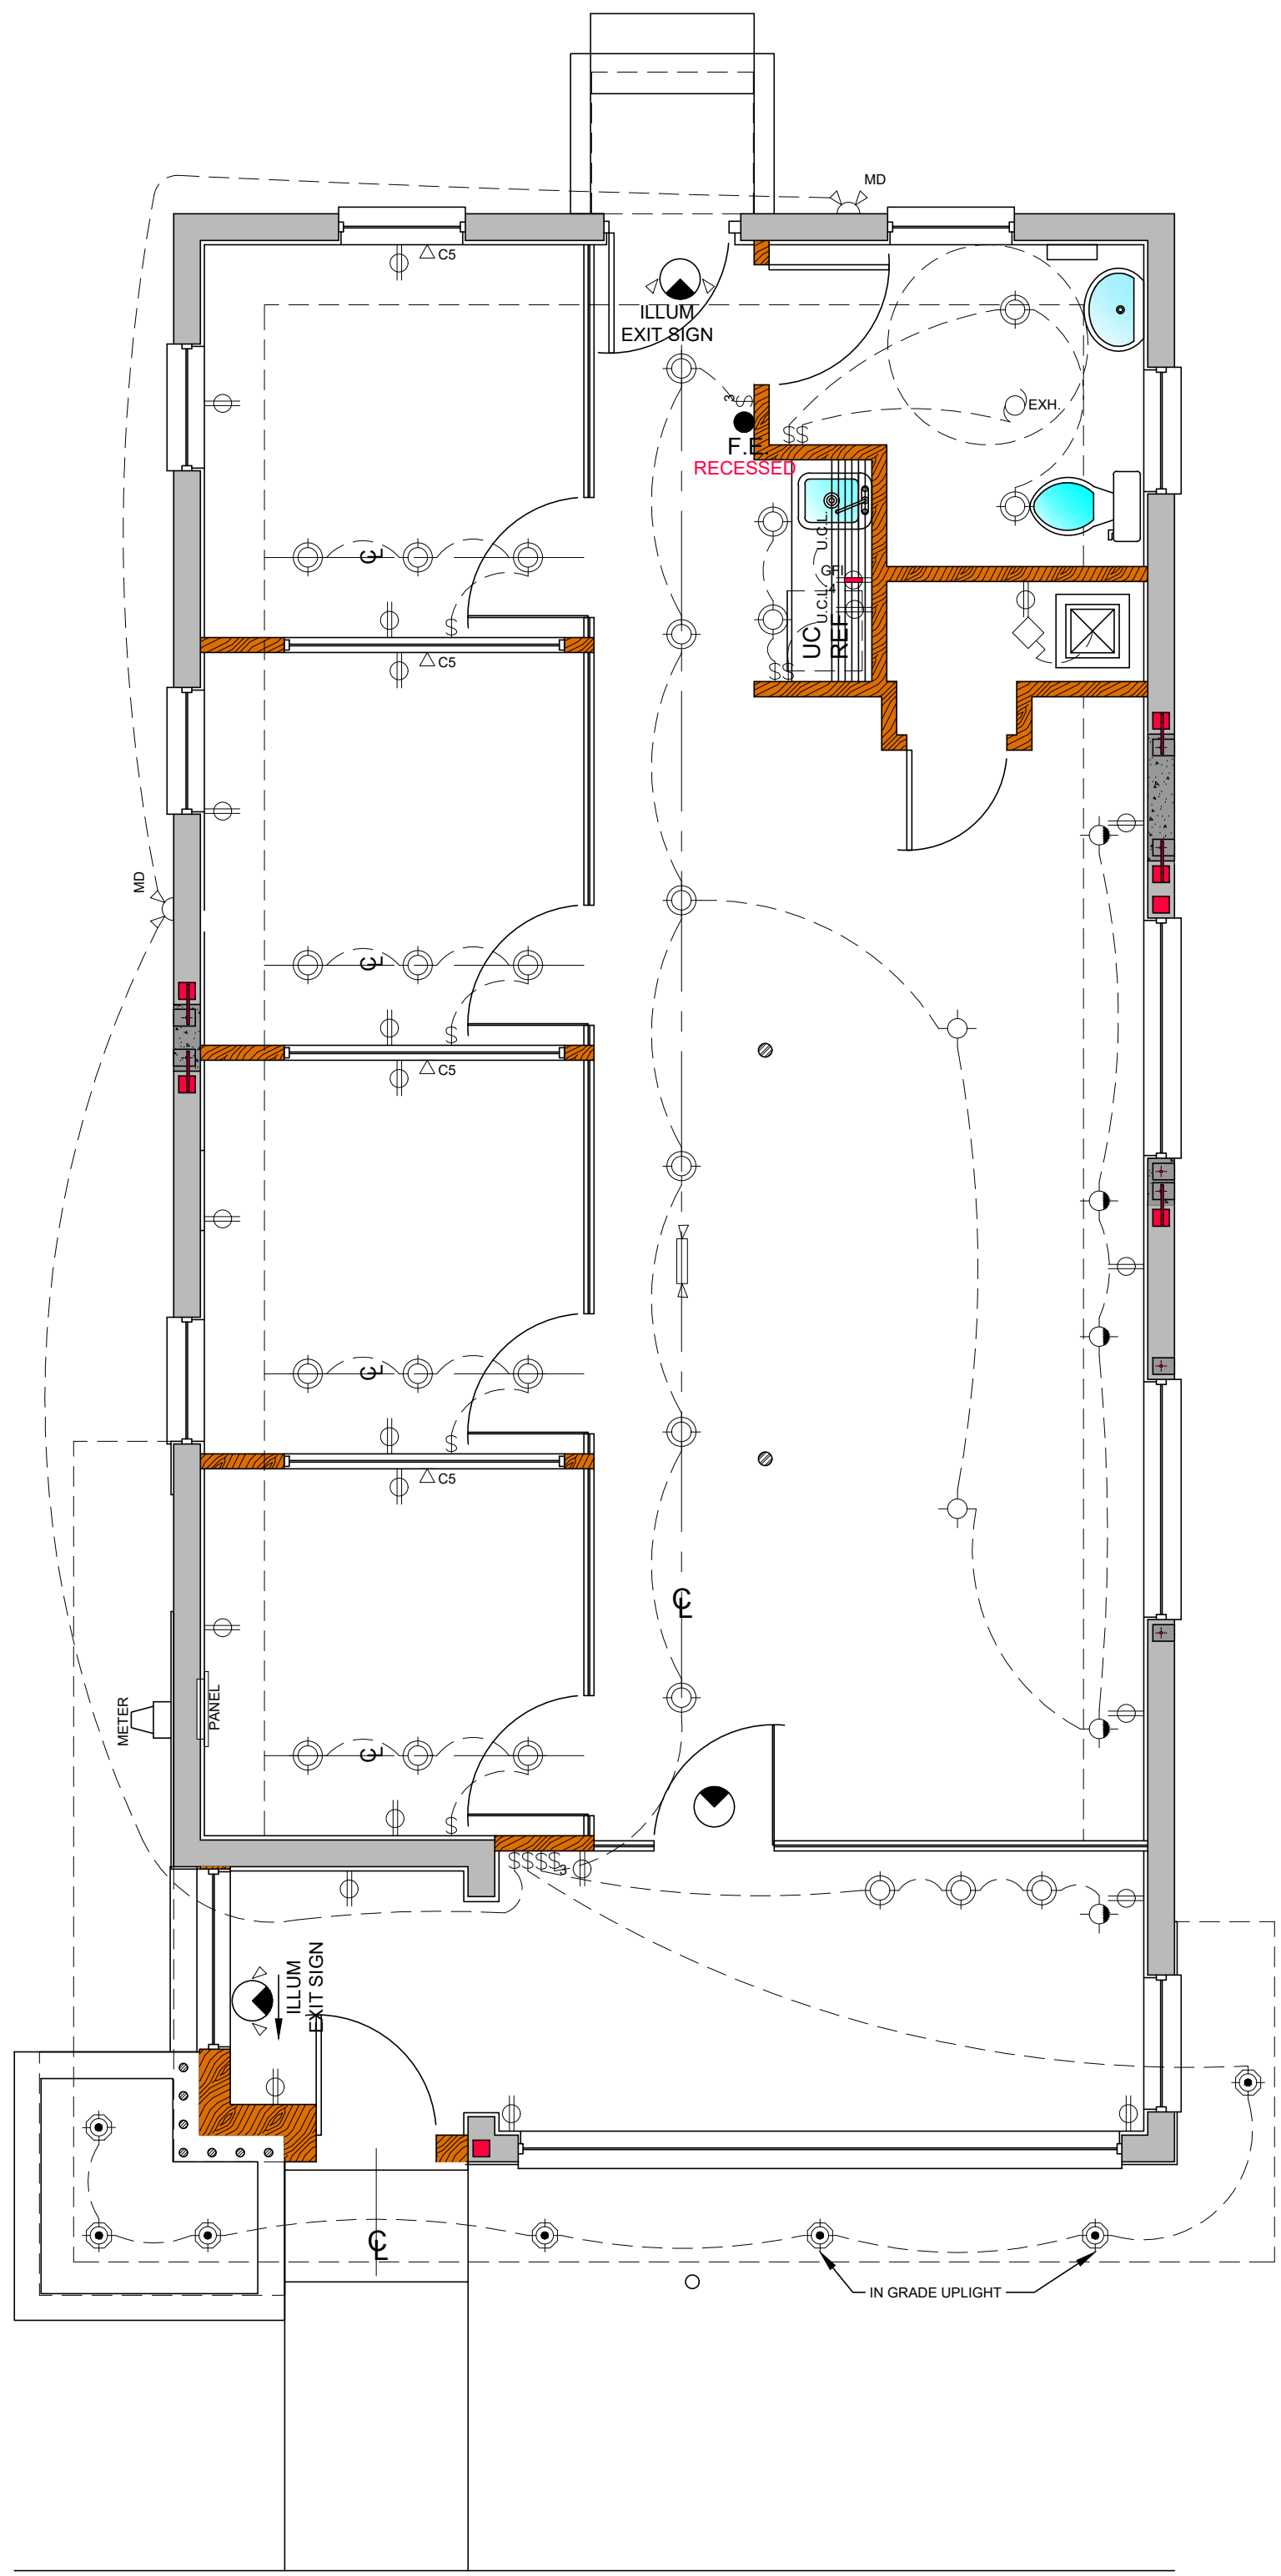

Electrical Floor Plan
Scale: 1/4" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Consultor shall verify all
conformance to drawings
prior to starting any
work. The consultant's
measurements are to be
verified by the client and
any discrepancies noted
by the client shall be
the attention of JAE Carbon
and shall be resolved prior
to commencement of any
construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755



REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS	
ELECTRICAL	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET E101	
OF 26 SHEETS	

Electrical Legend	
	4" RECESSED HE LED LIGHT FIXTURE
	4" RECESSED HE LED LIGHT FIXTURE (VAPOR PROOF)
	LIGHT FIXTURE
	RECESSED LIGHT FIXTURE
	WALL MOUNTED LIGHT FIXTURE
	MOTION ACTIVATED LIGHT FIXTURE
	FLOOD LIGHT FIXTURE
	WALL SCONCE FIXTURE
	CORNER WALL SCONCE FIXTURE
	WALL MOUNTED STRIP FIXTURE
	EYEBALL LIGHT FIXTURE
	UNDER CABINET LIGHTING
	HANGING LIGHT FIXTURE
	COVE LIGHTING
	FLUORESCENT LIGHT FIXTURE
	LED LIGHT FIXTURE
	WALL WASH LIGHT
	FLOOR UPLIGHT
	SMOKE/CO DETECTOR interconnected w/ BATTERY BACK-UP SMOKE ALARM SHALL BE INTERCONNECTED HARD-WIRED WITH BATTERY BACKUP AND SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72
	110 V. OUTLET
	QUAD 110 V. OUTLET
	IN FLOOR OUTLET
	1/2 HOT TO SWITCH 110 V. OUTLET
	GROUND FAULT INTERCEPT
	220 V. OUTLET
	WEATHER PROOF 110V. OUTLET
	FLOOR OUTLET
	SINGLE POLE SWITCH
	2 WAY SWITCH
	3 WAY SWITCH
	MULTI WAY SWITCH
	AIR SWITCH
	OCCUPANCY SENSOR
	HUMIDSTAT SWITCH
	SWITCH W/ DIMMER
	PHOTOCONTROL AND AUTOMATIC TIME SWITCH CONTROL
	PUSH BUTTON
	EXHAUST FAN-CAPABLE OF 50 CFM MINIMUM, MAX 3 SONES
	RANGE HOOD - 10" Ø DUCT FROM KITCHEN HOOD. KITCHEN HOOD DIRECT VENT TO OUTDOOR
	CEILING FAN W/ LIGHTS
	CEILING FAN W/ OUT LIGHTS
	GAS STUB
	HOSE BIB
	GARAGE DOOR OPENER
	DISH WASHER SPECIAL CONNECTION
	TELEVISION CONNECTION
	CAT 5 CONNECTION (COMPUTER)
	PHONE CONNECTION
	PUSH BUTTON
	ELECTRIC SERVICE PANEL
	A/C DISCONNECT
	THERMOSTAT
	SPEAKER PRE-WIRE
	CAMERA PRE-WIRE
	EMERGENCY LIGHT
	EXIT LIGHT w/ ILLUMINATION LIGHTS

Electrical Notes

- ANY NEW CIRCUITS TO BE APPLIED TO EXISTING ELECTRICAL PANEL
- ALL EXISTING ELECTRICAL TO REMAIN ALL ELECTRICAL SHOWN IS NEW
- VERIFY THAT SMOKE/CO DETECTORS MEET CURRENT CODE OR REPLACE WITH SMOKE/CO DETECTOR INTERCONNECTED THAT MEET UL1217
- ALL CIRCUITS TO BE GFI ON KITCHEN COUNTERS
- ALL RECEPTACLES MUST BE TAMPER-RESISTANT PER NEC 406.12(4)

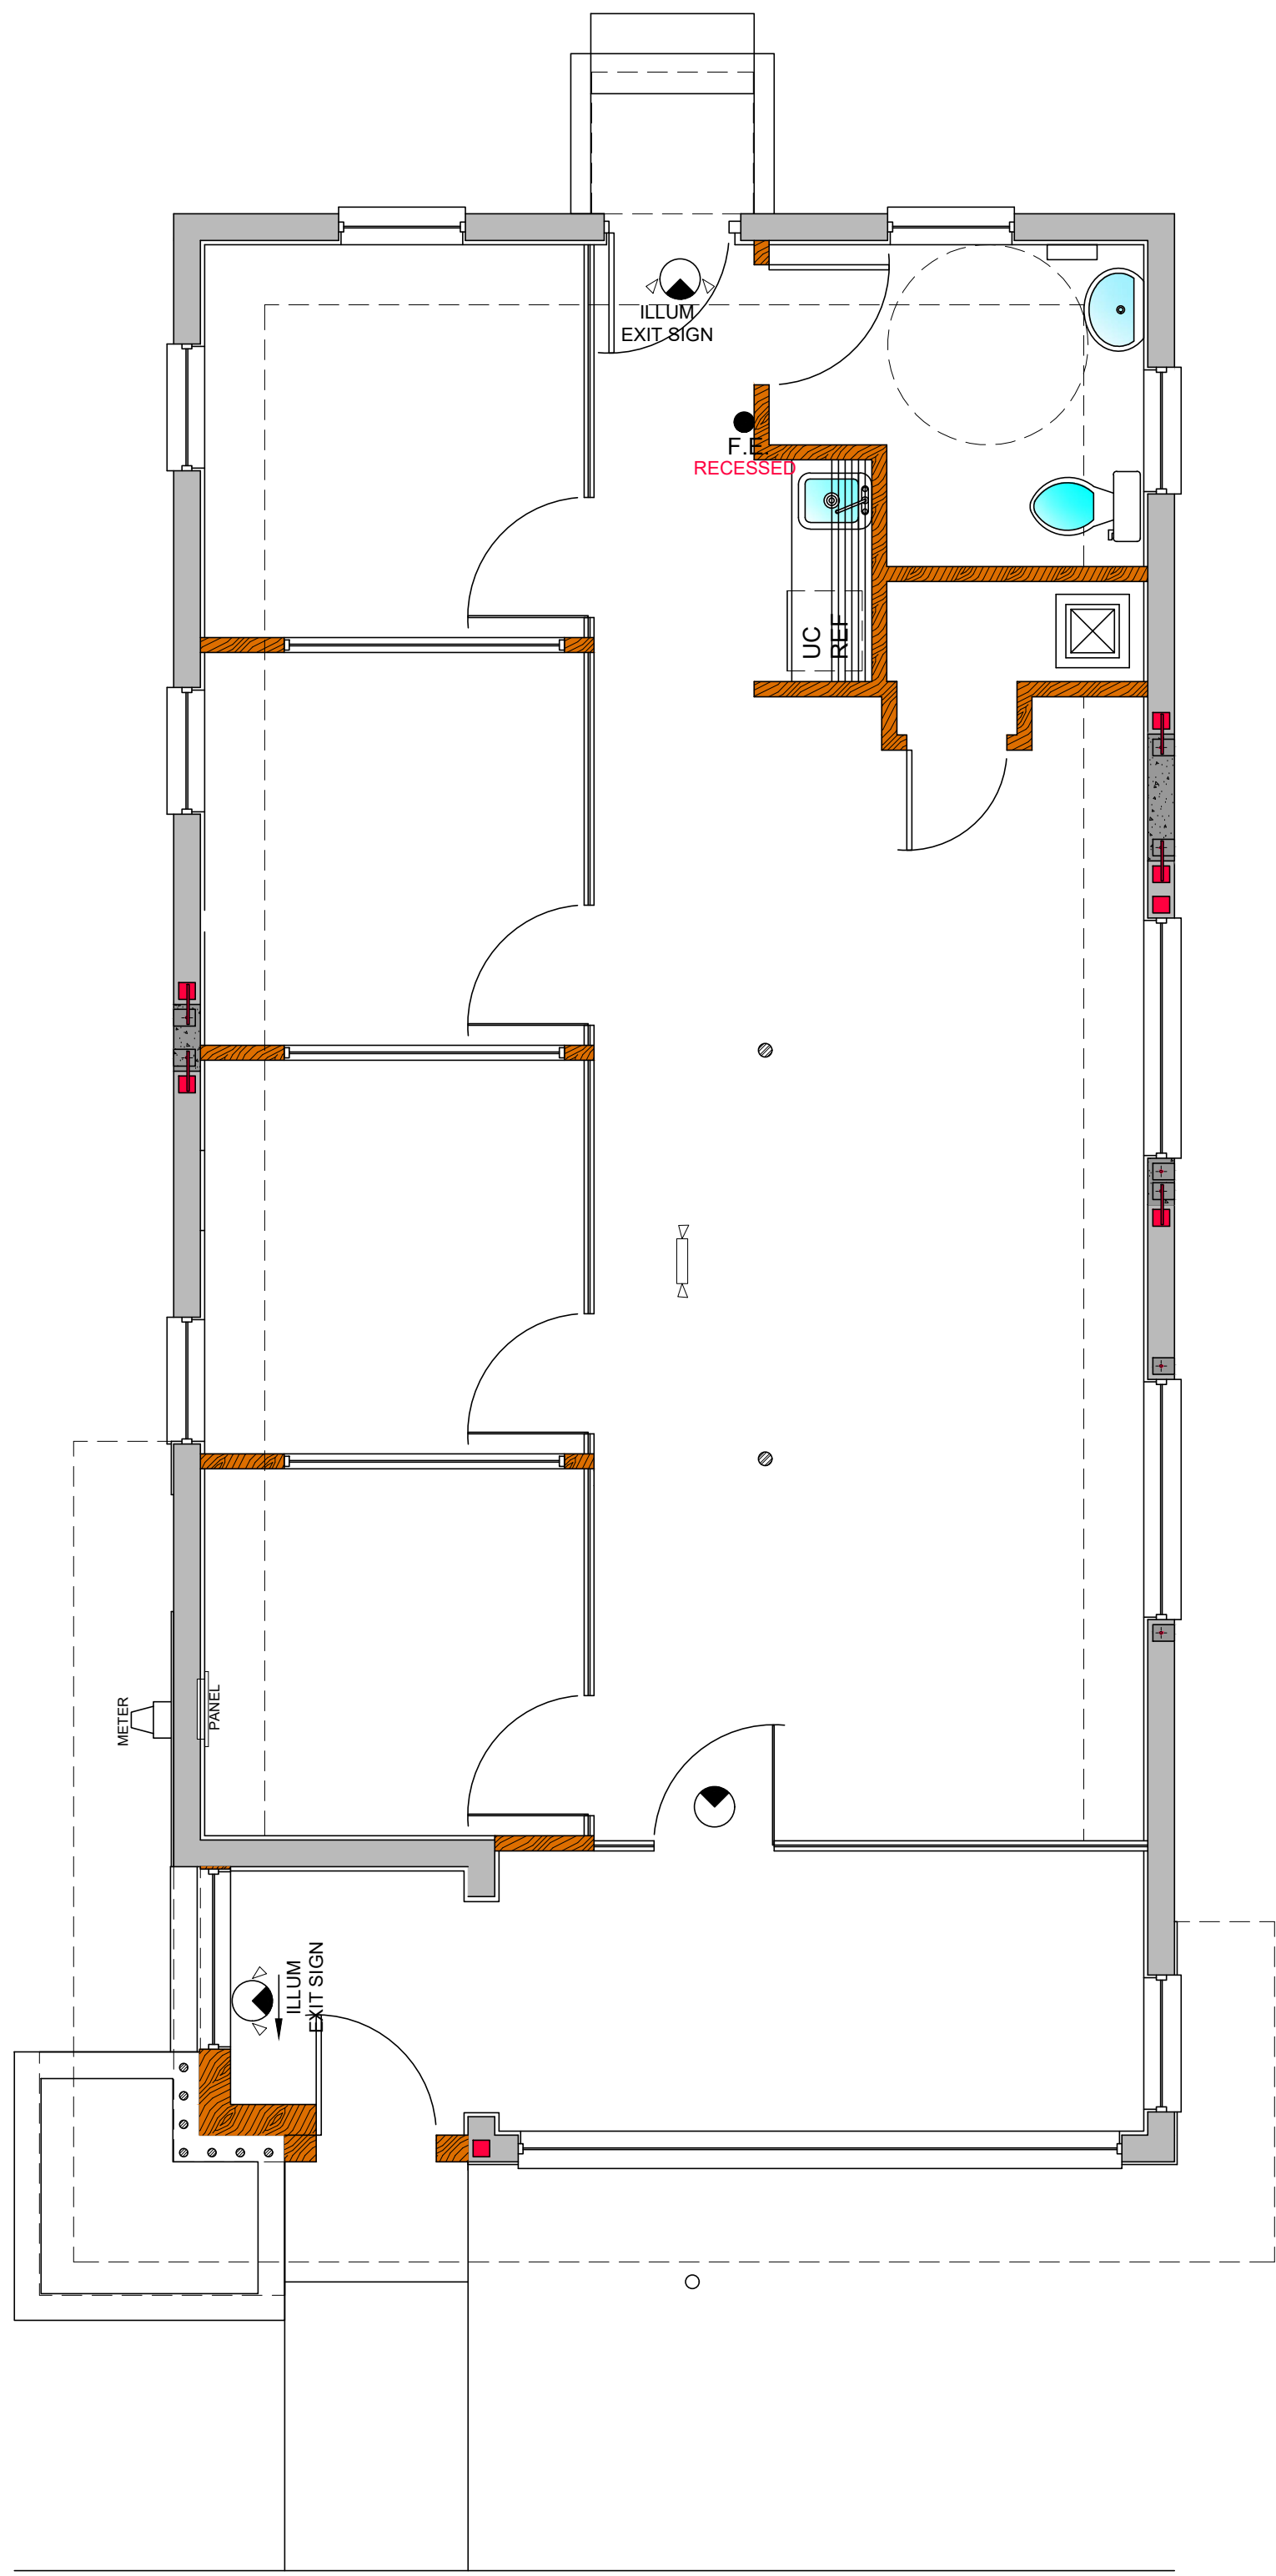

Electrical Emergency Lighting
Scale: 1/4" = 1'-0"

MARK ACCIANI
FLORIDA P.E. LICENSE #83929
P.O. Box 1390
RUNNING SPRINGS, CA 92382
PHONE (909) 286-6147
MARKACCIANI@YAHOO.COM

SIGNATURE & SEAL

Contractor shall verify all measurements and dimensions prior to starting any work. Any discrepancies and measurements are to be verified by the architect and any discrepancies shall be the attention of JAE Carbon Construction, Inc. and not the architect. No commitment of any construction or fabrication.

TRUE
BUILDING, INC.
CLEARWATER, FLORIDA

Project Title:
A Remodel For:
1171 NE Cleveland St,
Clearwater, FL
33755

REV	DATE	DESCRIPTION
1	XX-XX-XXXX	XX-XX
2		
3		
4		

SHEET CONTENTS	
ELECTRICAL	
DRAWN BY J.A.E.	
DATE 05/14/2026	
SCALE 1/4"= 1'-0"	
JOB	
SHEET E102	
OF 26 SHEETS	