




nicholas w nicholson
Digitally signed by nicholas w nicholson
Date: 2026.03.10 13:25:42 -04'00'

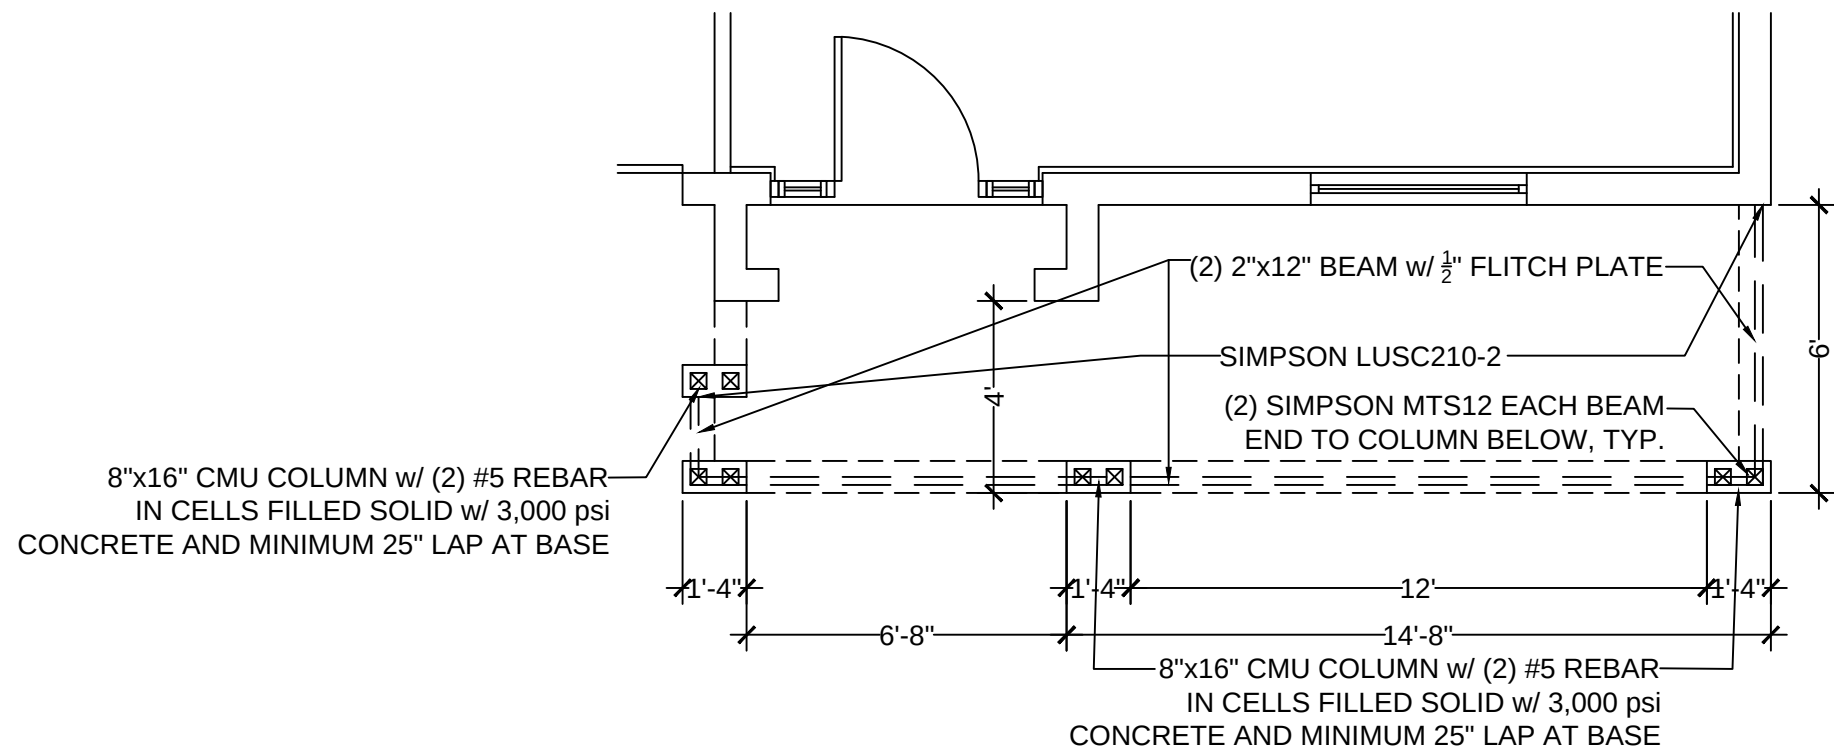


PROPOSED GROUND FLOOR PLAN

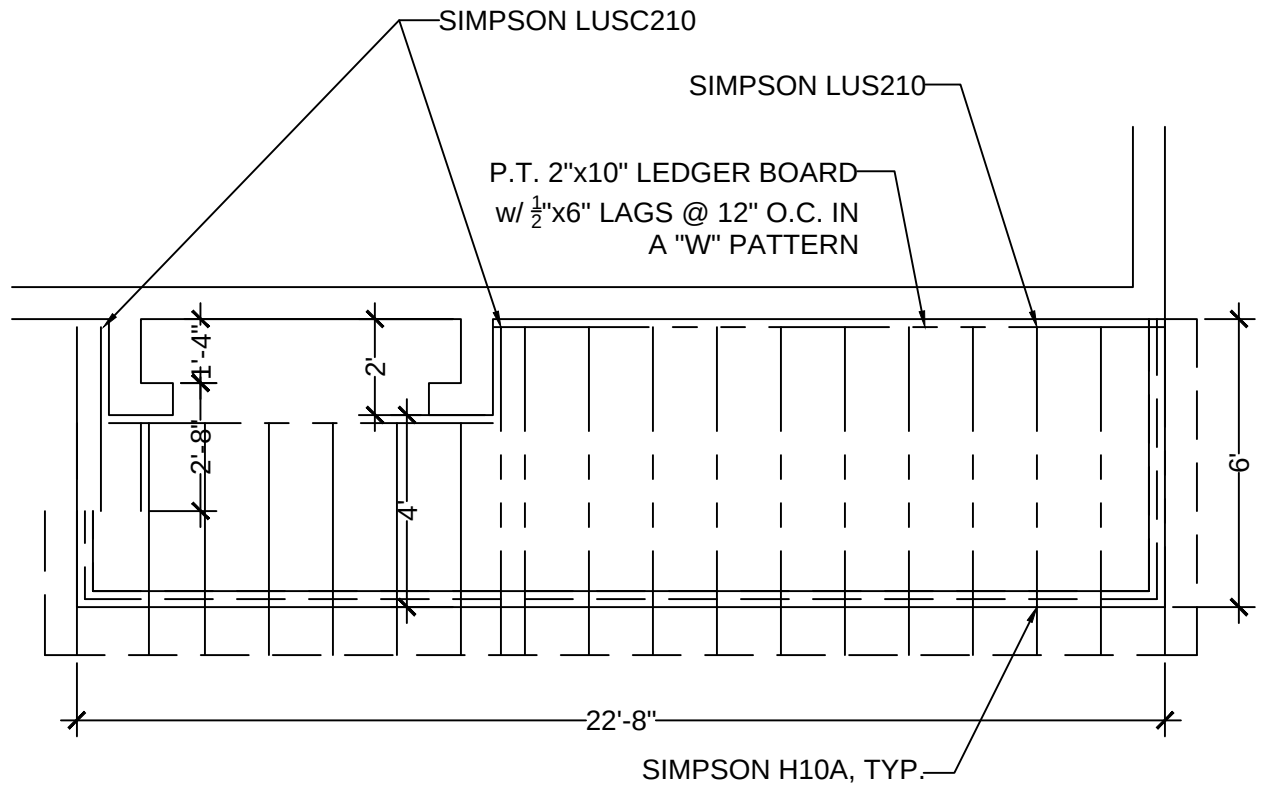

PROPOSED GROUND FLOOR FRAMING PLAN

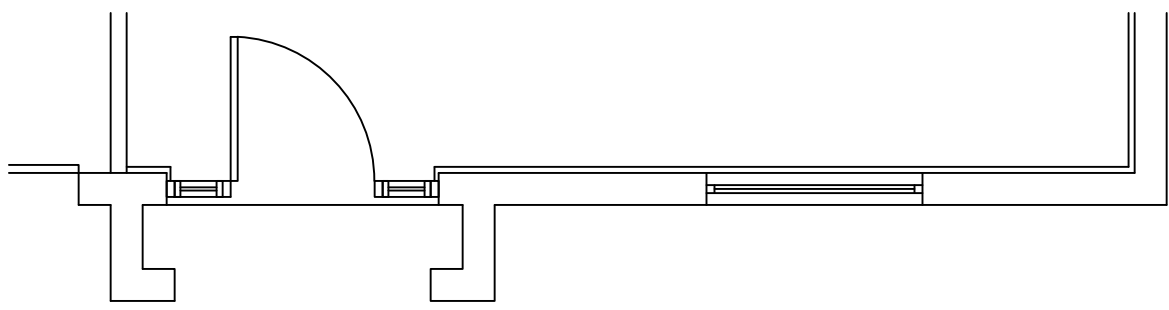


EXISTING GROUND FLOOR PLAN

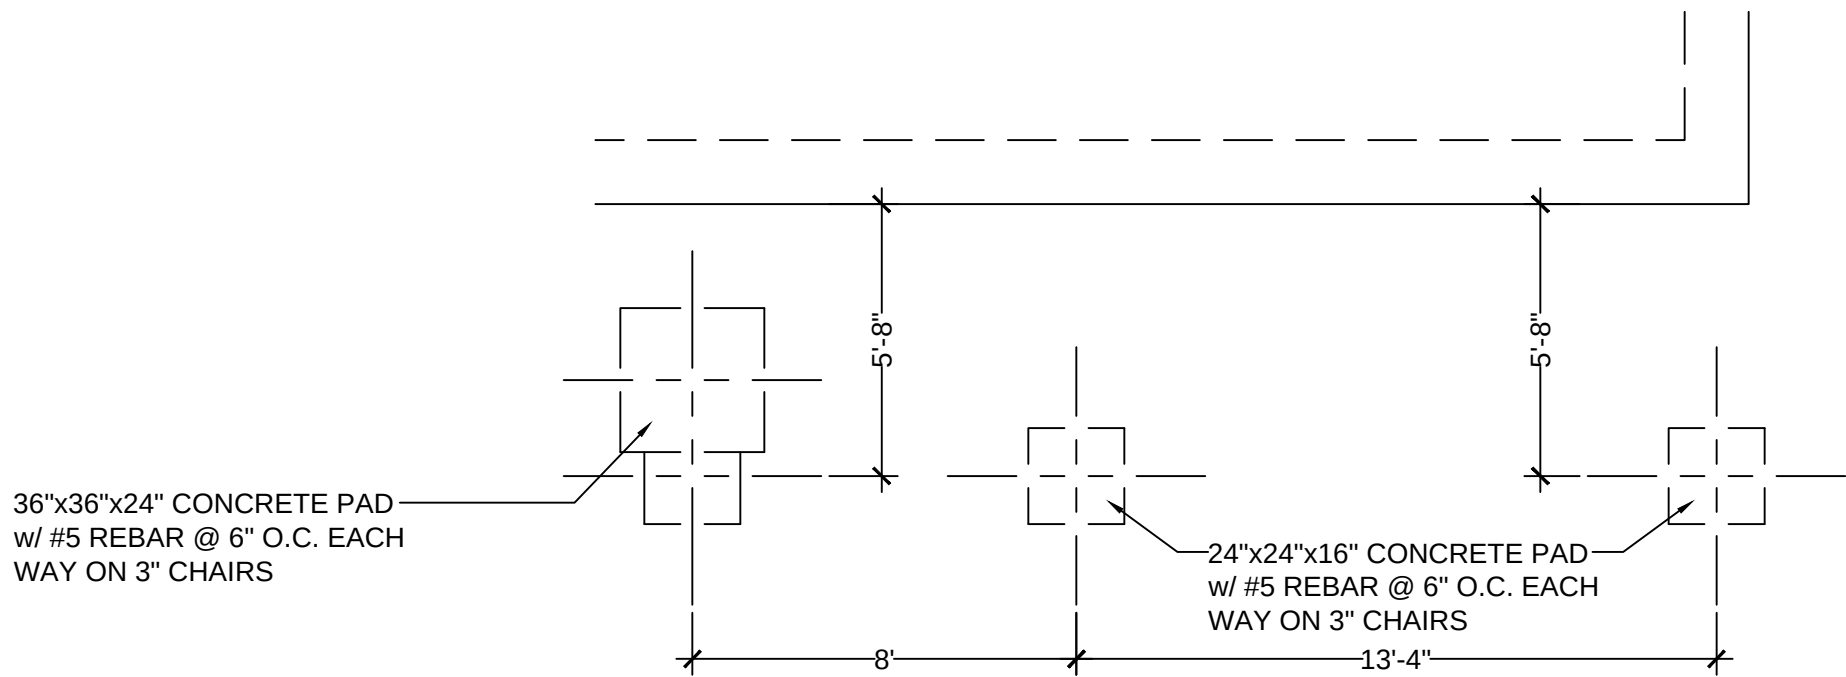


PROPOSED FOUNDATION PLAN


DATE		REVISION	
13163 SPRING HILL DRIVE SPRING HILL, FL 34609 P: 352-410-0189 ROBERT@AKDRAFTINGDESIGN.COM WWW.AKDRAFTINGDESIGN.COM A&K DRAFTING AND DESIGN DESIGN IS HOW IT WORKS NICHOLSON ENGINEERING ASSOC. INC. NICHOLAS W. NICHOLSON, P.E. 13163 SPRING HILL DRIVE, SPRING HILL, FLORIDA 34609 352-353-5240			
NEW ADDITION FOR: THE UZOHO RESIDENCE 11033 AUBURNDALE ST SPRING HILL, FLORIDA I hereby certify that this plan and specification were prepared by me or under my direct supervision. THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY: NICHOLAS W. NICHOLSON, P.E. ON THE DATE ADJACENT TO THE SEAL PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES. WILLIAM NICHOLSON LICENSE No. 37862 STATE OF FLORIDA PROFESSIONAL ENGINEER DATE: 1/12/26 SCALE: 1/4" TITLE: PLANS SHEET NO. 1 OF 3			

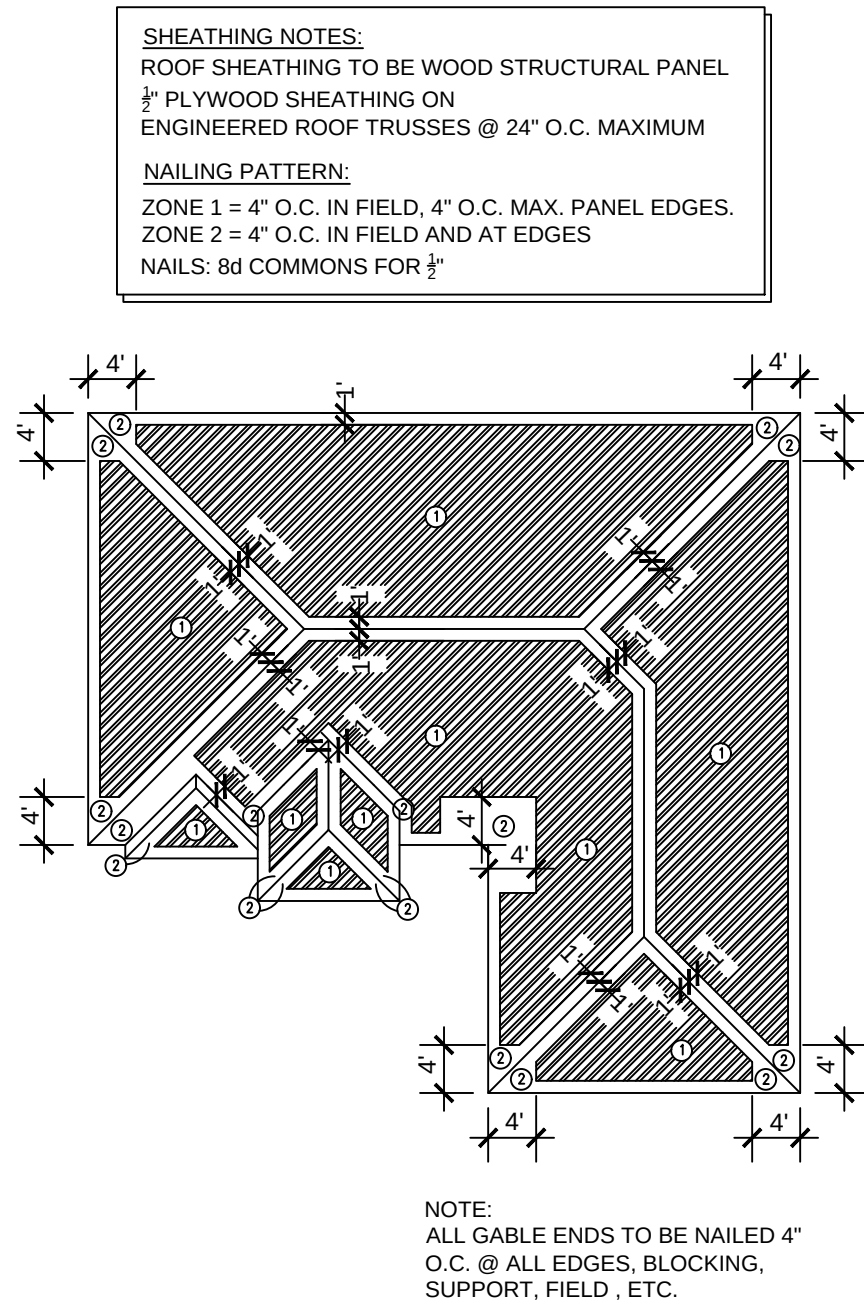

SHEATHING DETAIL

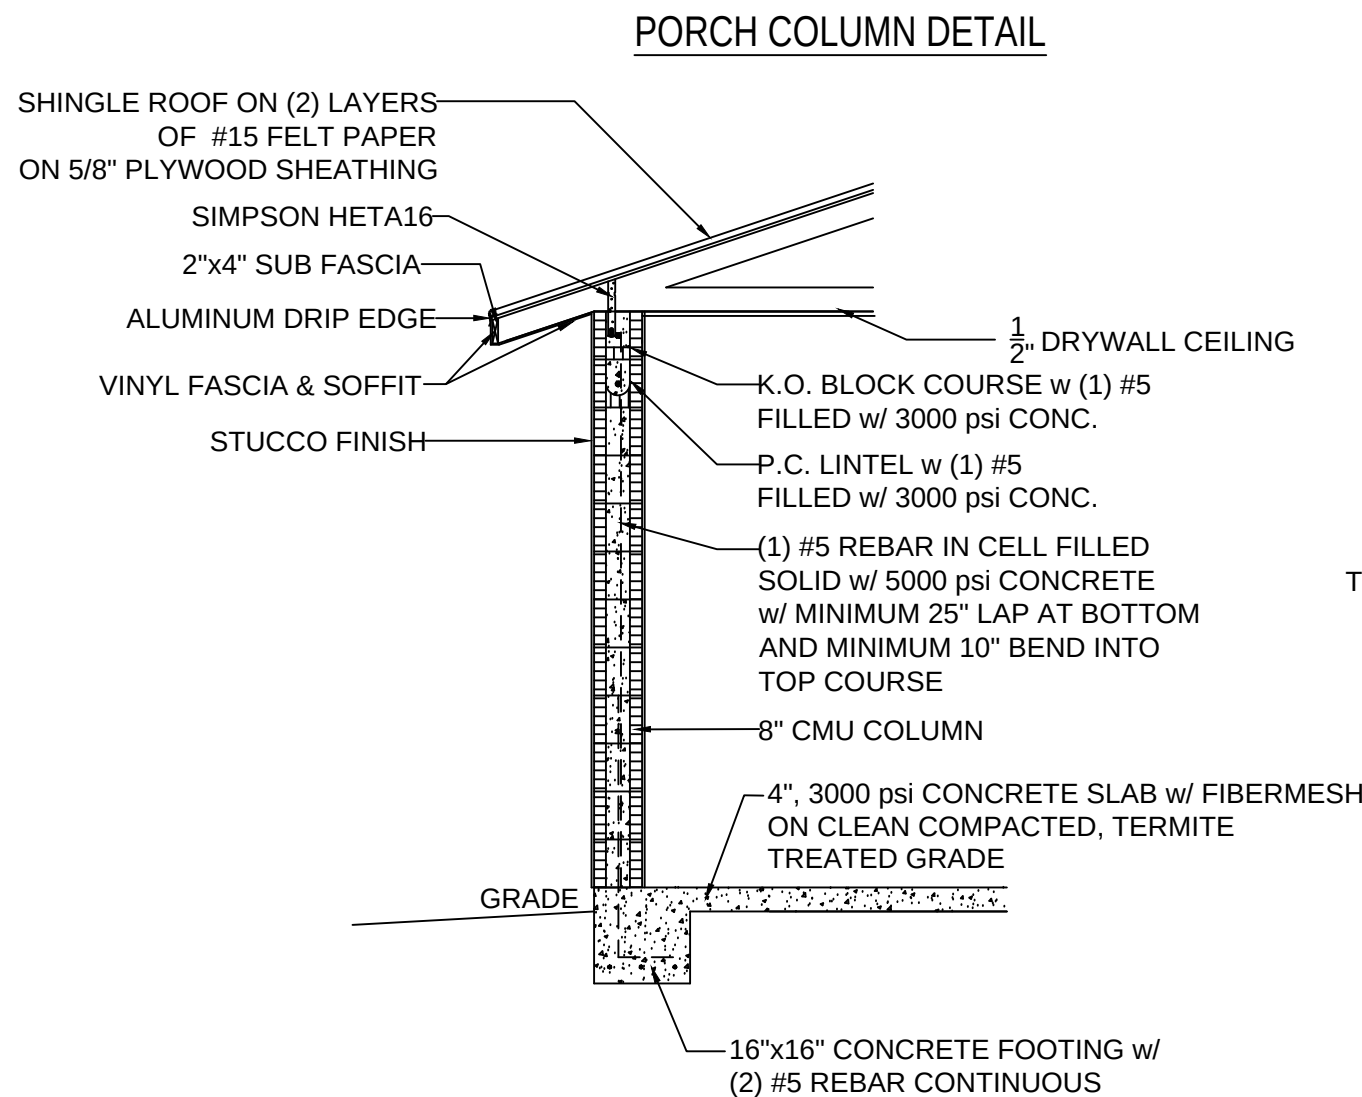


TYPICAL SINGLE STORY WALL SECTION

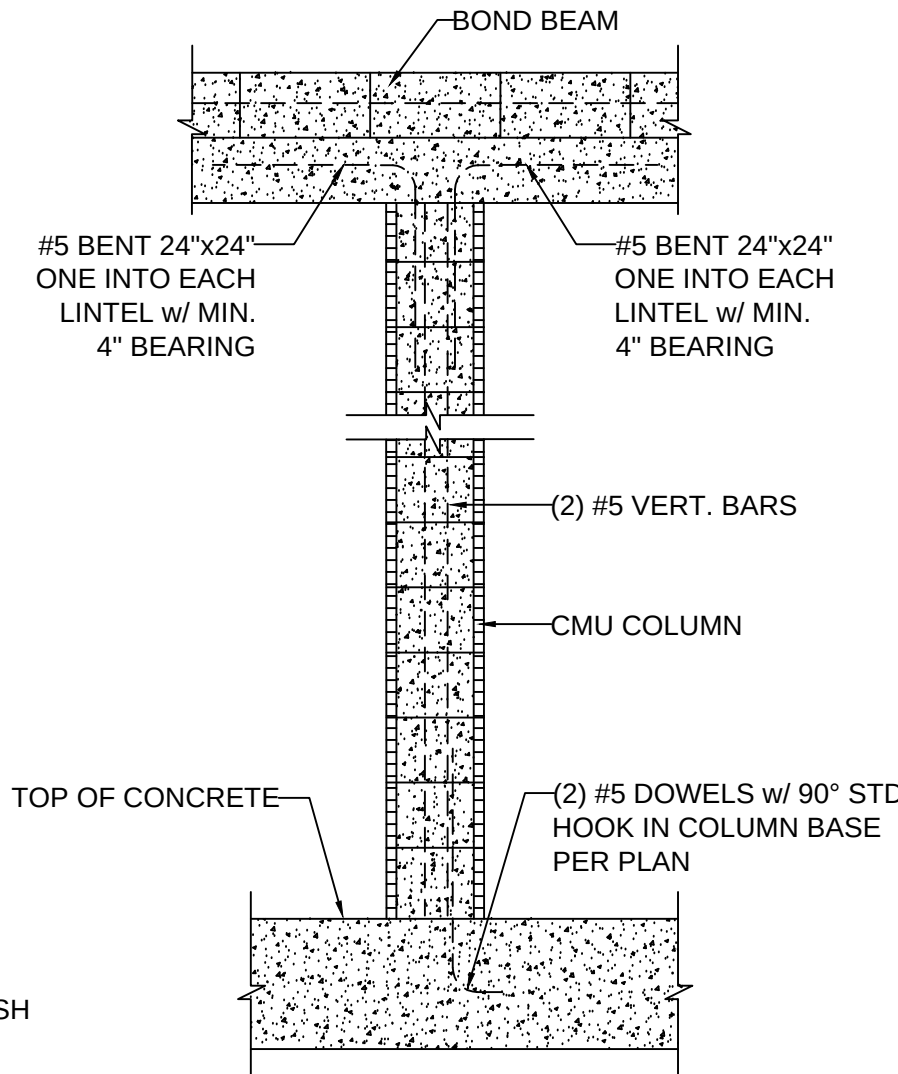


CONCRETE COLUMN DETAIL



PROPOSED FRONT ELEVATION

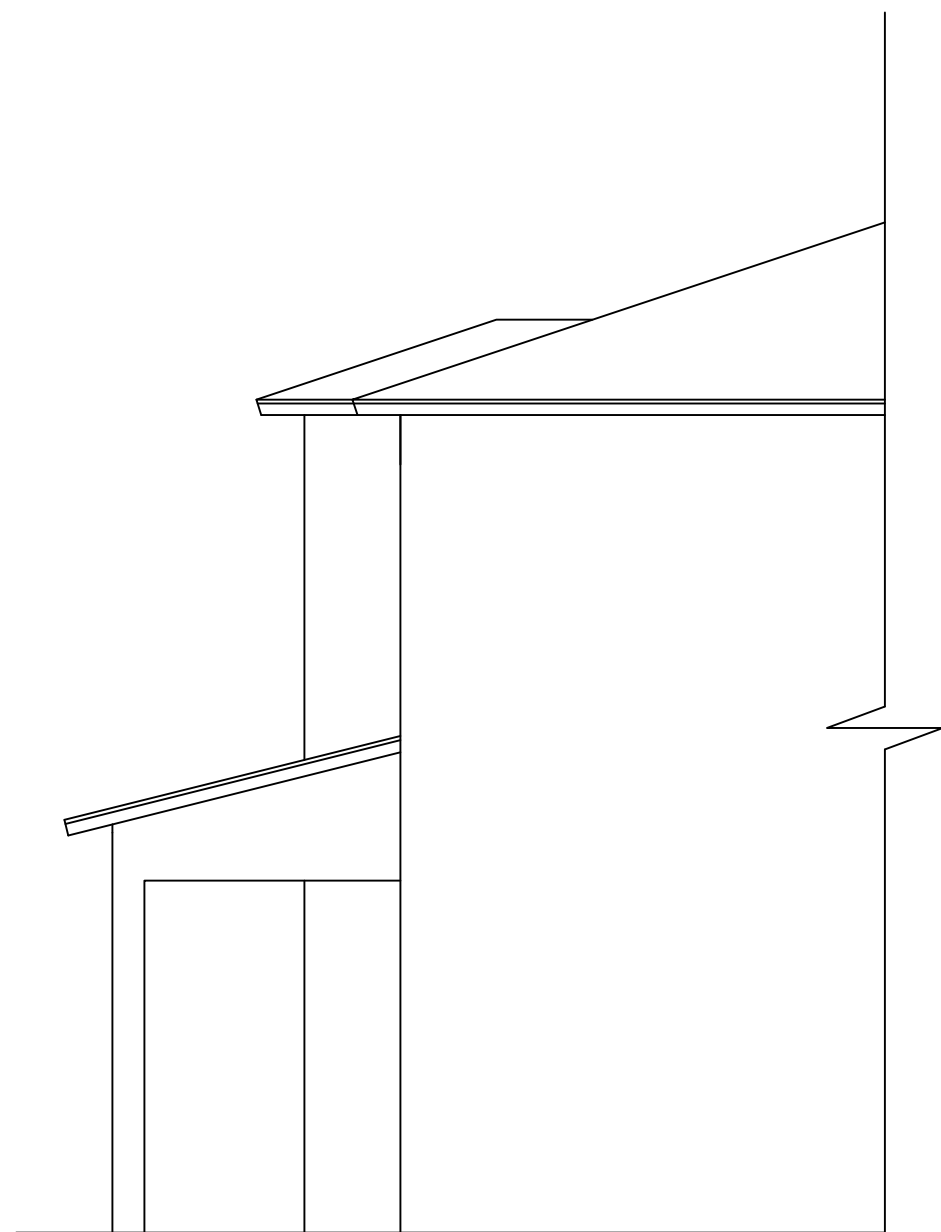


PROPOSED LEFT ELEVATION

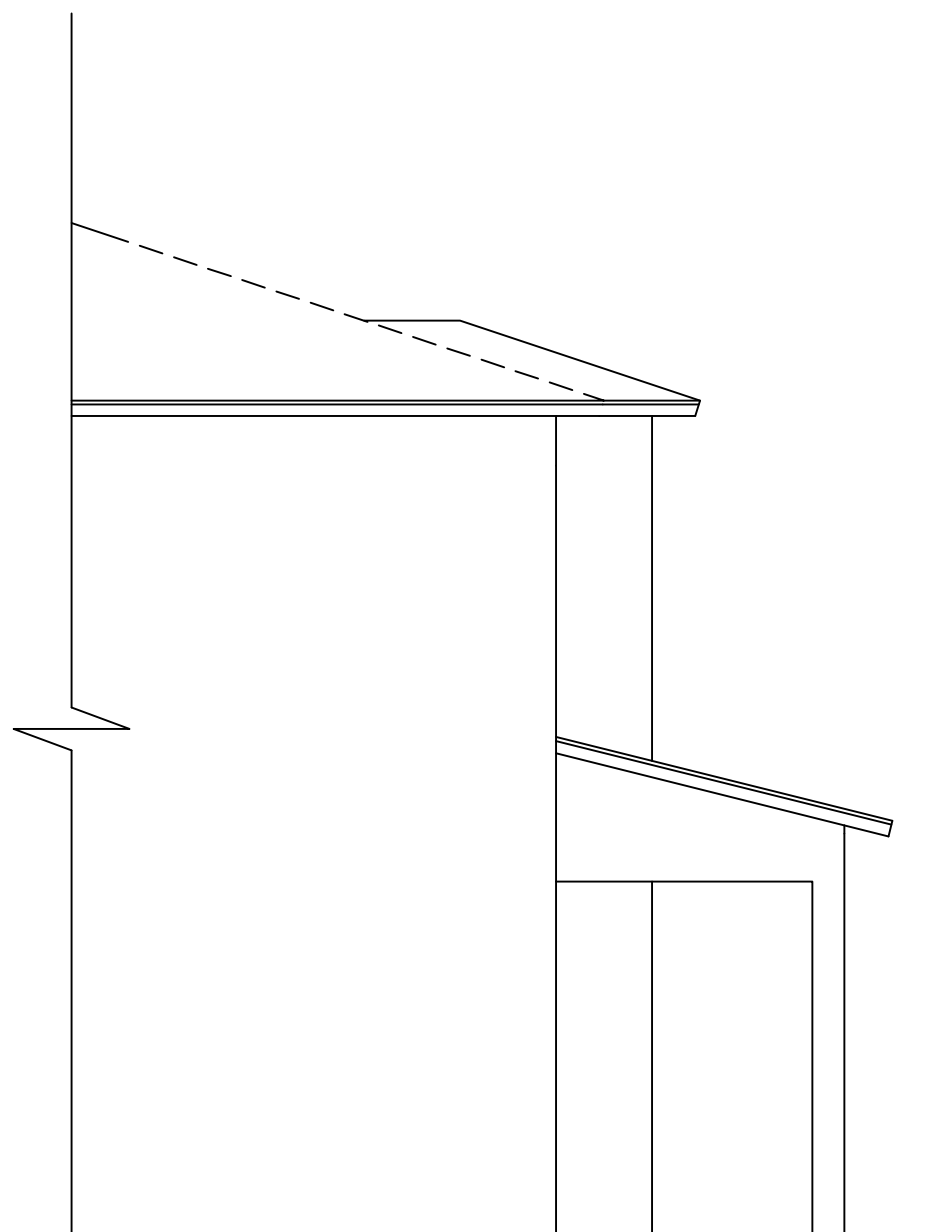

PROPOSED RIGHT ELEVATION

nicholas w nicholson


Digitally signed by
nicholas w nicholson
Date: 2026.03.10 13:25:50 -04'00'



DATE	REVISION
13163 SPRING HILL DRIVE SPRING HILL, FL 34609 P: 352-410-0199 ROBERT@AKDRAFTINGDESIGN.COM WWW.AKDRAFTINGDESIGN.COM	
A&K DRAFTING AND DESIGN DESIGN IS HOW IT WORKS	
NICHOLSON ENGINEERING ASSOC. INC. NICHOLAS W. NICHOLSON, P.E. FLORIDA LICENSE NO. 37862 13163 SPRING HILL DRIVE, SPRING HILL, FLORIDA 34609 352-353-5240	

NEW ADDITION FOR:
THE UZOHO RESIDENCE
11033 AUBURNDALE ST
SPRING HILL, FLORIDA

I hereby certify that this plan and specification
were prepared by me or under my direct supervision

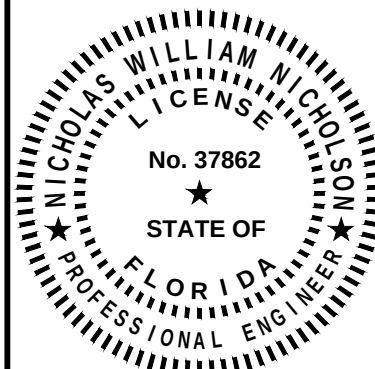

DATE: 1/12/26
SCALE: 1/4"
TITLE: ELEVATIONS

GENERAL DESIGN NOTES

PRESUMPTIVE LOAD-BEARINGS VALUES

Class Of Materials	Vertical Foundation Pressure	Lateral Bearing pressure (psf)/below natural grade)	Coefficient of friction	Cohesion (psf)
Crystalline Bedrock	12,000	1,200	0.70	
Sedimentary and foliated rock	4,000	400	0.35	
Sandy gravel, and or gravel (gw and dp)	3,000	200	0.35	
Sand, silty sand, clayey sand, silty gravel, clayey gravel, (SW,SP,SM,SC,GM,GC)	2,000	150	0.25	
Clay, sandy clay, silty clay, clayey silt, silt and sand silt.(CL,ML,MH,CH)	1,500	100		130

1. THE DESIGN LOAD BEARING VALUES OF THE SOILS HAVE BEEN TAKEN INTO ACCOUNT FOR THEDESIGN OF HE STRUCTURE . THE VALUES ARE SHOWN IN TABLE 1806.2 SEE NOTE 7 FOR COMPONENT AND CLADDING PRESSURES
2. COMPACTION TEST MUST BE ON SITE FOR THE FOOTER/SLAB INSPECTION (IF ANY FILL 12" OR MORE IS PUT ON THE PROPERTY UNDER THE SLAB) BEFORE AN INSPECTION CAN BE APPROVED
3. SOIL BEARING VALUE IS 2,000 P.S.F. UNLESS NOTED OTHERWISE.

PROJECT NOTES:

1. THE CONTRACTOR MAY SUBSTITUTE AN ANCHOR CONTAINED IN THESE PLANS. THE ANCHOR MUST MEET OR EXCEED:THE UPLIFT, F1, F2, & DEAD LOAD AS SPECIFIED IN THE MANUFACTURER'S CATALOG. FLORIDA PRODUCT APPROVAL IS REQUIRED.
4. CONVENTIONAL FRAMING SHALL BE A MIN. OF 2X8 #2 SPF W/ JUS28
5. ANCHORS AT RIDGE. RIDGE MATERIAL SHALL BE (2) 2X10 #2 SYP.
6. W/(1) MSTA21 STRAP @ TOP. UNLESS OTHERWISE NOTED.
7. NAILING SCHEDULE
SUB-FLOOR/WALL/ROOF NAILING SCHEDULE:
REG. 8D NAILS AT 4" O.C. ON EDGES & ENDS.
REG. 8D NAILS AT 8" O.C. ON INTERIOR.
CEILING NAILING SCHEDULE:
FOR DRYWALL IN END ZONES: MINIMUM 8" USE SCREWS
A MAXIMUM OF 7" O.C.
DRYWALL IN INTERIOR: 5D COOLER NAILS @ 7" O.C.
AT EDGES AND 8D NAILS AT 8" O.C. ON INTERIOR ENDS.
8. ALL BEAMS BY BUILDERS SHALL BE A MIN. OF 2- 2 X 12 UNLESS OTHERWISE NOTED. SEE SHEET S1 FOR ANCHOR CONNECTIONS.
10. WINDOWS AND DOORS SHALL BE INSTALLED AS PER MANUF. SPECIFICATIONS.
12. SOFFITS MATERIAL AND INSTALLATION SHALL MEET OR EXCEED FLORIDA PRODUCT APPROVAL REQUIREMENTS.
13. FOR GARAGE OPENINGS PER FBC-BUILDING TABLE 1609.6E (140 M.P.H., EXPOSURE B)
>50 FT²: USE -20.9 AND +18.5 (TYPICAL 9' x 7' DOOR)
>100 FT²: USE -19.7 AND +17.7 (TYPICAL 16' x 7' DOOR)
ALL OTHER OPENINGS USE WORST CASE CONDITION: USE - 25.9 AND + 21.5

NOTES:

1. EDGE STRIP IS 10% OF LEAST HORIZONTAL BUILDING DIMENSION OR 40% OF MEAN ROOF HEIGHT WHICHEVER IS LESS. BUT NOT LESS THAN EITHER 4% OF LEAST HORIZONTAL BUILDING DIMENSION OR 3". END ZONES SHALL BE TWICE THE WIDTH OF THE EDGE STRIP.
2. GARAGE CONCENTRATED LOAD ACTS ON AN AREA OF 20 IN.²
3. STAIR TREAD CONCENTRATED LOAD ACTS ON AN AREA OF 4 IN.²
4. BALUSTER LOAD ACTS HORIZONTALLY ON AN AREA NOT TO EXCEED 1 FT.²
- HANDRAIL LOADS ARE APPLIED AT THE TOP OF THE HANDRAIL IN ANY DIRECTION. HANDRAIL AND BALUSTER LOADS NEED NOT BE SUPERIMPOSED ON EACH OTHER.
5. DEAD LOADS USED ARE ACTUAL WEIGHTS OF MATERIALS AND CONSTRUCTIONS
6. BASED ON FBC APPENDIX A.
7. INTERNAL PRESSURE COEFFICIENTS SHALL BE 0.00 FOR OPEN, ±0.55 FOR PARTIALLY ENCLOSED, & ±0.18 FOR ENCLOSED BUILDINGS.
8. WIND BORNE DEBRIS REGIONS ARE AREAS WITHIN 1 MILE OF THE COAST WHERE WIND SPEEDS ARE 130 MPH & ALL AREAS WHERE WIND SPEEDS ARE 140+ PER ASCE 7-10, FIGURE 6-1.

A. FOUNDATION:

1. FOUNDATION IS DESIGNED BASED ON PRESUMPTIVE SAFE MINIMUM ALLOWABLE SOIL BEARING PRESSURE OF 3000 PSF. THE CONTRACTOR SHALL VERIFY THAT THE MINIMUM BEARING CAPACITY OF 3000 PSF IS PRESENT PRIOR TO FOOTING PLACEMENT.
2. ALL GRADE SHALL BE CLEAN COARSE SAND COMPACTED TO 98% BY HEAVY VIBRATORY ROLLER IN MAXIMUM LIFTS OF 8" CONFORM TO ASTM D 1557.
3. GRADING, SOIL PREPARATION AND FOUNDATION CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF THE GEOTECHNICAL REPORT AND THE FLORIDA BUILDING CODE 2023 EIGHTH EDITION.
4. FOOTING GRADE AND UTILITY TRENCH GRADE WITHIN BUILDING AREA SHALL BE MECHANICALLY COMPACTED IN LAYERS PER GEOTECHNICAL REPORT. FLOODING WILL NOT BE PERMITTED.
5. ABANDONED FOOTINGS, UTILITIES, ECT. THAT INTERFERE WITH NEW CONSTRUCTION SHALL BE REMOVED.
6. PROVIDE MIN 6 MIL. APPROVED VAPOR BARRIER. ALL JOINTS TO BE LAPPED MIN 6" AND SEALED.

E. CONCRETE:

1. CONCRETE SHALL CONFORM TO THE "BUILDING REQUIREMENTS FOR REINFORCED CONCRETE" (ACI 318 LATEST EDITION) WITH MODIFICATIONS AS NOTED IN THE DRAWINGS AND SPECIFICATIONS.
2. DESIGN BASED ON 3000 PSI, 28 DAY STRENGTH, UNLESS OTHERWISE NOTED.
3. PROTECTION COVER (CLEAR) SHALL BE AS FOLLOWS (U.N.O):
- a. CONCRETE PLACED AGAINST EARTH - 3 INCHES CLEAR
- b. STRUCTURAL SLABS ON GROUND - 1.5 INCHES CLEAR
- c. FORMED CONCRETE WITH EARTH BACKFILL - 3 INCHES CLEAR
- d. WELDED WIRE MESH (WWW) USED IN SLABS SHALL BE FULLY SUPPORTED USING CHAIR APPROVED BY THE MANUFACTURE AT MINIMUM OF 2 FOOT SPACING OR IN ACCORDANCE WITH MANUFACTURES SPECIFICATIONS.
4. CONTRACTION JOINTS SHALL BE CUT OR TOOLED IN THE SLAB 1/3 THE SLAB THICKNESS. ALL SAW CUTS ARE TO BE MADE WITHIN 24 HOURS OF THE CONCRETE PLACEMENT.

BUILDING CODE REFERENCES

FBC 2023 EIGHTH EDITION
FBCR 2024 EIGHTH EDITION
2023 FLORIDA BUILDING CODE ACCESSIBILITY
2023 FLORIDA BUILDING CODE ENERGY
2023 FLORIDA BUILDING CODE MECHANICAL
2023 FLORIDA BUILDING CODE PLUMBING
ASCE 7-22 STANDARDS

F. MASONRY WALL CONSTRUCTION:

1. MASONRY UNITS SHALL MEET ASTM C-90, GRADE N-1 FOR HOLLOW LOAD BEARING TYPE II MASONRY WITH UNIT STRENGTH OF 1,900 PSI ON THE NET AREA (F'M = 1,500 PSI). UNITS SHALL BE NORMAL WEIGHT 8"X8"X16", TWO HOLES, SQUARE END BLOCKS UNLESS NOTED OTHERWISE. UNITS SHALL HAVE A ROUGH TEXTURE FOR STUCCO APPLICATION.
2. ALL MORTAR SHALL CONFORM TO ASTM C 270, TYPE "S" OR "M".
3. COURSE GROUT SHALL CONFORM TO ASTM C476 WITH A MAXIMUM AGGREGATE SIZE OF 3/8" AND A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.
4. VERTICAL REINFORCEMENT SHALL BE AS NOTED ON THE DRAWINGS, WITH FILLED CELLS FILLED WITH COURSE GROUT.
5. VERTICAL REINFORCEMENT SHALL BE HELD IN POSITION AT THE TOP AND THE BOTTOM AND AT A MAXIMUM SPACING OF 8'-0" UNLESS OTHERWISE NOTED. REINFORCEMENT SHALL BE PLACED IN THE CENTER OF THE MASONRY CELL, TYPICAL, UNLESS OTHERWISE NOTED.
6. REINFORCING STEEL SHALL BE LAPPED A MINIMUM OF 30 INCHES UNLESS NOTED OTHERWISE ON THE DRAWINGS.
7. HOOKS AT TOP AND BOTTOM OF VERTICAL REINFORCING BARS TO BOND COURSE AND FOOTING TO BE NO LESS THAN 12 BAR DIAMETERS, EXCLUDING BEND.
8. EXPANSION TYPE ANCHORS ARE NOT TO BE USED IN BOND COURSE, EMBEDDED ANCHORS OR EPOXY FASTENED STUDS SHALL BE USED.
9. ALL MASONRY UNITS SHALL BE LAID IN RUNNING BOND UNLESS NOTED OTHERWISE.
10. OVER ALL MASONRY OPENINGS IN WALLS PROVIDE LINTELS, CAST-IN-PLACE CONCRETE BEAMS, OR OTHER HEADERS AS NOTED ON PLANS.

11. VERTICAL FILLED CELLS SHALL HAVE A MINIMUM OF (1) #5 REBAR LAPPED AND TIED TO THE FOUNDATION DOWEL, AND A STANDARD ACI HOOK AT THE TOP, LAPPED AND TIED TO THE HORIZONTAL REINFORCING IN THE TOP OF THE WALL. SEE CHART BELOW FOR MINIMUM LAP AND HOOK LENGTHS.
12. HORIZONTAL JOINT REINFORCING (WIRE TYPE WITH 9 GAUGE EQUAL TO DUR-O-WAL) SHALL BE PLACED AT 16" O.C. VERTICALLY AND SHALL EXTEND ATLEAST 6" INTO VERTICAL COLUMNS OR PILASTERS. HORIZONTAL REINFORCEMENT SHALL NOT BE CONTINUOUS ACROSS CONTROL JOINTS AND SHALL BE PLACED FULLY EMBEDDED IN FACE-SHELL MORTAR
13. BEDS FOR THEIR ENTIRE LENGTH (MINIMUM MORTAR COVER OF 3/8").

THE FINAL SELECTION OF ANY CONCRETE LINTEL WILL BE VERIFIED BY THE EOR AFTER TRUSS ENGINEERING AND LAYOUT PROVIDED BY ROOF AND FLOOR SYSTEM ENGINEER.

G. REINFORCING STEEL:

1. WALL BARS AND COLUMN BARS SHALL CONFORM TO ASTM A-615, GRADE 60. FOOTING BARS AND BOND BEAM BARS SHALL CONFORM TO ASTM A-615, GRADE 60.
2. BAR BENDS SHALL BE MADE COLD, IN STRICT ACCORDANCE WITH THE DRAWINGS AND C.R.S.I. LATEST EDITION. NO KINKS ALLOWED. SEE CHART FOR STANDARD HOOK SIZES.
3. REBAR LAP SPLICES ARE TO BE: CLASS "B" MINIMUM LAP LENGTH SHALL BE PER CHART UNLESS NOTED OTHERWISE. MINIMUM LAP OF WELDED WIRE FABRIC SHALL BE 6 INCHES OR ONE FULL AND HALF MESH, WHICHEVER IS GREATER.
4. FIELD WELDING OF REINFORCING BARS IN NOT PERMITTED, UNLESS NOTED OTHERWISE
5. DOWELS BETWEEN FOOTINGS SHALL BE THE SAME SIZE AND SPACING OR NUMBER AS THE HORIZONTAL REINFORCING.
6. DOWELS BETWEEN FOOTING AND WALLS OR COLUMNS SHALL BE THE SAME SIZE AND SPACING OR NUMBER AS THE VERTICAL REINFORCEMENT.

H. WOOD FRAMING:

1. FRAMING LUMBER SHALL BE SURFACE DRY AND HAVE A MAXIMUM MOISTURE CONTENT WHEN USED OF 19%. ALLOWABLE STRESS REQUIREMENTS OF ALL WOOD MEMBERS SHALL BE IN ACCORDANCE WITH THE 2001 EDITION OF THE NDS SUPPLEMENT TABLES 4A, 4D AND 5A.
2. ALL FRAMING LUMBER USED FOR EXTERIOR WALLS SHALL BE SOUTHERN PINE NUMBER 2 OR BETTER @ 16" O.C. MAX. LUMBER IN CONTACT WITH GROUND, CONCRETE, OR MASONRY SHALL BE SOUTHERN PINE PRESSURE TREATED. ENGINEERED LUMBER SHALL BE I-LEVEL PRODUCTS OR EQUAL. TYPE, SIZE PER PLANS. FB = 3,100 PSI MINIMUM
3. WOOD STUDS FOR INTERIOR LOAD BEARING WALLS SHALL BE SPRUCE PINE FIR (SPF) OR BETTER AT 16" O.C. AND WOOD OR METAL STUDS FOR NON-LOAD BEARING WALLS SHALL BE 24" (MAX) ON UNLESS NOTED OTHERWISE ON WALL FRAMING.
4. WALL FRAMING:
- a. FOR 2X4 STUD WALL PROVIDE: (1) 2X4 KING STUD AND (1) 2X4 TRIMMER AT EACH END OF (2) PLY HEADER, UNLESS NOTED OTHERWISE.
- b. FOR 2X6 STUD WALL PROVIDE: (1) 2X6 KING STUD AND (1) 2X6 TRIMMER AT EACH END OF (3) PLY HEADER, UNLESS NOTED OTHERWISE.
- c. ADD DOUBLE 2X STUDS UNDER BEARING POINTS OF GIRDER TRUSSES OR BEAMS, UNLESS NOTED OTHERWISE. AT MULTIPLE 2X STUDS OR TRIMMERS, USE FACE NAIL 16D G.N. AT 8" O.C. FOR EACH, UNLESS NOTED OTHERWISE.
- d. ALL BEAMS AND HEADERS, DIMENSIONAL AND ENGINEER WOOD, SHALL BE A MINIMUM OF (2) PLY UNLESS NOTED OTHERWISE.
- e. ALL TOP LOADED BEAMS AND HEADERS SHALL BE NAILED WITH (3) ROWS 16D GUN NAILS OR 12D COMMON NAILS (MIN) AT 12" O.C. UNLESS NOTED OTHERWISE.

5. STUCCO INSTALLED ON WOOD FRAMED WALLS SHALL BE INSTALLED PER 2023 FBC EIGHTH EDITION, FBCR, ASTM C926 AMD ASTM C1063.
6. THE FINAL SELECTION OF ANY WOOD FRAMED HEADER WILL BE VERIFIED BY THE EOR AFTER TRUSS ENGINEERING AND LAYOUT PROVIDED BY ROOF AND FLOOR SYSTEM ENGINEER.

I. PREFABRICATED WOOD TRUSSES & FLOOR JOISTS:

1. THE ROOF PLAN DEPICTED IS NOT INTENDED TO SERVE AS A TRUSS DESIGN. SEE THE TRUSS ENGINEERING AND LAYOUT PROVIDED BY THE DELEGATED ROOF AND FLOOR SYSTEMS ENGINEER.
2. TOP PLATE HEIGHTS MAY VARY. SEE BUILDING SECTIONS, WALL SECTIONS AND ELEVATIONS FOR BEARING HEIGHTS.
3. TRUSS SPACING SHALL BE 24" O.C. MAX UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHALL BE 16 INCHES O.C. MAX UNLESS NOTED OTHERWISE.
4. FRAME WALLS UP TO UNDERSIDE OF ROOF TRUSSES AT ALL NON-BEARING WALLS AND AT VOLUME AREA UNLESS NOTED OTHERWISE.
5. ALIGN TRUSSES AND HAND FRAMING SO ALL GYPSUM WALL BOARD WILL BE CONTINUOUS FROM FLOOR TO CEILING. ENSURE TRUSSES AND WALL FRAMING ARE LEVEL TO PREVENT BOWING OR WAVING OF GYPSUM WALL AND CEILING BOARD.
6. PROVIDE BRACING AND BLOCKING PER HIB-91 IN ADDITION TO BRACING AND BLOCKING SHOWN ON TRUSS LAYOUTS PROVIDED BY THE DELEGATED TRUSS SYSTEM ENGINEER.
7. PROVIDED APPROVED MOISTURE BARRIER AT ALL CONTACT POINTS BETWEEN TRUSS / NON-P.T. WOOD AND MASONRY.
8. ROOF TRUSSES SHALL BE DESIGNED FOR A 10 PSF NON-CONCURRENT BOTTOM CHORD LIVE LOAD.
9. ALL ROOF TRUSS AND FLOOR JOIST CONNECTIONS TO BE VERIFIED AFTER TRUSS ENGINEERING AND LAYOUT PROVIDED BY ROOF AND FLOOR SYSTEM ENGINEER.

J. ROOFING:

1. ALL ROOF UNDERLAYMENT APPLICATIONS WILL FOLLOW 2023 FBC EIGHTH EDITION SECTION 1507.2.8 AND R905.2.7.
2. CONTRADICTIONS:
3. IN THE EVENT OF CONTRADICTIONS BETWEEN DRAWINGS NOTES AND THE SPECIFICATIONS ON THIS SHEET THE ENGINEER OF RECORD IS TO BE NOTIFIED IMMEDIATELY FOR CLARIFICATION.

nicholas w nicholson
Digitally signed by nicholas w nicholson
Date: 2026.03.10 13:25:57 -04'00'

13163 SPRING HILL DRIVE
SPRING HILL, FL 34609
P: 352-410-0189
ROBERT@AKRAFTINGDESIGN.COM
WWW.AKRAFTINGDESIGN.COM

AKRAFTING AND DESIGN
DESIGN IS HOW IT WORKS




NICHOLSON ENGINEERING ASSOC. INC.
Nicholson, P.E. and L.L. P.E.
NICHOLSON ENGINEERING ASSOCIATES
13163 SPRING HILL, FLORIDA 34609
352-353-9240

No. 37862
STATE OF FLORIDA
PROFESSIONAL ENGINEER

NEW ADDITION FOR:
THE UZOHO RESIDENCE
11033 AUBURNDALE ST
SPRING HILL, FLORIDA

I hereby certify that this plan and specification were prepared by me or under my direct supervision.

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY NICHOLAS W. NICHOLSON, P.E. ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

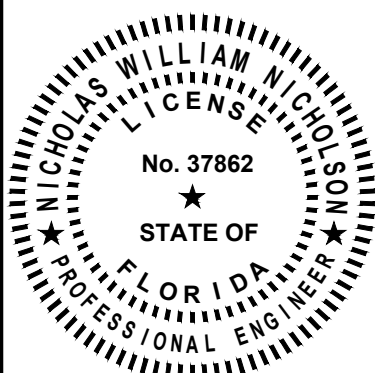

DATE: 5/6/25
SCALE: N.T.S.
TITLE: GENERAL DESIGN NOTES

TABLE R301.2(2)																											
COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET LOCATED IN EXPOSURE B (ASD) (psf) a, b, c, d, e, f, g																											
Zone	Effective Wind Area	90		95		100		105		110		115		120		130		140		150		160		170		180	
		POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG
1'	10	3.6	-8.0	4.0	-8.9	4.4	-9.9	4.8	-10.0	5.3	12.5	5.8	13.3	6.3	14.7	7.4	16.8	8.6	19.9	9.9	22.1	11.7	25.2	14.2	28.2	14.2	32.0
1'	20	3.3	-8.0	3.7	-8.9	4.1	-9.9	4.5	-10.0	5.0	12.5	5.4	13.3	5.9	14.7	7.0	16.8	8.1	19.9	9.3	22.5	11.7	25.5	14.2	28.3	14.2	32.0
1'	50	3.0	-8.0	3.4	-8.9	3.8	-9.9	4.1	-10.0	4.5	12.5	5.0	13.3	5.4	14.7	6.3	16.8	7.4	19.9	8.4	22.2	11.7	26.2	14.2	28.3	14.2	32.0
1'	100	2.8	-8.0	3.1	-8.9	3.5	-9.9	3.8	-10.0	4.2	12.5	4.6	13.3	5.0	14.7	5.9	16.8	6.8	19.9	7.8	22.2	11.7	26.2	14.2	28.3	14.2	32.0
1	10	3.6	13.3	4.0	15.4	4.4	17.4	4.8	19.9	5.3	20.0	5.8	22.2	6.3	24.7	7.4	29.8	8.6	33.9	9.3	37.2	11.7	42.0	14.2	47.0	14.2	55.7
1	20	3.3	13.3	3.7	14.1	4.1	16.5	4.5	17.0	5.0	19.9	5.4	21.5	5.9	23.7	7.0	27.7	8.1	31.9	9.3	36.1	11.7	41.1	14.2	46.1	14.2	52.0
1	50	3.0	13.1	3.4	13.8	3.8	14.4	4.1	16.3	4.5	17.0	5.0	19.9	5.4	21.5	6.3	24.7	7.4	28.8	8.4	32.3	11.7	40.2	14.2	47.2	14.2	47.2
Gable Roof < 7 degrees	100	2.8	13.1	3.1	13.3	3.4	13.8	3.4	14.2	4.2	16.3	4.6	17.0	5.0	19.9	5.2	20.6	6.3	27.8	7.8	30.2	11.7	38.9	14.2	44.0	14.2	43.5
2	10	3.6	18.4	4.0	20.4	4.2	22.8	4.5	23.7	4.7	5.8	30.3	6.3	32.7	7.4	38.8	8.6	44.9	9.9	51.2	11.7	58.1	14.2	65.2	14.2	73.5	
2	20	3.3	17.7	3.7	19.9	4.1	21.5	4.5	23.5	5.0	25.5	5.4	28.0	5.9	30.3	7.0	35.8	8.1	41.9	9.3	47.5	11.7	54.9	14.2	61.3	14.2	68.8
2	50	3.0	15.3	3.4	17.7	3.8	19.9	4.1	21.5	4.5	23.5	5.0	25.5	5.4	27.7	6.3	32.7	7.4	37.8	8.4	43.9	11.7	50.9	14.2	55.2	14.2	62.5
2	100	2.8	14.4	3.1	16.5	3.5	17.7	3.8	19.9	4.2	21.5	4.6	23.5	5.0	25.5	5.9	30.3	6.8	35.8	7.8	40.3	11.7	48.9	14.2	53.1	14.2	57.8
3	10	3.6	25.4	4.0	27.4	4.4	30.3	4.8	34.4	5.3	37.8	5.8	40.3	6.3	44.4	7.4	52.4	8.6	60.4	9.9	69.2	11.7	79.7	14.2	90.2	14.2	100.7
3	20	3.3	22.7	3.7	25.3	4.1	28.4	4.5	30.3	5.0	33.7	5.4	37.8	5.9	40.3	7.0	47.8	8.1	54.9	9.3	63.0	11.7	71.9	14.2	80.9	14.2	94.0
3	50	3.0	19.9	3.4	21.5	3.8	24.4	4.1	26.3	4.5	29.9	5.0	34.4	5.4	38.8	6.3	44.4	7.4	47.8	8.4	54.9	11.7	66.1	14.2	69.2	14.2	78.2
3	100	2.8	17.7	3.1	19.9	3.5	21.5	3.8	24.4	4.2	25.5	4.6	28.0	5.0	30.3	5.9	35.8	6.8	41.9	7.8	47.5	11.7	58.1	14.2	61.3	14.2	68.8
1	10	5.8	16.8	6.4	18.7	7.1	19.9	7.9	22.2	8.6	24.7	9.4	26.8	10.1	28.9	11.7	34.0	16.8	40.3	17.4	43.9	11.7	51.9	14.2	57.1	14.2	64.6
1	20	5.3	13.3	5.9	15.5	6.5	17.7	7.2	18.7	7.9	20.0	8.6	22.2	9.4	24.7	11.7	29.8	16.8	35.8	16.8	40.3	11.7	48.9	14.2	53.1	14.2	55.5
1	50	4.6	10.0	5.1	12.5	5.7	13.3	6.2	14.4	6.8	16.5	7.5	17.7	8.2	19.9	9.6	22.1	13.3	26.8	13.3	30.3	11.7	34.0	14.2	38.8	14.2	43.6
1	100	4.1	8.6	4.5	9.6	5.0	11.1	5.5	11.1	6.1	12.5	6.6	14.4	7.2	15.5	8.5	18.7	13.3	24.7	13.3	28.9	11.7	31.9	14.2	35.8	14.2	34.5
2	10	5.8	21.5	6.4	23.7	7.1	26.8	7.9	29.9	8.6	31.9	9.4	34.4	10.1	37.8	11.7	44.4	16.8	50.4	17.4	54.9	11.7	61.3	14.2	67.2	14.2	85.4
2	20	5.3	18.7	5.9	20.0	6.5	22.2	7.2	23.5	7.9	27.7	8.6	30.3	9.4	32.7	11.7	38.8	16.8	44.4	17.4	50.4	11.7	58.1	14.2	65.2	14.2	78.3
Gable Roof > 7 to 20 degrees	50	4.6	14.4	5.1	16.5	5.7	18.7	6.2	19.9	6.8	21.5	7.5	23.5	8.2	25.5	9.6	30.3	11.7	35.8	11.7	40.3	11.7	46.1	14.2	51.9	14.2	58.6
2	100	4.1	11.1	4.5	13.3	5.0	14.4	5.5	15.5	6.1	17.7	6.6	19.9	7.2	20.0	8.5	24.7	13.3	29.8	13.3	34.0	11.7	38.8	14.2	44.0	14.2	46.3
3	10	5.8	28.4	6.4	31.9	7.1	34.4	7.9	38.8	8.6	41.9	9.4	45.9	10.1	49.9	11.7	58.4	16.8	64.4	17.4	70.4	11.7	88.9	14.2	99.9	14.2	112.0

Copyright © 2024 International Code Council, Inc., or its licensors (ALL RIGHTS RESERVED).
 Accessed by Robert Parker on 01/16/2024 pursuant to License Agreement with ICC. No further reproduction or distribution authorized. Any Unauthorized reproduction or distribution is a violation of the federal copyright, and subject to civil and criminal penalties.

Hip Roof = 45 degrees		2	20	Wind Speed (V _{ult}) converted from V _{ult} per Section R301.2.1.3																		49.8								
				116 mph 119 mph 124 mph 132 mph 139 mph 147 mph 155 mph																										
Walls	9	20	5.6	12.4	6.3	13.2	6.9	14.5	7.7	16.8	8.4	18.6	9.2	20.3	10	22	11	25	13	30	15	34	17	39	20	44	22	50		
			6	13	7	15	8	18	9	20	10	23	11	26	13	31	15	35	18	41	20	45	22	50	25	55	28	62		
	2	50	4.4	-9.5	5.0	11.5	7.1	16.1	8.2	18.4	7.3	15.9	7.9	16.6	9	19.6	9	18.3	10	22	12	26	14	30	15	39	17	38		
			6	13	8	19	9	21	10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62				
	2	100	3.6	-7.3	4.0	-8.1	4.4	-9.0	4.8	-9.9	5.3	10.8	5.8	11.1	6.3	12.7	7.4	15.5	8.6	17.7	9.9	20	11	22	12	27	15	34	22	50
			8	19	9	21	10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77		
	3	10	6.5	19.7	7.3	21.0	8.0	23.8	8.9	26.6	9.7	28.6	10	31.2	11	34.4	12	39.9	15.5	46.8	18.7	51.1	20	60	23	68	26	76	35	76.5
			7	22	8	24	9	27	10	30	11	33	12	36	13	39	15	42	17	48	20	57	22	63	26	72	30	81		
	3	20	5.6	16.3	6.1	17.9	6.9	19.7	7.1	21.8	8.2	23.6	8.6	25.4	9	28.0	9.4	31.9	13.3	38.8	15.5	44.4	17	50	20	57	22	57	25	64.0
			7	22	8	24	9	27	10	30	11	33	12	36	13	39	15	42	17	48	20	57	22	63	26	72	30	81		
3	50	4.4	11.1	5.0	13.3	5.5	14.4	6.1	16.5	6.6	17.7	7.3	19.9	7.9	21.5	8.2	23.5	10.1	28.9	13.3	33.7	15	42	17	42	17	42	17	47.5	
		6	13	7	15	8	18	9	20	10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62			
3	100	3.6	-8.7	4.0	-9.7	4.4	-10.0	4.8	-11.1	5.3	13.3	5.8	14.4	6.3	15.5	7.4	18.7	8.6	21.5	9.9	24.7	11	27	12	27	12	27	12	35.0	
		8	19	9	21	10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77			
4	10	8.7	-9.5	9.7	-10.0	10.1	-11.1	11.2	-13.3	14.4	-15.5	16.5	-18.7	19.9	-21.5	22.2	-24.7	26.8	-27.7	30.3	-31.9	34.4	35	40	33	35	40	37.9		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			
4	20	8.3	-9.1	9.3	-10.1	10.1	-11.2	12.5	-13.3	14.4	-16.5	17.7	-19.9	20.0	-22.2	23.5	-26.8	28.9	-30.3	31.9	-34.4	36.4	38	43	36	43	36	43		
		12	28	13	31	14	32	15	35	16	38	18	41	19	44	20	46	21	49	22	51	23	53	24	56	25	58			
4	50	7.8	-8.6	8.7	-9.5	9.7	-10.0	10.1	-11.1	11.2	-12.5	13.3	-14.4	15.5	-17.7	18.7	-20.0	21.5	-23.5	24.7	-27.7	30.3	32	37	30	37	30	37		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			
4	100	7.4	-8.2	8.3	-9.1	9.2	-10.0	10.1	-11.1	11.2	-12.5	13.3	-14.4	15.5	-17.7	18.7	-20.0	21.5	-23.5	24.7	-27.7	30.3	32	37	30	37	30	37		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			
5	10	8.7	11.1	9.7	13.3	8.8	14.4	9.9	15.5	17.7	19.9	20.0	24.7	25.5	28.9	31.9	34.4	38.8	44.4	48.2	51.1	55	63	31	41	35	45	46.8		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			
5	20	8.3	10.9	9.3	12.5	10.1	13.3	11.1	14.4	16.5	17.7	20.0	22.2	24.7	26.8	30.3	34.4	38.8	44.4	48.2	51.1	55	63	31	41	35	45	46.8		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			
5	50	7.8	-9.9	8.7	-11.1	9.7	-12.5	10.1	-13.3	11.1	-14.4	16.5	17.7	-20.0	18.7	-22.2	20.0	-24.7	22.2	-26.8	24.7	27	31	27	31	27	31	39.5		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			
5	100	7.4	-9.1	8.3	-10.0	9.2	-11.1	10.1	-12.5	11.1	-13.3	12.5	-14.4	15.5	-17.7	18.7	-20.0	21.5	-23.5	24.7	-27.7	30.3	32	37	30	37	30	37		
		10	23	11	26	13	30	15	34	17	39	20	44	22	50	25	55	28	62	31	69	34	77	38	84	40	92			

For SI: 1 foot = 304.8 mm, 1 square foot = 0.0929 m², 1 mile per hour = 0.447 m/s, 1 pound per square foot = 0.0479 kPa.

- The effective wind area shall be equal to the span length multiplied by an effective width. This width shall be permitted to be not less than one-third the span length. For cladding fasteners, the effective wind area shall not be greater than the area that is tributary to an individual fastener.
- For effective wind areas between those given, the load shall be interpolated or the load associated with the lower effective wind area shall be used.
- Table values shall be adjusted for height and exposure by multiplying by the adjustment coefficient in Table R301.2(3).
- See Figure R301.2(7) for location of zones.
- Plus and minus signs signify pressures acting toward and away from the building surfaces.
- Positive and negative design wind pressures shall not be less than 10 psf.
- Roof overhang loads shall be determined by summing the applicable roof zone pressure with the adjacent wall zone pressure.
- Table values have been multiplied by 0.6 to convert component and cladding pressures to ASD.

TABLE R301.2(2)																								
COMPONENT AND CLADDING LOADS FOR A BUILDING WITH A MEAN ROOF HEIGHT OF 30 FEET LOCATED IN EXPOSURE B (ASD) (psf) a, b, c, d, e, f, g																								
Zone of Wind Area	Effect	90		95		100		105		110		115		120		130		140		150		160		180
		POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG	POS	NEG			
Gable Roof < 7 degrees	1'	10	3.6	-8.0	4.0	-8.9	4.4	-9.9	4.8	-10.0	5.3	12.5	5.8	13.3	6.3	14.7	7.4	16.8	8.6	19.9	9.2	22.1	11.7	32.0
	1'	20	3.3	-8.0	3.7	-8.9	4.1	-9.9	4.5	-10.0	5.0	12.5	5.4	13.3	5.9	14.7	7.0	16.8	8.1	19.9	9.2	22.1	11.7	32.0
	1'	50	3.0	-8.0	3.4	-8.9	3.8	-9.9	4.1	-10.0	4.5	12.5	5.0	13.3	5.4	14.7	6.3	16.8	7.4	16.8	8.1	19.9	9.2	32.0
	1'	100	2.8	-8.0	3.1	-8.9	3.5	-9.9	3.8	-10.0	4.2	12.5	4.6	13.3	5.0	14.7	5.9	16.8	6.8	19.9	7.8	22.1	11.7	32.0
	1'	200	3.6	-10.3	4.1	-10.8	4.6	-11.3	5.1	-11.8	5.6	-12.3	6.1	-12.8	6.6	-13.3	7.1	-13.8	7.6	-14.3	8.1	-14.6	8.6	35.7
	1'	300	3.1	-10.3	3.7	-10.8	4.1	-11.3	4.6	-11.8	5.0	-12.3	5.5	-12.8	6.0	-13.3	6.5	-13.8	7.0	-14.3	7.5	-14.6	8.1	35.7
	1'	400	3.1	-10.3	3.7	-10.8	4.1	-11.3	4.6	-11.8	5.0	-12.3	5.5	-12.8	6.0	-13.3	6.5	-13.8	7.0	-14.3	7.5	-14.6	8.1	35.7
	1'	500	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	35.7
	1'	600	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	35.7
	1'	700	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	35.7
Gable Roof > 7 to 20 degrees	1'	100	2.8	-10.3	3.1	-10.8	3.5	-11.3	3.8	-11.8	4.2	-12.3	4.6	-12.8	5.0	-13.3	5.4	-13.8	5.8	-14.3	6.2	-14.6	6.6	33.3
	1'	200	3.6	-10.3	4.1	-10.8	4.6	-11.3	5.1	-11.8	5.6	-12.3	6.1	-12.8	6.6	-13.3	7.1	-13.8	7.6	-14.3	8.1	-14.6	8.6	33.3
	1'	300	3.1	-10.3	3.7	-10.8	4.1	-11.3	4.6	-11.8	5.0	-12.3	5.5	-12.8	6.0	-13.3	6.5	-13.8	7.0	-14.3	7.5	-14.6	8.1	33.3
	1'	400	3.1	-10.3	3.7	-10.8	4.1	-11.3	4.6	-11.8	5.0	-12.3	5.5	-12.8	6.0	-13.3	6.5	-13.8	7.0	-14.3	7.5	-14.6	8.1	33.3
	1'	500	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	33.3
	1'	600	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	33.3
	1'	700	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	33.3
	1'	800	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	33.3
	1'	900	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	33.3
	1'	1000	3.0	-10.3	3.6	-10.8	4.0	-11.3	4.5	-11.8	4.9	-12.3	5.4	-12.8	5.9	-13.3	6.4	-13.8	6.9	-14.3	7.4	-14.6	7.9	33.3