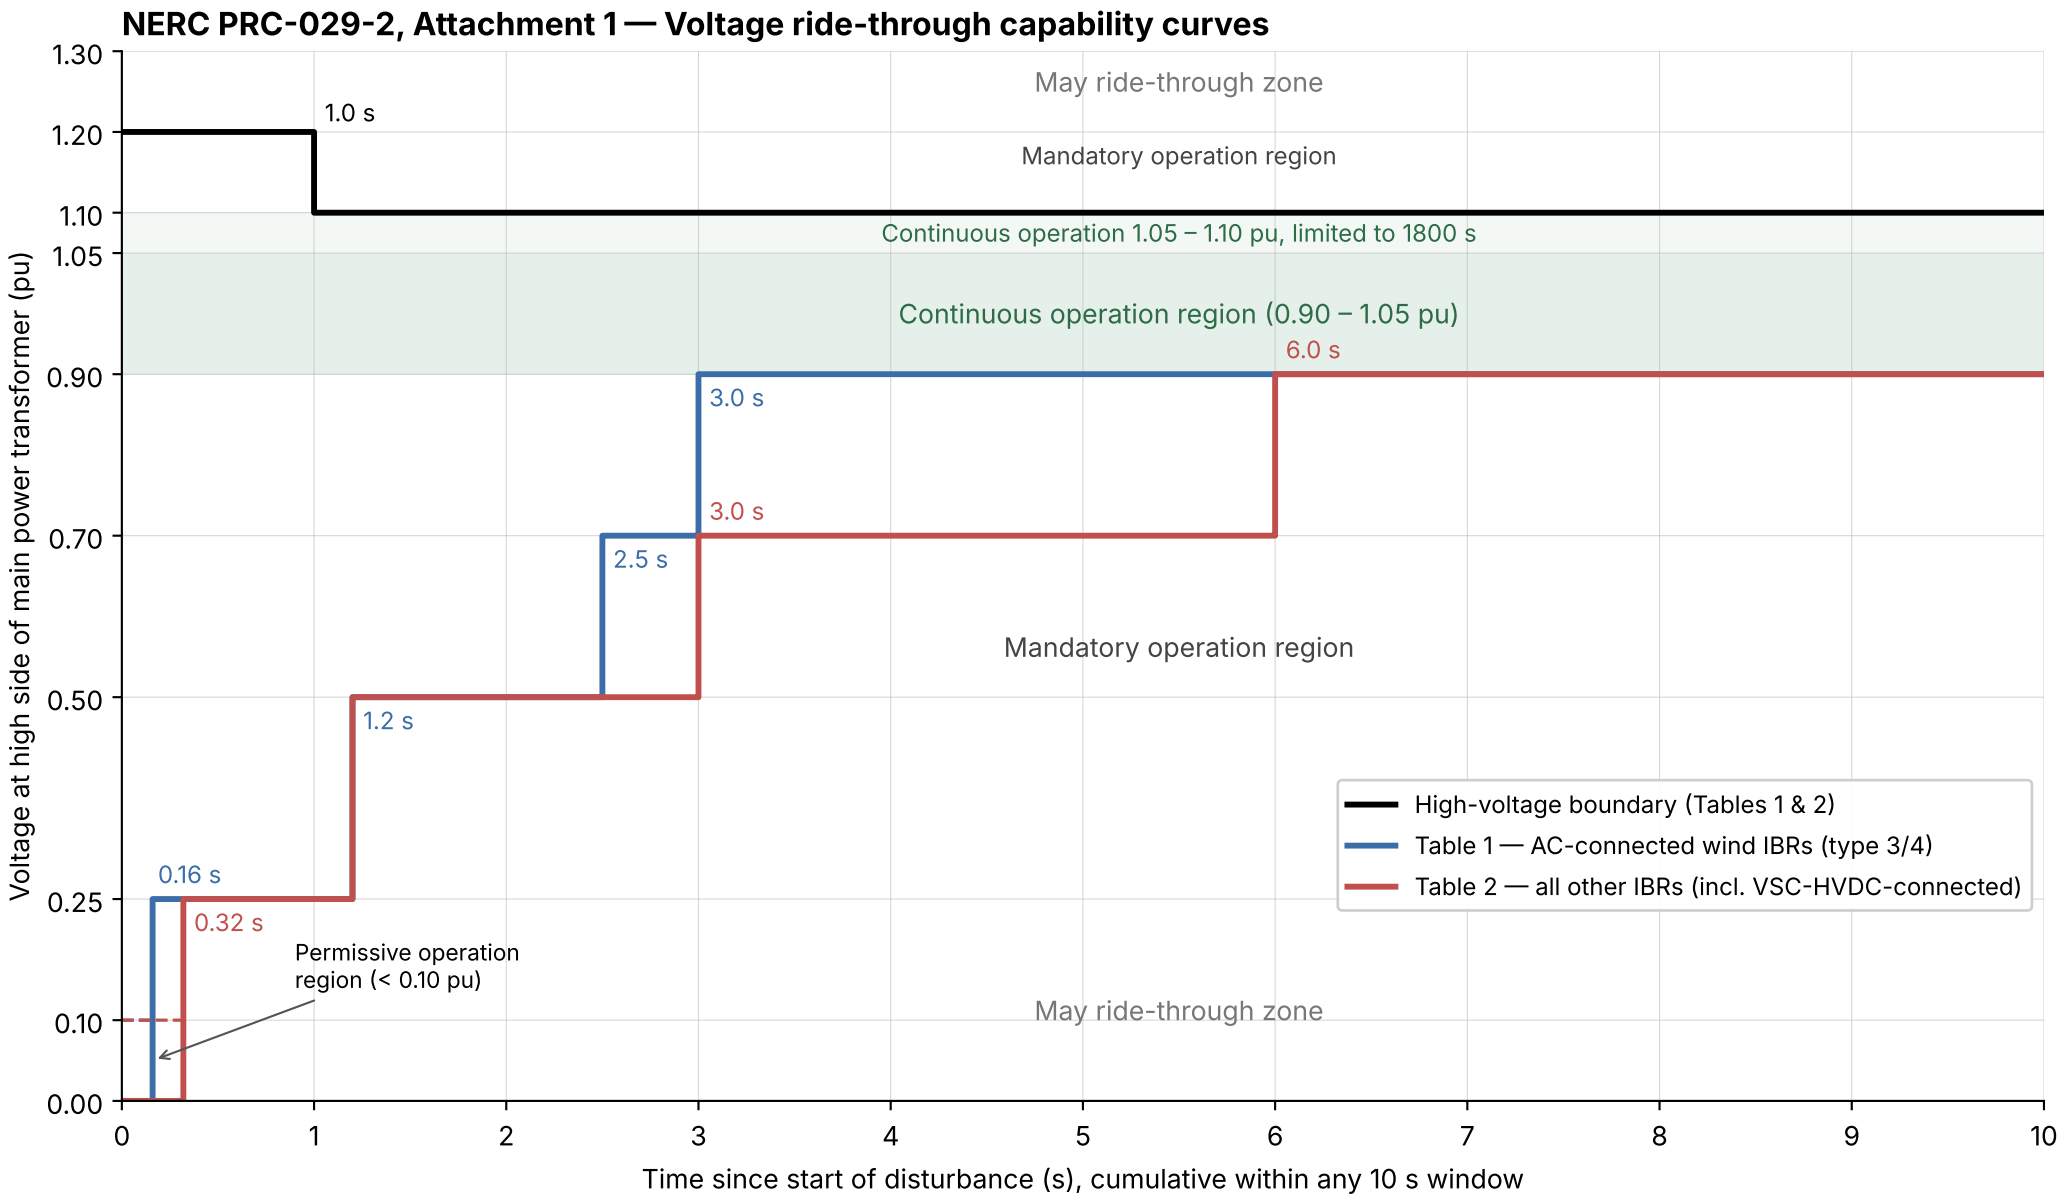
NERC PRC-029-2, Attachment 1 — Voltage ride-through capability curves
May ride-through zone
1.0 s
Mandatory operation region
Continuous operation 1.05 – 1.10 pu, limited to 1800 s
Continuous operation region (0.90 – 1.05 pu)
6.0 s
3.0 s
3.0 s
2.5 s
Mandatory operation region
1.2 s
0.16 s
0.32 s
Permissive operation region (< 0.10 pu)
May ride-through zone
High-voltage boundary (Tables 1 & 2)
Table 1 — AC-connected wind IBRs (type 3/4)
Table 2 — all other IBRs (incl. VSC-HVDC-connected)
Voltage at high side of main power transformer (pu)
1.30
1.20
1.10
1.05
0.90
0.70
0.50
0.25
0.10
0.00
0
1
2
3
4
5
6
7
8
9
10
Time since start of disturbance (s), cumulative within any 10 s window