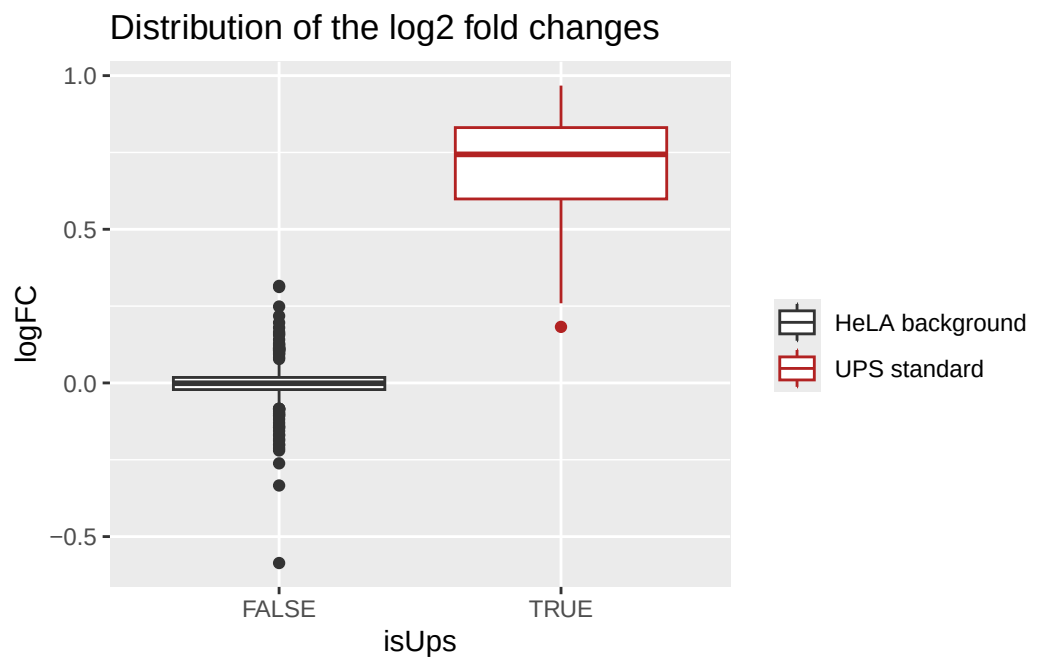
Distribution of the log2 fold changes
1.0
0.5
0.0
−0.5
logFC
FALSE
TRUE
isUps
HeLA background
UPS standard