


Plate 2 – VAN-040 / ST 39 – fitted smooth spline

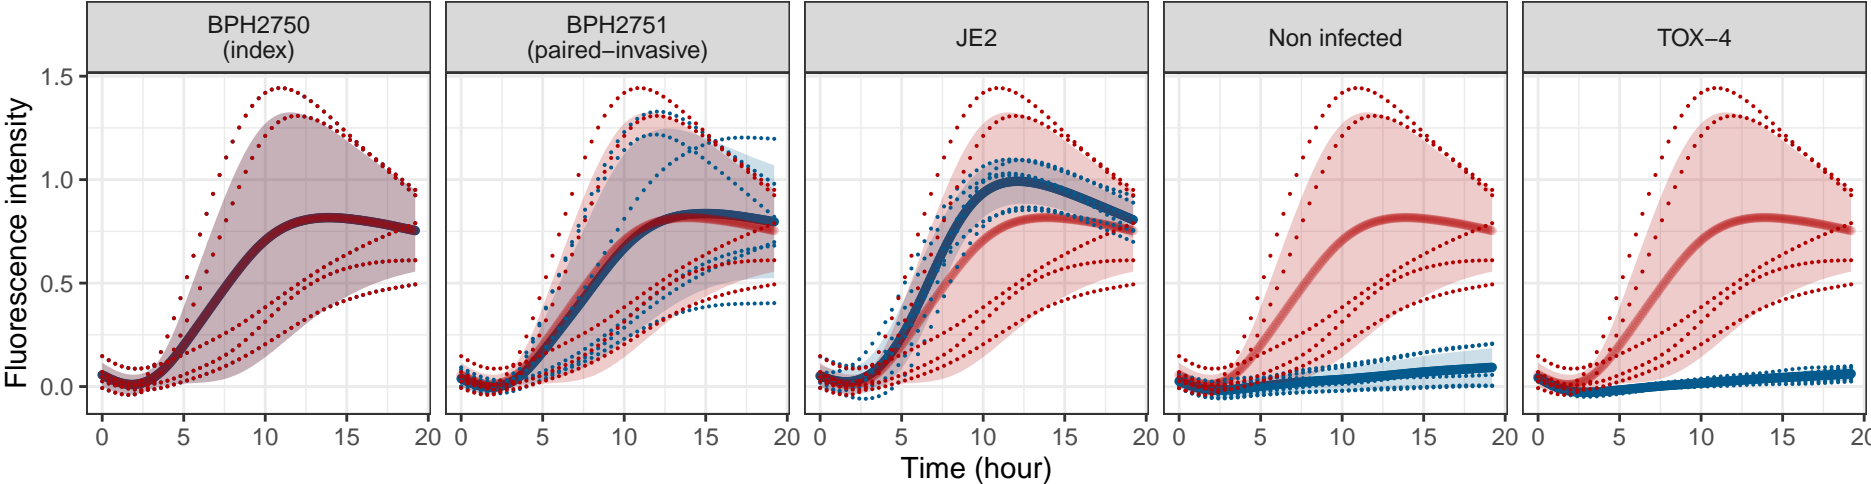

	sample_id	sample_type	intrahost_sampledelay	persister_type	scv	vanco_difference	mut_count
1	BPH2751 (paired-invasive)	paired-invasive	4	Relapse (on treatment)	FALSE	0.5	1