The TTEST Procedure

Difference: DRUG_A - DRUG_B

N	Mean	Std Dev	Std Err	Minimum	Maximum
8	2.2500	2.1213	0.7500	-1.0000	5.0000

Mean	95% CL Mean		Std Dev	95% CL Std Dev	
2.2500	0.4765	4.0235	2.1213	1.4026	4.3175

DF	t Value	Pr > |t|
7	3.00	0.0199

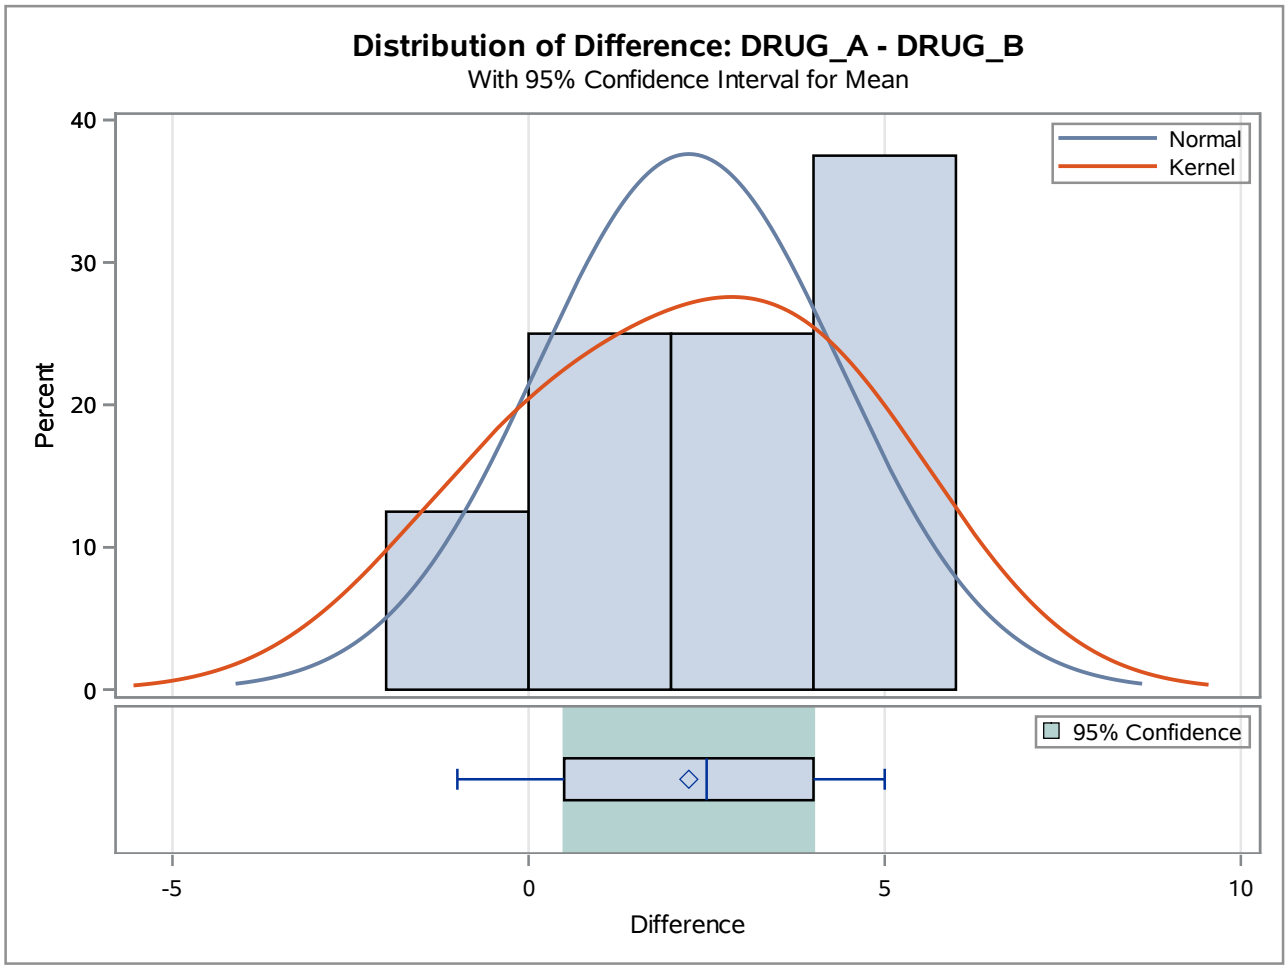

The TTEST Procedure

Difference: DRUG_A - DRUG_B

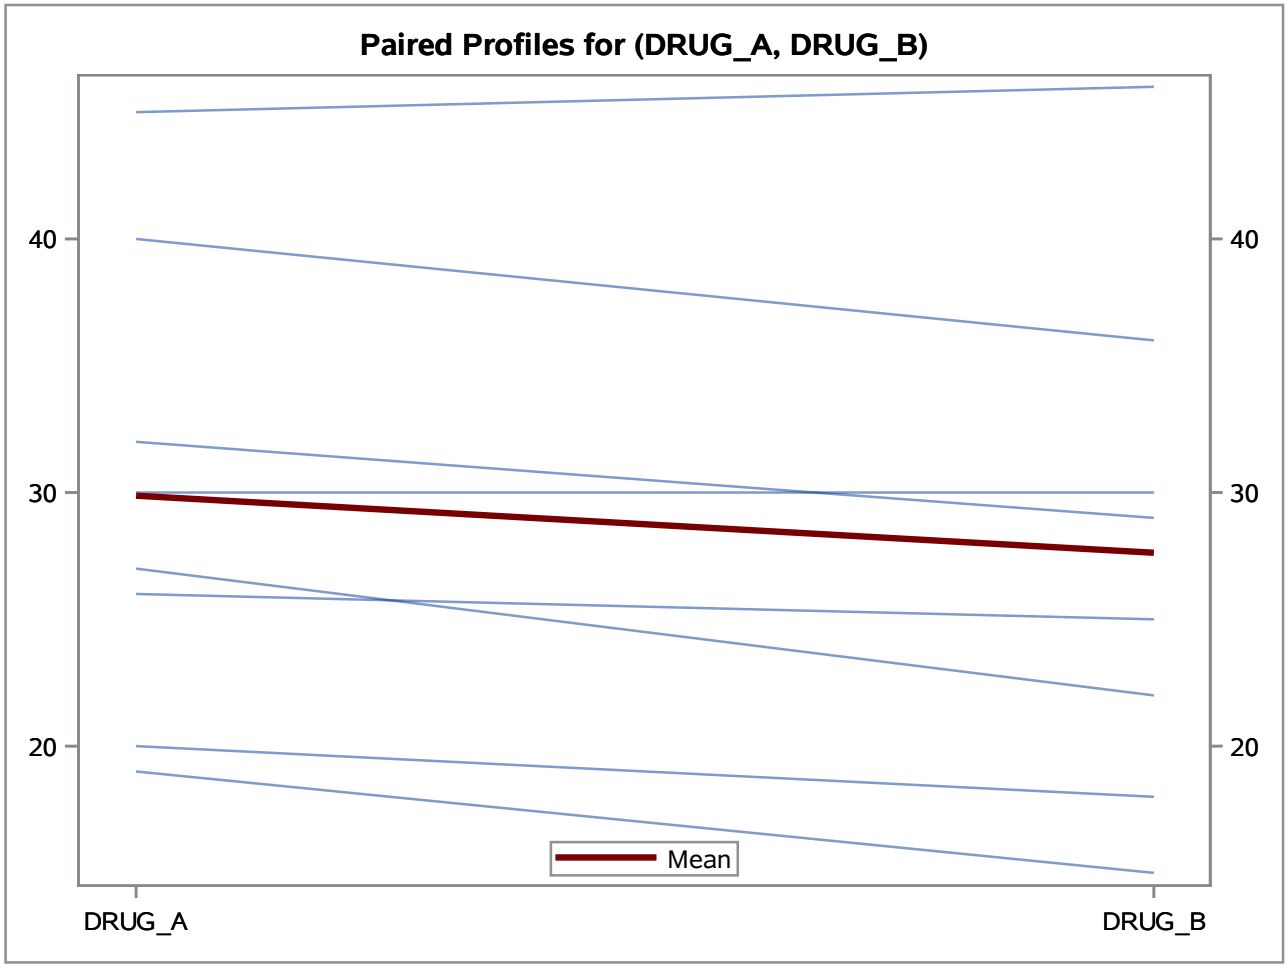

The TTEST Procedure

Difference: DRUG_A - DRUG_B

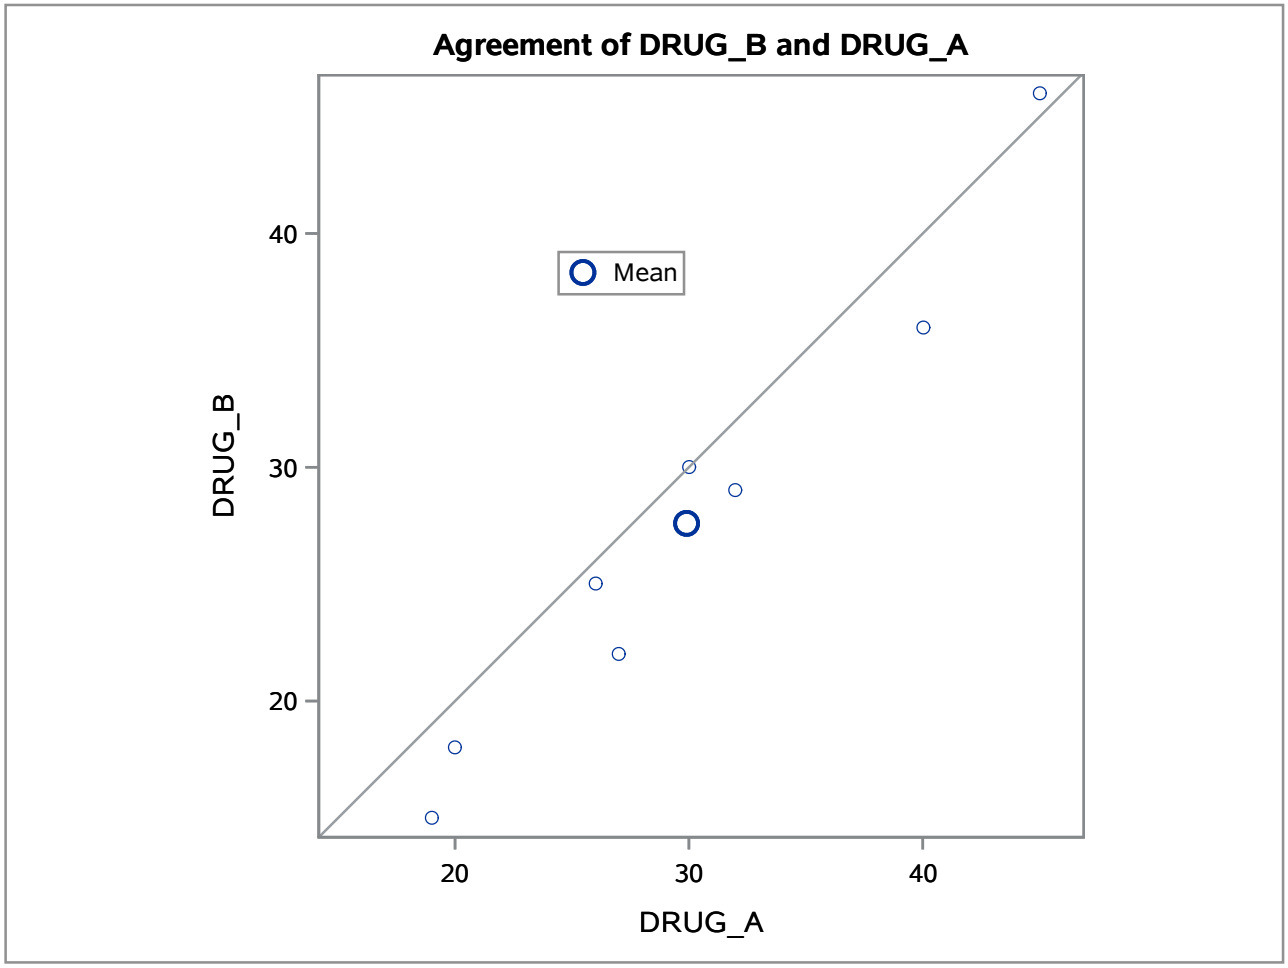

The TTEST Procedure
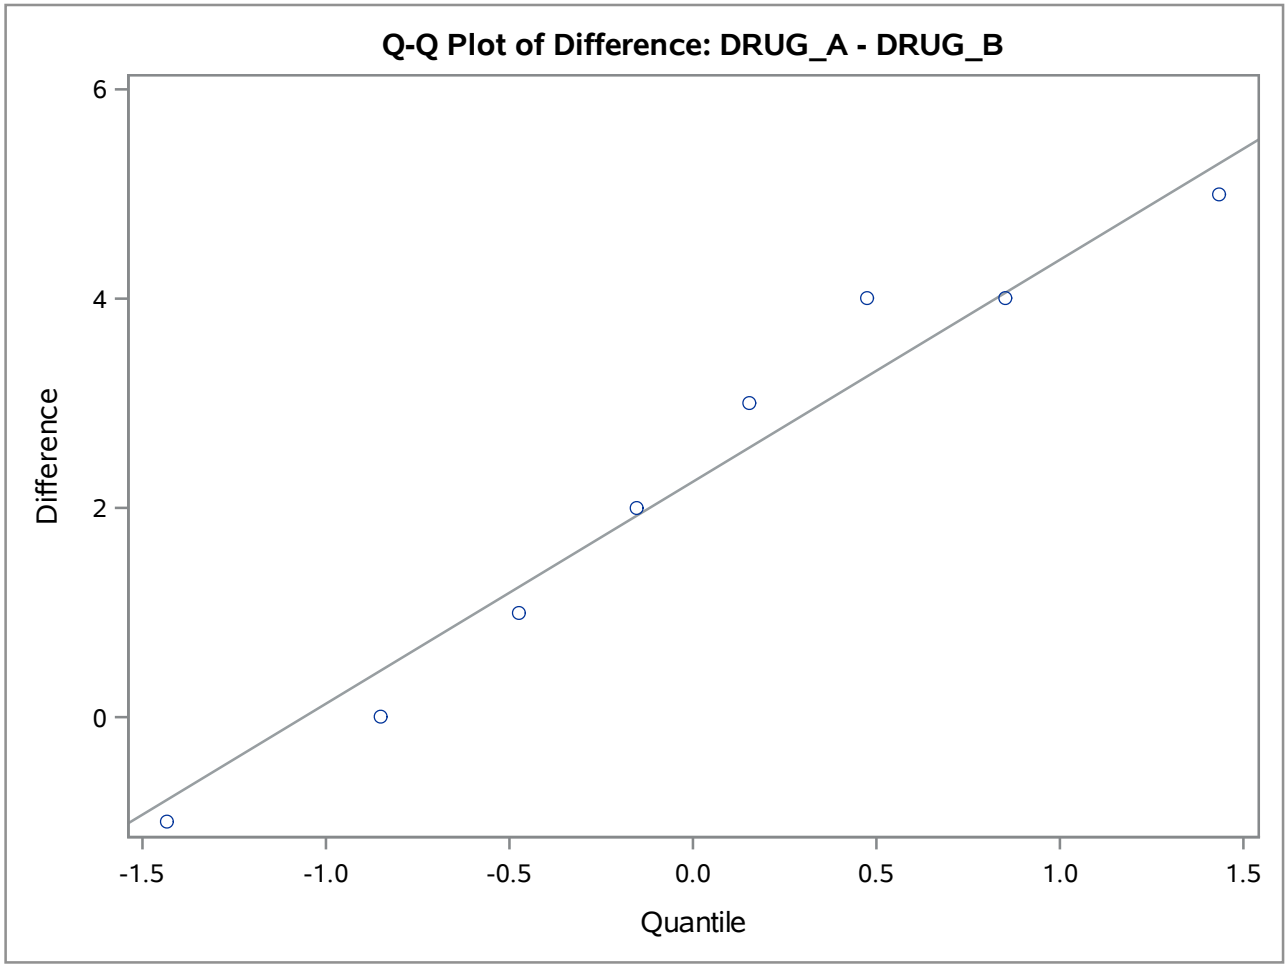
Difference: DRUG_A - DRUG_B