


Sensor ablation: command accuracy (zero modality at encoder input)

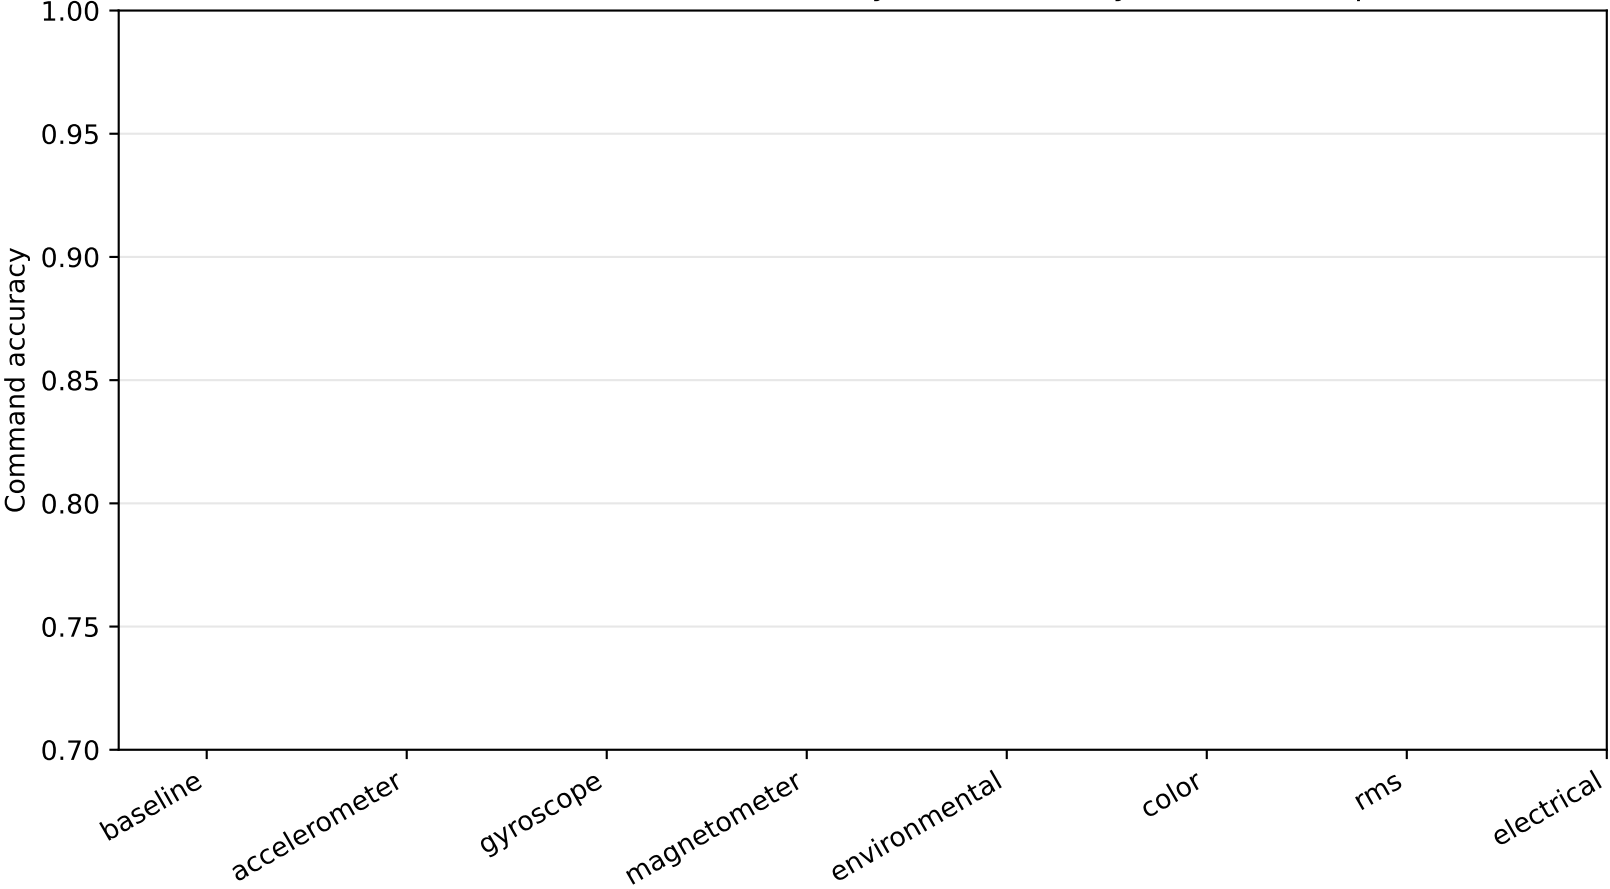

0.000
(n=0)