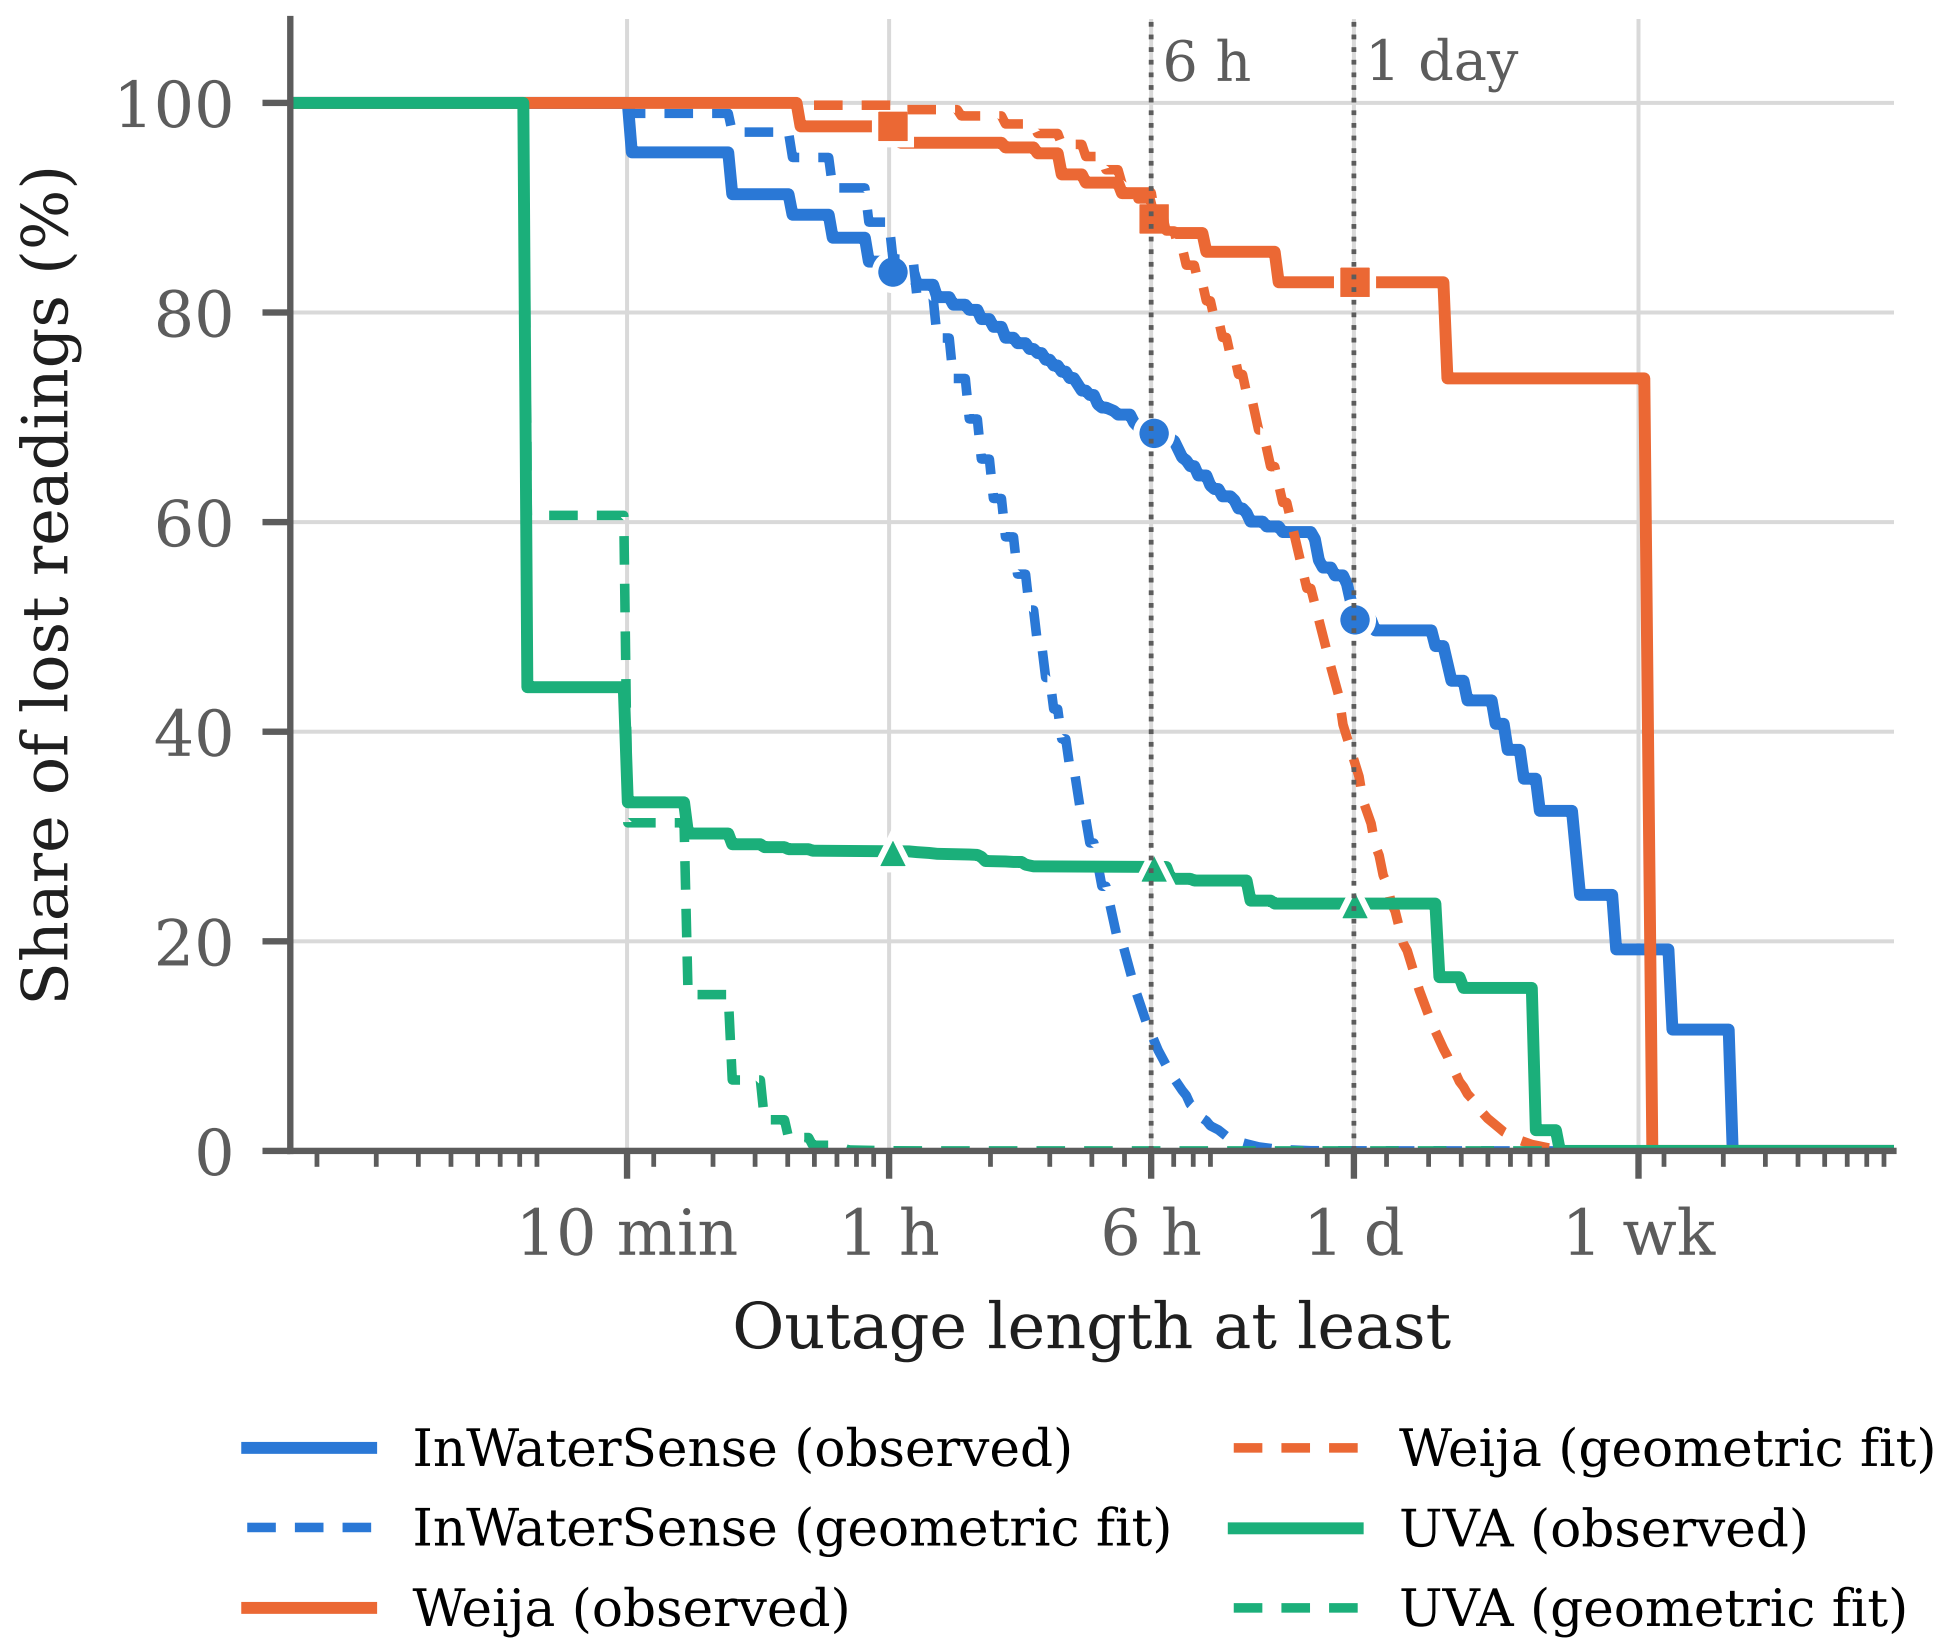
6 h
1 day
100
80
60
40
20
0
Share of lost readings (%)
10 min
1 h
6 h
1 d
1 wk
Outage length at least
InWaterSense (observed)
InWaterSense (geometric fit)
Weija (observed)
Weija (geometric fit)
UVA (observed)
UVA (geometric fit)