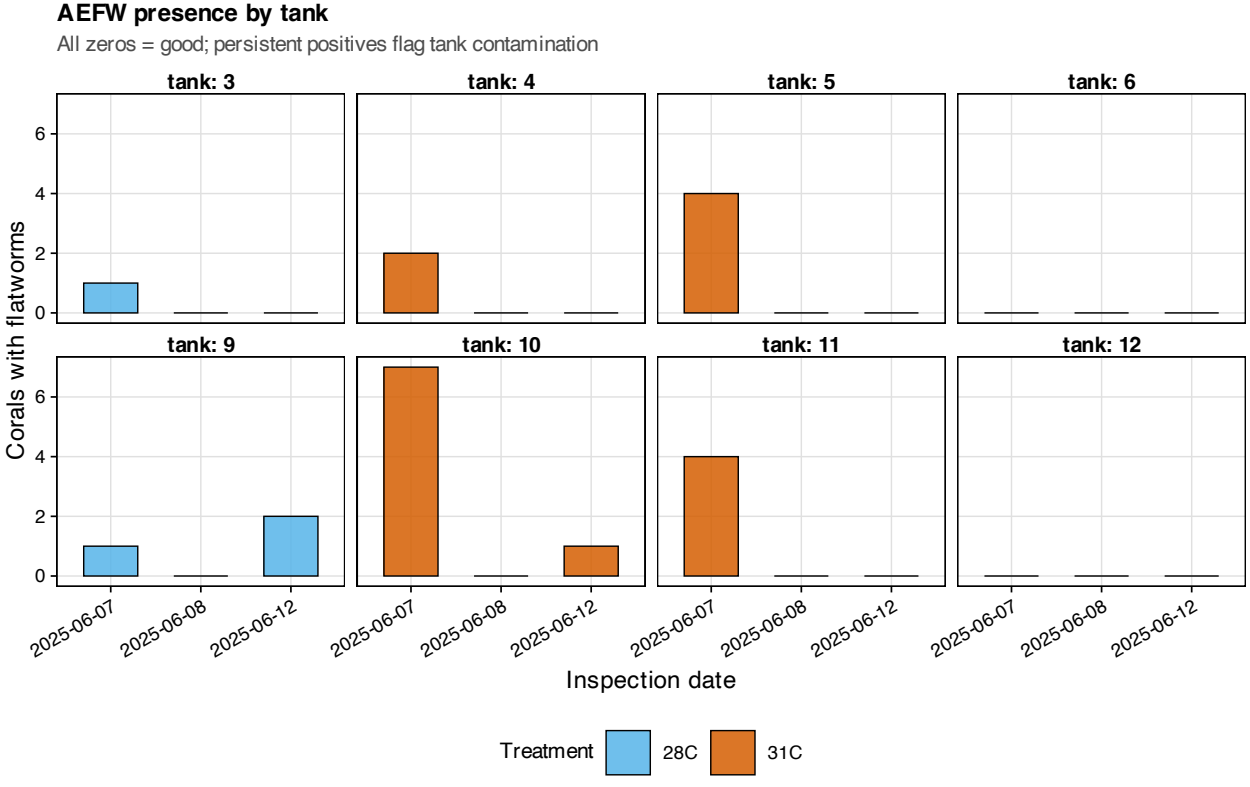
AEFW presence by tank
All zeros = good; persistent positives flag tank contamination
tank: 3
tank: 4
tank: 5
tank: 6
tank: 9
tank: 10
tank: 11
tank: 12
Corals with flatworms
0
2
4
6
2025-06-07
2025-06-08
2025-06-12
Inspection date
Treatment
28C
31C