


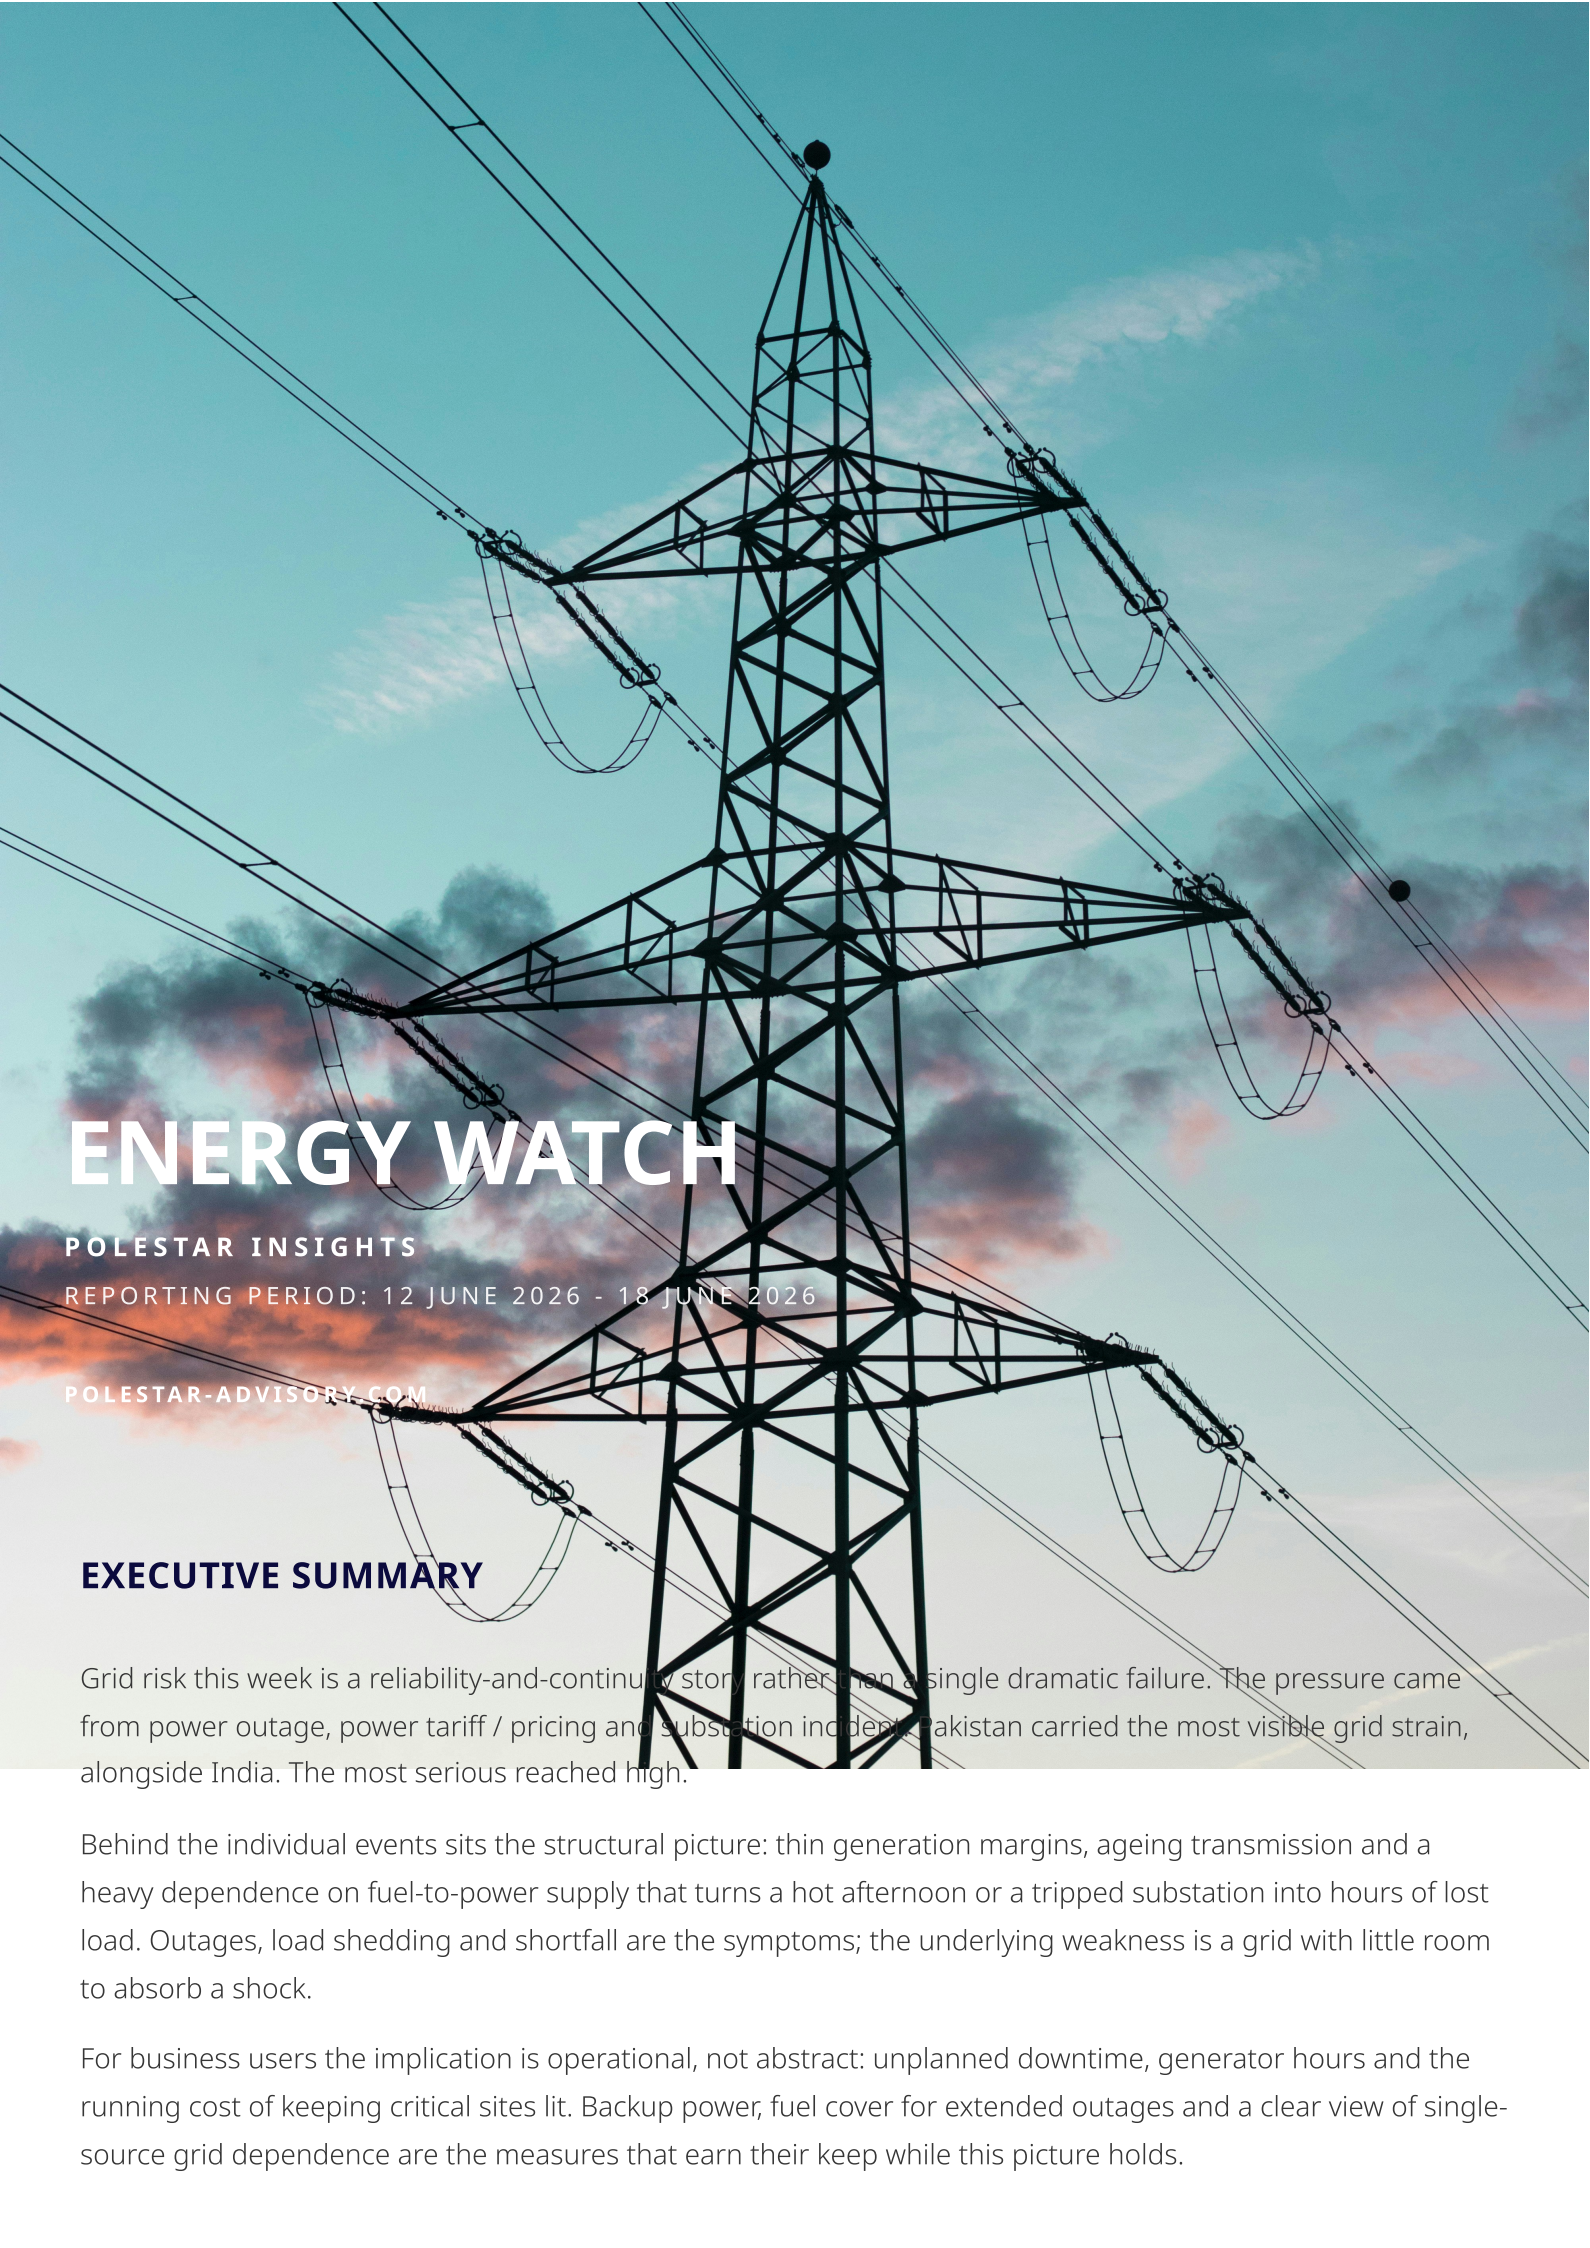

ENERGY WATCH

POLESTAR INSIGHTS

REPORTING PERIOD: 12 JUNE 2026 - 18 JUNE 2026

POLESTAR-ADVISORY.COM

EXECUTIVE SUMMARY

Grid risk this week is a reliability-and-continuity story rather than a single dramatic failure. The pressure came from power outage, power tariff / pricing and substation incidents. Pakistan carried the most visible grid strain, alongside India. The most serious reached high.

Behind the individual events sits the structural picture: thin generation margins, ageing transmission and a heavy dependence on fuel-to-power supply that turns a hot afternoon or a tripped substation into hours of lost load. Outages, load shedding and shortfall are the symptoms; the underlying weakness is a grid with little room to absorb a shock.

For business users the implication is operational, not abstract: unplanned downtime, generator hours and the running cost of keeping critical sites lit. Backup power, fuel cover for extended outages and a clear view of single-source grid dependence are the measures that earn their keep while this picture holds.

FAST FACTS

REPORTING PERIOD 12 Jun - 18 Jun 2026	TOTAL RECORDS 5 Energy this period	HIGHEST SEVERITY High Highest rating this period
TOP ISSUE TYPE Power outage 2 records	MOST AFFECTED COUNTRY Pakistan 2 records	LATEST INCIDENT 17 Jun 2026

SITUATION

Capacity margins stay thin and fuel-to-power supply remains the underlying weakness, so the grid has little headroom when demand peaks or a feeder trips. This matters because reliability and cost move together here: every hour of lost load is both a continuity problem and a generator-fuel bill, and long restorations turn a brief dip into real operational disruption. Pakistan sits at the centre of the current reporting.

WHAT HAPPENED

Reporting centred on power outage, power tariff / pricing and substation incident. Reporting concentrated on Pakistan, with more from India. The most serious reached high.

WHAT MATTERS

Reliability gaps land first on site uptime and generator load, then on the running cost of business continuity. When outages run long the cost shifts from inconvenience to fuel burn, spoiled stock, missed production and overtime to recover. Exposure to Pakistan is the live pressure point for backup power, generator fuel and continuity spend.

Where weak generation margins meet a transmission fault or a fuel-supply squeeze, the impact compounds: load shedding deepens, restoration slows, and sites on a single grid feed lose the buffer they assumed they had. That is the exposure worth planning against now, rather than after the next peak-demand failure.

IMPLICATIONS FOR BUSINESS

- Check backup generator cover and service status against a multi-hour outage, not just a brief dip.
- Hold fuel stock for extended generator runtime wherever the public grid is the only feed.
- Confirm UPS run-time and failover on critical loads — servers, cold chain, life-safety and security systems.
- Map single-source dependence on the public grid and line up alternate supply or on-site generation before the next peak.
- Build outage cost into continuity budgets — fuel burn, spoilage, lost production and recovery overtime add up fast on long restorations.

WATCH NEXT

- Load-shedding schedules — fresh rationing notices are the clearest sign generation margins are tightening.

POLESTAR VIEW

Energy Watch is flagging standing grid fragility rather than a single dramatic failure. The risk is structural — thin generation margins and heavy fuel-to-power dependence — so the operational answer is resilience: backup power, fuel cover and a clear view of single-grid dependence. Pakistan is the clearest country pressure point, with the rest of the picture filled in by India.

RELATED INCIDENTS

DATE	TYPE	TITLE	SEVERITY
17 Jun 2026	Power tariff / pricing	Electricity tariff likely to rise in Pakistan Low: Reporting indicates electricity tariffs are likely to rise in Pakistan, with potential cost implications for operations. <i>Source: ARY News</i>	LOW
14 Jun 2026	Power outage	Karnataka: Escoms resolved 2 crore complaints in 3 years; power cut tops woes Moderate: In Karnataka, power cuts are reported as the leading public complaint to electricity supply companies, indicating recurring electricity disruption that may affect continuity. <i>Source: Deccan Herald</i>	MODERATE
13 Jun 2026	Substation incident	Train service restored around Woerden after substation fire forces 1,300 evacuations High: A substation fire around Woerden forced evacuations and disrupted train services, affecting movement until services were restored. <i>Source: NL Times</i>	HIGH
12 Jun 2026	Load shedding	K-Electric refutes claims of 14-hour long load-shedding Low: K-Electric has denied claims of prolonged load-shedding in Pakistan; the item does not confirm an outage. <i>Source: Business Recorder</i>	LOW
12 Jun 2026	Power outage	Politics or maintenance failures: What’s behind Tamil Nadu’s growing power outages? Low: Reporting describes growing power outages in Tamil Nadu and links them to possible political or maintenance issues, indicating a continuing risk of electricity disruption. <i>Source: The South First</i>	LOW

DISCLAIMER

Polestar Advisory Pte. Ltd. is an independent company registered in Singapore. The information in this report is based on open sources and is assessed as accurate at the time of writing. It is provided for general informational purposes only and does not constitute advice or a comprehensive assessment of all risks. No reliance should be placed on this information for operational decision-making without further independent verification.