

संदर्भ संख्या : - GRID-INDIA/NLDC/MR/

दिनांक : 24.05.2023

सेवा में,

वितरण सूची के अनुसार

विषय:- निष्पादन रिपोर्ट – अप्रैल 2023

महोदय,

आई०ई०जी०सी०-2010 के प्रावधान के अनुसार, अप्रैल 2023 माह की अखिल भारतीय प्रणाली की निष्पादन रिपोर्ट संलग्न है।

धन्यवाद

भवदीय



(सुरजीत बनर्जी)

मुख्य महाप्रबन्धक (प्रणाली प्रचालन)

(रा०भा०प्रे०के०)

संलग्नक : मासिक प्रणाली रिपोर्ट

वितरण सूची Distribution List

- 1 सचिव, के.वि.नि.आ. तीसरा एवं चौथा तल, चंद्रलोक भवन, 36, जनपथ, नई दिल्ली-110001
Secretary, CERC, 3rd & 4th Floor, Chanderlok Building, 36, Janpath, New Delhi-110001
- 2 मुख्य अभियंता (जी एम), के.वि.प्रा., सेवा भवन, आर. के. पुरम, नई दिल्ली-110066
Chief Engineer (GM), CEA, Sewa Bhavan, R.K.Puram, New Delhi-110066
- 3 सदस्य सचिव, उ. क्षेत्र. वि. स., 18/ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Member Secretary, NRPC, 18/A, SJSS Marg, Katwaria Sarai, New Delhi-110016
- 4 सदस्य सचिव, प. क्षेत्र. वि. स., एफ-3, एम आई डी सी क्षेत्र, अंधेरी (पूर्व), मुंबई - 400093
Member Secretary, WRPC, F-3, MIDC Area, Andheri (East), Mumbai-400093
- 5 सदस्य सचिव, द. क्षेत्र. वि. स., 29, रेस कोर्स क्रॉस रोड, बंगलूरु - 560009
Member Secretary, SRPC, 29, Race Course Cross Road, Bangalore-560009
- 6 सदस्य सचिव, पू. क्षेत्र. वि. स., 14, गोल्फ क्लब रोड, कोलकाता - 700033
Member Secretary, ERPC, 14, Golf Club Road, Kolkata-700033
- 7 सदस्य सचिव, उ. पू. क्षेत्र. वि. स., मेघालय राज्य आवासीय वित्त सहकारी समिति लिमिटेड भवन, नॉग्रिम हिल्स, शिलोंग - 793003
Member Secretary, NERPC, Meghalaya State Housing Finance Cooperative Society Ltd. Building, Nongrim Hills, Shillong -793003
- 8 मुख्य अभियंता, राष्ट्रीय विद्युत समिति, एनआरपीसी भवन, तृतीय तल, 18/ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Chief Engineer, National Power Committee, NRPC Building, 3rd floor, 18/A, SJSS Marg, Katwaria Sarai, New Delhi-110016
- 9 कार्यपालक निदेशक, पू. क्षेत्र. भा. प्रे. के., 14, गोल्फ क्लब रोड, कोलकाता - 700033
Executive Director, ERLDC, 14, Golf Club Road, Kolkata-700033
- 10 कार्यपालक निदेशक, प. क्षेत्र. भा. प्रे. के., एफ-3, एम आई डी सी क्षेत्र, अंधेरी (पूर्व), मुंबई - 400093
Executive Director, WRLDC, F-3, MIDC Area, Andheri (East), Mumbai-400093
- 11 कार्यपालक निदेशक, उ. क्षेत्र. भा. प्रे. के., 18/ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Executive Director, NRPC, 18/A, SJSS Marg, Katwaria Sarai, New Delhi-110016
- 12 कार्यपालक निदेशक, द. क्षेत्र. भा. प्रे. के., 29, रेस कोर्स क्रॉस रोड, बंगलूरु - 560009
Executive Director, SRLDC, 29, Race Course Cross Road, Bangalore-560009
- 13 कार्यपालक निदेशक, पू. क्षेत्र. भा. प्रे. के., डोंगतिह, लोअर नॉग्रह, लापलंग, शिलोंग- 793006
Executive Director, NERLDC, Dongtieh, Lower Nongrah, Laplang, Shillong-793006



ग्रिड-इंडिया
GRID-INDIA

GRID CONTROLLER OF INDIA LIMITED

Formerly Power System Operation Corporation Limited

ग्रिड कंट्रोलर ऑफ इंडिया लिमिटेड

NATIONAL LOAD DESPATCH CENTRE –राष्ट्रीय भार प्रेषण केन्द्र

मासिक ऑपरेशन रिपोर्ट

Monthly
Operation Report



अप्रैल 2023

ग्रिड कंट्रोलर ऑफ इंडिया लिमिटेड
राष्ट्रीय भार प्रेषण केंद्र, नई दिल्ली

GRID CONTROLLER OF INDIA LIMITED

Formerly Power System Operation Corporation Limited

NATIONAL LOAD DESPATCH CENTRE, NEW DELHI



ग्रिड-इंडिया
GRID-INDIA

माह अप्रैल 2023 के लिए प्रचालन निष्पादन रिपोर्ट

OPERATIONAL PERFORMANCE REPORT FOR THE

MONTH OF APRIL-2023


पृष्ठसूची CONTENTS

1	माह अप्रैल 2023 की सारांश रिपोर्ट Summary of report for the month of APRIL 2023	1-5
2	क्षेत्रवार स्थापित विद्युत क्षमता Region wise Installed Capacity	6
3	राष्ट्रीय स्तर पर सांध्यकालीन शिखर मांगपूर्ति Peak demand met at National level	7-8
4	राष्ट्रीय स्तर पर विद्युत ऊर्जा खपत Energy consumption at National level	9-10
5	फ्रिक्वेंसी रूपरेखा Frequency profile	11-12
6	राष्ट्रीय स्तर पर जल विद्युत ऊर्जा उत्पादन Hydro generation at National level	13-14
7	राष्ट्रीय स्तर पर पवन ऊर्जा उत्पादन Wind generation at National level	15
8	राष्ट्रीय स्तर पर सौर ऊर्जा उत्पादन Solar generation at National level	16
9	राष्ट्रीय स्तर पर दैनिक अधिकतम विद्युत मांग पूर्ति Daily maximum demand met at National level	17
10	18 अप्रैल के माँग एवं उत्पादन प्लॉट (अधिकतम मांग पूर्ति) व माँग का डाटा (15 मिनट अंतराल) Demand and generation plots for 18-APRIL (Max Demand Met) and Demand data (15-minute interval)	18-22
11	ऊर्जा आपूर्ति की वास्तविक स्थिति Actual power supply position	23
12	ऊर्जा आवश्यकता एवं आपूर्ति की पिछले वर्ष माह अप्रैल 2022 से तुलना Energy requirement and met comparison with APRIL 2022	24
13	शिखर मांग आवश्यकता एवं आपूर्ति की पिछले वर्ष माह अप्रैल 2022 से तुलना Peak demand requirement and met comparison with APRIL 2022	25


14	क्षेत्रीय स्तर पर शिड्यूल एवं ड्रावल Schedule & drawal at regional level	26
15	अंतर क्षेत्रीय विनिमय Inter-regional exchanges	27-38
16	अंतर राष्ट्रीय विद्युत विनिमय Inter-national exchanges	39-41
17	एसटीओए (द्विपक्षीय एवं सामूहिक) एवं यू आइ का ब्यौरा Bilateral and collective short-term open access & UI details	42
18	पावर मार्केट की सूचना Power market information	43-46
19	अक्षय ऊर्जा प्रमाण पत्र प्रक्रिया Renewable energy certificate mechanism	47-49
20	मुख्य घटनाएँ एवं डिस्टर्बेंस Important events/disturbances	50-57
21	नए कमीशंड पारेषण तत्व New elements commissioned	58
22	विभव रूपरेखा Voltage profile	59
23	अप्रैल 2023 के दौरान रा. भा. प्रे. के. द्वारा निगरानी में तत्वों के आउटेज की सूची List of outage of elements monitored by NLDC for the month of APRIL 2023	-
24	अब तक उच्चतम (मांग व ऊर्जा) आँकड़े : माह अप्रैल 2023 तक All Time Highest (Demand & Energy) figures: Till APRIL 2023	60
25	अप्रैल 2023 के लिए सिस्टम रिलाइबिलिटी सूचकांक System Reliability Indices for APRIL 2023	61

1. SUMMARY OF REPORT FOR THE MONTH OF APR-2023

EVENING PEAK HOUR (at 2000hrs) DEMAND MET AT NATIONAL LEVEL (MW)

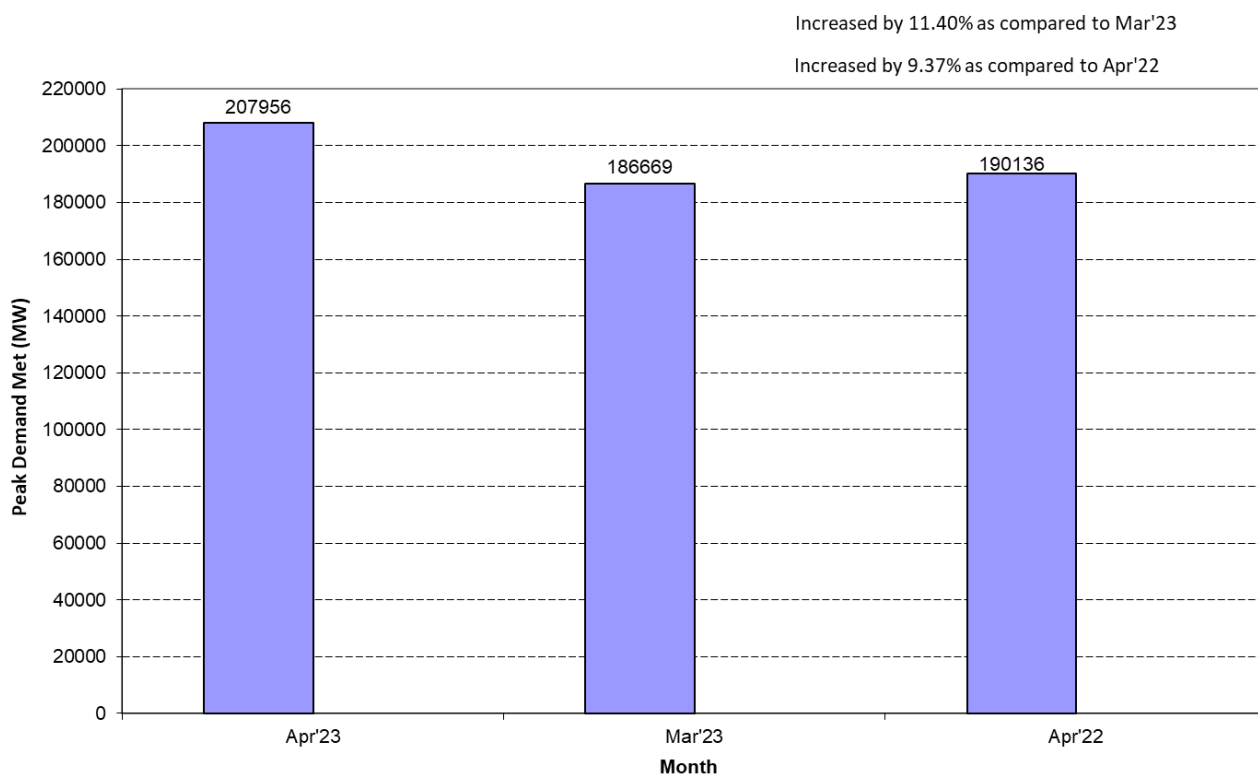


Frequency within IEGC Band

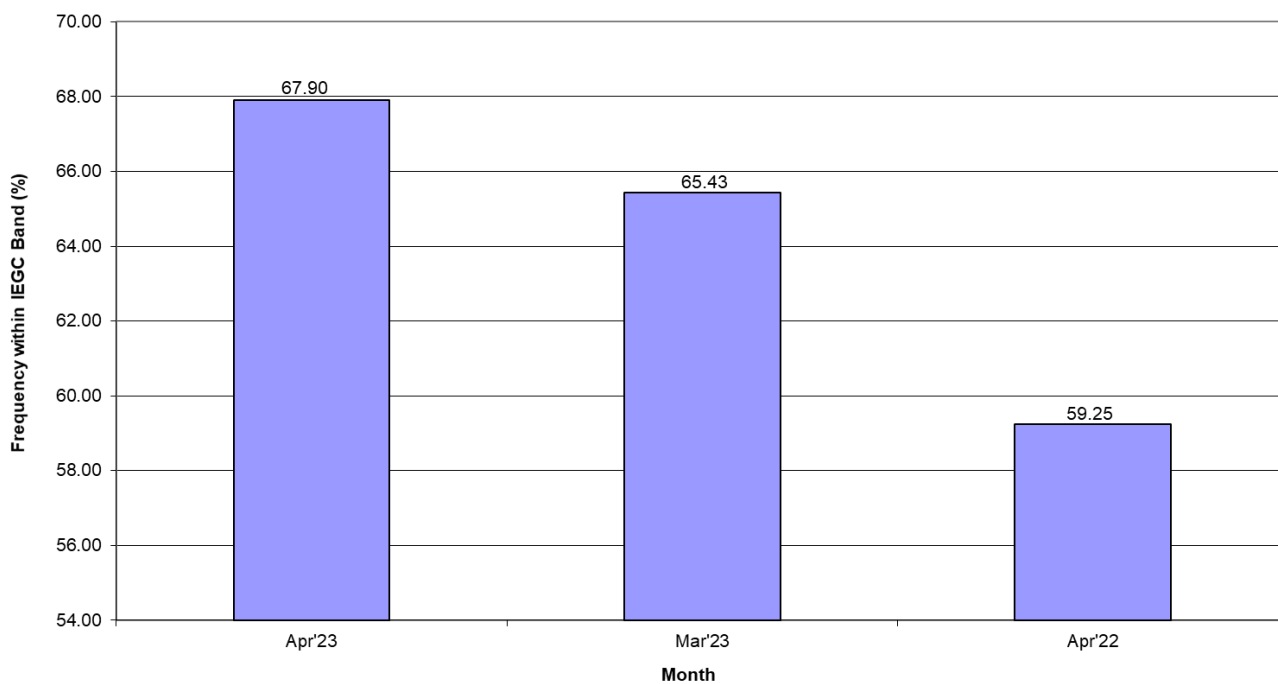

ENERGY MET AT NATIONAL LEVEL (MU)


Increased by 2.38% as compared to Mar'23

Decreased by 1.80% as compared to Apr'22

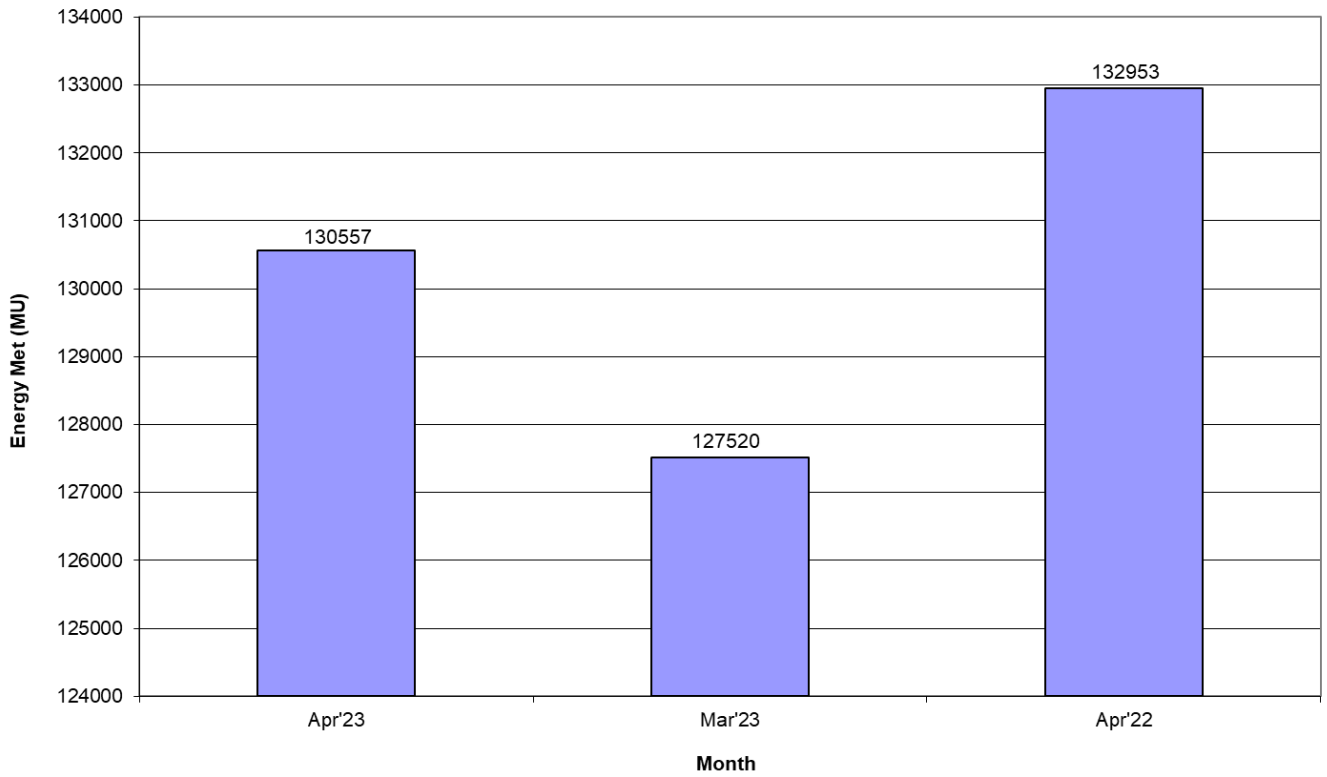


AVERAGE ENERGY MET AT NATIONAL LEVEL (MU/Day)


Decreased by 1.80% as compared to Apr'22

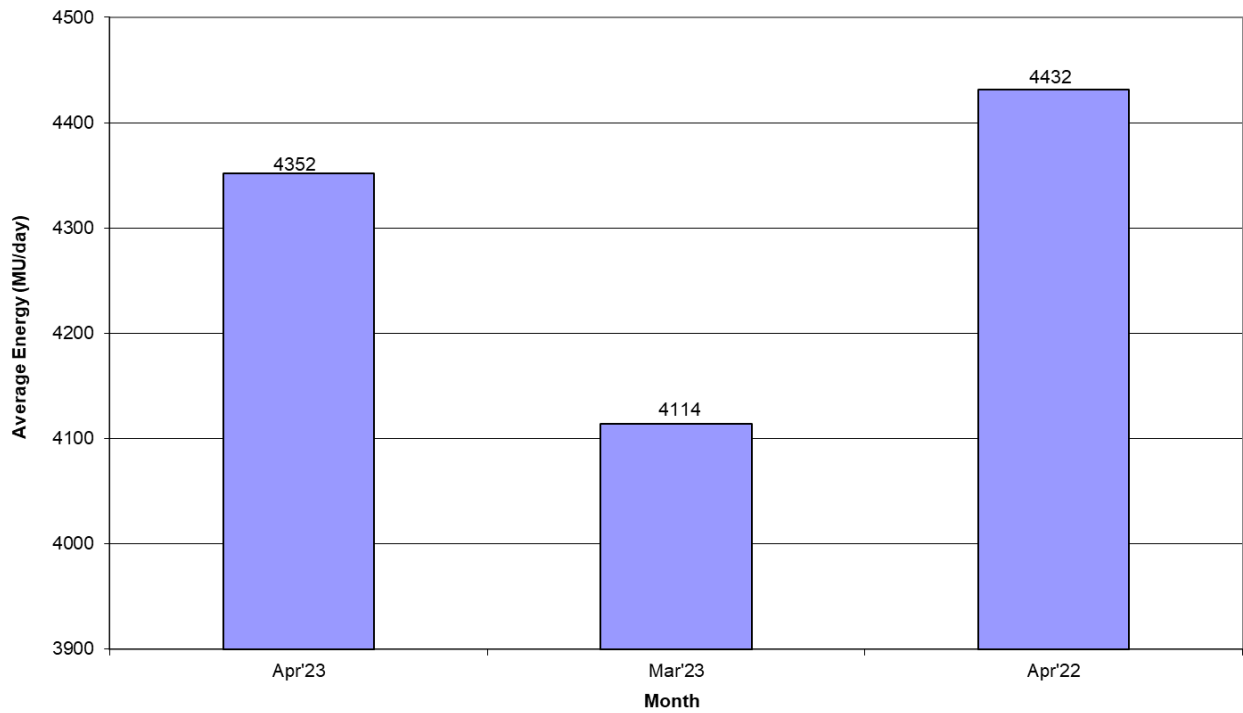

HYDRO GENERATION AT NATIONAL LEVEL (MU)

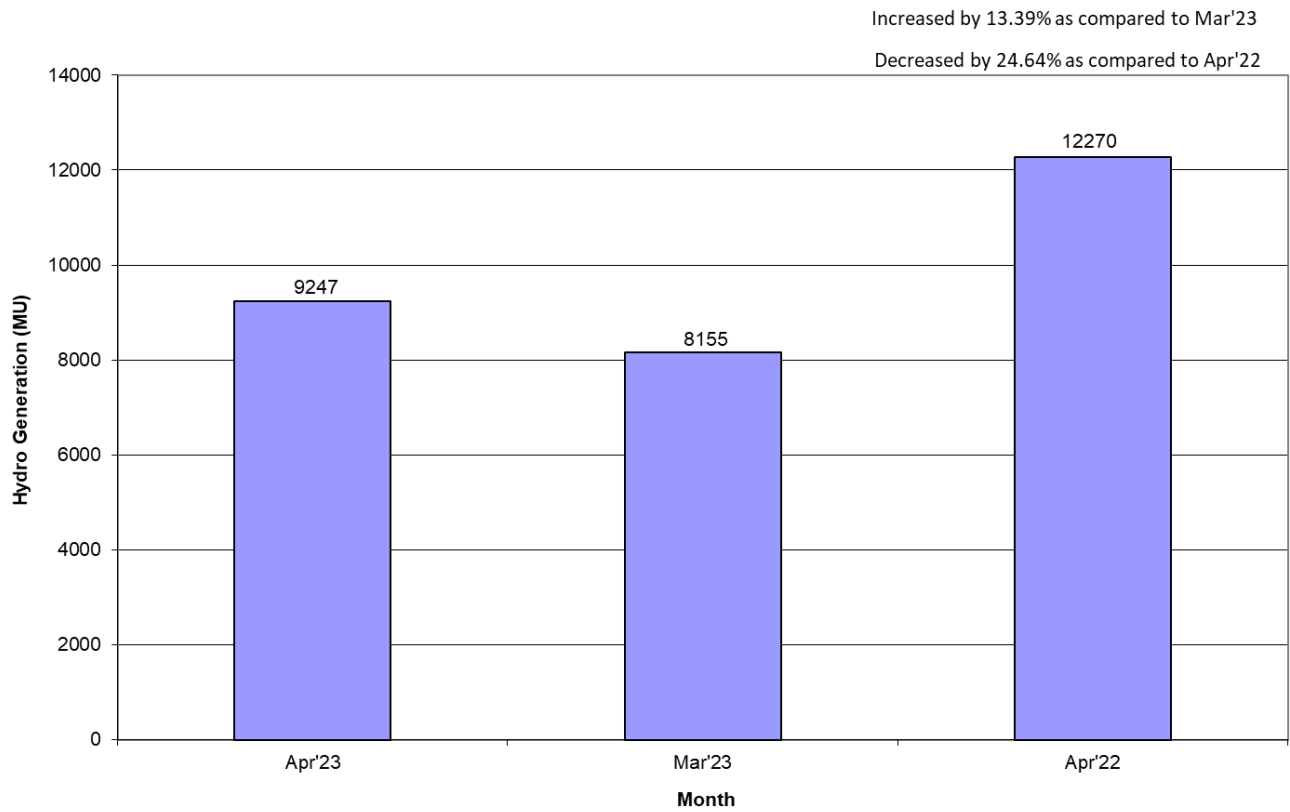


AVERAGE HYDRO GENERATION AT NATIONAL LEVEL (MU/Day)

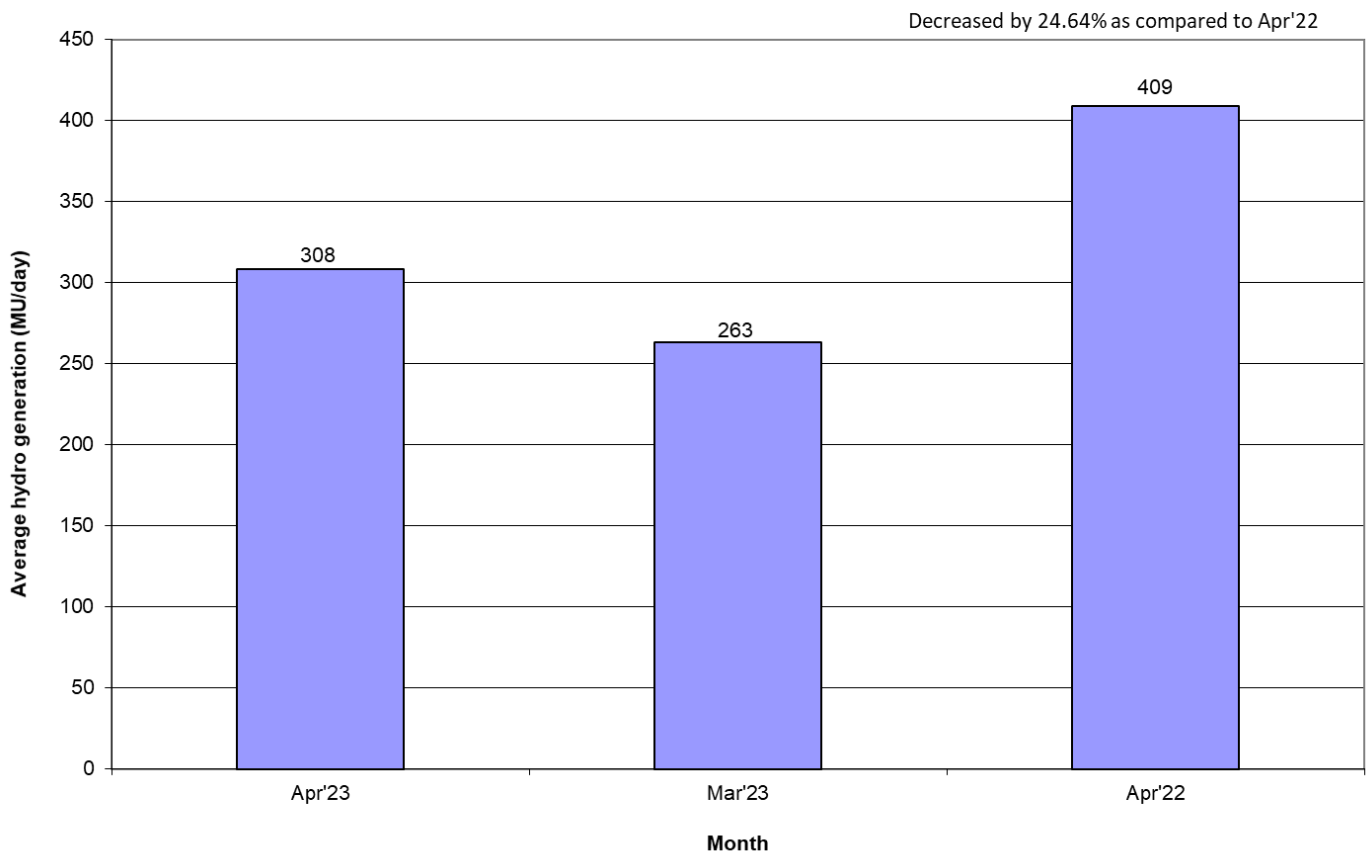

WIND GENERATION AT NATIONAL LEVEL (MU)


Increased by 3.24% as compared to Mar'23

Increased by 1.76% as compared to Apr'22

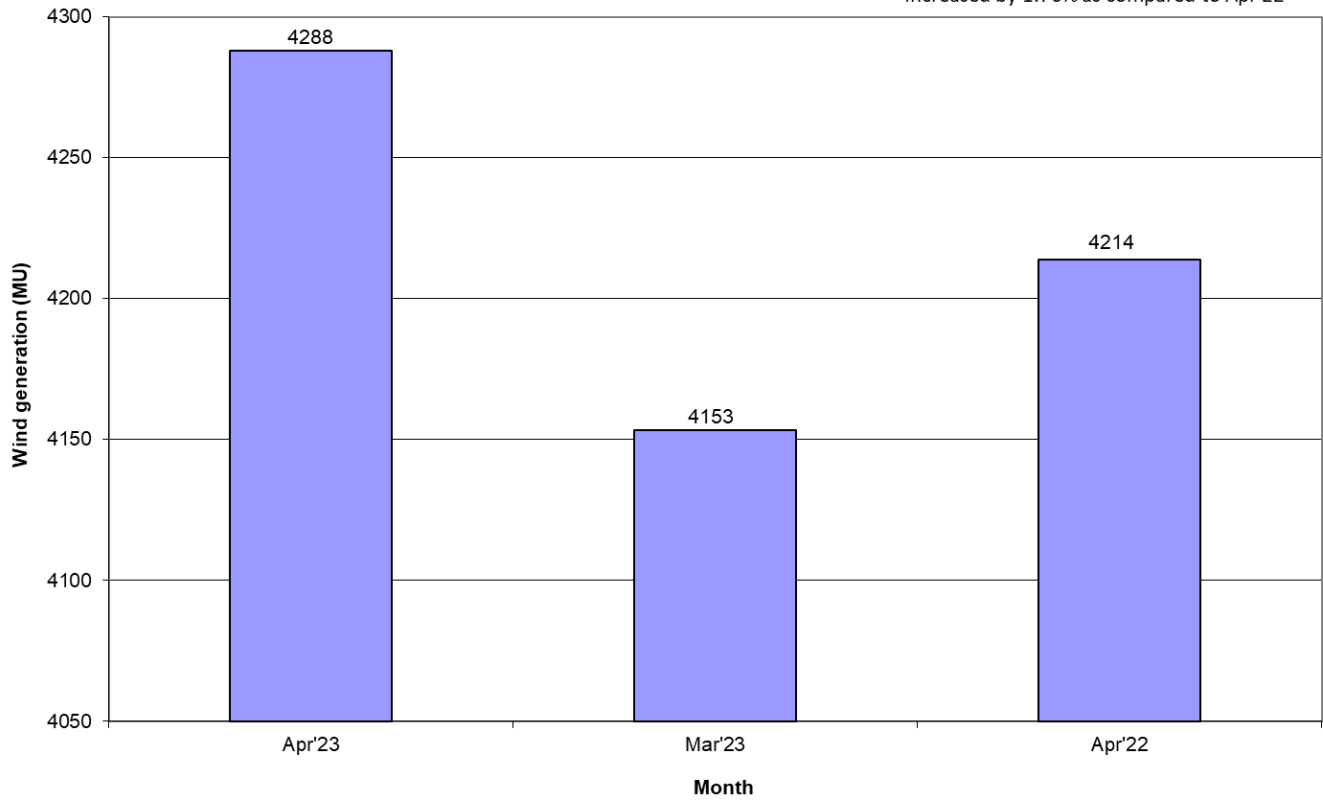

AVERAGE WIND GENERATION AT NATIONAL LEVEL (MU/Day)


Increased by 1.76% as compared to Apr'22

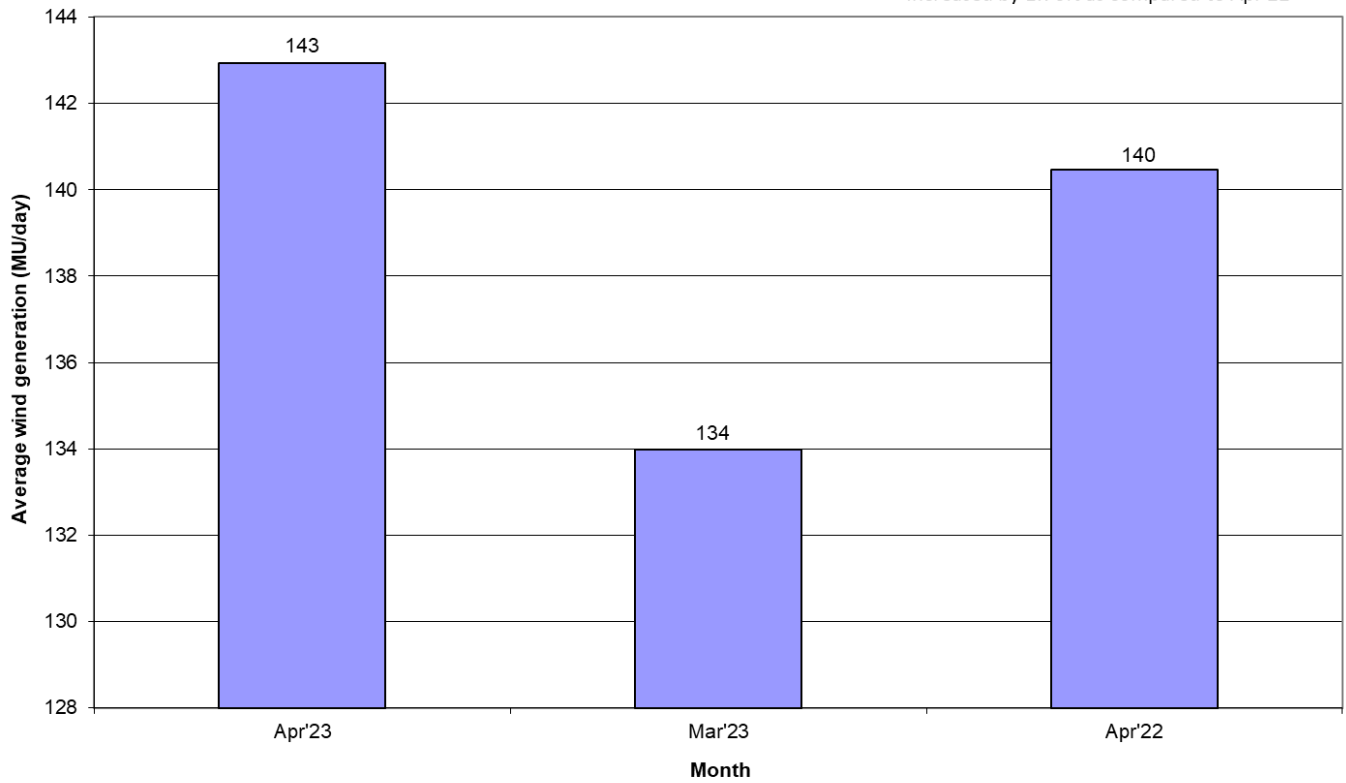

SOLAR GENERATION AT NATIONAL LEVEL (MU)


Increased by 0.84% as compared to Mar'23

Increased by 22.58% as compared to Apr'22

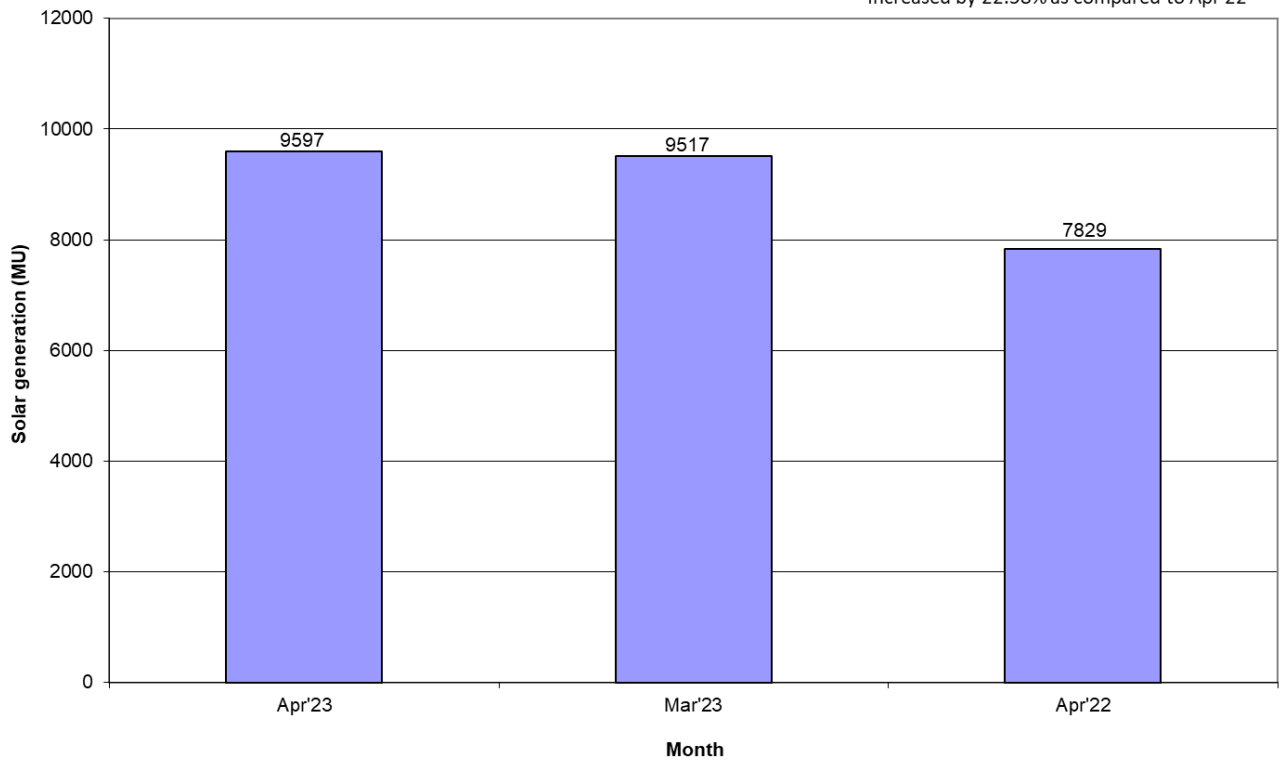

AVERAGE SOLAR GENERATION AT NATIONAL LEVEL (MU/Day)

Increased by 22.58% as compared to Apr'22

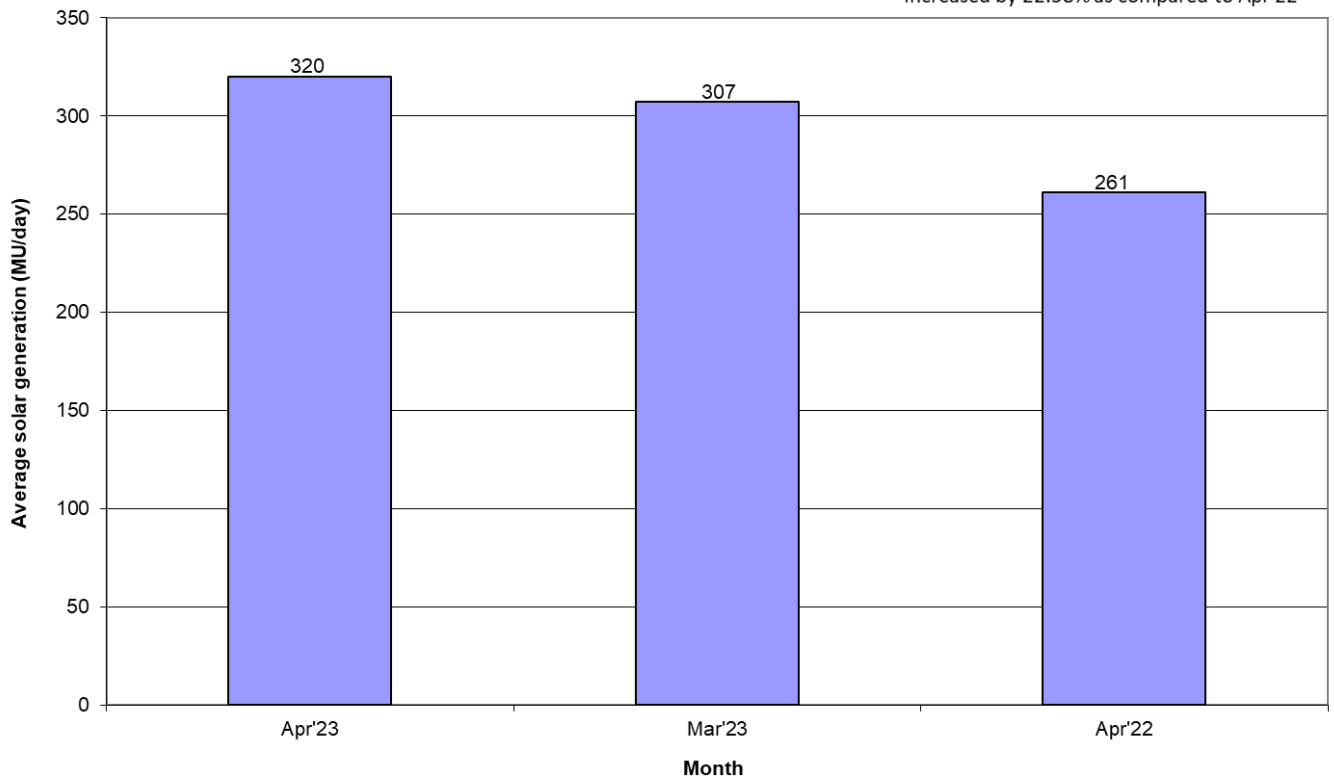

2. ALL INDIA REGIONWISE INSTALLED CAPACITY

As on 30.04.2023
(All figures are in MW)

S No	Region	THERMAL					NUCLEAR	HYDRO	RES @ MNRE	GRAND TOTAL
		COAL	LIGNITE	GAS	DIESEL	TOTAL				
1	NR	55458	1580	5781	0	62819	1620	20752	33113	118303
2	WR	74463	1400	10806	0	86669	1840	7563	39748	135820
3	SR	47005	3640	6492	434	57571	3320	11827	50409	123127
4	ER	27700	0	80	0	27780	0	4764	1843	34387
5	NER	610	0	1665	36	2311	0	1944	540	4796
6	ISLANDS	0	0	0	120	120	0	0	38	158
	ALL INDIA	205235	6620	24824	589	237269	6780	46850	125692	416591

Remarks: Data from CEA website

3. राष्ट्रीय स्तर पर संध्याकालीन शिखर विद्युत मांग पूर्ति
EVENING PEAK HOUR DEMAND MET AT NATIONAL LEVEL

माह: अप्रैल 2023 MONTH:- APR 2023


सभी आंकड़े मेगावाट मे All figures in MW

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
1-Apr-23	42504	55102	47759	20026	2437	167828
2-Apr-23	42813	54661	44519	20946	2230	165169
3-Apr-23	45698	57981	48215	22045	2424	176363
4-Apr-23	46974	59000	47566	23214	2398	179152
5-Apr-23	46306	58599	48318	22953	2628	178804
6-Apr-23	48858	58488	48879	22857	2623	181705
7-Apr-23	49427	55680	47740	23869	2572	179288
8-Apr-23	49779	57267	48049	23404	2695	181194
9-Apr-23	48418	56338	44458	24661	2622	176497
10-Apr-23	51198	61383	48890	24570	2764	188805
11-Apr-23	53596	61721	49832	25584	2856	193589
12-Apr-23	54966	62642	50473	25938	2843	196862
13-Apr-23	54406	61595	50505	25999	2931	195436
14-Apr-23	55204	59664	48409	26345	2835	192457
15-Apr-23	56004	60313	49445	27099	2804	195665
16-Apr-23	56674	59678	46916	26766	2908	192942
17-Apr-23	59936	62760	51325	27455	3096	204572
18-Apr-23	60395	63593	52366	28579	3023	207956
19-Apr-23	60436	62902	52343	27674	2552	205907
20-Apr-23	56963	59470	51919	26647	2696	197695
21-Apr-23	57209	60787	49031	24659	2313	193999
22-Apr-23	55675	56605	47476	22119	2561	184436
23-Apr-23	48923	56478	43308	22429	2005	173143
24-Apr-23	50735	59292	48950	22400	2604	183981
25-Apr-23	55670	59593	45702	24102	2741	187808
26-Apr-23	56572	56348	48670	24369	2914	188873
27-Apr-23	52217	58439	49111	23678	2867	186312
28-Apr-23	56453	54537	48761	24959	2932	187642
29-Apr-23	52953	53948	45465	23364	2644	178374
30-Apr-23	45268	50429	42472	20046	2571	160786
उच्चतम MAXIMUM	60436	63593	52366	28579	3096	207956
निम्नतम MINIMUM	42504	50429	42472	20026	2005	160786
औसत AVERAGE	52408	58510	48229	24292	2670	186108
अब तक का उच्चतम All Time Max.	71909	63593	52366	28579	3510	207956
दिनांक Date	09.09.22	18.04.23	18.04.23	18.04.23	12.08.22	18.04.23

नोट : सभी आंकड़े 2000 बजे की मांगपूर्ति पर आधारित है ।

Note: The above figures correspond to value at 2000 Hrs

EVENTING PEAK HOUR DEMAND (2000hrs) MET DURING THE MONTH OF APRIL 2023

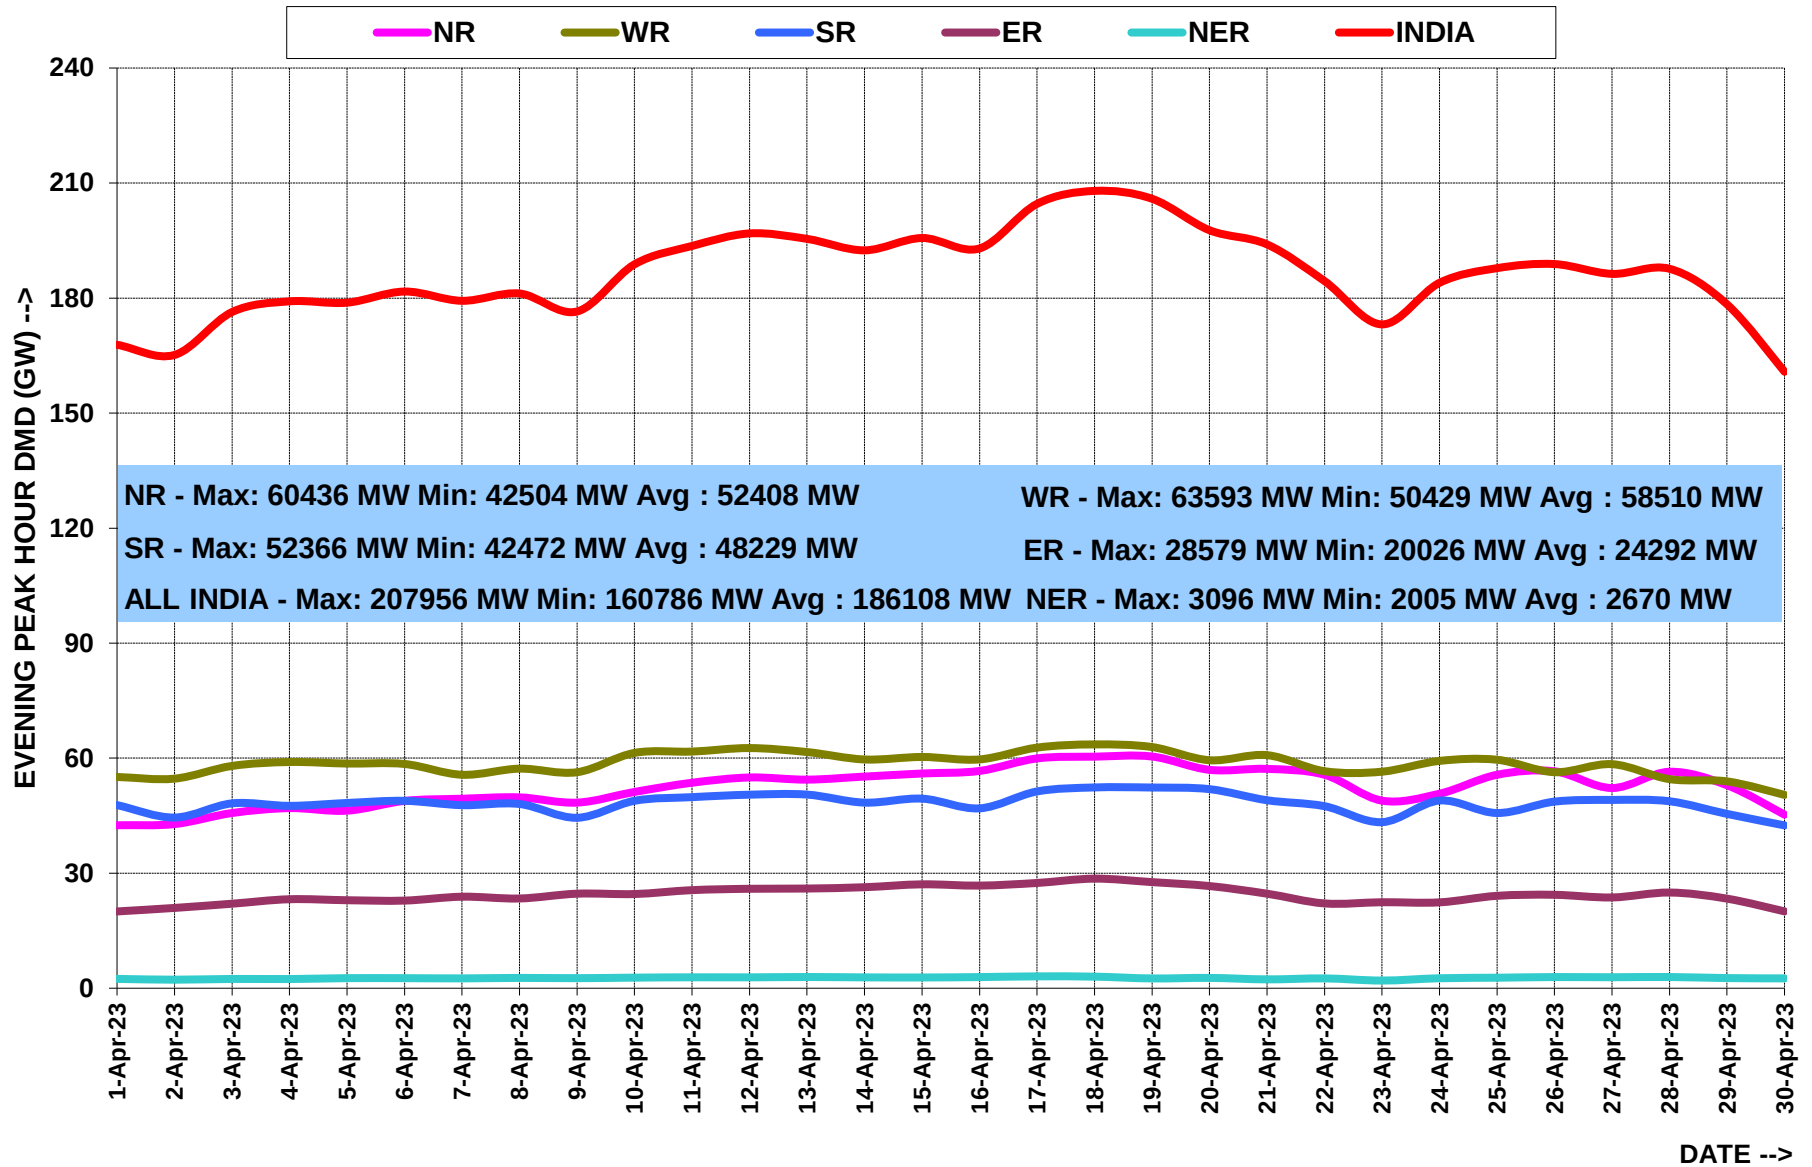


4. राष्ट्रीय स्तर पर विद्युत ऊर्जा आपूर्ति ENERGY MET AT NATIONAL LEVEL

माह: अप्रैल 2023 MONTH:- APR 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Apr-23	892	1326	1261	411	45	3935
02-Apr-23	886	1326	1187	434	40	3874
03-Apr-23	944	1394	1253	465	41	4097
04-Apr-23	960	1423	1252	501	45	4181
05-Apr-23	988	1404	1257	510	46	4204
06-Apr-23	994	1409	1276	506	47	4232
07-Apr-23	1025	1378	1248	522	49	4222
08-Apr-23	1034	1395	1230	532	50	4241
09-Apr-23	1005	1378	1188	531	49	4151
10-Apr-23	1051	1443	1258	545	50	4349
11-Apr-23	1091	1459	1291	559	53	4452
12-Apr-23	1134	1502	1305	561	54	4555
13-Apr-23	1136	1518	1313	571	55	4592
14-Apr-23	1177	1497	1281	586	53	4594
15-Apr-23	1192	1460	1251	605	53	4560
16-Apr-23	1168	1432	1226	599	55	4480
17-Apr-23	1263	1509	1287	605	57	4721
18-Apr-23	1286	1539	1321	631	59	4836
19-Apr-23	1242	1537	1329	630	54	4792
20-Apr-23	1263	1505	1328	608	49	4752
21-Apr-23	1229	1462	1274	570	43	4578
22-Apr-23	1202	1433	1206	512	43	4396
23-Apr-23	1075	1362	1112	496	39	4084
24-Apr-23	1113	1428	1178	483	45	4247
25-Apr-23	1160	1453	1177	495	50	4335
26-Apr-23	1226	1433	1139	527	53	4378
27-Apr-23	1212	1392	1175	529	53	4361
28-Apr-23	1220	1357	1188	525	52	4343
29-Apr-23	1197	1293	1134	536	50	4211
30-Apr-23	1047	1201	1018	490	48	3804
कुल TOTAL	33412	42647	36942	16075	1480	130557
उच्चतम MAXIMUM	1286	1539	1329	631	59	4836
निम्नतम MINIMUM	886	1201	1018	411	39	3804
औसत AVERAGE	1114	1422	1231	536	49	4352
संचयी 2023-24 Cumulative 2023-24	33412	42647	36942	16075	1480	130557
अब तक का उच्चतम All Time Max.	1737	1539	1329	631	69	4836
दिनांक Date	28.06.22	18.04.23	19.04.23	18.04.23	15.07.22	18.04.23

ENERGY MET DURING THE MONTH OF APRIL' 2023

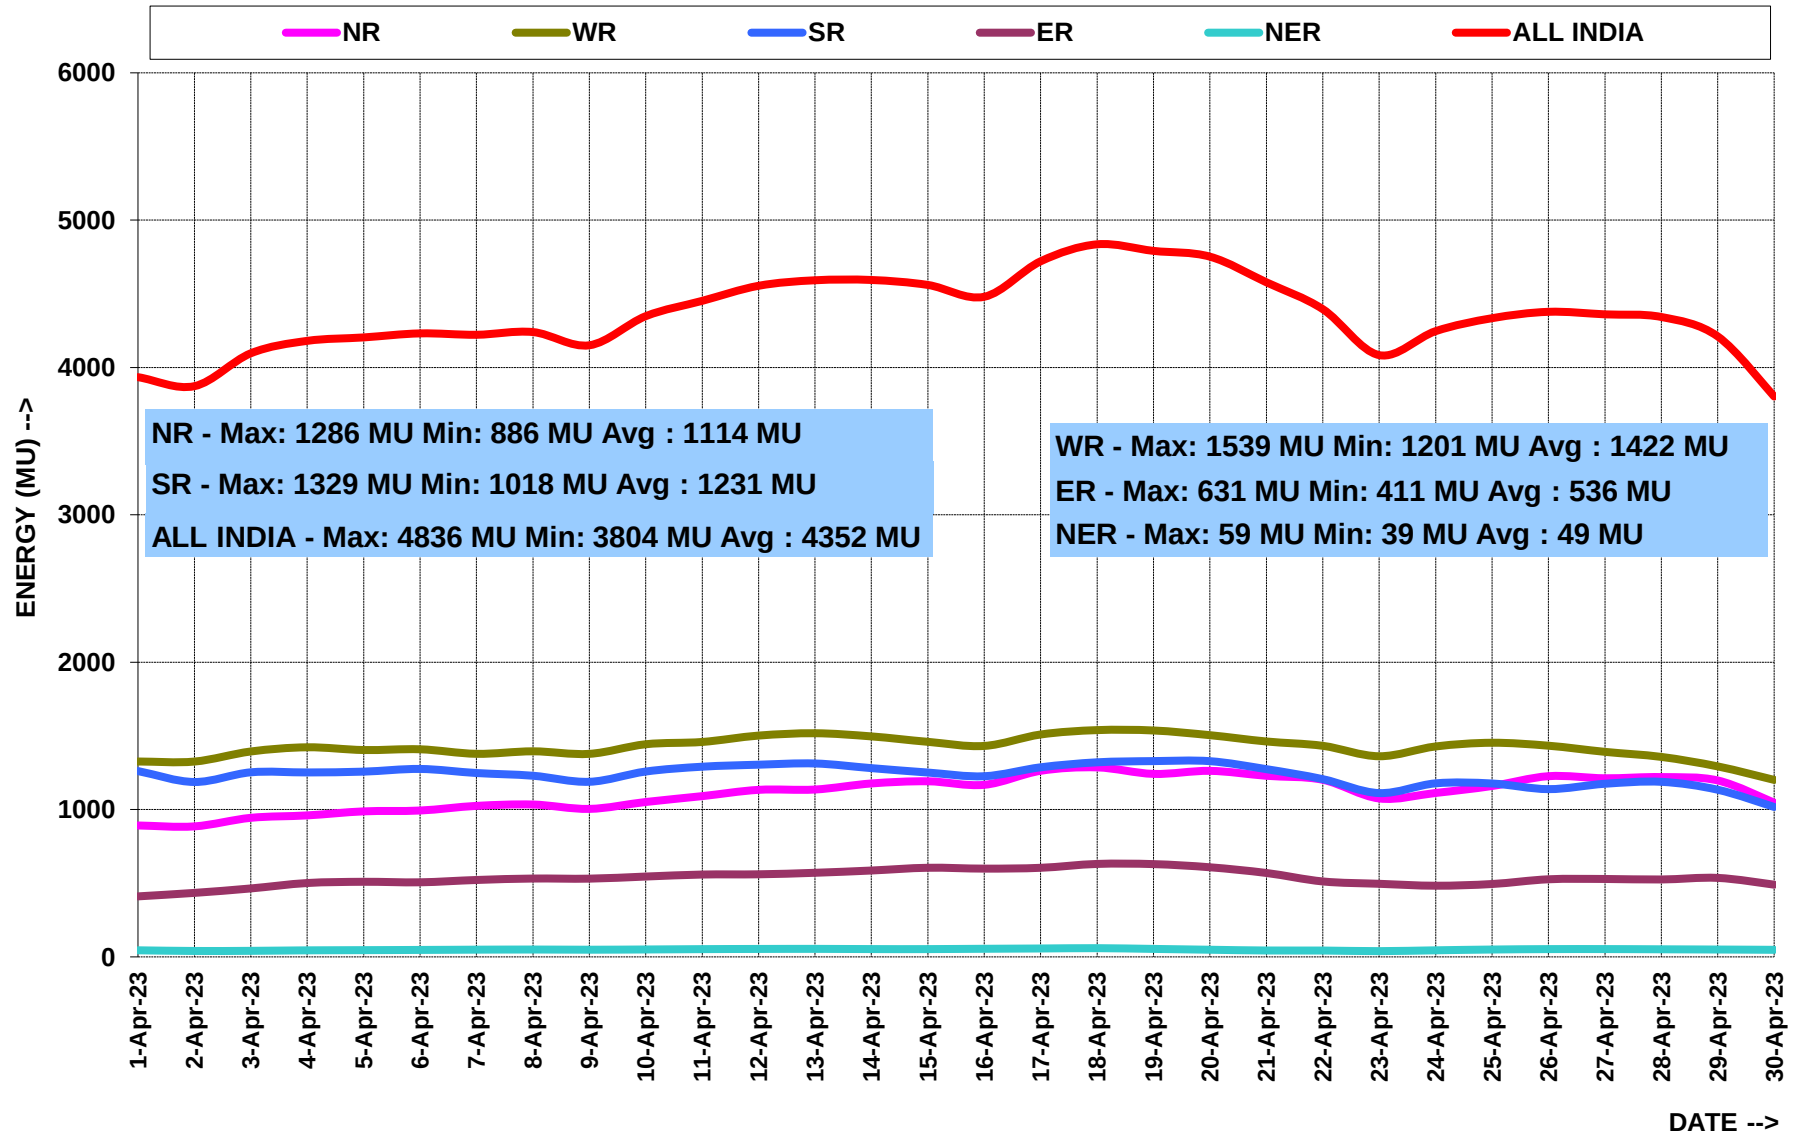

5. वर्ष 2023-24 के लिए आवृत्ति रूपरेखा FREQUENCY PROFILE FOR YEAR 2023-24

राष्ट्रीय ग्रीड NATIONAL GRID								
फ्रिक्वेंसी रूपरेखा (Hz)			<49.9	49.9-50.05	>50.05	उच्चतम फ्रिक्वेंसी	निम्नतम फ्रिक्वेंसी	औसत फ्रिक्वेंसी
% समय	Apr-23	All India Grid	10.54	67.90	21.56	50.33	49.49	49.99
	2023-24 (upto Apr)	All India Grid	10.54	67.90	21.56	50.33	49.49	49.99

5.1 अप्रैल 2023 के लिए आवृत्ति रूपरेखा FREQUENCY PROFILE FOR APRIL 2023

फ्रिक्वेंसी रूपरेखा (Hz)		<49.9	49.9-50.05	>50.05	उच्चतम फ्रिक्वेंसी	निम्नतम फ्रिक्वेंसी	औसत फ्रिक्वेंसी	एफ़.वी.आई.
% समय	01-Apr-23	9.19	64.47	26.34	50.29	49.75	50.00	0.07
	02-Apr-23	7.92	72.14	19.94	50.27	49.75	50.00	0.05
	03-Apr-23	13.60	72.69	13.72	50.24	49.67	49.97	0.07
	04-Apr-23	12.00	72.37	15.63	50.23	49.78	49.98	0.05
	05-Apr-23	8.94	69.80	21.26	50.29	49.70	50.00	0.06
	06-Apr-23	13.38	64.59	22.03	50.23	49.70	49.99	0.07
	07-Apr-23	6.94	70.10	22.95	50.31	49.75	50.00	0.05
	08-Apr-23	9.88	71.11	19.00	50.22	49.73	49.99	0.05
	09-Apr-23	9.16	68.65	22.20	50.25	49.71	50.00	0.06
	10-Apr-23	16.91	65.27	17.82	50.17	49.64	49.98	0.08
	11-Apr-23	14.98	68.94	16.09	50.25	49.62	49.98	0.07
	12-Apr-23	7.81	63.04	29.14	50.31	49.78	50.01	0.06
	13-Apr-23	12.70	71.77	15.53	50.27	49.70	49.98	0.06
	14-Apr-23	12.12	71.46	16.42	50.23	49.69	49.98	0.06
	15-Apr-23	22.03	63.75	14.22	50.26	49.49	49.96	0.11
	16-Apr-23	11.23	66.97	21.81	50.33	49.61	49.99	0.07
	17-Apr-23	12.20	59.19	28.61	50.22	49.51	50.00	0.08
	18-Apr-23	5.23	73.88	20.89	50.27	49.78	50.00	0.04
	19-Apr-23	8.30	67.25	24.46	50.30	49.75	50.00	0.05
	20-Apr-23	4.97	69.14	25.89	50.23	49.82	50.01	0.04
	21-Apr-23	7.14	63.66	29.20	50.26	49.78	50.01	0.05
	22-Apr-23	2.30	72.87	24.83	50.30	49.80	50.01	0.04
	23-Apr-23	4.85	64.24	30.91	50.33	49.77	50.02	0.06
	24-Apr-23	11.76	72.00	16.24	50.21	49.77	49.98	0.05
	25-Apr-23	6.49	68.67	24.84	50.31	49.68	50.00	0.06
	26-Apr-23	16.56	66.19	17.25	50.32	49.65	49.98	0.09
	27-Apr-23	9.99	71.64	18.37	50.25	49.69	49.99	0.05
	28-Apr-23	15.35	68.70	15.95	50.21	49.55	49.97	0.09
	29-Apr-23	9.29	66.04	24.66	50.28	49.74	50.00	0.06
	30-Apr-23	13.11	56.42	30.46	50.33	49.73	50.01	0.11


6.राष्ट्रीय स्तर पर जल विद्युत उत्पादन
HYDRO GENERATION AT NATIONAL LEVEL

माह: अप्रैल 2023 MONTH:- APR 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Apr-23	116	20	61	27	7	230
02-Apr-23	118	19	57	28	11	233
03-Apr-23	121	35	73	34	11	274
04-Apr-23	125	43	69	40	11	289
05-Apr-23	121	67	72	43	15	317
06-Apr-23	118	66	79	38	10	311
07-Apr-23	115	49	72	41	11	287
08-Apr-23	112	31	70	41	10	263
09-Apr-23	117	28	64	39	9	257
10-Apr-23	118	40	70	40	9	277
11-Apr-23	124	65	79	38	8	314
12-Apr-23	124	49	82	35	9	298
13-Apr-23	134	44	90	41	9	317
14-Apr-23	144	33	75	46	8	307
15-Apr-23	159	32	77	51	8	327
16-Apr-23	154	30	77	44	9	315
17-Apr-23	159	44	89	45	9	345
18-Apr-23	161	46	91	47	11	355
19-Apr-23	187	41	77	48	8	362
20-Apr-23	218	35	75	53	13	395
21-Apr-23	217	29	64	47	13	370
22-Apr-23	192	24	51	42	13	322
23-Apr-23	172	18	52	43	10	294
24-Apr-23	162	31	69	40	10	312
25-Apr-23	164	25	68	33	10	300
26-Apr-23	174	25	67	37	10	313
27-Apr-23	178	24	75	36	8	321
28-Apr-23	188	20	71	40	9	329
29-Apr-23	187	26	53	41	11	318
30-Apr-23	174	15	51	40	15	296
कुल TOTAL	4550	1054	2121	1220	303	9247
उच्चतम MAXIMUM	218	67	91	53	15	395
निम्नतम MINIMUM	112	15	51	27	7	230
औसत AVERAGE	152	35	71	41	10	308
संचयी 2023-24 Cumulative 2023-24	4550	1054	2121	1220	303	9247
अब तक का उच्चतम All Time Max.	409	167	208	157	41	877
दिनांक Date	22.08.22	18.12.14	31.08.18	14.09.22	01.08.22	30.08.22

HYDRO ENERGY DURING THE MONTH OF APRIL' 2023

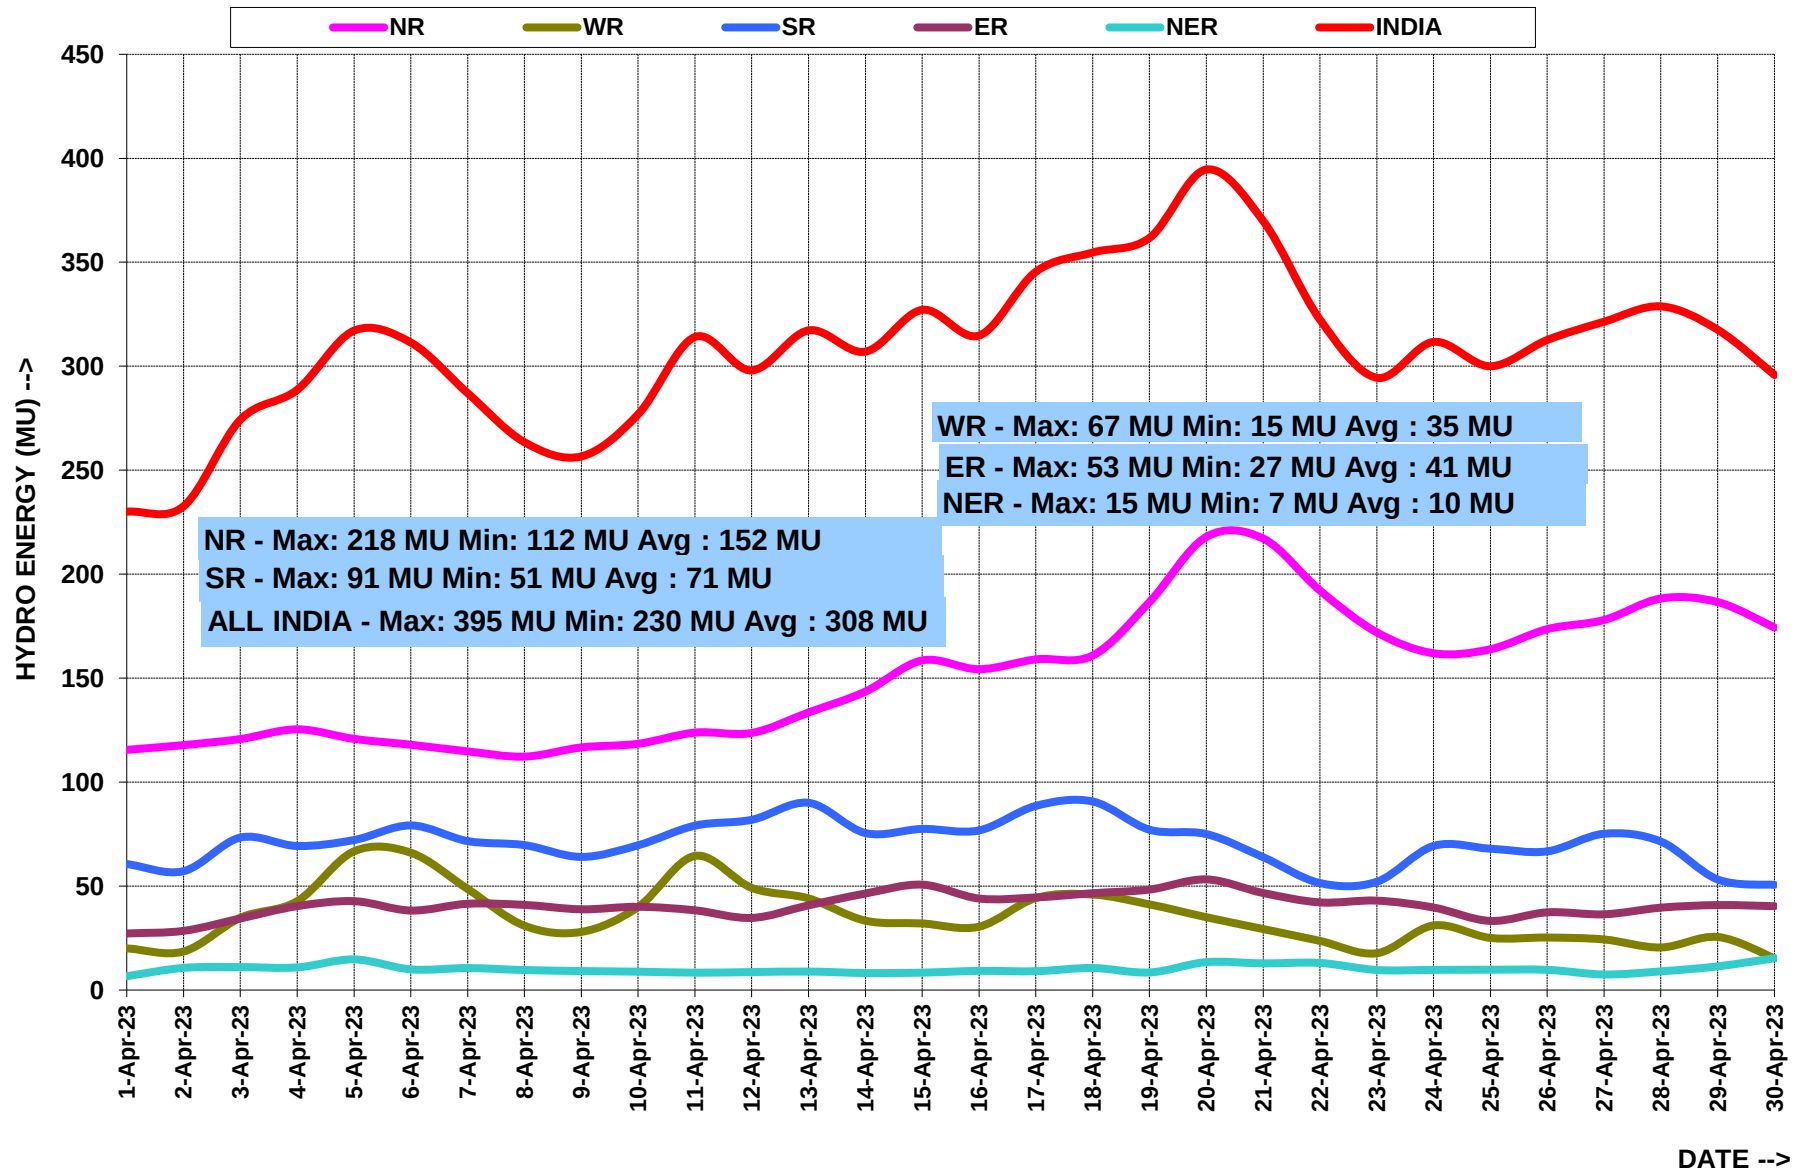

7. राष्ट्रीय स्तर पर पवन ऊर्जा उत्पादन
WIND GENERATION AT NATIONAL LEVEL

माह: अप्रैल 2023 MONTH:- APR 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Apr-23	15	90	40	-----	-----	145
02-Apr-23	35	80	47	-----	-----	162
03-Apr-23	49	108	32	-----	-----	189
04-Apr-23	13	90	29	-----	-----	132
05-Apr-23	17	132	28	-----	-----	178
06-Apr-23	41	111	32	-----	-----	184
07-Apr-23	44	106	33	-----	-----	183
08-Apr-23	30	63	49	-----	-----	143
09-Apr-23	20	55	47	-----	-----	121
10-Apr-23	22	49	55	-----	-----	125
11-Apr-23	17	57	41	-----	-----	115
12-Apr-23	16	69	37	-----	-----	122
13-Apr-23	9	83	28	-----	-----	120
14-Apr-23	14	103	32	-----	-----	149
15-Apr-23	24	85	43	-----	-----	153
16-Apr-23	20	80	28	-----	-----	127
17-Apr-23	27	76	40	-----	-----	143
18-Apr-23	33	73	31	-----	-----	137
19-Apr-23	15	117	33	-----	-----	165
20-Apr-23	21	117	61	-----	-----	199
21-Apr-23	11	102	62	-----	-----	175
22-Apr-23	16	108	41	-----	-----	165
23-Apr-23	26	95	38	-----	-----	159
24-Apr-23	18	58	32	-----	-----	108
25-Apr-23	14	81	32	-----	-----	126
26-Apr-23	26	107	24	-----	-----	157
27-Apr-23	15	70	32	-----	-----	116
28-Apr-23	19	57	30	-----	-----	106
29-Apr-23	13	44	31	-----	-----	88
30-Apr-23	8	60	29	-----	-----	98
कुल TOTAL	647	2526	1115	-----	-----	4288
उच्चतम MAXIMUM	49	132	62	-----	-----	199
निम्नतम MINIMUM	8	44	24	-----	-----	88
औसत AVERAGE	22	84	37	-----	-----	143
संचयी 2023-24 Cumulative 2023-24	647	2526	1115	-----	-----	4288
अब तक का उच्चतम All Time Max.	78	272	297	-----	-----	555
दिनांक Date	09.06.22	22.05.22	12.07.22	-----	-----	22.05.22

***Source:** As reported by SLDCs. Limited visibility of embedded wind generator data.

8. राष्ट्रीय स्तर पर सौर ऊर्जा उत्पादन
SOLAR GENERATION AT NATIONAL LEVEL

माह: अप्रैल 2023 MONTH:- APR 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Apr-23	136	66	127	3.5	0.3	333
02-Apr-23	140	68	128	3.3	0.7	340
03-Apr-23	134	67	127	2.0	0.6	331
04-Apr-23	140	65	118	2.5	0.6	326
05-Apr-23	142	59	126	6.0	0.9	334
06-Apr-23	139	60	121	5.3	1.2	326
07-Apr-23	142	52	114	6.0	1.2	315
08-Apr-23	139	55	122	5.7	1.2	323
09-Apr-23	141	63	123	3.2	1.1	332
10-Apr-23	127	65	133	3.2	1.2	329
11-Apr-23	100	64	134	2.9	1.2	302
12-Apr-23	141	67	132	2.8	1.1	343
13-Apr-23	140	57	126	5.3	1.1	330
14-Apr-23	137	63	118	5.2	1.1	325
15-Apr-23	131	62	118	5.8	1.0	317
16-Apr-23	138	68	131	5.1	0.9	343
17-Apr-23	139	68	130	3.3	1.0	341
18-Apr-23	136	66	128	2.6	0.9	333
19-Apr-23	123	66	125	2.6	1.0	317
20-Apr-23	133	64	122	2.6	1.1	322
21-Apr-23	147	67	117	4.8	0.8	337
22-Apr-23	144	65	110	2.5	1.1	322
23-Apr-23	143	63	128	5.1	0.5	340
24-Apr-23	142	64	126	5.5	1.4	339
25-Apr-23	141	65	110	2.7	1.4	319
26-Apr-23	120	59	112	3.0	1.3	296
27-Apr-23	100	64	109	2.5	1.2	277
28-Apr-23	103	54	108	2.6	1.1	269
29-Apr-23	119	43	103	5.0	0.9	272
30-Apr-23	100	51	108	5.1	1.1	265
कुल TOTAL	3955	1860	3634	118	30	9597
उच्चतम MAXIMUM	147	68	134	6	1	343
निम्नतम MINIMUM	100	43	103	2	0	265
औसत AVERAGE	132	62	121	4	1	320
संचयी 2023-24 Cumulative 2023-24	3955	1860	3634	118	30.3	9597
अब तक का उच्चतम All Time Max.	147	70	143	7	2.4	345
दिनांक Date	21.04.23	21.02.23	21.03.23	23.03.23	22.06.22	13.02.23

*Source: RLDCs for solar connected to ISTs; SLDCs for embedded solar. Limited visibility of embedded solar data.

9. राष्ट्रीय स्तर पर दैनिक अधिकतम विद्युत मांग पूर्ति
DAILY MAXIMUM DEMAND MET AT NATIONAL LEVEL

माह: अप्रैल 2023 MONTH:- APR 2023

सभी आंकड़े मेगावाट में All figures in MW


दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL	विभिन्नता फैक्टर Diversity Factor*
01-Apr-23	45142	59789	60780	20186	2557	180284	1.045
02-Apr-23	44928	59392	55930	21113	2370	174691	1.052
03-Apr-23	48037	63829	61219	22752	2570	187729	1.057
04-Apr-23	50179	64099	60798	23809	2596	189684	1.062
05-Apr-23	50374	63992	60779	23773	2704	189003	1.067
06-Apr-23	51324	64374	62404	23633	2752	192061	1.065
07-Apr-23	52050	65159	60428	24428	2779	193282	1.060
08-Apr-23	52309	63430	58886	24396	2863	189327	1.066
09-Apr-23	50128	61900	55426	24839	2727	182654	1.068
10-Apr-23	52803	65837	61065	24747	2914	194537	1.066
11-Apr-23	54945	67327	61635	25931	3005	197928	1.075
12-Apr-23	56319	66563	62037	26097	3028	200574	1.067
13-Apr-23	55873	68285	62929	26431	3052	203546	1.064
14-Apr-23	56619	68186	62453	26792	2914	206183	1.052
15-Apr-23	57245	67459	60391	27109	2978	202601	1.062
16-Apr-23	56806	65176	57637	27264	3040	194976	1.077
17-Apr-23	60685	69436	62500	27928	3157	210829	1.061
18-Apr-23	61308	70646	62744	28913	3235	215882	1.051
19-Apr-23	60762	70402	63221	29302	2888	214924	1.054
20-Apr-23	57635	68595	63794	28763	2911	211804	1.047
21-Apr-23	58121	67085	61326	27535	2489	204777	1.058
22-Apr-23	56871	65049	57489	24011	2663	198272	1.039
23-Apr-23	52938	60088	51567	23084	2043	184407	1.029
24-Apr-23	52646	65614	56756	22769	2732	191917	1.045
25-Apr-23	56618	65826	56380	24293	2836	194367	1.060
26-Apr-23	57628	66049	53709	24873	2965	195821	1.048
27-Apr-23	54108	64466	55896	24205	2908	196240	1.027
28-Apr-23	57401	62038	56241	25565	3061	197000	1.037
29-Apr-23	53549	57819	53853	24831	2801	188802	1.021
30-Apr-23	50639	53455	47523	23949	2774	173339	1.029
उच्चतम MAXIMUM	61308	70646	63794	29302	3235	215882	1.077
निम्नतम MINIMUM	44928	53455	47523	20186	2043	173339	1.021
औसत AVERAGE	54200	64712	58927	25111	2810	195248	1.054
अब तक का उच्चतम All Time Max.	77091	71321	64314	29302	3596	215882	
दिनांक Date	28.06.22	27.12.22	15.03.23	19.04.23	17.08.22	18.04.23	

* Diversity factor = (Sum of regional max demands) / All India max demand


नोट : यह आंकड़े एनएलडीसी स्काडा प्रणाली में दर्ज दैनिक अधिकतम मांगपूर्ति दर्शाते हैं ।

Note: The above figures denote daily maximum demand met recorded in NLDC SCADA.


10. DEMAND AND GENERATION PLOTS FOR 18 APRIL (MAXIMUM DEMAND MET)

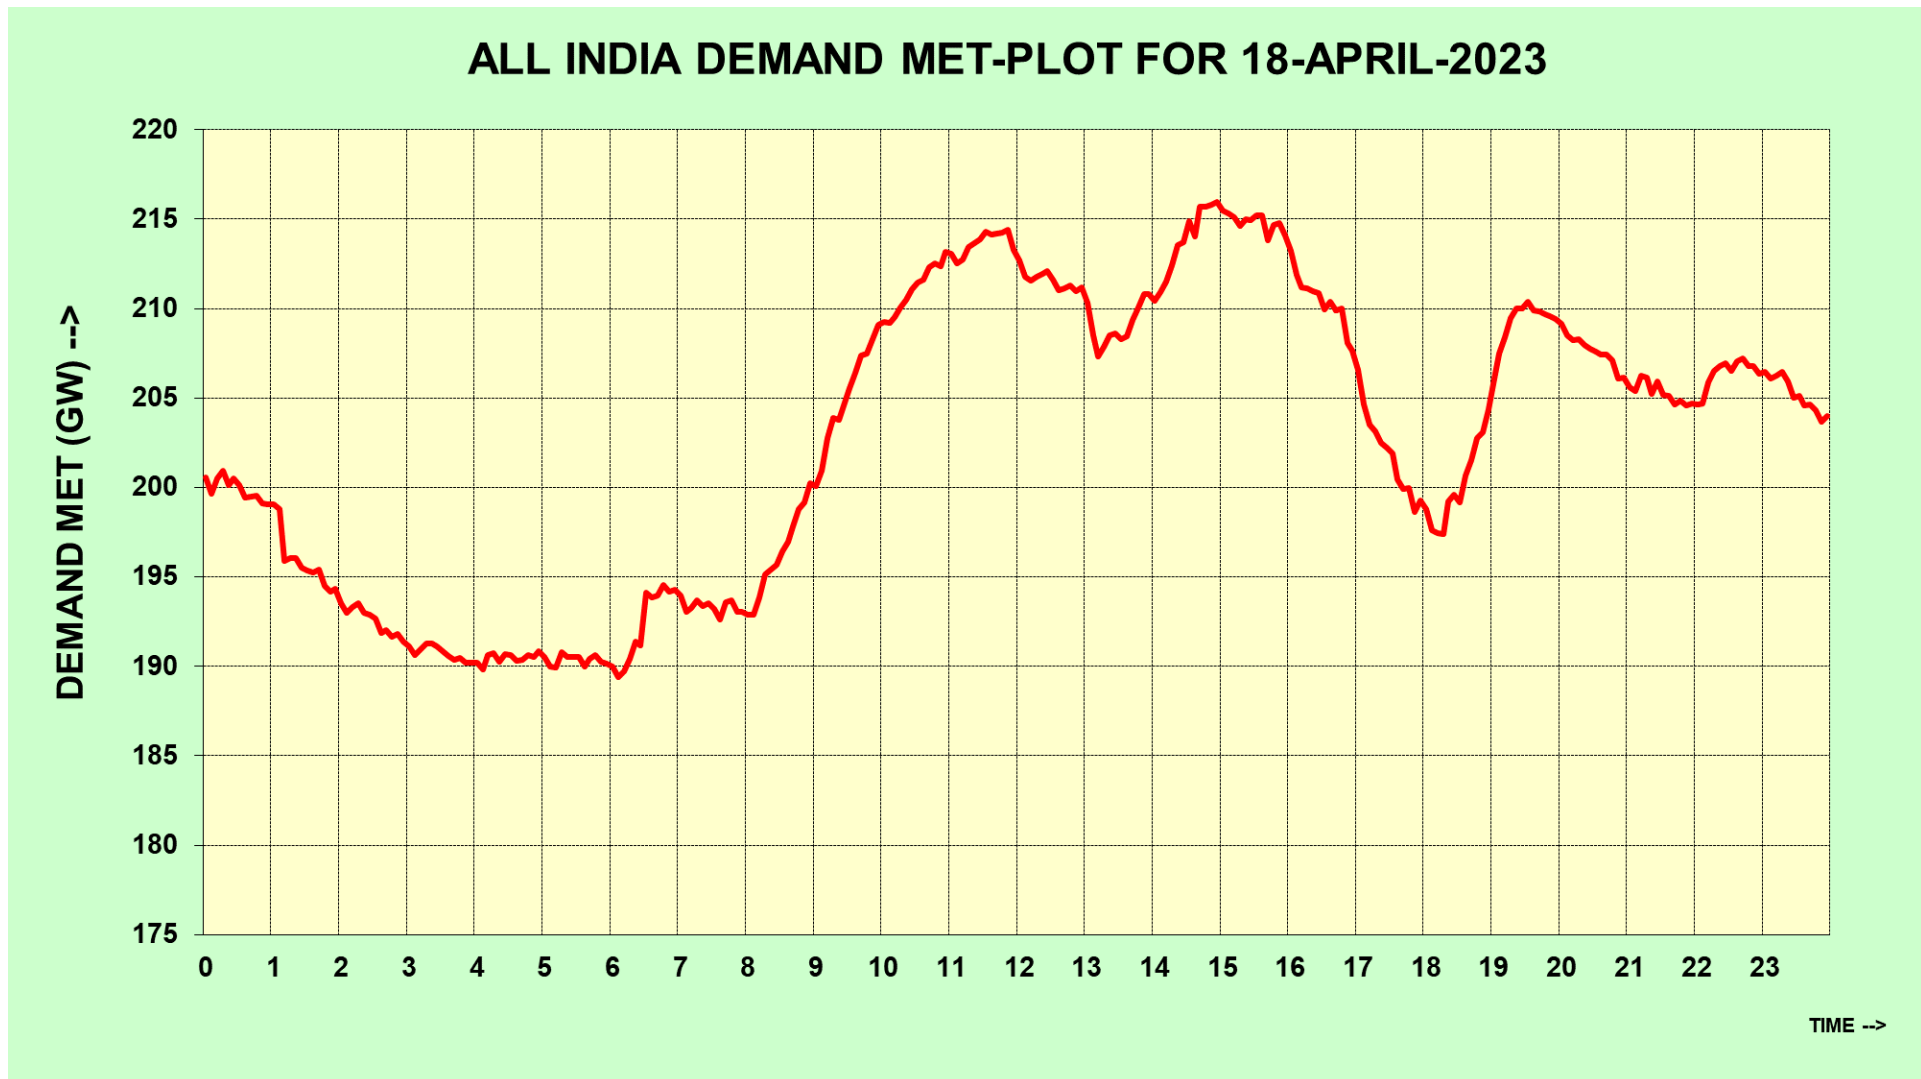


REGIONAL DEMAND MET-PLOT FOR 18-APRIL-2023

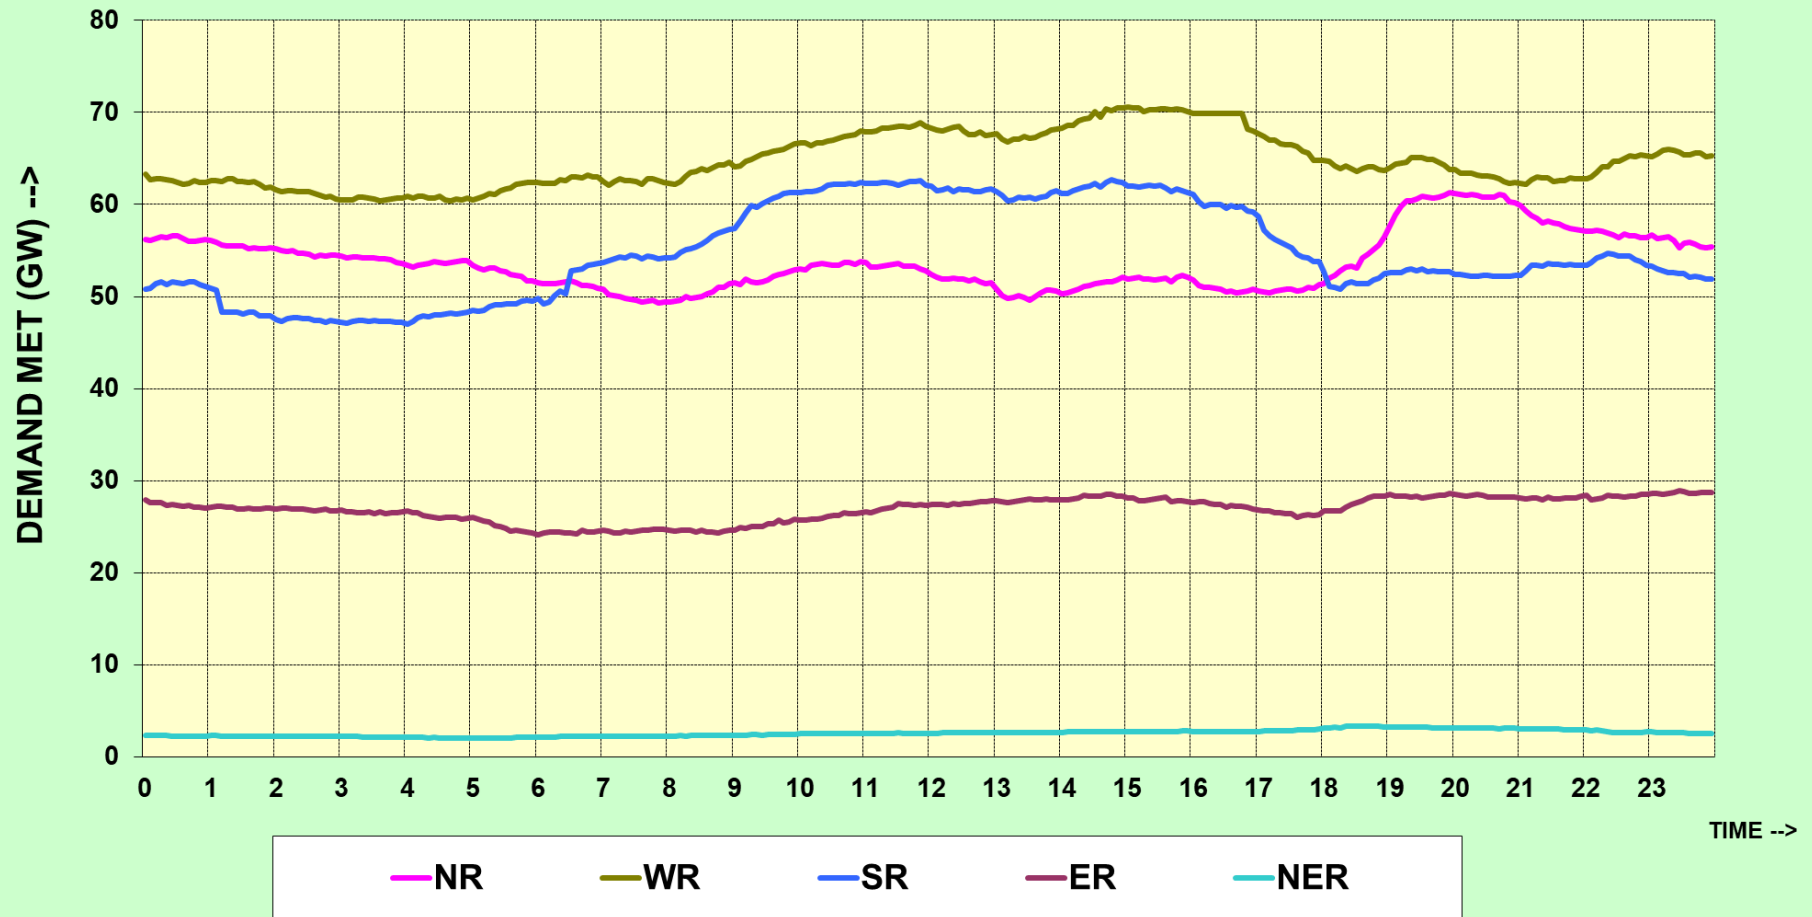

ALL INDIA GENERATION PLOT FOR 18-APRIL-2023

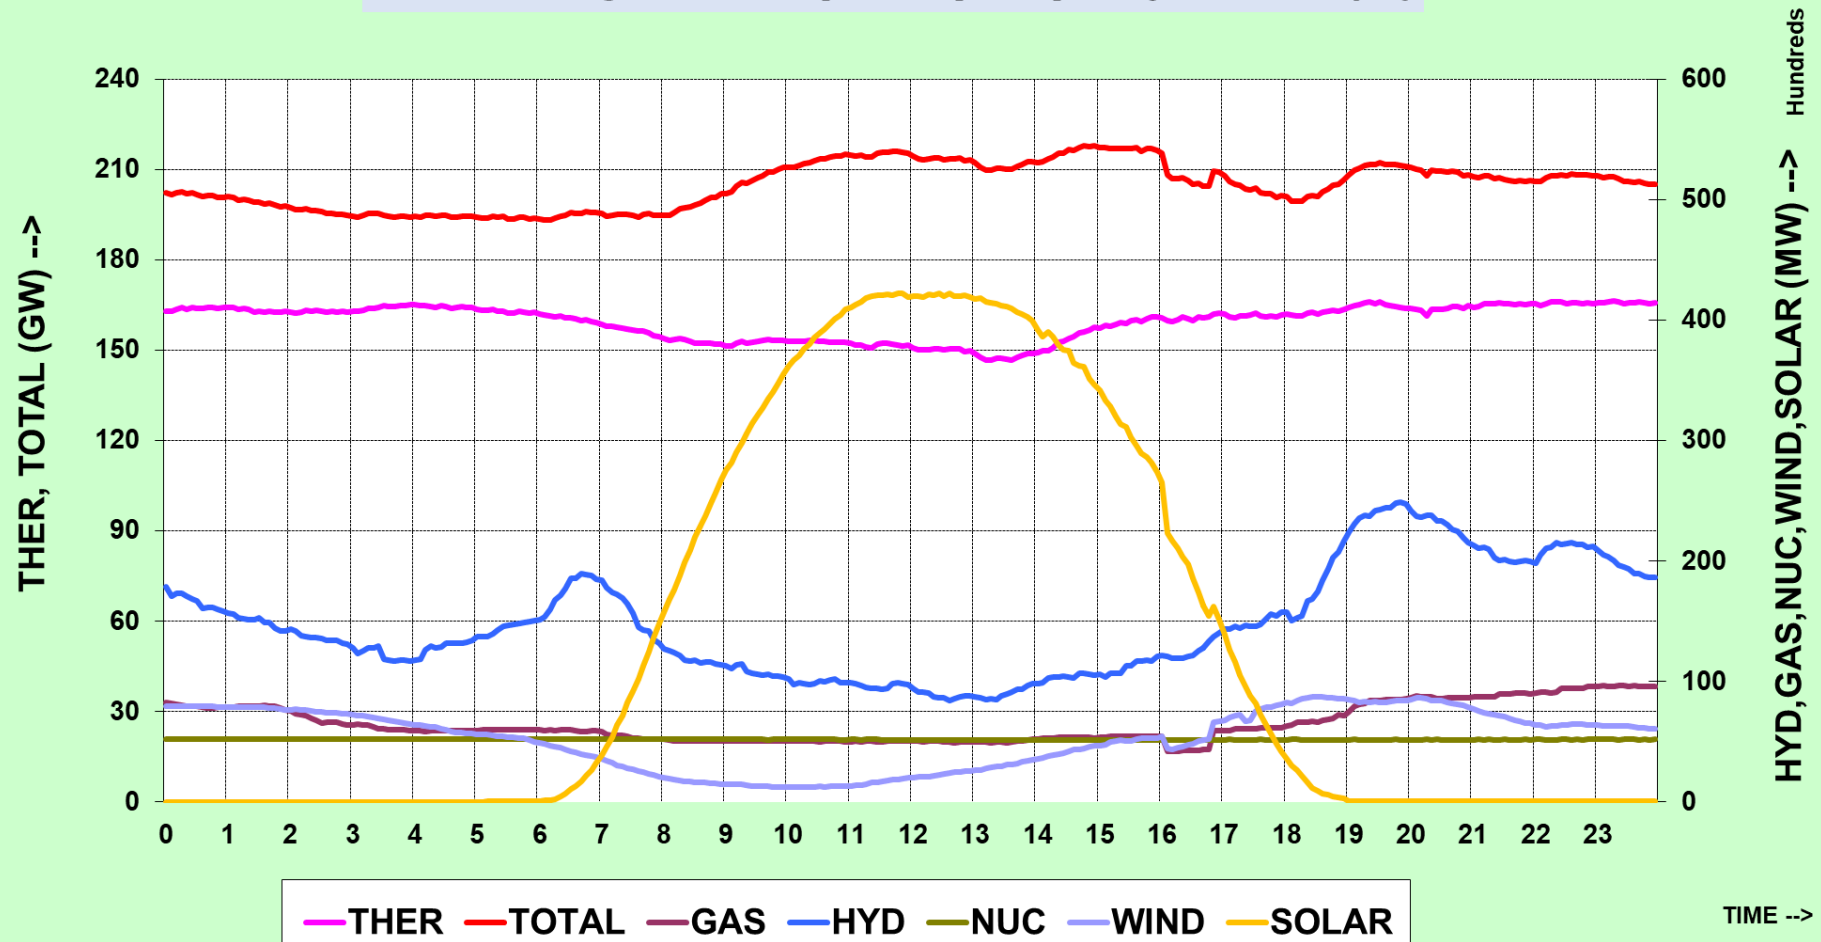

All India Fuel-wise Generation Patterns for 18-APRIL-2023

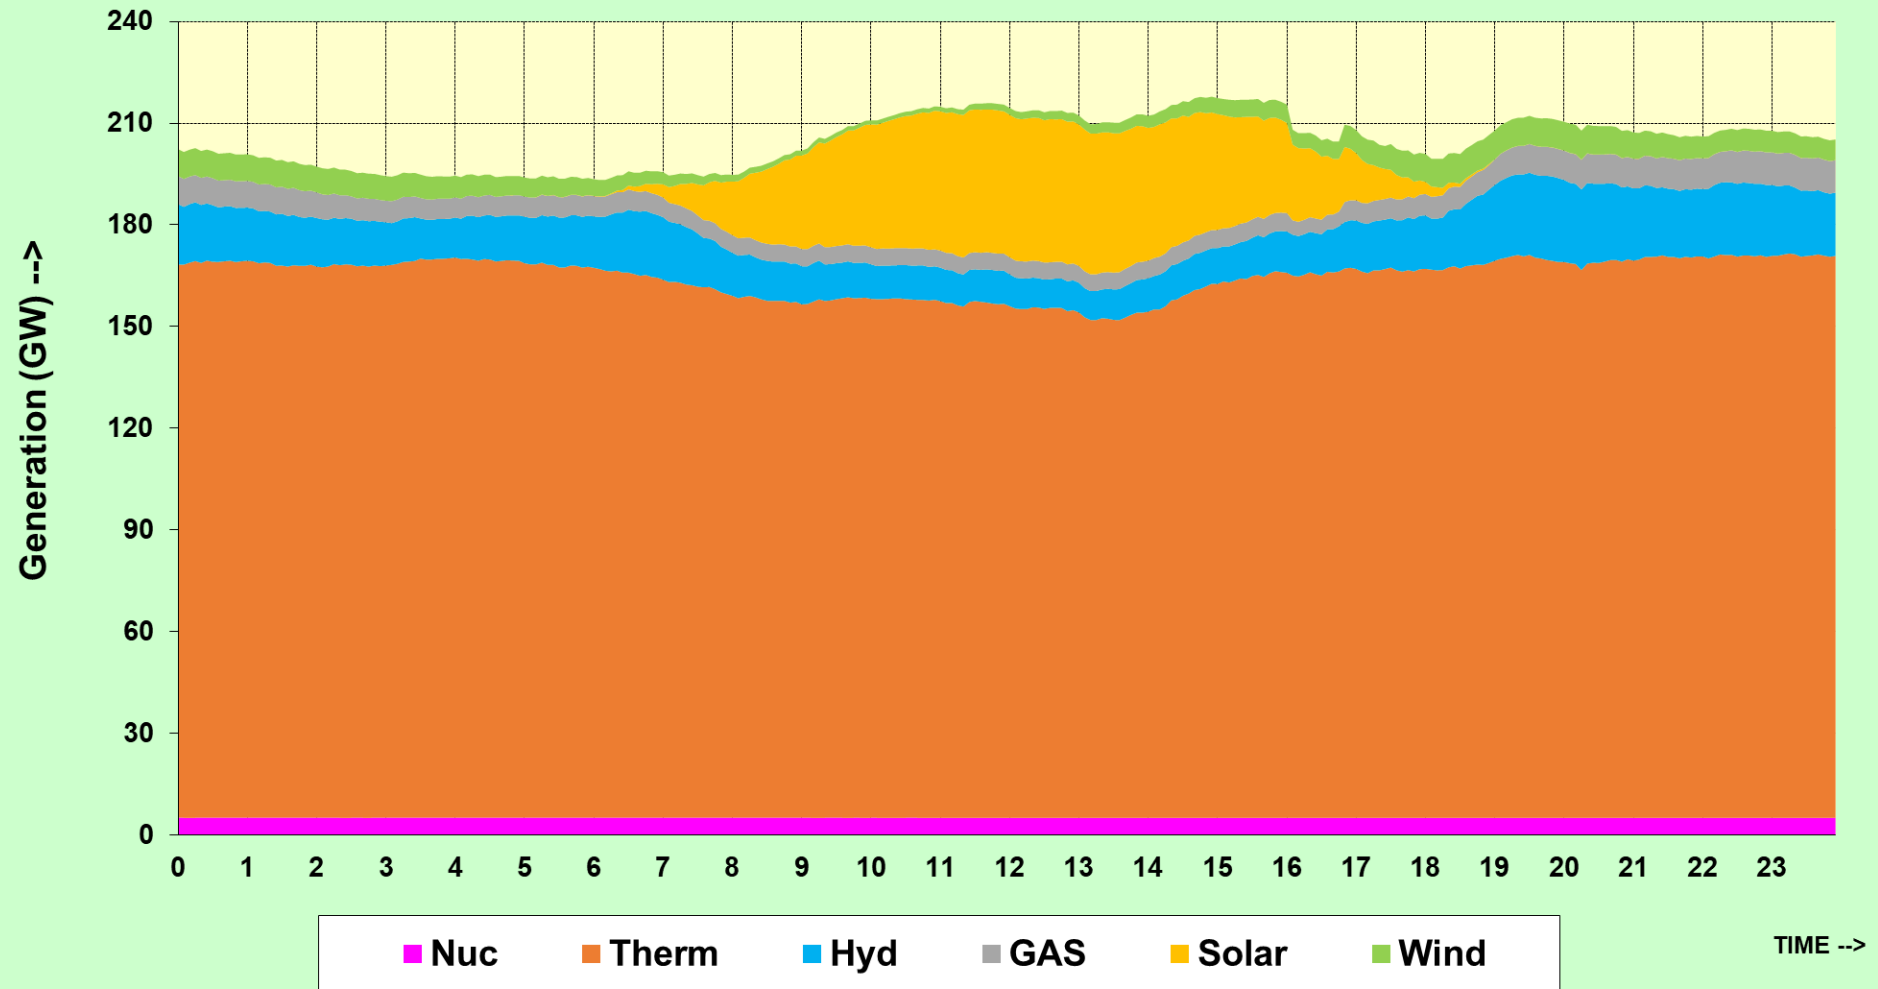

18 अप्रैल 2023 (अधिकतम माँग) की आल इंडिया माँग आपूर्ति
ALL INDIA DEMAND MET FOR 18 APRIL 2023 (MAXIMUM DEMAND*)

Time (hrs)	All India Demand (MW)		Time (hrs)	All India Demand (MW)
00:05	199640		12:05	211776
00:20	200105		12:20	211916
00:35	199423		12:35	211021
00:50	199098		12:50	210960
01:05	198767		13:05	208487
01:20	196075		13:20	208506
01:35	195246		13:35	208444
01:50	194146		13:50	210795
02:05	193015		14:05	210912
02:20	192990		14:20	213530
02:35	191889		14:35	214019
02:50	191786		14:50	215804
03:05	190605		15:05	215320
03:20	191260		15:20	214990
03:35	190596		15:35	215221
03:50	190208		15:50	214757
04:05	189828		16:05	211901
04:20	190273		16:20	210970
04:35	190303		16:35	210387
04:50	190535		16:50	208087
05:05	190007		17:05	204641
05:20	190501		17:20	202476
05:35	190003		17:35	200457
05:50	190275		17:50	198628
06:05	189408		18:05	197591
06:20	191356		18:20	199210
06:35	193830		18:35	200670
06:50	194187		18:50	203059
07:05	193036		19:05	207498
07:20	193372		19:20	209990
07:35	192633		19:35	209915
07:50	193065		19:50	209574
08:05	192874		20:05	208515
08:20	195407		20:20	207992
08:35	196968		20:35	207406
08:50	199178		20:50	206062
09:05	200954		21:05	205373
09:20	203787		21:20	205245
09:35	206431		21:35	205114
09:50	208304		21:50	204588
10:05	209206		22:05	204692
10:20	210468		22:20	206810
10:35	211626		22:35	207049
10:50	212351		22:50	206801
11:05	212509		23:05	206096
11:20	213643		23:20	205929
11:35	214112		23:35	204611
11:50	214405		23:50	203673
Maximum Demand of 215882 MW met@14:44 hrs (from 1 min. interval SCADA DATA)				

* 15 minute interval SCADA DATA of instantaneous demand

11. ACTUAL POWER SUPPLY POSITION - APRIL 2023

REGION	STATE	Requirement/Availability in MU/DAY			Requirement/Availability in MU				Peak Demand/Peak Met in MW			
		Requirement	Energy met	Surplus(+)/ Deficit(-)	Requirement	Energy met	Surplus(+)/ Deficit(-)	% Shortage	Requirement	Peak Demand Met	Surplus(+)/ Deficit(-)	% Shortage
NR	Chandigarh	4	4	0.0	121	121	0	0.0	252	252	0	0.0
	Delhi	85	85	0.0	2553	2553	0	0.0	5465	5422	-43	-0.8
	Haryana	141	140	-1.0	4226	4195	-31	-0.7	8345	8345	0	0.0
	Himachal Pradesh	31	30	-0.1	918	914	-4	-0.4	1809	1809	0	0.0
	J&K(UT) and Ladakh(UT)	56	56	-0.7	1695	1675	-20	-1.2	2890	2890	0	0.0
	Punjab	140	140	-0.2	4199	4194	-5	-0.1	8143	8143	0	0.0
	Rajasthan	247	245	-1.4	7402	7359	-43	-0.6	13766	13766	0	0.0
	Uttar Pradesh	370	369	-0.5	11099	11083	-16	-0.1	23473	23473	0	0.0
	Uttarakhand	41	40	-0.5	1222	1207	-15	-1.2	2228	2228	0	0.0
	Railway	3	3	0.0	96	96	0	0.0	175	175	0	0.0
	NFL	0	0	0.0	2	2	0	0.0	12	12	0	0.0
	TOTAL	1118	1113	-4.5	33534	33399	-134	-0.4	61740	60996	-744	-1.2
WR	Gujarat	433	433	0.0	12977	12977	0	0.0	21627	21627	0	0.0
	Madhya Pradesh	239	239	0.0	7170	7170	0	0.0	12402	12402	0	0.0
	Chhattisgarh	115	115	-0.2	3442	3435	-7	-0.2	5642	5642	0	0.0
	Maharashtra	562	561	-0.1	16846	16844	-2	0.0	28584	28584	0	0.0
	Goa	15	15	0.0	443	442	-1	-0.1	759	759	0	0.0
	DNHDDPDCL	29	29	0.0	859	859	0	0.0	1271	1271	0	0.0
	AMNSIL	18	18	0.0	541	541	0	0.0	895	895	0	0.0
	BALCO*	12	12	0.0	371	371	0	0.0	522	522	0	0.0
	TOTAL	1422	1421	-0.3	42649	42640	-9	0.0	70257	70233	-25	0.0
SR	Andhra Pradesh	234	232	-2.2	7011	6946	-65	-0.9	12494	12494	0	0.0
	Telangana	237	234	-2.5	7111	7034	-76	-1.1	14517	14499	-18	-0.1
	Karnataka	290	288	-2.6	8710	8631	-78	-0.9	16110	16110	0	0.0
	Kerala	93	92	-0.9	2792	2765	-27	-1.0	5028	5024	-4	-0.1
	Tamil Nadu	379	376	-3.5	11377	11272	-105	-0.9	19387	19387	0	0.0
	Puducherry	10	10	-0.1	297	294	-3	-1.0	474	474	0	0.0
	TOTAL	1243	1231	-11.8	37297	36942	-355	-1.0	63939	63939	0	0.0
ER	Bihar	113	112	-0.9	3400	3372	-28	-0.8	6820	6456	-364	-5.3
	Jharkhand	34	32	-2.0	1031	970	-61	-5.9	1857	1857	0	0.0
	DVC	76	76	0.0	2289	2289	0	0.0	3751	3751	0	0.0
	Odisha	117	117	0.0	3501	3501	0	0.0	7192	7192	0	0.0
	West Bengal	197	197	-0.2	5907	5901	-6	-0.1	11868	11868	0	0.0
	Sikkim	1	1	0.0	42	42	0	0.0	105	105	0	0.0
	Railways_ER ISTS*	0	0	0.0	1	1	0	0.0	11	11	0	0.0
	TOTAL	539	536	-3.2	16171	16076	-95	-0.6	29658	29359	-299	-1.0
NER	Arunachal Pradesh	3	3	0.0	81	81	0	0.0	155	155	0	0.0
	Assam	30	30	-0.1	913	911	-2	-0.2	2013	2013	0	0.0
	Manipur	3	3	0.0	78	78	0	-0.2	213	213	0	0.0
	Meghalaya	6	5	-1.3	193	153	-40	-20.9	336	336	0	0.0
	Mizoram	2	2	0.0	53	53	0	0.0	127	127	0	0.0
	Nagaland	2	2	0.0	65	65	0	0.0	150	150	0	0.0
	Tripura	5	5	0.0	150	150	0	0.0	338	338	0	0.0
	TOTAL	51	50	-1.4	1532	1490	-42	-2.8	3266	3211	-55	-1.7
ALL INDIA		4373	4352	-21.2	131183	130547	-636	-0.5				

* BALCO has been added as new entity wef 20.12.2022

NOTE: BASED ON THE DATA FURNISHED BY ENTITIES ON DAILY BASIS

12. ENERGY COMPARISON OF APRIL 2023 vs APRIL 2022

REGION	STATE	Energy Requirement (MU)					Energy Met (MU)				
		Apr-22	Apr-23	Difference	% Change	Average MU/day for Apr-23	Apr-22	Apr-23	Difference	% Change	Average MU/day for Apr-23
NR	Chandigarh	147	121	-25	-17	4	147	121	-25	-17	4
	Delhi	3171	2553	-618	-19	85	3171	2553	-618	-19	85
	Haryana	4836	4226	-610	-13	141	4539	4195	-344	-8	140
	Himachal Pradesh	975	918	-57	-6	31	964	914	-50	-5	30
	J&K(UT) and Ladakh(UT)	1519	1695	176	12	56	1370	1675	305	22	56
	Punjab	5015	4199	-816	-16	140	4873	4194	-679	-14	140
	Rajasthan	8217	7402	-816	-10	247	7768	7359	-409	-5	245
	Uttar Pradesh	12813	11099	-1714	-13	370	12571	11083	-1488	-12	369
	Uttarakhand	1296	1222	-74	-6	41	1236	1207	-29	-2	40
	Railway/NFL	87	98	12	14	3	87	98	12	14	3
	TOTAL	38075	33534	-4542	-12	1118	36726	33399	-3326	-9	1113
WR	Gujarat	12989	12977	-12	0	433	12989	12977	-12	0	433
	Madhya Pradesh	8282	7170	-1112	-13	239	8051	7170	-882	-11	239
	Chhattisgarh	3650	3442	-208	-6	115	3600	3435	-164	-5	115
	Maharashtra	18321	16846	-1474	-8	562	18203	16844	-1359	-7	561
	Goa	436	443	7	2	15	432	442	10	2	15
	DNHDDPDCL	833	859	26	3	29	832	859	27	3	29
	AMNSIL	516	541	25	5	18	516	541	25	5	18
	BALCO*		371	-	-	12		371	-	-	12
	TOTAL	45027	42649	-2378	-5	1422	44624	42640	-1984	-4	1421
SR	Andhra Pradesh	6377	7011	634	10	234	6362	6946	584	9	232
	Telangana	7233	7111	-122	-2	237	7217	7034	-182	-3	234
	Karnataka	7388	8710	1322	18	290	7370	8631	1261	17	288
	Kerala	2474	2792	318	13	93	2468	2765	297	12	92
	Tamil Nadu	10632	11377	745	7	379	10605	11272	667	6	376
	Puducherry	276	297	21	8	10	275	294	19	7	10
	TOTAL	34379	37297	2918	8	1243	34296	36942	2646	8	1231
ER	Bihar	3628	3400	-228	-6	113	3494	3372	-122	-3	112
	Jharkhand	1148	1031	-116	-10	34	1032	970	-62	-6	32
	DVC	2356	2289	-67	-3	76	2345	2289	-57	-2	76
	Odisha	3529	3501	-28	-1	117	3499	3501	2	0	117
	West Bengal	5838	5907	69	1	197	5825	5901	75	1	197
	Sikkim	47	42	-5	-11	1	47	42	-5	-11	1
	Railways_ER ISTS*		1	-	-	0		1	-	-	0
	TOTAL	16547	16171	-376	-2	539	16242	16076	-167	-1	536
NER	Arunachal Pradesh	73	81	8	11	3	73	81	8	11	3
	Assam	733	913	180	25	30	728	911	183	25	30
	Manipur	74	78	4	5	3	73	78	4	6	3
	Meghalaya	166	193	26	16	6	165	153	-12	-7	5
	Mizoram	53	53	0	0	2	53	53	0	0	2
	Nagaland	62	65	3	4	2	62	65	3	5	2
	Tripura	246	150	-96	-39	5	246	150	-96	-39	5
	TOTAL	1407	1532	125	9	51	1399	1490	91	6	50
ALL INDIA		135435	131183	-4252	-3	4373	133287	130547	-2740	-2	4352

* BALCO has been added as new entity wef 20.12.2022

13. DEMAND COMPARISON OF APRIL 2023 vs APRIL 2022

REGION	STATE	Peak Requirement (MW)				Peak Met (MW)			
		Apr-22	Apr-23	Difference	% Change	Apr-22	Apr-23	Difference	% Change
NR	Chandigarh	308	252	-56	-18.2	308	252	-56	-18.2
	Delhi	6197	5465	-732	-11.8	6197	5422	-775	-12.5
	Haryana	9320	8345	-975	-10.5	9320	8345	-975	-10.5
	Himachal Pradesh	1717	1809	92	5.4	1717	1809	92	5.4
	J&K(UT) and Ladakh(UT)	2603	2890	287	11.0	2603	2890	287	11.0
	Punjab	9986	8143	-1843	-18.5	9986	8143	-1843	-18.5
	Rajasthan	14415	13766	-649	-4.5	14291	13766	-525	-3.7
	Uttar Pradesh	21146	23473	2327	11.0	21146	23473	2327	11.0
	Uttarakhand	2329	2228	-101	-4.3	2329	2228	-101	-4.3
	Railway/NFL	153	187	34	22.3	153	187	34	22.3
WR	Gujarat	21464	21627	163	1	21382	21627	245	1.1
	Madhya Pradesh	12751	12402	-349	-3	12592	12402	-190	-1.5
	Chhattisgarh	5339	5642	303	6	5285	5642	357	6.8
	Maharashtra	30935	28584	-2351	-8	28846	28584	-262	-0.9
	Goa	718	759	42	6	713	759	46	6.5
	DNHDDPDCL	1250	1271	21	1.7	1250	1271	21	1.7
	AMNSIL	893	895	2	0.3	893	895	2	0.3
	BALCO*		522	-	-		522	-	-
SR	Andhra Pradesh	12293	12494	201	1.6	12293	12494	201	1.6
	Telangana	13654	14517	863	6.3	13636	14499	863	6.3
	Karnataka	14732	16110	1378	9.4	14725	16110	1385	9.4
	Kerala	4404	5028	624	14.2	4385	5024	639	14.6
	Tamil Nadu	17646	19387	1741	9.9	17563	19387	1824	10.4
	Puducherry	467	474	7	1.4	465	474	9	1.9
ER	Bihar	7138	6820	-318	-4.5	6028	6456	428	7.1
	Jharkhand	2230	1857	-373	-16.7	1807	1857	50	2.8
	DVC	3730	3751	21	0.6	3530	3751	221	6.3
	Odisha	5750	7192	1442	25.1	5600	7192	1592	28.4
	West Bengal	9905	11868	1963	19.8	9880	11868	1988	20.1
	Sikkim	117	105	-12	-10.3	117	105	-12	-10.3
	Railways_ER ISTS*		11	11	-		11	11	-
NER	Arunachal Pradesh	133	155	22	16.7	133	155	22	16.7
	Assam	1796	2013	217	12.1	1759	2013	254	14.5
	Manipur	202	213	11	5.3	202	213	11	5.3
	Meghalaya	359	336	-23	-6.4	359	336	-23	-6.4
	Mizoram	118	127	9	7.5	118	127	9	7.5
	Nagaland	138	150	12	8.8	138	150	12	8.8
	Tripura	316	338	21	6.7	316	338	21	6.7

* BALCO has been added as new entity wef 20.12.2022

14. SCHEDULE AND DRAWAL OF CONSTITUENTS - APRIL 2023

REGION	STATE	SCHEDULE (MU)	ACTUAL DRAWAL (MU)	Over drawal(+)/ Under Drawal(-) (MU)	% OD/UD	SCHEDULE (MU/DAY)	ACTUAL DRAWAL (MU/DAY)	Over drawal(+)/ Under Drawal(-) (MU/DAY)
NR	Chandigarh	124.34	121.55	-2.79	-2.24	4.14	4.05	-0.09
	Delhi	2437.66	2389.31	-48.34	-1.98	81.26	79.64	-1.61
	Haryana	2682.09	2645.88	-36.21	-1.35	89.40	88.20	-1.21
	Himachal Pradesh	486.89	489.31	2.42	0.50	16.23	16.31	0.08
	J&K(UT) and Ladakh(UT)	1313.06	1310.02	-3.04	-0.23	43.77	43.67	-0.10
	Punjab	1167.47	1132.75	-34.73	-2.97	38.92	37.76	-1.16
	Rajasthan	1794.59	1675.42	-119.17	-6.64	59.82	55.85	-3.97
	Uttar Pradesh	3901.88	3853.65	-48.23	-1.24	130.06	128.45	-1.61
	Uttarakhand	735.06	739.45	4.39	0.60	24.50	24.65	0.15
	Railway	94.65	96.05	1.40	1.48	3.15	3.20	0.05
	NFL	1.69	2.23	0.54	31.76	0.06	0.07	0.02
	Total	14739.38	14455.62	-283.76	-1.93	491.31	481.85	-9.46
WR	Gujarat	5851.97	5839.09	-12.88	-0.22	195.07	194.64	-0.43
	Madhya Pradesh	3992.16	3899.19	-92.97	-2.33	133.07	129.97	-3.10
	Chhattisgarh	1721.88	1687.53	-34.35	-1.99	57.40	56.25	-1.15
	Maharashtra	5831.88	5811.74	-20.15	-0.35	194.40	193.72	-0.67
	Goa	436.15	427.57	-8.58	-1.97	14.54	14.25	-0.29
	DNHDDPDCL	870.03	859.26	-10.77	-1.24	29.00	28.64	-0.36
	AMNSIL	224.62	228.99	4.37	1.95	7.49	7.63	0.15
	BALCO*	372.62	371.20	-1.42	-0.38	12.42	12.37	-0.05
	Total	19301.31	19124.55	-176.76	-0.92	643.38	637.49	-5.89
SR	Andhra Pradesh	2772.06	2768.06	-4.00	-0.14	92.40	92.27	-0.13
	Telangana	3210.41	3209.99	-0.42	-0.01	107.01	107.00	-0.01
	Karnataka	3676.45	3667.30	-9.15	-0.25	122.55	122.24	-0.31
	Kerala	2112.69	2109.40	-3.29	-0.16	70.42	70.31	-0.11
	Tamil Nadu	6936.71	6917.39	-19.32	-0.28	231.22	230.58	-0.64
	Puducherry	294.05	274.58	-19.47	-6.62	9.80	9.15	-0.65
	Goa (SR)	73.00	77.07	4.07	5.58	2.43	2.57	0.14
	Total	19075.37	19023.79	-51.58	-0.27	635.85	634.13	-1.72
ER	Bihar	3085.43	3050.99	-34.44	-1.12	102.85	101.70	-1.15
	Jharkhand	765.06	758.02	-7.03	-0.92	25.50	25.27	-0.23
	DVC	-1383.66	-1371.81	11.85	-0.86	-46.12	-45.73	0.39
	Odisha	1330.52	1297.18	-33.34	-2.51	44.35	43.24	-1.11
	West Bengal	1823.89	1737.53	-86.37	-4.74	60.80	57.92	-2.88
	Sikkim	40.04	42.17	2.13	5.31	1.33	1.41	0.07
	Railways_ER ISTS*	2.96	0.86	-2.10	-70.95	0.10	0.03	-0.07
	Total	5664.23	5514.93	-149.30	-2.64	188.81	183.83	-4.98
NER	Arunachal Pradesh	76.94	77.87	0.93	1.21	2.56	2.60	0.03
	Assam	706.52	708.39	1.86	0.26	23.55	23.61	0.06
	Manipur	80.43	77.82	-2.61	-3.24	2.68	2.59	-0.09
	Meghalaya	102.11	107.93	5.82	5.70	3.40	3.60	0.19
	Mizoram	45.30	40.23	-5.07	-11.19	1.51	1.34	-0.17
	Nagaland	67.66	64.61	-3.05	-4.51	2.26	2.15	-0.10
	Tripura	138.54	144.25	5.71	4.12	4.62	4.81	0.19
	Total	1217.51	1221.10	3.59	0.30	40.58	40.70	0.12
All India Total		59997.80	59339.99	-657.81	-1.10	1999.93	1978.00	-21.93

* BALCO has been added as new entity wef 20.12.2022

15. INTER REGIONAL EXCHANGES 2023-24

(All figures in MU)

	Apr'23	Fin. Year 2023-24
Name of Line		
Import of NR from WR (WR-NR)		
WR - NR 765 kV Gwalior - Agra 2xS/C	635.95	635.95
WR-NR 765 kV Gwalior - Phagi 2xS/C	553.05	553.05
WR-NR 765 kV Jabalpur-Orai D/C	430.29	430.29
WR-NR 765 kV Satna-Orai	505.37	505.37
WR-NR 765 kV Gwalior-Orai	0.00	0.00
WR - NR HVDC Champa - Kurukshetra	804.26	804.26
WR - NR HVDC Vindhyachal	0.49	0.49
WR - NR 400 kV Zerda Kankroli	0.00	0.00
WR - NR 400 kV Zerda Bhinmal	0.00	0.00
WR - NR 400 kV RAPP C - Shujalpur D/C	2.28	2.28
WR - NR 220 kV Bhanpura - Ranpur	9.67	9.67
WR - NR 220 kV Bhanpura - Modak	0.00	0.00
WR - NR 220 kV Auraiya - Malanpur/Mehgaon	0.00	0.00
WR - NR 400 kV Vindhyachal-Rihand D/C	0.00	0.00
WR - NR HVDC Mundra - Mohindergarh	132.55	132.55
WR-NR 765 kV Banaskata-Chittorgarh D/C	0.00	0.00
WR-NR 765 kV Varanasi-Vindhyachal	1030.05	1030.05
Total WR - NR	4103.96	4103.96
Export of NR to WR (NR-WR)		
NR - WR 765 kV Gwalior - Agra 2xS/C	0.00	0.00
NR - WR 765 kV Gwalior - Phagi 2xS/C	0.00	0.00
NR - WR 765 kV Jabalpur-Orai D/C	0.00	0.00
NR - WR 765 kV Satna-Orai	0.00	0.00
NR - WR 765 kV Gwalior-Orai	440.87	440.87
NR - WR HVDC Champa- Kurukshetra	0.00	0.00
NR - WR HVDC Vindhyachal	289.83	289.83
NR - WR 400 kV Zerda Kankroli	185.75	185.75
NR - WR 400 kV Zerda Bhinmal	282.42	282.42
NR - WR 400 kV RAPP C - Shujalpur D/C	85.74	85.74
NR - WR 220 kV Bhanpura - Ranpur	0.00	0.00
NR - WR 220 kV Bhanpura - Modak	0.00	0.00
NR - WR 220 kV Auraiya - Malanpur/Mehgaon	56.56	56.56
NR-WR 400 kV Rihand-Vindhyachal D/C	644.30	644.30
NR - WR HVDC Mundra - Mohindergarh	243.86	243.86
NR - WR 765 kV Banaskata-Chittorgarh D/C	976.83	976.83
NR-WR 765 kV Varanasi-Vindhyachal	0.00	0.00

	Apr'23	Fin. Year 2023-24
Name of Line		
Total NR - WR	3206.16	3206.16

	Apr'23	Fin. Year 2023-24
Name of Line		
Import of NR from ER (ER-NR)		
ER - NR 765 kV Sasaram - Fatehpur	166.02	166.02
ER - NR 765 kV Gaya - Varanasi 2*S/C	224.56	224.56
ER - NR 765 kV Gaya - Balia	246.38	246.38
ER - NR HVDC Alipurduar - Agra	0.00	0.00
ER-NR 400 kV Patna - Balia D/C	219.16	219.16
ER - NR 400 kV Muzaffarpur - Gorakhpur D/C	127.03	127.03
ER - NR 400 kV Biharshariff - Balia D/C	22.11	22.11
ER - NR 400 kV Motihari - Gorakhpur D/C	156.88	156.88
ER - NR 400 kV Biharshariff - Varanasi D/C	67.56	67.56
ER - NR 400 kV Sasaram -Varanasi	74.99	74.99
ER - NR 400 kV Sasaram -Allahabad	51.91	51.91
ER - NR 220 kV Sahupuri-Karnamasa	78.64	78.64
ER - NR 132 kV Sahupuri - Karnamasa	1.92	1.92
ER - NR 132 kV 132 kV Rihand - Nagar Untari	0.00	0.00
ER - NR 132 kV Rihand - Garhwa	0.46	0.46
ER-NR 400 kV Naubatpur - Balia D/C	211.13	211.13
Total ER-NR	1648.75	1648.75
Import of NR from NER (NER-NR)		
NER-NR HVDC Biswanath Chariali - Agra	0.00	0.00
Total NER - NR	0.00	0.00
Export of NR to ER (NR-ER)		
NR - ER 765 kV Sasaram - Fatehpur	0.00	0.00
NR - ER 765 kV Gaya - Varanasi 2*S/C	0.30	0.30
NR - ER 765 kV Gaya - Balia	0.00	0.00
NR - ER HVDC Alipurduar - Agra	0.00	0.00
NR - ER 400 kV Patna - Balia 2xD/C	0.00	0.00
NR - ER 400 kV Muzaffarpur - Gorakhpur D/C	3.47	3.47
NR - ER 400 kV Biharshariff - Balia D/C	17.15	17.15
ER - NR 400 kV Motihari - Gorakhpur D/C	0.00	0.00
NR - ER 400 kV Biharshariff - Varanasi D/C	2.90	2.90
NR - ER 400 kV Sasaram -Varanasi	0.00	0.00
NR - ER 400 kV Sasaram -Allahabad	2.25	2.25
NR - ER 220 kV Sahupuri-Karnamasa	0.00	0.00
NR - ER 132 kV Sahupuri - Karnamasa	0.01	0.01
NR - ER 132 kV 132 kV Rihand - Nagar Untari	1.74	1.74
ER - NR 132 kV Rihand - Garhwa	10.23	10.23
NR-ER 400 kV Balia- Naubatpur D/C	0.00	0.00
Total NR - ER	38.05	38.05
Export of NR to NER (NER-NR)		

	Apr'23	Fin. Year 2023-24
Name of Line		
NR-NER HVDC Biswanath Chariali - Agra	261.93	261.93
Total NR - NER	261.93	261.93

	Apr'23	Fin. Year 2023-24
Name of Line		
Export of WR to ER (WR-ER)		
WR - ER 765 kV Ranchi - Dharamjaygarh 2xS/C	139.81	139.81
WR - ER 765 kV Dharamjaygarh - Jharsuguda 2xD/C	652.31	652.31
WR - ER 765 kV Durg - Jharsuguda D/C	0.00	0.00
WR - ER 400 kV Sipat - Ranchi D/C	15.97	15.97
WR - ER 400 kV Raigarh - Jharsuguda 2xD/C	0.44	0.44
WR - ER 220 kV Korba - Budhipadar D/C	36.08	36.08
WR - ER 220 kV Raigarh - Budhipadar	0.15	0.15
Total WR - ER	844.75	844.75
Import of WR from ER (ER - WR)		
ER - WR 765 kV Ranchi - Dharamjaygarh 2xS/C	144.10	144.10
ER - WR 765 kV Dharamjaygarh - Jharsuguda 2XD/C	25.46	25.46
ER - WR 765 kV Durg - Jharsuguda D/C	394.08	394.08
ER - WR 400 kV Sipat - Ranchi D/C	55.56	55.56
ER - WR 400 kV Raigarh - Jharsuguda 2xD/C	248.78	248.78
ER - WR 220 kV Korba - Budhipadar D/C	1.45	1.45
ER - WR 220 kV Raigarh - Budhipadar	55.98	55.98
Total ER - WR	925.41	925.41
Export of ER to NER (ER - NER)		
ER - NER 400 kV Binaguri - Bongaigaon D/C	6.99	6.99
ER - NER 400 kV Alipurduar - Bongaigaon D/C	4.62	4.62
ER - NER 220 kV Birpara - Salakati D/C	0.54	0.54
Total ER - NER	12.16	12.16
Import of ER from NER (NER - ER)		
NER - ER 400 kV Binaguri - Bongaigaon D/C	52.83	52.83
NER - ER 400 kV Alipurduar - Bongaigaon D/C	182.37	182.37
NER - ER 220 kV Birpara - Salakati D/C	34.59	34.59
Total NER - ER	269.78	269.78
Export of ER to SR (ER - SR)		
ER - SR HVDC Gazuwaka	375.93	375.93
ER - SR HVDC Talchar - Kolar	1233.20	1233.20
ER - SR 765 kV Angul- Srikakulam D/C	1683.42	1683.42
Total ER - SR	3292.55	3292.55
Import of ER from SR (SR - ER)		
SR - ER HVDC Gazuwaka	0.00	0.00
SR - ER HVDC Talchar - Kolar	0.00	0.00
SR - ER 765 kV Angul- Srikakulam D/C	0.00	0.00
Total SR - ER	0.00	0.00

	Apr'23	Fin. Year 2023-24
Name of Line		
Export of WR to SR (WR-SR)		
WR - SR HVDC Bhadrawati	544.41	544.41
WR - SR 765 kV Sholapur - Raichur 2xS/C	417.69	417.69
WR - SR 765 kV Wardha - Nizamabad D/C	1323.51	1323.51
WR - SR 400KV Kolhapur-Kudgi D/C	0.00	0.00
WR-SR HVDC Raigarh-Pugalur	3004.35	3004.35
WR-SR 220kV Xeldem - Ambewadi S/C	77.16	77.16
WR-SR 220kV Ponda - Ambewadi S/C	0.29	0.29
Total WR - SR	5367.41	5367.41
Import of WR from SR (SR - WR)		
SR - WR HVDC Bhadrawati	4.11	4.11
SR - WR 765 kV Raichur - Sholapur 2xS/C	29.13	29.13
SR - WR 765 kV Wardha - Nizamabad D/C	0.00	0.00
SR - WR 400KV Kolhapur-Kudgi D/C	623.59	623.59
SR-WR HVDC Pugalur-Raigarh	0.00	0.00
WR-SR 220kV Ambewadi - Xeldem S/C	0.00	0.00
WR-SR 220kV Ambewadi-Ponda S/C	0.00	0.00
Total SR - WR	656.84	656.84
TOTAL ALL INDIA	20628	20628
*In case of mutiple ckt / DC pole year corres. to the commissioning of final element		

Date	15.1 Import-Export of NR with WR during April 2023																	
	Import of NR from WR (WR-NR)																	
	WR - NR 765 kV Gwalior - Agra 2x5/C	WR-NR 765 kV Gwalior-Phagi 2x5/C	WR-NR 765 kV Jabalpur- Orai D/C	WR-NR 765 kV Satna- Orai	WR-NR 765 kV Gwalior-Orai	WR - NR HVDC Champa- Kurukshetra	WR - NR HVDC Vindhyachal	WR - NR 400 kV Zerda- Kankroli	WR - NR 400 kV Zerda- Bhinmal	WR-NR 400 kV RAPP C - Shujalpur D/C	WR - NR 220 kV Bhanpura Ranpur	WR - NR 220 kV Bhanpura - Modak	WR - NR 220 kV Auraiya - Malanpur / Mehgaon	WR-NR 400 KV Rihand Vindhyachal D/C	WR - NR HVDC Mundra - M'garh	WR - NR 765 kV Banaskata - Chittorgarh D/C	WR-NR 765 kV Varanasi- Vindhyachal	Total WR - NR
1-Apr-23	14.46	18.63	5.88	17.18	0.00	37.10	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	19.20	112.45
2-Apr-23	14.31	12.44	7.23	14.52	0.00	28.10	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	17.73	94.33
3-Apr-23	22.11	17.17	8.96	16.13	0.00	12.09	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	22.52	98.98
4-Apr-23	24.41	20.89	15.24	16.54	0.00	18.38	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	25.64	121.10
5-Apr-23	22.77	23.14	15.24	17.85	0.00	18.39	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	31.79	129.18
6-Apr-23	19.53	21.75	11.72	17.32	0.00	19.25	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	28.69	118.26
7-Apr-23	23.72	21.68	15.03	16.86	0.00	12.02	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	28.48	117.79
8-Apr-23	25.03	23.61	14.38	17.71	0.00	7.21	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	30.89	118.83
9-Apr-23	24.92	24.58	16.59	17.98	0.00	8.52	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	30.92	123.51
10-Apr-23	20.13	26.39	19.89	18.87	0.00	19.69	0.00	0.00	0.00	0.00			0.00	0.00	0.00	0.00	24.38	129.35
11-Apr-23	20.46	31.12	23.37	19.27	0.00	23.29	0.00	0.00	0.00	0.24			0.00	0.00	1.21	0.00	23.86	142.82
12-Apr-23	16.94	22.60	15.95	17.28	0.00	26.48	0.00	0.00	0.00	0.00			0.00	0.00	1.97	0.00	26.34	127.56
13-Apr-23	16.70	24.44	14.15	16.62	0.00	31.62	0.00	0.00	0.00	0.00			0.00	0.00	0.03	0.00	33.23	136.79
14-Apr-23	17.60	22.30	12.32	15.45	0.00	35.10	0.00	0.00	0.00	0.00			0.00	0.00		0.00	39.90	142.67
15-Apr-23	19.70	23.29	14.11	17.48	0.00	35.03	0.00	0.00	0.00	0.00			0.00	0.00		0.00	35.66	145.27
16-Apr-23	17.04	15.37	11.53	16.09	0.00	35.02	0.00	0.00	0.00	0.00			0.00	0.00	9.24	0.00	38.03	142.32
17-Apr-23	18.29	14.93	12.27	17.30	0.00	34.94	0.00	0.00	0.00	0.00			0.00	0.00	10.83	0.00	41.84	150.40
18-Apr-23	17.77	12.23	13.22	17.04	0.00	35.04	0.49	0.00	0.00	0.00			0.00	0.00	19.39	0.00	45.54	160.72
19-Apr-23	17.57	9.23	10.54	14.25	0.00	35.07	0.00	0.00	0.00	0.00			0.00	0.00	13.15	0.00	38.07	137.88
20-Apr-23	13.85	6.31	8.51	12.74	0.00	34.65	0.00	0.00	0.00	0.00			0.00	0.00	25.05	0.00	34.88	135.99
21-Apr-23	15.45	8.41	10.49	13.71	0.00	30.93	0.00	0.00	0.00	0.00			0.00	0.00	27.21	0.00	37.76	143.96
22-Apr-23	18.82	10.84	11.54	16.50	0.00	22.35	0.00	0.00	0.00	0.00			0.00	0.00	16.69	0.00	40.67	137.41
23-Apr-23	19.63	7.86	11.56	14.76	0.00	15.10	0.00	0.00	0.00	0.00			0.00	0.00	7.35	0.00	40.46	116.72
24-Apr-23	22.68	18.31	14.84	17.81	0.00	20.33	0.00	0.00	0.00	0.00			0.00	0.00	0.43	0.00	33.54	127.94
25-Apr-23	23.56	18.40	17.00	17.47	0.00	35.03	0.00	0.00	0.00	0.00	0.57		0.00	0.00	0.00	0.00	36.71	148.74
26-Apr-23	31.08	16.91	21.15	18.14	0.00	34.88	0.00	0.00	0.00	0.00	1.84		0.00	0.00	0.00	0.00	45.45	169.45
27-Apr-23	31.55	26.05	22.89	19.06	0.00	35.05	0.00	0.00	0.00	2.04	1.88		0.00	0.00	0.00	0.00	42.61	181.13
28-Apr-23	26.71	22.42	17.57	19.34	0.00	35.01	0.00	0.00	0.00	0.00	1.97		0.00	0.00	0.00	0.00	41.69	164.71
29-Apr-23	27.52	18.86	17.88	17.91	0.00	34.90	0.00	0.00	0.00	0.00	1.81		0.00	0.00	0.00	0.00	45.23	164.11
30-Apr-23	31.64	12.89	19.24	16.19	0.00	33.69	0.00	0.00	0.00	0.00	1.60		0.00	0.00	0.00	0.00	48.34	163.59
Total	635.95	553.05	430.29	505.37	0.00	804.26	0.49	0.00	0.00	2.28	9.67	0.00	0.00	0.00	132.55	0.00	1030.05	4103.96

Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day

Date	15.1 Import-Export of NR with WR during April 2023																	
	Export of NR to WR (NR- WR)																	
	NR - WR 765 kV Gwalior - Agra 2x5/C	NR-WR 765 kV Gwalior- Phagi 2x5/C	NR-WR 765 kV Jabalpur- Orai D/C	NR-WR 765 kV Satna- Orai	NR-WR 765 kV Gwalior-Orai	NR - WR HVDC Champa- Kurukshetra	NR - WR HVDC Vindhyachal	NR - WR 400 kV Zerda- Kankroli	NR - WR 400 kV Zerda- Bhinmal	NR-WR 400 kV RAPP C - Shujalpur D/C	WR - NR 220 kV Bhanpura - Ranpur	WR - NR 220 kV Bhanpura - Modak	NR - WR 220 kV Auraiya - Malanpur / Mehgaon	NR-WR 400 kV Rihand- Vindhyachal D/C	NR - WR HVDC Mundra - M'garh	NR - WR 765 kV Banaskata - Chittorgarh D/C	NR-WR 765 kV Varanasi- Vindhyachal	Total NR - WR
1-Apr-23	0.00	0.00	0.00	0.00	14.10	0.00	10.25	6.37	10.25	5.30			2.47	21.65	23.30	32.23	0.00	125.92
2-Apr-23	0.00	0.00	0.00	0.00	13.02	0.00	12.16	6.67	12.60	6.85			2.51	20.51	24.41	33.06	0.00	131.79
3-Apr-23	0.00	0.00	0.00	0.00	14.93	0.00	7.85	6.13	12.07	4.90			1.95	22.48	22.11	26.27	0.00	118.69
4-Apr-23	0.00	0.00	0.00	0.00	16.25	0.00	12.20	6.23	9.05	2.27			1.85	21.79	26.94	33.00	0.00	129.58
5-Apr-23	0.00	0.00	0.00	0.00	16.35	0.00	12.17	6.61	9.80	2.80			1.81	21.95	22.51	35.15	0.00	129.15
6-Apr-23	0.00	0.00	0.00	0.00	16.17	0.00	12.16	7.54	12.55	5.45			2.09	21.07	26.50	39.74	0.00	143.27
7-Apr-23	0.00	0.00	0.00	0.00	16.86	0.00	7.24	7.96	13.28	4.09			1.99	20.86	26.25	41.51	0.00	140.04
8-Apr-23	0.00	0.00	0.00	0.00	18.57	0.00	3.64	6.95	11.70	2.65			2.01	21.26	13.19	34.97	0.00	114.94
9-Apr-23	0.00	0.00	0.00	0.00	17.07	0.00	3.64	6.62	10.49	1.52			1.71	20.56	9.68	35.54	0.00	106.83
10-Apr-23	0.00	0.00	0.00	0.00	15.18	0.00	3.87	7.02	11.17	1.39			2.14	22.09	5.69	37.73	0.00	106.28
11-Apr-23	0.00	0.00	0.00	0.00	16.03	0.00	7.29	6.59	9.06	0.00			1.74	21.98	0.00	38.31	0.00	101.00
12-Apr-23	0.00	0.00	0.00	0.00	15.40	0.00	7.27	7.41	10.60	3.00			2.27	20.48	0.00	40.66	0.00	107.09
13-Apr-23	0.00	0.00	0.00	0.00	16.92	0.00	7.28	6.78	9.22	1.94			2.43	21.68	0.00	39.35	0.00	105.60
14-Apr-23	0.00	0.00	0.00	0.00	11.41	0.00	8.28	5.75	7.72	0.72			2.26	21.44		33.48	0.00	91.06
15-Apr-23	0.00	0.00	0.00	0.00	17.29	0.00	12.15	6.22	8.18	1.21			2.09	22.23		34.94	0.00	104.31
16-Apr-23	0.00	0.00	0.00	0.00	14.27	0.00	12.20	6.36	8.50	3.33			2.13	20.34	0.00	36.37	0.00	103.50
17-Apr-23	0.00	0.00	0.00	0.00	12.11	0.00	10.30	6.09	8.85	3.33			2.82	22.07	0.00	35.01	0.00	100.58
18-Apr-23	0.00	0.00	0.00	0.00	11.29	0.00	5.87	6.54	9.88	3.20			3.13	21.98	0.00	35.34	0.00	97.23
19-Apr-23	0.00	0.00	0.00	0.00	12.04	0.00	6.07	4.71	6.47	3.64			3.21	22.12	0.00	25.77	0.00	84.03
20-Apr-23	0.00	0.00	0.00	0.00	11.53	0.00	7.41	6.52	9.21	5.23			2.26	21.72	0.00	32.05	0.00	95.93
21-Apr-23	0.00	0.00	0.00	0.00	11.10	0.00	11.08	5.62	8.01	4.71			1.92	21.62	0.00	30.49	0.00	94.55
22-Apr-23	0.00	0.00	0.00	0.00	13.54	0.00	12.13	5.40	7.93	4.24			1.81	21.80	0.00	29.36	0.00	96.21
23-Apr-23	0.00	0.00	0.00	0.00	11.73	0.00	12.14	5.95	9.25	4.69			1.31	18.89	0.00	30.70	0.00	94.66
24-Apr-23	0.00	0.00	0.00	0.00	15.94	0.00	12.19	7.33	10.53	3.37			1.34	21.94	0.00	39.75	0.00	112.39
25-Apr-23	0.00	0.00	0.00	0.00	15.62	0.00	12.16	5.63	7.99	2.14	0.00		1.29	21.95	7.22	29.36	0.00	103.36
26-Apr-23	0.00	0.00	0.00	0.00	15.53	0.00	12.19	4.33	6.80	0.84	0.00		0.74	22.00	7.21	18.31	0.00	87.95
27-Apr-23	0.00	0.00	0.00	0.00	17.37	0.00	12.13	3.95	5.64	0.00	0.00		1.02	22.53	7.21	18.77	0.00	88.62
28-Apr-23	0.00	0.00	0.00	0.00	15.58	0.00	12.18	5.50	9.11	0.56	0.00		1.05	21.80	7.21	26.22	0.00	99.21
29-Apr-23	0.00	0.00	0.00	0.00	15.04	0.00	12.15	6.16	9.83	1.08	0.00		0.75	22.03	7.21	29.17	0.00	103.42
30-Apr-23	0.00	0.00	0.00	0.00	12.63	0.00	12.18	4.81	6.68	1.29	0.00		0.46	19.48	7.22	24.22	0.00	88.97
Total	0.00	0.00	0.00	0.00	440.87	0.00	289.83	185.75	282.42	85.74	0.00	0.00	56.56	644.30	243.86	976.83	0.00	3206.16
Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day																		

Date	15.2 Import-Export of NR with ER & NER during April 2023																		
	Import of NR from ER (ER-NR)																	Import of NR from NER (NER-NR)	
	ER - NR 765 kV Sasaram - Fatehpur	ER - NR 765 kV Gaya - Varanasi 2*S/C	ER - NR 765 kV Gaya Balia	ER - NR HVDC Alipurduar - Agra	ER-NR 400 kV Patna - Balia D/C	ER - NR 400 kV Muzaffarpur - Gorakhpur D/C	ER - NR 400 kV Biharshariff - Balia D/C	ER - NR 400 kV Motihari - Gorakhpur D/C	ER - NR 400 kV Biharshariff - Varanasi D/C	ER-NR 400 kV Sasaram - Varanasi	ER-NR 400 kV Sasaram - Allahabad	ER - NR 220 kV Sahupuri Karamnasa	ER - NR 132 kV Sahupuri Karamnasa	ER - NR 132 kV Rihand - Nagar Untari	NR - ER 132 kV Rihand - Garhwa	ER-NR 400 kV Naubatpur - Balia D/C	Total ER - NR	NER-NR HVDC Biswanath Chariali - Agra	Total NER-NR
1-Apr-23	5.68	9.66	7.44		7.54	6.26	1.14	5.95	2.30	4.10	3.00	1.90			0.00	7.71	62.68		0.00
2-Apr-23	5.01	8.88	6.55		6.88	5.58	0.34	5.62	2.40	4.03	2.87	2.00			0.00	6.93	57.09		0.00
3-Apr-23	6.79	11.74	7.11		7.52	4.82	0.24	6.32	3.88	3.43	2.98	2.30			0.00	7.60	64.73		0.00
4-Apr-23	6.41	11.66	7.30		7.84	5.48	0.00	6.21	3.40	3.88	3.32	2.48			0.00	8.09	66.07		0.00
5-Apr-23	7.22	11.30	7.98		8.37	6.64	0.47	6.10	3.80	3.49	3.60	2.61	0.48		0.00	8.75	70.81		0.00
6-Apr-23	6.99	10.72	7.87		8.90	5.94	0.78	6.39	3.67	3.94	3.35	2.62	0.00		0.00	9.11	70.28		0.00
7-Apr-23	6.34	10.68	8.37		8.58	5.06	0.50	6.50	3.26	4.16	2.94	2.72	0.48		0.00	9.05	68.64		0.00
8-Apr-23	5.40	7.82	7.66		7.39	2.69	0.00	5.61	1.55	4.48	2.60	2.80	0.00		0.00	7.40	55.40	0.00	0.00
9-Apr-23	4.90	7.13	6.89		6.65	4.08	0.00	6.17	0.85	4.45	2.50	2.40			0.00	6.37	52.39	0.00	0.00
10-Apr-23	3.64	11.84	7.25		7.30	4.63	0.00	7.13	3.04	4.32		2.69		0.00		7.00	58.84	0.00	0.00
11-Apr-23	8.40	14.23	7.54		6.81	4.53	0.00	7.00	4.03	3.96	2.67	2.67	0.00	0.00		7.23	69.07	0.00	0.00
12-Apr-23	7.25	9.33	6.40		5.71	2.66	0.00	4.96	2.64	4.04	2.33	2.69	0.00	0.00	0.00	6.22	54.23	0.00	0.00
13-Apr-23	6.14	8.20	8.21		7.21	2.53	0.00	4.07	2.15	4.45	2.52	2.77			0.00	8.36	56.61	0.00	0.00
14-Apr-23	3.85	4.95	8.43		7.29	2.17	0.00	3.60	0.61	4.84	2.23	2.80			0.00	7.98	48.75	0.00	0.00
15-Apr-23	5.86	6.55	6.93		7.95	2.18	0.00	3.72	1.33	0.31	2.32	2.80			0.00	4.45	44.40	0.00	0.00
16-Apr-23	5.20	2.29	5.21		4.57	0.69	0.00	3.24	0.53	0.50	0.53	3.24	0.00		0.00	2.69	28.69	0.00	0.00
17-Apr-23	5.40	2.23	7.20		6.15	0.20	0.00	3.67	0.45	0.65	0.00	3.42	0.00		0.00	5.77	35.14	0.00	0.00
18-Apr-23	2.31	0.00	7.93		6.24	0.00	0.00	2.68	0.00	1.20		3.05			0.46	5.49	29.36	0.00	0.00
19-Apr-23	2.20	0.58	8.20		6.50	0.00	2.62	2.47	0.00	1.20	0.00	3.00	0.48		0.00	5.39	32.64	0.00	0.00
20-Apr-23	2.99	1.75	6.82		5.06	1.19	0.00	3.07	0.09	2.43	0.00	3.17	0.00		0.00	4.67	31.24	0.00	0.00
21-Apr-23	3.74	2.31	7.83		5.29	3.15	0.18	3.60	1.01	2.09	0.21	3.41	0.00		0.00	4.98	37.80	0.00	0.00
22-Apr-23	5.75	7.28	9.40		7.25	7.64	2.51	5.81	2.32	1.83	0.56	1.75	0.00	0.00		7.32	59.42	0.00	0.00
23-Apr-23	2.90	2.49	6.72		3.44	5.65	0.00	4.15	0.84	1.44	0.89	1.47			0.00	2.98	32.97	0.00	0.00
24-Apr-23	5.97	8.26	7.98		6.17	5.97	1.14	5.87	3.35	0.96	1.28	2.05				6.03	55.03	0.00	0.00
25-Apr-23	9.83	10.90	10.17		8.75	6.21	2.05	6.10	3.21	0.80	1.56	1.87			0.00	8.98	70.43	0.00	0.00
26-Apr-23	6.72	8.41	11.02		8.28	5.00	0.65	5.98	3.26	0.98	1.33	2.38			0.00	7.44	61.45	0.00	0.00
27-Apr-23	8.32	11.22	11.27		10.57	5.91	0.86	6.60	4.18	0.38	1.90	2.80			0.00	8.94	72.95	0.00	0.00
28-Apr-23	6.81	10.32	11.13		9.27	6.63	1.58	6.22	3.91	0.10	2.25	2.80	0.00		0.00	9.40	70.42	0.00	0.00
29-Apr-23	5.50	7.02	11.81		9.96	5.90	2.64	6.17	3.00	1.35	1.02	3.01	0.00		0.00	8.81	66.19	0.00	0.00
30-Apr-23	2.50	4.81	11.76		9.72	7.64	4.41	5.90	2.50	1.20	1.15	2.97	0.48		0.00	9.99	65.03	0.00	0.00
Total	166.02	224.56	246.38	0.00	219.16	127.03	22.11	156.88	67.56	74.99	51.91	78.64	1.92	0.00	0.46	211.13	1648.75	0.00	0.00
Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day																			

Date	15.2 Import-Export of NR with ER & NER during April 2023																		
	Export of NR to ER (NR- ER)																	Export of NR to NER (NR-NER)	
	NR - ER 765 kV Sasaram - Fatehpur	NR - ER 765 kV Gaya - Varanasi 2*S/C	NR - ER 765 kV Gaya Balla	NR - ER HVDC Alipurduar - Agra	NR-ER 400 kV Patna - Balla D/C	NR - ER 400 kV Muzaffarpur - Gorakhpur D/C	NR - ER 400 kV Biharshariff - Balla D/C	NR - ER 400 kV Motihari - Gorakhpur D/C	NR - ER 400 kV Biharshariff - Varanasi D/C	NR-ER 400 kV Sasaram - Varanasi	NR-ER 400 kV Sasaram - Allahabad	NR - ER 220 kV Sahupuri- Karamnasa	NR - ER 132 kV Sahupuri - Karamnasa	NR - ER 132 kV Rihand - Nagar Untari	NR - ER 132 kV Rihand - Garhwa	NR-ER 400 kV Balla- Naubatpur D/C	Total NR - ER	NR-NER HVDC Biswanath Chariali - Agra	Total NR-NER
1-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.41	0.00	0.41		0.00
2-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.48	0.00	0.48		0.00
3-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.44	0.00	0.44		0.00
4-Apr-23	0.00	0.00	0.00		0.00	0.00	0.09	0.00	0.00	0.00	0.00	0.00			0.46	0.00	0.55		0.00
5-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.52	0.00	0.52		0.00
6-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01		0.52	0.00	0.53		0.00
7-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.53	0.00	0.53		0.00
8-Apr-23	0.00	0.00	0.00		0.00	0.00	1.20	0.00	0.00	0.00	0.00	0.00	0.00		0.46	0.00	1.66	7.75	7.75
9-Apr-23	0.00	0.00	0.00		0.00	0.00	1.29	0.00	0.00	0.00	0.00	0.00			0.37	0.00	1.66	16.31	16.31
10-Apr-23	0.00	0.00	0.00		0.00	0.00	0.74	0.00	0.00	0.00		0.00		0.41		0.00	1.15	11.61	11.61
11-Apr-23	0.00	0.00	0.00		0.00	0.00	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.47		0.00	1.47	12.06	12.06
12-Apr-23	0.00	0.00	0.00		0.00	0.00	1.73	0.00	0.00	0.00	0.00	0.00	0.00	0.43	0.43	0.00	2.59	12.19	12.19
13-Apr-23	0.00	0.00	0.00		0.00	0.00	0.28	0.00	0.00	0.00	0.00	0.00			0.33	0.00	0.61	10.65	10.65
14-Apr-23	0.00	0.00	0.00		0.00	0.00	0.22	0.00	0.00	0.00	0.00	0.00			0.36	0.00	0.58	10.38	10.38
15-Apr-23	0.00	0.00	0.00		0.00	0.00	1.26	0.00	0.00	0.00	0.00	0.00			0.38	0.00	1.64	12.05	12.05
16-Apr-23	0.00	0.00	0.00		0.00	0.00	3.80	0.00	0.00	0.00	0.00	0.00	0.00		0.42	0.00	4.22	11.25	11.25
17-Apr-23	0.00	0.00	0.00		0.00	0.00	1.27	0.00	0.00	0.00	0.65	0.00	0.00		0.43	0.00	2.35	10.94	10.94
18-Apr-23	0.00	0.30	0.00		0.00	1.76	2.77	0.00	1.40	0.00		0.00			0.00	0.00	6.23	10.54	10.54
19-Apr-23	0.00	0.00	0.00		0.00	1.71	0.00	0.00	1.50	0.00	1.50	0.00	0.00		0.42	0.00	5.13	11.52	11.52
20-Apr-23	0.00	0.00	0.00		0.00	0.00	0.80	0.00	0.00	0.00	0.10	0.00	0.00		0.39	0.00	1.29	11.08	11.08
21-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.30	0.00	0.30	11.72	11.72
22-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.43		0.00	0.43	12.29	12.29
23-Apr-23	0.00	0.00	0.00		0.00	0.00	0.70	0.00	0.00	0.00	0.00	0.00			0.33	0.00	1.03	11.47	11.47
24-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				0.00	0.00	11.97	11.97
25-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.34	0.00	0.34	12.01	12.01
26-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.41	0.00	0.41	11.99	11.99
27-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.39	0.00	0.39	12.13	12.13
28-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.37	0.00	0.37	10.85	10.85
29-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.35	0.00	0.35	7.37	7.37
30-Apr-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.39	0.00	0.39	11.80	11.80
Total	0.00	0.30	0.00	0.00	0.00	3.47	17.15	0.00	2.90	0.00	2.25	0.00	0.01	1.74	10.23	0.00	38.05	261.93	261.93
Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day																			

Date	15.3 Import and Export of ER with WR & NER during April 2023																							
	Export of WR to ER (WR-ER)								Import of WR from ER (ER - WR)								Export of ER to NER (ER-NER)				Import of ER from NER (NER-ER)			
	WR - ER 765 kV Dharamjaygarh - Ranchi 2x5/C	WR - ER 765 kV Dharamjaygarh - Jharsuguda Q/C	WR - ER 765 kV Durg - Jharsuguda D/C	WR - ER 400 kV Sipat - Ranchi D/C	WR - ER 400 kV Raigarh - Jharsuguda-2x5/D/C	WR - ER 220 kV Korba - Budhipadar D/C	WR - ER 220 kV Raigarh - Budhipadar	Total WR - ER	ER - WR 765 kV Dharamjaygarh - Ranchi 2x5/C	ER-WR 765 kV Dharamjaygarh - Jharsuguda D/C	ER-WR 765 kV Durg - Jharsuguda D/C	ER - WR 400 kV Sipat - Ranchi D/C	ER - WR 400 kV Raigarh - Jharsuguda-2x5/D/C	ER - WR 220 kV Korba - Budhipadar D/C	ER - WR 220 kV Raigarh - Budhipadar	Total ER - WR	ER - NER 400 kV Binaguri - Bongaigaon D/C	ER - NER 400 kV Alipurduar - Bongaigaon D/C	ER - NER 220 kV Birpara - Salakati D/C	Total ER - NER	NER - ER 400 kV Binaguri - Bongaigaon D/C	NER - ER 400 kV Alipurduar - Bongaigaon 2x5/D/C	NER - ER 220 kV Birpara - Salakati D/C	Total NER - ER
1-Apr-23	0.0	11.2	0.0	0.0	0.0	1.1	0.0	12.26	20.5	0.4	21.8	5.5	7.9	0.0	1.3	57.36	1.91	1.39	0.14	3.43	0.31	0.87	0.17	1.35
2-Apr-23	0.0	17.3	0.0	0.0	0.0	0.6	0.0	17.92	15.0	0.1	17.0	4.6	8.2	0.0	2.0	47.01	0.19	0.00	0.00	0.20	1.96	4.28	0.94	7.17
3-Apr-23	0.0	14.5	0.0	0.0	0.0	0.5	0.0	15.01	12.2	1.3	17.7	3.5	8.9	0.0	2.1	45.72	0.17	0.00	0.00	0.18	2.10	4.62	0.99	7.72
4-Apr-23	0.3	15.0	0.0	0.0	0.0	0.2	0.0	15.44	9.3	2.0	17.2	3.0	8.9	0.1	2.2	42.73	0.37	0.09	0.01	0.47	1.83	3.88	0.77	6.47
5-Apr-23	0.9	15.4	0.0	0.0	0.0	0.4	0.0	16.61	8.1	1.6	18.0	3.1	10.4	0.2	2.3	43.68	0.02	0.00	0.00	0.02	2.38	5.11	1.04	8.52
6-Apr-23	1.2	18.9	0.0	0.0	0.0	0.0	0.0	20.16	7.9	0.2	19.2	3.0	14.3	0.3	2.7	47.79	0.45	0.16	0.06	0.68	1.39	3.28	0.56	5.23
7-Apr-23	1.9	17.3	0.0	0.1	0.0	0.3	0.0	19.55	5.5	0.4	18.4	2.5	12.2	0.1	2.5	41.55	0.39	0.07	0.01	0.48	0.96	2.85	0.53	4.34
8-Apr-23	2.0	20.9	0.0	0.0	0.0	0.7	0.0	23.64	4.3	0.4	14.8	2.3	8.9	0.0	2.2	32.76	0.30	0.13	0.01	0.44	1.66	5.72	0.99	8.37
9-Apr-23	3.2	26.1	0.0	0.1	0.0	0.9	0.0	30.35	4.0	0.1	13.0	2.2	10.1	0.0	2.2	31.68	0.00	0.00	0.00	0.00	3.03	10.97	1.82	15.82
10-Apr-23	2.8	22.4	0.0	0.1	0.0	0.7	0.0	25.98	6.0	0.3	15.8	2.5	10.7	0.0	2.4	37.66	0.05	0.06	0.01	0.11	1.87	7.29	1.24	10.40
11-Apr-23	3.7	21.3	0.0	0.1	0.0	0.6	0.0	25.57	3.4	0.9	16.8	1.8	11.3	0.1	2.5	36.89	0.10	0.02	0.00	0.12	1.43	5.89	0.98	8.31
12-Apr-23	3.9	23.2	0.0	0.1	0.0	0.3	0.0	27.54	3.9	0.6	15.8	2.0	10.9	0.2	2.4	35.76	0.14	0.08	0.02	0.24	1.40	5.70	0.92	8.02
13-Apr-23	4.2	21.2	0.0	0.1	0.0	0.2	0.0	25.73	3.3	0.2	16.7	2.6	10.8	0.2	2.4	36.25	0.11	0.03	0.01	0.15	1.30	5.25	0.73	7.27
14-Apr-23	6.9	29.9	0.0	0.4	0.0	0.6	0.0	37.80	3.1	0.1	13.4	1.4	8.5	0.0	2.3	28.83	0.08	0.11	0.02	0.21	1.40	5.75	0.65	7.80
15-Apr-23	6.3	33.7	0.0	0.4	0.0	0.8	0.0	41.27	2.8	0.0	10.5	1.3	5.5	0.0	2.6	22.71	0.16	0.22	0.04	0.43	1.53	5.67	1.06	8.25
16-Apr-23	9.0	29.5	0.0	1.0	0.0	0.9	0.0	40.43	2.6	0.0	10.1	1.1	6.8	0.0	2.5	23.24	0.34	0.33	0.05	0.72	1.10	4.30	0.73	6.13
17-Apr-23	11.0	30.0	0.0	1.1	0.0	1.0	0.0	43.05	1.3	0.0	10.2	1.0	7.9	0.0	1.8	22.19	0.23	0.17	0.03	0.43	0.95	3.63	0.64	5.23
18-Apr-23	14.7	27.8	0.0	1.9	0.0	1.4	0.0	45.81	0.1	0.0	9.0	0.4	6.7	0.0	1.6	17.86	0.52	0.51	0.06	1.10	0.86	3.45	0.62	4.93
19-Apr-23	15.2	33.0	0.0	1.8	0.0	1.9	0.0	52.00	0.5	0.0	8.5	0.3	6.2	0.0	1.0	16.65	0.28	0.41	0.04	0.73	1.36	4.91	1.13	7.39
20-Apr-23	13.3	30.5	0.0	1.5	0.0	1.1	0.0	46.44	0.4	0.0	10.9	0.5	7.1	0.0	1.9	20.87	0.00	0.00	0.00	0.00	3.26	11.28	2.15	16.69
21-Apr-23	9.3	33.6	0.0	1.6	0.0	1.7	0.0	46.23	0.7	0.1	9.9	0.2	4.2	0.0	1.8	16.85	0.00	0.00	0.00	0.00	3.94	12.61	2.34	18.89
22-Apr-23	3.1	31.7	0.0	0.3	0.0	2.3	0.0	37.50	2.7	0.0	11.9	1.0	5.1	0.0	1.2	21.90	0.00	0.00	0.00	0.00	3.75	11.93	2.05	17.73
23-Apr-23	2.8	28.8	0.0	0.5	0.1	2.7	0.0	34.98	1.8	0.0	8.9	0.9	5.0	0.0	0.7	17.32	0.00	0.00	0.00	0.00	3.10	10.65	2.10	15.84
24-Apr-23	0.7	16.9	0.0	0.0	0.0	2.7	0.0	20.32	6.1	0.3	10.2	2.7	7.3	0.0	0.9	27.49	0.00	0.00	0.00	0.00	2.28	8.92	1.83	13.02
25-Apr-23	0.8	8.3	0.0	0.0	0.0	2.2	0.0	11.29	6.7	2.2	11.7	2.4	8.1	0.0	1.6	32.60	0.07	0.00	0.00	0.07	1.41	6.63	1.39	9.43
26-Apr-23	4.8	10.4	0.0	1.0	0.0	0.9	0.0	17.02	0.8	6.2	9.9	0.4	6.4	0.0	1.4	25.11	0.22	0.02	0.00	0.24	1.02	5.20	1.23	7.46
27-Apr-23	4.9	15.6	0.0	0.8	0.0	1.1	0.0	22.40	3.3	0.9	9.0	1.0	8.8	0.0	1.5	24.47	0.22	0.05	0.00	0.27	0.64	3.94	0.97	5.55
28-Apr-23	1.5	16.0	0.0	0.3	0.0	1.8	0.0	19.66	5.0	3.7	10.9	1.5	8.7	0.0	1.2	30.97	0.25	0.16	0.01	0.42	1.08	4.68	1.17	6.93
29-Apr-23	4.0	12.7	0.0	0.7	0.0	2.8	0.0	20.21	1.7	1.3	9.4	0.7	7.2	0.0	1.6	22.03	0.39	0.61	0.01	1.02	1.08	4.25	1.02	6.35
30-Apr-23	7.2	19.4	0.0	2.0	0.2	3.7	0.1	32.60	1.2	2.1	7.2	0.3	5.6	0.0	1.1	17.49	0.00	0.00	0.00	0.00	2.45	8.85	1.85	13.15
Total	139.81	652.31	0.00	15.97	0.44	36.08	0.15	844.75	144.10	25.46	394.08	55.56	248.78	1.45	55.98	925.41	6.99	4.62	0.54	12.16	52.83	182.37	34.59	269.78

Date	15.4 Import and Export of SR with ER & WR during April 2023																							
	Export of ER to SR (ER - SR)				Import of ER from SR (SR - ER)				Export of WR to SR (WR-SR)								Import of WR from SR (SR - WR)							
	ER - SR HVDC Gazuwaka	ER - SR HVDC Talchar -Kolar	ER-SR 765 kV Angul-Srikakulam D/C	Total ER - SR	SR - ER HVDC Gazuwaka	SR - ER HVDC Talchar -	SR-ER 765 kV Angul-Srikakulam D/C	Total SR - ER	WR - SR HVDC Bhadravati	WR - SR 765 kV Sholapur - Raichur 2x5/C	WR-SR 765 kV Wardha - Nizamabad D/C	WR-SR 400KV Kolhapur- Kudgi D/C	WR-SR HVDC Raigarh- Puglur	WR-SR 220kV Xeldem - Ambewadi S/C	WR-SR 220kV Ponda - Ambewadi S/C	Total WR - SR	SR - WR HVDC Bhadravati	SR - WR 765 kV Raichur- Sholapur 2x5/C	SR-WR 765 kV Wardha - Nizamabad D/C	SR-WR 400KV Kolhapur- Kudgi D/C	SR-WR HVDC Raigarh- Puglur	WR-SR 220kV Xeldem - Ambewadi S/C	WR-SR 220kV Ponda - Ambewadi S/C	Total SR - WR
1-Apr-23	12.64	45.17	60.82	118.63	0.00	0.00	0.00	0.00	17.46	18.78	59.91	0.00	127.09	2.38	0.01	225.63	0.00	0.03	0.00	18.55	0.00	0.00	0.00	18.58
2-Apr-23	12.63	39.25	56.64	108.52	0.00	0.00	0.00	0.00	15.40	18.13	54.88	0.00	106.74	2.24	0.01	197.39	0.00	0.59	0.00	17.46	0.00	0.00	0.00	18.05
3-Apr-23	12.63	47.64	57.12	117.39	0.00	0.00	0.00	0.00	20.25	15.92	58.54	0.00	126.54	2.40	0.01	223.66	0.00	0.51	0.00	18.89	0.00	0.00	0.00	19.40
4-Apr-23	9.95	47.96	55.97	113.88	0.00	0.00	0.00	0.00	17.66	14.34	51.09	0.00	117.34	2.27	0.01	202.71	0.00	0.76	0.00	19.45	0.00	0.00	0.00	20.21
5-Apr-23	7.45	46.85	57.65	111.96	0.00	0.00	0.00	0.00	16.04	12.88	49.28	0.00	105.39	2.39	0.01	185.98	0.00	0.62	0.00	19.24	0.00	0.00	0.00	19.86
6-Apr-23	7.46	45.36	64.05	116.87	0.00	0.00	0.00	0.00	24.14	21.18	53.31	0.00	91.66	2.28	0.01	192.59	0.00	0.02	0.00	16.67	0.00	0.00	0.00	16.69
7-Apr-23	9.21	46.43	62.21	117.84	0.00	0.00	0.00	0.00	24.15	21.15	51.75	0.00	96.21	2.36	0.01	195.63	0.00	0.28	0.00	19.58	0.00	0.00	0.00	19.86
8-Apr-23	12.63	44.33	53.88	110.85	0.00	0.00	0.00	0.00	22.66	16.41	42.77	0.00	112.29	2.56	0.01	196.69	0.00	0.53	0.00	20.44	0.00	0.00	0.00	20.97
9-Apr-23	13.26	40.06	56.23	109.55	0.00	0.00	0.00	0.00	24.06	11.97	43.28	0.00	102.91	2.63	0.01	184.86	0.00	2.33	0.00	21.34	0.00	0.00	0.00	23.67
10-Apr-23	15.06	39.66	58.75	113.48	0.00	0.00	0.00	0.00	14.60	10.09	45.62	0.00	112.53	2.70	0.01	185.55	0.00	1.52	0.00	21.65	0.00	0.00	0.00	23.17
11-Apr-23	15.05	38.17	60.11	113.33	0.00	0.00	0.00	0.00	16.18	13.38	47.78	0.00	105.31	2.70	0.01	185.36	0.00	2.54	0.00	22.28	0.00	0.00	0.00	24.82
12-Apr-23	15.06	44.83	58.39	118.28	0.00	0.00	0.00	0.00	16.38	8.63	49.14	0.00	114.75	2.82	0.01	191.73	0.00	1.09	0.00	23.73	0.00	0.00	0.00	24.82
13-Apr-23	15.05	39.64	58.51	113.20	0.00	0.00	0.00	0.00	18.06	12.45	50.69	0.00	107.16	2.64	0.01	191.03	0.00	0.11	0.00	23.86	0.00	0.00	0.00	23.96
14-Apr-23	15.07	39.61	55.87	110.55	0.00	0.00	0.00	0.00	14.64	13.68	47.53	0.00	89.73	2.81	0.01	168.39	0.00	0.34	0.00	22.33	0.00	0.00	0.00	22.67
15-Apr-23	15.06	39.65	57.82	112.53	0.00	0.00	0.00	0.00	6.11	19.02	51.28	0.00	88.73	2.61	0.01	167.75	1.38	0.88	0.00	24.29	0.00	0.00	0.00	26.56
16-Apr-23	15.06	39.69	51.44	106.19	0.00	0.00	0.00	0.00	8.93	11.24	45.89	0.00	86.08	2.47	0.01	154.62	0.00	0.23	0.00	24.22	0.00	0.00	0.00	24.45
17-Apr-23	15.07	39.67	52.05	106.79	0.00	0.00	0.00	0.00	14.24	14.61	50.70	0.00	83.60	2.61	0.01	165.77	0.00	0.00	0.00	19.76	0.00	0.00	0.00	19.76
18-Apr-23	15.07	39.66	48.36	103.09	0.00	0.00	0.00	0.00	19.38	11.26	45.40	0.00	98.43	2.70	0.01	177.17	0.00	2.41	0.00	22.22	0.00	0.00	0.00	24.63
19-Apr-23	15.07	39.69	55.39	110.16	0.00	0.00	0.00	0.00	21.28	17.78	53.55	0.00	94.20	2.54	0.01	189.36	0.00	0.08	0.00	19.72	0.00	0.00	0.00	19.80
20-Apr-23	15.09	39.69	54.88	109.66	0.00	0.00	0.00	0.00	23.44	13.86	48.60	0.00	104.18	2.49	0.01	192.58	0.00	0.00	0.00	21.82	0.00	0.00	0.00	21.82
21-Apr-23	12.22	38.92	54.39	105.54	0.00	0.00	0.00	0.00	14.99	13.21	45.62	0.00	107.30	2.66	0.01	183.79	0.98	0.26	0.00	20.29	0.00	0.00	0.00	21.53
22-Apr-23	9.99	37.04	59.74	106.77	0.00	0.00	0.00	0.00	8.60	20.21	48.63	0.00	93.68	2.65	0.01	173.78	1.75	0.00	0.00	17.91	0.00	0.00	0.00	19.66
23-Apr-23	10.00	36.45	56.23	102.68	0.00	0.00	0.00	0.00	12.10	17.42	40.49	0.00	76.63	2.47	0.01	149.12	0.00	0.57	0.00	19.12	0.00	0.00	0.00	19.70
24-Apr-23	9.99	39.67	59.79	109.45	0.00	0.00	0.00	0.00	14.39	12.90	39.07	0.00	103.69	2.63	0.01	172.69	0.00	0.30	0.00	20.01	0.00	0.00	0.00	20.30
25-Apr-23	9.99	39.68	53.91	103.58	0.00	0.00	0.00	0.00	19.38	6.17	28.59	0.00	101.85	2.57	0.01	158.58	0.00	0.91	0.00	22.49	0.00	0.00	0.00	23.40
26-Apr-23	10.53	39.68	48.38	98.60	0.00	0.00	0.00	0.00	24.06	5.58	15.48	0.00	108.69	2.70	0.01	156.52	0.00	7.05	0.00	24.02	0.00	0.00	0.00	31.07
27-Apr-23	11.90	39.68	55.43	107.00	0.00	0.00	0.00	0.00	24.01	11.39	27.34	0.00	88.77	2.78	0.01	154.29	0.00	0.30	0.00	21.09	0.00	0.00	0.00	21.40
28-Apr-23	12.57	39.67	56.61	108.85	0.00	0.00	0.00	0.00	23.97	12.76	29.86	0.00	103.97	2.70	0.01	173.28	0.00	0.79	0.00	20.23	0.00	0.00	0.00	21.01
29-Apr-23	12.57	39.68	53.54	105.79	0.00	0.00	0.00	0.00	23.94	10.71	24.97	0.00	91.62	2.70	0.01	153.95	0.00	0.38	0.00	19.86	0.00	0.00	0.00	20.24
30-Apr-23	12.59	39.68	49.25	101.53	0.00	0.00	0.00	0.00	23.91	10.59	22.47	0.00	57.30	2.68	0.01	116.96	0.00	3.69	0.00	21.07	0.00	0.00	0.00	24.76
TOTAL	375.93	1233.20	1683.42	3292.55	0.00	0.00	0.00	0.00	544.41	417.69	1323.51	0.00	3004.35	77.16	0.29	5367.41	4.11	29.13	0.00	623.59	0.00	0.00	0.00	656.84

16. भूटान , नेपाल, बांग्लादेश एवं म्यान्मार के साथ अंतरराष्ट्रीय विद्युत विनिमय

अप्रैल 2023 से मार्च 2024 April 2023 to March 2024

अंतरराष्ट्रीय विद्युत विनिमय [भारत 'से' निर्यात/ 'को' आयात]

Transnational Exchange ('Export from'/'Import to' India)

माह MONTH	भूटान BHUTAN		नेपाल NEPAL		बांग्लादेश BANGLADESH		म्यान्मार MYANMAR	
	Energy Exported (In MU)	Energy Imported (In MU)	Energy Exported (In MU)	Energy Imported (In MU)	Energy Exported (In MU)	Energy Imported (In MU)	Energy Exported (In MU)	Energy Imported (In MU)
अप्रैल 2023 APR'23	19.40	41.40	357.99	0.00	687.30	0.00	0.00	1.04
कुल Total	19.40	41.40	357.99	0.00	687.30	0.00	0.00	1.04

* Based on daily operational data

Date	16.1 Import from neighbouring countries during Apr 2023													
	(All figures in MU)													
	Import from Bhutan								Import from Bangladesh		Import from Nepal			Import from Myanmar
	400 kV Tala-Binaguri I,II & IV	400 kV Binaguri-Malbase	220 kV Birpara-Chuka D/C	220 kV Birpara-Malbase	400 kV Punatsanchu-Alipurwar D/C*	400 kV Jigmeling-Alipurwar D/C	132 kV Rangia-Motanga	132 kV Salakati-Gelephu	400 kV Behrampur-Bheramara 1,2,3&4	132 kV Surjyamaninagar-Comilla D/C	132 kV Tanakpur-Mahendranagar	400 kV Muzaffarpur-Dhalkebar	From BIHAR Source	11 kV Moreh-Tamu
1-Apr-23	0.62	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2-Apr-23	1.10	0.66	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
3-Apr-23	1.89	1.28	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4-Apr-23	1.72	1.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5-Apr-23	2.36	1.73	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
6-Apr-23	2.12	1.49	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
7-Apr-23	1.30	0.73	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8-Apr-23	1.09	0.53	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
9-Apr-23	1.46	0.92	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
10-Apr-23	1.57	1.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
11-Apr-23	1.95	1.31	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12-Apr-23	1.64	1.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
13-Apr-23	0.86	0.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
14-Apr-23	2.28	0.93	0.00	0.00	0.00	0.29	0.25	0.00	0.00	0.00	0.00	0.00	0.00	0.00
15-Apr-23	2.73	0.74	0.00	0.00	0.00	0.81	0.78	0.00	0.00	0.00	0.00	0.00	0.00	0.00
16-Apr-23	2.77	0.78	0.00	0.00	0.00	0.09	0.74	0.00	0.00	0.00	0.00	0.00	0.00	0.00
17-Apr-23	2.47	0.64	0.00	0.00	0.56	0.91	0.68	0.00	0.00	0.00	0.00	0.00	0.00	0.00
18-Apr-23	2.53	0.62	0.00	0.00	0.00	0.04	0.68	0.00	0.00	0.00	0.00	0.00	0.00	0.00
19-Apr-23	3.05	1.11	0.00	0.00	0.62	0.99	0.68	0.00	0.00	0.00	0.00	0.00	0.00	0.00
20-Apr-23	4.66	1.93	0.00	0.00	0.28	0.52	0.28	0.00	0.00	0.00	0.00	0.00	0.00	0.00
21-Apr-23	3.99	1.59	0.00	0.00	0.63	1.00	0.11	0.00	0.00	0.00	0.00	0.00	0.00	0.00
22-Apr-23	2.95	1.85	0.00	0.00	0.63	0.95	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00
23-Apr-23	4.27	1.97	0.00	0.00	0.05	0.12	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00
24-Apr-23	5.17	1.16	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00
25-Apr-23	3.59	1.70	0.00	0.00	0.00	0.00	0.16	0.00	0.00	0.00	0.00	0.00	0.00	0.00
26-Apr-23	3.16	1.48	0.00	0.00	0.00	0.00	0.21	0.00	0.00	0.00	0.00	0.00	0.00	0.00
27-Apr-23	2.63	1.22	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00
28-Apr-23	3.48	1.63	0.00	0.00	0.00	0.00	0.22	0.00	0.00	0.00	0.00	0.00	0.00	0.00
29-Apr-23	3.09	1.51	0.00	0.00	0.19	0.20	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00
30-Apr-23	4.20	1.88	0.00	0.00	0.19	0.40	0.38	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total	76.68	34.86	0.00	0.00	3.16	6.33	5.39	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Based on SEM/Energy meter data for links where available (*Mangdechu generation receipt at APD through a bypassed arrangement at 400kV Punatsanchu station)

Date	16.2 Export to neighbouring countries during Apr 2023													
	(All figures in MU)													
	Export to Bhutan								Export to Bangladesh		Export to Nepal			Export to Myanmar
	400 kV Tala-Binaguri I, II & IV	400 kV Binaguri-Malbase	220 kV Birpara-Chuka D/C	220 kV Birpara-Malbase	400 kV Punatsanchu-Alipurwar D/C*	400 kV Jigmeling-Alipurwar D/C	132 kV Rangia-Motanga	132 kV Salakati-Gelephu	400 kV Behrampur-Bheramara 1,2,3&4	132 kV Surjyamaninagar-Comilla D/C	132 kV Tanakpur-Mahendranagar	400 kV Muzaffarpur-Dhalkebar	From BIHAR Source	11 kV Moreh-Tamu
1-Apr-23	0.00	0.06	1.89	1.39	0.00	0.96	0.00	0.14	18.35	2.62	0.54	0.55	2.59	0.05
2-Apr-23	0.00	0.00	1.60	1.35	0.00	0.76	0.00	0.50	21.56	2.95	1.16	6.92	1.72	0.02
3-Apr-23	0.00	0.00	1.51	1.22	0.00	0.87	0.00	0.23	21.17	3.19	1.27	7.25	1.89	0.03
4-Apr-23	0.00	0.00	1.26	1.10	0.00	0.56	0.00	0.18	21.09	3.43	1.15	6.83	2.08	0.00
5-Apr-23	0.00	0.00	1.05	0.93	0.00	0.01	0.00	0.18	21.03	3.32	1.22	7.22	2.14	0.04
6-Apr-23	0.00	0.00	1.16	0.93	0.00	0.69	0.00	0.16	21.01	3.15	1.28	7.65	2.08	0.02
7-Apr-23	0.00	0.00	1.48	1.02	0.00	1.12	0.00	0.18	18.42	2.23	1.39	7.93	1.82	0.02
8-Apr-23	0.00	0.00	1.43	1.15	0.00	1.12	0.00	0.25	21.38	2.40	1.30	7.80	1.84	0.03
9-Apr-23	0.00	0.00	1.32	1.18	0.00	0.83	0.00	0.33	21.45	2.59	1.42	8.68	2.04	0.03
10-Apr-23	0.00	0.00	0.98	1.10	0.00	0.61	0.00	0.26	21.65	2.54	1.59	9.11	2.37	0.00
11-Apr-23	0.00	0.00	1.10	1.05	0.00	0.80	0.00	0.21	21.79	2.89	1.52	9.58	2.50	0.03
12-Apr-23	0.00	0.00	1.04	1.03	0.00	0.62	0.00	0.19	21.81	3.01	1.52	9.15	2.06	0.03
13-Apr-23	0.00	0.00	1.22	1.10	0.00	0.07	0.00	0.14	21.78	3.01	1.58	9.82	2.64	0.03
14-Apr-23	0.00	0.00	1.26	0.59	0.00	0.00	0.00	0.15	21.82	2.87	1.47	9.08	1.96	0.03
15-Apr-23	0.00	0.00	1.16	0.64	0.00	0.00	0.00	0.15	16.86	2.93	1.42	8.65	1.87	0.03
16-Apr-23	0.00	0.00	1.18	0.55	0.00	0.00	0.00	0.15	17.80	3.30	1.55	9.25	2.79	0.02
17-Apr-23	0.00	0.00	0.86	0.89	0.00	0.00	0.00	0.03	21.60	3.24	1.55	10.16	1.84	0.03
18-Apr-23	0.00	0.00	0.87	0.88	0.00	0.00	0.00	0.09	21.91	3.24	1.59	9.05	3.59	0.03
19-Apr-23	0.00	0.00	0.40	0.70	0.00	0.00	0.00	0.06	22.14	3.23	1.61	8.44	2.83	0.03
20-Apr-23	0.00	0.00	0.72	1.14	0.00	0.00	0.00	0.25	21.72	2.99	1.63	9.37	1.67	0.02
21-Apr-23	0.00	0.00	0.72	0.91	0.00	0.00	0.00	0.26	21.72	2.36	1.46	9.35	2.10	0.00
22-Apr-23	0.00	0.00	0.59	0.35	0.00	0.00	0.00	0.30	21.72	2.93	1.49	9.34	1.84	0.00
23-Apr-23	0.00	0.00	1.48	1.58	0.00	0.00	0.00	0.41	21.81	3.12	1.63	10.23	2.02	0.01
24-Apr-23	0.00	0.00	2.09	2.34	0.45	0.62	0.00	0.41	20.23	3.01	1.46	9.00	1.96	0.02
25-Apr-23	0.00	0.00	2.37	2.70	0.84	1.21	0.00	0.34	21.97	3.10	1.44	8.86	2.01	0.03
26-Apr-23	0.00	0.00	2.51	2.88	0.89	1.28	0.00	0.38	21.60	3.08	1.63	10.14	2.04	0.03
27-Apr-23	0.00	0.00	2.75	3.08	0.70	1.01	0.00	0.28	13.36	2.53	1.64	10.47	2.46	0.03
28-Apr-23	0.00	0.00	2.44	2.88	0.14	0.15	0.00	0.23	12.12	2.43	1.61	10.50	2.54	0.03
29-Apr-23	0.00	0.00	1.09	2.52	0.00	0.00	0.00	0.15	11.10	3.18	0.00	9.48	1.90	0.03
30-Apr-23	0.00	0.00	2.17	2.66	0.00	0.00	0.00	0.30	14.59	3.09	1.40	9.24	1.75	0.04
Total	0.00	0.06	41.72	41.83	3.01	13.29	0.00	6.89	596.54	87.94	41.52	259.07	64.95	0.73

Based on SEM/Energy meter data for links where available (*Mangdechu generation receipt at APD through a bypassed arrangement at 400kV Punatsanchu station)

17. एसटीओए (द्विपक्षीय एवं सामूहिक) एवं डी एस एम बिलिंग का ब्योरा – अप्रैल 2023

STOA (BILATERAL AND COLLECTIVE) & DSM BILLING DETAILS - APRIL 2023

द्विपक्षीय एसटीओए BILATERAL SHORT TERM OPEN ACCESS

अप्रैल 2023	APRIL 2023		Apr'23-Mar'24	
नोडल क्षेत्र.भा.प्रे.के. का नाम Name of Nodal RLDC	अनुमोदित लेन – देनों की संख्या No. of Approved Transactions	अनुमोदित ऊर्जा (मि.यु.) Energy Approved(MU)	अनुमोदित लेन – देनों की संख्या No. of Approved Transactions	अनुमोदित ऊर्जा (मि.यु.) Energy Approved (MU)
ऊ. क्षेत्र. NR	789	1490	789	1490
प.क्ष. WR	914	2796	914	2796
द.क्ष. SR	841	4579	841	4579
पू.क्ष. ER	705	837	705	837
पूर्वांचल क्षेत्र. NER	73	12	73	12
कुल TOTAL	3322	9714	3322	9714

एसटीओए SHORT TERM OPEN ACCESS

	सामूहिक एसटीओए Collective STOA		द्विपक्षीय एसटीओए Bilateral STOA	
माह MONTH	क्रेताओं / विक्रेताओं की सं. NO. of Buyers/Sellers	अनुमोदित ऊर्जा (मि.यु.) Approved Energy (MU)	अनुमोदित लेन – देनों की संख्या No. of Approved Transactions	अनुमोदित ऊर्जा (मि.यु.) Approved Energy (MU)
अप्रैल 2023 Apr'23	5580	6941	3322	9714
कुल TOTAL	5580	6941	3322	9714

* Approved Energy (MU) includes the Real Time Market (RTM) transactions (started from 1st Jun-20) as well, while No. of Buyers/Sellers are excluding RTM transactions.

** Approved Energy (MU) includes the Real Time Market (RTM) transactions (started from 1st Jun-20) as well, while No. of Buyers/Sellers are excluding RTM transactions

मासिक डी एस एम बिलिंग का ब्योरा* 2021-22
MONTHLY DSM BILLING DETAILS* 2021-22

अनंतिम आँकड़े
Provisional data
subject to change
करोड़ रु. में (RS. IN CRORES)

क्षेत्र REGION →	उत्तरी क्षेत्र NORTH	पश्चिमी क्षेत्र WEST	दक्षिणी क्षेत्र SOUTH	पूर्वी क्षेत्र EAST	पूर्वांचल क्षेत्र NORTH EAST
सप्ताह WEEK ↓					
03.04.23 to 09.04.23	117.08	183.75	141.67	138.20	---
10.04.23 to 16.04.23	97.88	201.55	195.60	97.81	---
17.04.23 to 23.04.23	113.60	180.41	173.60	108.13	---
24.04.23 to 30.04.23	85.35	123.76	124.10	90.69	---

* Amount shown is Payable to DSM pool ^Provisional Data

18. पावर मार्केट की सूचना (स्रोत : ओई.ई.एक्स. एच पी.एक्स.आई.एल.) POWER MARKET INFORMATION (Source IEX & PXIL) पावर एक्सचेंज के माध्यम से विनिमय - माह:- अप्रैल 2023 EXCHANGES THROUGH POWER EXCHANGES - APRIL 2023								
क्र.सं. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्सचेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU					
			Day Ahead Market (DAM)		Real Time Market (RTM)		Total (DAM+RTM)	
			विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase
1	पंजाब Punjab	उत्तरी क्षेत्र NR	0.86	421.85	3.00	189.65	3.86	611.49
2	हरियाणा Haryana		227.20	22.56	26.27	24.04	253.46	46.60
3	राजस्थान Rajasthan		52.56	136.35	140.69	129.62	193.25	265.98
4	दिल्ली Delhi		216.09	16.81	121.81	22.65	337.90	39.46
5	उत्तर प्रदेश Uttar Pradesh		955.46	169.77	96.22	126.02	1051.68	295.79
6	उत्तराखंड Uttarakhand		13.61	166.07	11.28	20.89	24.89	186.96
7	हिमाचल प्रदेश Himachal Pradesh		77.54	30.85	66.01	6.03	143.55	36.88
8	जम्मू और कश्मीर J & K		15.98	406.14	26.68	128.33	42.67	534.47
9	केन्द्र शासित चंडीगढ़ UT Chandigarh		35.15	0.00	0.41	0.00	35.55	0.00
10	ए डी हाइड्रो AD Hydro		7.09	0.00	0.35	0.00	7.44	0.00
11	करचम वंगटू Karcham Wangtoo		8.95	0.00	0.69	0.00	9.64	0.00
12	श्री सीमेंट Shree Cement		2.38	0.00	0.35	0.00	2.73	0.00
13	नाथपा झाकरी Nathpa Jhakri		0.00	0.00	0.00	0.00	0.00	0.00
14	लांको बुधिल Lanco Budhil		1.13	0.00	0.19	0.00	1.31	0.00
15	सिंगरौली Singrauli		0.00	0.00	0.00	0.00	0.00	0.00
16	दादरी-I Dadri TPS		0.00	0.00	0.00	0.00	0.00	0.00
17	दादरी-II Dadri stg-II		0.00	0.00	0.00	0.00	0.00	0.00
18	ऊंचाहार-I Unchahar-I TPS		0.00	0.00	0.00	0.00	0.00	0.00
19	ऊंचाहार-II Unchahar-II TPS		0.00	0.00	0.00	0.00	0.00	0.00
20	ऊंचाहार-III Unchahar-III TPS		0.00	0.00	0.00	0.00	0.00	0.00
21	रिहंद-I Rihand STPS-I		0.00	0.00	0.00	0.00	0.00	0.00
22	रिहंद-II Rihand STPS-II		0.00	0.00	0.00	0.00	0.00	0.00
23	रिहंद-III Rihand STPS-III		0.00	0.00	0.00	0.00	0.00	0.00
24	एपीसीपीएल झुजर APCPL Bhajjar		0.00	0.00	0.00	0.00	0.00	0.00
25	सैज Sainj HEP		7.80	0.00	3.01	0.04	10.81	0.04
26	दादरी गैस Dadri GPP		0.00	0.00	0.00	0.00	0.00	0.00
27	औरैया गैस NTPC Auraiya		0.00	0.00	0.00	0.00	0.00	0.00
28	अंता गैस NTPC Anta		0.00	0.00	0.00	0.00	0.00	0.00
29	रामपुर एचईपी RAMPUR HEP		0.00	0.00	0.00	0.00	0.00	0.00
30	ऊंचाहार-IV UNCHAHAR-IV		0.00	0.00	0.00	0.00	0.00	0.00
31	एनटीपीसी कोलडाम NTPC KOLDAM		0.00	0.00	0.00	0.00	0.00	0.00
32	कोटेड्वर Koteswar		0.00	0.00	0.00	0.00	0.00	0.00
33	टांडा स्टेज-२ Tanda Stg-2		0.00	0.00	0.00	0.00	0.00	0.00
34	अदानी सौर एनर्जि टू लिमिटेड Adani Solar Energy Jodhpur Two Limited		11.45	0.00	0.00	0.00	11.45	0.00
35	सिंगोली भटवारी हेप Singoli Bhatwari HEP		6.14	0.00	2.48	0.00	8.62	0.00
36	रेलवे Railways		0.00	11.59	0.00	3.32	0.00	14.91
37	टिहरी Tehri		0.00	0.00	0.00	0.00	0.00	0.00
38	Renew Solar Energy (Jharkhand Three) Private Limited (RSEJTPs)		0.00	0.00	0.00	0.00	0.00	0.00
39	सोरंग एच.ई.पी. Sorang HEP, (Himachal Sorang Power Private Ltd)		0.26	0.00	0.75	0.00	1.01	0.00
40	अदानी संकर ऊर्जा जैसलमेर वन लिमिटेड (सौर) Adani Hybrid Energy Jaisalmer One Limited (Solar)		0.00	0.00	0.00	0.00	0.00	0.00
41	अदानी संकर ऊर्जा जैसलमेर टू लिमिटेड (सौर) Adani Hybrid Energy Jaisalmer Two Limited (Solar)		0.00	0.00	0.00	0.00	0.00	0.00
42	अदानी संकर ऊर्जा जैसलमेर थ्री लिमिटेड (सौर) Adani Hybrid Energy Jaisalmer Three Limited (Solar)		0.00	0.00	0.00	0.00	0.00	0.00
43	अयाना रिनूवेबल पावर वन लिमिटेड Ayana Renewable Power One Private Limited		0.00	0.00	0.00	0.00	0.00	0.00
44	Adani Hybrid Energy Jaisalmer Four Limited (Solar)अदानी संकर ऊर्जा जैसलमेर चार लिमिटेड (सौर)		0.00	0.00	0.00	0.00	0.00	0.00
45	रिचीय सौर ऊर्जा प्राइवेट लिमिटेड Renew Solar Urja private limited		0.00	0.00	0.00	0.00	0.00	0.00
46	NEA-NR एन ई ए-एन आर		0.00	18.55	0.00	0.00	0.00	18.55
47	रेनव सूर्या रवि प्राइवेट लिमिटेड (सौर) Renew Surya Ravi Private Limited (Solar)		10.37	0.00	1.16	0.00	11.53	0.00
48	अज़र पावर मपल प्राइवेट लिमिटेड (सौर) Azure Power Maple Pvt Ltd (Solar)		0.00	0.00	0.00	0.00	0.00	0.00
49	अदानी ग्रीन हाइब्रिड सौर जैसलमेर Adani Green Hybrid Solar Jaisalmer		0.00	0.00	0.00	0.00	0.00	0.00
50	अदानी ग्रीन हाइब्रिड पवन जैसलमेरAdani Green Hybrid Wind Jaisalmer		0.00	0.00	0.00	0.00	0.00	0.00
51	अदानी ग्रीन सौर जैसलमेर Adani Green Solar Jaisalmer		0.00	0.00	0.00	0.00	0.00	0.00
52	ABC Renewable Energy (RJ-01) Private Limited एबीसी नवीकरणीय ऊर्जा (आर-01) प्राइवेट लिमिटेड		0.00	0.00	0.00	0.00	0.00	0.00
53	SBSR Power Cleantech Eleven Private Limited एसबीएसआर पावर क्लीनटेक लिमिटेड		1.67	0.00	0.07	0.00	1.73	0.00
54	टनकपुर पावर स्टेशन Tanakpur Power Station		0.00	0.00	0.00	0.00	0.00	0.00
55	उरी पावर स्टेशन Uri I Power Station		0.00	0.00	0.00	0.00	0.00	0.00
56	उरी पावर स्टेशन Uri II Power Station		0.00	0.00	0.00	0.00	0.00	0.00
57	चमेरा पावर स्टेशन Chamera I Power Station		0.00	0.00	0.00	0.00	0.00	0.00
58	चमेरा पावर स्टेशन Chamera II Power Station		0.00	0.00	0.00	0.00	0.00	0.00
59	चमेरा पावर स्टेशन Chamera III Power Station		0.00	0.00	0.00	0.00	0.00	0.00
60	धौलीगंगा पावर स्टेशन Dhauliganga Power Station		0.00	0.00	0.00	0.00	0.00	0.00
61	दुलहश्ती पावर स्टेशन Dulhashti Power Station		0.00	0.00	0.00	0.00	0.00	0.00
62	किशनगंगा पावर स्टेशन Kishanganga Power Station		0.00	0.00	0.00	0.00	0.00	0.00
63	पार्वती पावर स्टेशन Parbati III Power Station		0.00	0.00	0.00	0.00	0.00	0.00
64	सेवा पावर स्टेशन Sewa II Power Station		0.00	0.00	0.00	0.00	0.00	0.00
65	सलाल पावर स्टेशन Salal Power Station		0.00	0.00	0.00	0.00	0.00	0.00
66	ADANI SOLAR ENERGY JAISALMER ONE PRIVATE LIMITED AHS अदानी सौर ऊर्जा जैसलमेर वन प्राइवेट लिमिटेड ए एच अंस		0.00	0.00	0.00	0.00	0.00	0.00
67	पार्वती H. ई. प्रोजेक्ट Parbati II HE Project		1.61	0.00	0.00	0.00	1.61	0.00
68	एनटीपीसी अंटा जीपीएस NTPCANTA GPS RLNG		8.01	0.00	3.18	0.00	11.19	0.00
69	एनटीपीसी औरैया जीपीएस NTPC AURAIYA GPS RLNG		9.29	0.00	3.30	0.00	12.58	0.00
70	एनटीपीसी दादरी जीपीएस NTPC DADRI GPS RLNG		12.17	0.00	6.06	0.00	18.23	0.00

18. पावर मार्केट की सूचना (स्रोत : ओई.ई.एक्स. एवं पी.एक्स.आई.एल.) POWER MARKET INFORMATION (Source IEX & PXIL) पावर एक्सचेंज के माध्यम से विनिमय – माह:- अप्रैल 2023 EXCHANGES THROUGH POWER EXCHANGES - APRIL 2023								
क्र.सं. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्सचेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU					
			Day Ahead Market (DAM)		Real Time Market (RTM)		Total (DAM+RTM)	
			विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase
71	मध्य प्रदेश Madhya Pradesh	पश्चिमी क्षेत्र WR	55.41	27.44	369.96	10.06	425.36	37.50
72	महाराष्ट्र Maharashtra		80.96	265.02	50.95	271.65	131.91	536.67
73	गुजरात Gujarat		63.01	966.07	17.17	147.17	80.19	1113.24
74	छत्तीसगढ़ Chhattisgarh		310.28	5.86	106.20	6.58	416.48	12.45
75	गोवा डब्लू आर Goa WR		28.67	9.13	0.00	2.47	28.67	11.60
76	जिंदल पावर JINDAL POWER		112.24	0.00	3.74	0.42	115.99	0.42
77	लॉको Lanco		0.00	0.00	0.00	0.00	0.00	0.00
78	ए सी बी आई एल ACBIL		20.12	0.00	15.51	0.13	35.63	0.13
79	जिंदल स्टील JINDAL STEEL		61.68	0.00	2.97	0.00	64.65	0.00
80	बालको 2 BALCO 2		6.63	0.00	6.06	0.00	12.69	0.00
81	जीएमआर वरौरा GMR Warora		8.76	0.00	2.23	0.00	10.99	0.00
82	एस्सर पावर एम पी Essar Power MP Ltd		41.34	0.00	6.87	0.00	48.21	0.00
83	के एस के महानदी KSK Mahanadi		0.00	0.00	0.00	0.00	0.00	0.00
84	जिंदल पावर लिमिटेड Jindal Power Ltd. Stg-II		181.41	0.00	6.21	0.14	187.62	0.14
85	रायगढ़ एनर्जी लिमिटेड Raigarh Energy Ltd.		11.73	0.00	0.46	0.00	12.19	0.00
86	डी बी पावर DB Power		121.45	0.00	0.23	0.00	121.68	0.00
87	धारीवाल Dhariwal		0.86	0.00	0.00	0.00	0.86	0.00
88	जेपी निगरी JAYPEE NIGRIE		136.03	0.00	0.59	0.00	136.62	0.00
89	डीजेन मेगा पावर DGEN Mega power		42.40	0.00	18.82	0.00	61.21	0.00
90	एम बी पावर MB Power		135.96	0.00	5.79	0.00	141.75	0.00
91	अदानी पावर स्टेशन 3 Adani Power STG3		0.00	0.00	0.00	0.00	0.00	0.00
92	टोरेंट पावर Torrent Power		0.00	0.00	0.00	0.00	0.00	0.00
93	मारुति क्लीन कोल पावर Maruti Clean Coal Power		19.86	0.00	4.17	1.51	24.03	1.51
94	झाबुआ पावर Jhabua Power		10.94	0.00	3.29	0.00	14.23	0.00
95	विंध्याचल स्टेज-1 Vindhyachal stg-1		0.00	0.00	0.00	0.00	0.00	0.00
96	विंध्याचल स्टेज-2 Vindhyachal stg-2		0.00	0.00	0.00	0.00	0.00	0.00
97	विंध्याचल स्टेज-3 Vindhyachal stg-3		0.00	0.00	0.00	0.00	0.00	0.00
98	विंध्याचल स्टेज-4 Vindhyachal stg-4		0.00	0.00	0.00	0.00	0.00	0.00
99	विंध्याचल स्टेज-5 Vindhyachal stg-5		0.00	0.00	0.00	0.00	0.00	0.00
100	मौदा स्टेज-1 Mouda Stg-1		0.00	0.00	0.00	0.00	0.00	0.00
101	सिपत स्टेज-1 Sipat Stg-1		0.00	0.00	0.00	0.00	0.00	0.00
102	सिपत स्टेज-2 Sipat Stg-2		0.00	0.00	0.00	0.00	0.00	0.00
103	सासन Sasan UMPP		0.00	0.00	11.50	0.00	11.50	0.00
104	भिलाई एनएसपीसीएल NSPCL Bhilai		0.00	0.00	0.00	0.00	0.00	0.00
105	कोरबा स्टेज-3 Korba Stg 3		0.00	0.00	0.00	0.00	0.00	0.00
106	टीआरएन एनर्जी TRN Energy		0.00	0.00	21.06	0.00	21.06	0.00
107	गंधार Gandhar		0.00	0.00	0.00	0.25	0.00	0.25
108	कोरबा Korba		0.00	0.00	0.00	0.00	0.00	0.00
109	आर के एम पावर RKM Power		11.38	0.00	23.64	0.00	35.01	0.00
110	कावस Kawas		0.00	0.00	0.00	0.16	0.00	0.16
111	मौदा स्टेज-2 Mouda Stg-2		0.00	0.00	0.00	0.00	0.00	0.00
112	एस के एस पावर SKS Power		98.53	0.00	25.75	0.18	124.28	0.18
113	एन टी पि सी शोलापुर NTPC Sholapur		0.00	0.00	0.00	0.00	0.00	0.00
114	एन टी पि सी गदरवारा NTPC Gadawara		0.00	0.00	0.00	0.00	0.00	0.00
115	एन टी पि सी लारा NTPC Lara		0.00	0.00	0.00	0.00	0.00	0.00
116	रायपुर एनेर्जी Raipur Energen		52.87	0.00	3.70	0.00	56.57	0.00
117	आर्सेलर मित्तल ArcelorMittal Nippon steel (ESIL)		0.00	76.90	0.00	23.85	0.00	100.75
118	खरगोन Khargone STPP		0.00	0.00	0.00	0.00	0.00	0.00
119	कोस्टल गुजरात पावर लिमिटेड Coastal Gujrat Power Limited		0.00	0.00	1.43	0.39	1.43	0.39
120	कंटीनम पावर ट्रेडिंग Continuum Power Trading (TN) Private Limited		1.42	0.00	0.60	0.00	2.03	0.00
121	ऑस्ट्रो एनर्जी प्राइवेट लिमिटेड Ostro Energy Private Limited (OEPL)		0.00	0.00	0.00	0.00	0.00	0.00
122	दमन डीयू/दादरा और नगर हवेलीDaman & Diu/Dadar and Nagar Haveli		0.00	113.60	1.58	21.83	1.58	135.44
123	अदानी विंड एनर्जी Adani Wind Energy Kutchni Five Limited		0.00	0.00	0.00	0.00	0.00	0.00
124	आर जी पी पि एस RGPPPL		0.00	0.00	0.00	0.13	0.00	0.13
125	Kakrapar Atomic Power Station काकरपर अटॉमिक पावर स्टेशन		0.00	0.00	282.39	0.00	282.39	0.00
126	BALCO बालको		0.00	7.21	0.00	3.27	0.00	10.48
127	अदानी बिंड एनर्जी कूच फोर लिमिटेड नख्तरना ADANI WIND ENERGY KUTCHH FOUR Ltd. Nakhatrana		9.24	0.00	0.29	0.00	9.53	0.00
128	एनटीपीसी झनार गंधार जीपीएस NTPC Jhanor Gandhar GPS RLNG		17.65	0.00	0.30	0.00	17.94	0.00
129	एनटीपीसी कावस गण्ड NTPC Kawas GPS RLNG		15.03	0.00	0.29	0.00	15.32	0.00
130	रत्नागिरी गैस और पावर प्राइवेट लिमिटेड Ratnagiri Gas and Power Private Limited-LTRLNG		29.60	0.00	0.20	0.00	29.80	0.00
131	विंड फाइव एनर्जी लिमिटेड WIND FIVE RENERGY LIMITED		0.24	0.00	0.00	0.00	0.24	0.00
132	एनटीपीसी झनार गंधार जीपीएस कॉम गैस NTPC Jhanor Gandhar GPS_COMGAS		0.00	0.00	0.00	0.00	0.00	0.00

18. पावर मार्केट की सूचना (स्रोत : ओ.ई.ई.एक्स. एवं पी.एक्स.आई.एल.) POWER MARKET INFORMATION (Source IEX & PXIL) पावर एक्स्चेंज के माध्यम से विनिमय - माह:- अप्रैल 2023 EXCHANGES THROUGH POWER EXCHANGES - APRIL 2023								
क्र.सं. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU					
			Day Ahead Market (DAM)		Real Time Market (RTM)		Total (DAM+RTM)	
			विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase
133	आंध्र प्रदेश Andhra Pradesh	दक्षिणी क्षेत्र SR	53.82	174.62	14.95	106.63	68.77	281.24
134	कर्नाटक Karnataka		90.09	54.30	17.11	55.41	107.21	109.71
135	केरलKerala		27.04	23.64	9.95	15.77	37.00	39.41
136	तमिलनाडु Tamilnadu		63.64	155.95	6.69	84.06	70.32	240.01
137	पण्डिचेरी Pondicherry		1.55	0.00	0.75	0.00	2.30	0.00
138	गोवा एस आर Goa SR		0.00	11.94	0.00	1.75	0.00	13.69
139	तेलंगाना TELANGANA		81.32	508.49	33.92	415.21	115.24	923.70
140	कोस्टल एनर्जेन Costal Energen		4.82	0.00	0.38	0.00	5.19	0.00
141	आई एल और एफ एस IL&FS		12.28	0.00	1.80	0.00	14.08	0.00
142	सिहाद्री स्टेज -2 Simhadri Stg-2		2.06	0.00	0.06	0.00	2.12	0.00
143	एनएलसी इंडिया स्टेशन 1 विस्तार NLC India Station I Expansion		0.00	0.00	0.00	0.00	0.00	0.00
144	एन एल सी स्टेज-1 NLC TPS-II Stg-1		0.00	0.00	0.00	0.00	0.00	0.00
145	एन एल सी स्टेज-2 NLC TPS-II Stg-2		0.00	0.00	0.00	0.00	0.00	0.00
146	रामगुंडम स्टेज-1 Ramagundam Stg-1		4.85	0.00	0.28	0.00	5.13	0.00
147	तलचर स्टेज -2 Talcher Stg-2		11.70	0.00	0.06	0.00	11.76	0.00
148	रामगुंडम स्टेज-3 Ramagundam Stg-3		2.28	0.00	0.08	0.00	2.36	0.00
149	सेम्कोर्प गायत्री Sembcorp Gayatri		33.79	0.00	5.69	0.00	39.48	0.00
150	वल्लूर Vallur		0.00	0.00	0.00	0.00	0.00	0.00
151	कुड्गुली NTPC Kudgi		7.62	0.00	0.34	0.00	7.96	0.00
152	सिहाद्री स्टेज -1 Simhadri Stg-1		0.00	0.00	0.00	0.00	0.00	0.00
153	एन एल सी टी पी एस -11 एक्सपन NLC TPS-II Expn		0.00	0.00	0.00	0.00	0.00	0.00
154	एनटीपीएल NTPL		0.53	0.00	5.82	0.00	6.35	0.00
155	नयवेली न्यू थर्मल पावर प्रोजेक्ट Neyveli New Thermal Power Project		0.00	0.00	0.00	0.00	0.00	0.00
156	रामगुंडम फ्लोटिंग सोलर पी वी स्टेशन Ramagundam Floating Solar PV Station		9.26	0.00	0.25	0.00	9.51	0.00
157	सिहाद्री फ्लोटिंग सोलर Simhadri Floating solar		2.04	0.00	0.00	0.00	2.04	0.00
158	सिहाद्री एफएसपी 15 एमवी प्रोजेक्ट Simhadri FSP 15 MW Project		3.05	0.00	0.00	0.00	3.05	0.00
159	सेमकोर्प एनर्जी इंडिया लिमिटेड Sembcorp energy india limited		20.65	0.00	3.35	0.00	24.00	0.00
160	जे एस डब्ल्यू रिनैव एनर्जी टू लिमिटेड JSW RENEW ENERGY TWO LIMITED		0.00	0.00	0.00	0.00	0.00	0.00
161	Ostro Kannada Power Private Limited ओस्ट्रो कन्नड़ पावर प्राइवेट लिमिटेड		7.06	0.00	0.74	0.00	7.80	0.00
162	Simhapuri Energy Limited सिमहापुरी एनर्जि लिमिटेड		0.60	0.00	2.23	1.04	2.83	1.04
163	पश्चिम बंगाल West Bengal	पूर्वी क्षेत्र ER	49.00	419.47	59.28	148.33	108.28	567.80
164	ओडिशा Odisha		45.87	19.47	85.91	81.58	131.78	101.05
165	बिहार Bihar		454.00	1.74	264.99	4.49	719.00	6.23
166	झारखंड Jharkhand		23.21	18.64	26.42	10.68	49.63	29.31
167	सिक्किम Sikkim		10.93	0.20	3.06	5.98	13.99	6.18
168	दामोदर घाटी परियोजना DVC		24.19	20.85	4.37	10.01	28.56	30.86
169	मैथन पावर लिमिटेड Maithon P. Ltd		0.00	0.00	0.00	0.00	0.00	0.00
170	आधुनिक पा. लिमिटेड Adhunik P.Ltd		0.07	0.00	0.40	0.00	0.47	0.00
171	चुजाचेन Chuzachen HEP		3.62	0.00	0.58	0.00	4.20	0.00
172	जीएमआर कमलंगा GMR Kamalanga		0.12	0.00	0.12	0.00	0.24	0.00
173	खिंदल आई पी टी एल JIPTL		24.88	0.00	2.04	0.00	26.92	0.00
174	जोरथांग Jorethang		0.00	0.00	0.00	0.00	0.00	0.00
175	फरक्का-III Farakka-III		0.00	0.00	0.00	0.00	0.00	0.00
176	बाढ़-II Barh Stage-II		0.00	0.00	0.00	0.00	0.00	0.00
177	कहलगाँव-II Kahalgaon Stage-II		0.00	0.00	0.00	0.00	0.00	0.00
178	फरक्का Farakka		0.02	0.00	0.00	0.00	0.02	0.00
179	कहलगाँव Kahalgaon		0.01	0.00	0.00	0.00	0.01	0.00
180	तालचर Talcher		0.02	0.00	0.00	0.00	0.02	0.00
181	तीस्ता-III Teesta-III		19.80	0.00	11.73	0.00	31.53	0.00
182	दिक्चु Dikchu HEP		2.88	0.00	7.09	0.00	9.97	0.00
183	ताशिदिंग Tashiding HEP		0.00	0.00	0.00	0.00	0.00	0.00
184	केबीएनएल KBUNL		0.00	0.00	0.00	0.00	0.00	0.00
185	दर्लीपल्ली Darlipalli		0.00	0.00	0.00	0.00	0.00	0.00
186	नवीनगर NPGC Nabinagar		0.00	0.00	0.00	0.00	0.00	0.00
187	नेपाल विद्युत प्राधिकरण Nepal Electricity Authority		0.00	163.24	0.00	0.00	0.00	163.24
188	Barh STPS Stage-I बाढ़ एसटीपीएस स्टेज-1		0.00	0.00	0.00	0.00	0.00	0.00
189	NTPC North Karanpura STPS नॉर्थ करनपुरा		0.00	0.00	0.00	0.00	0.00	0.00
190	Druk Green Power Corporation Limited-Bhutan द्रुक ग्रीन पावर कार्पोरेशन लिमिटेड-भूटान		0.00	48.33	0.00	0.00	0.00	48.33
191	NTPC BARH1 Unit 2 एनटीपीसी बाढ़ 1		0.00	0.00	0.00	0.00	0.00	0.00

18. पावर मार्केट की सूचना (स्रोत : ओई.ई.एक्स. एवं पी.एक्स.आई.एल.) POWER MARKET INFORMATION (Source IEX & PXIL) पावर एक्स्चेंज के माध्यम से विनिमय – माह:- अप्रैल 2023 EXCHANGES THROUGH POWER EXCHANGES - APRIL 2023								
क्र.सं. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (पि.यु. मे) Through Power Exchange in MU					
			Day Ahead Market (DAM)		Real Time Market (RTM)		Total (DAM+RTM)	
			विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase	विक्रय Sale	क्रय Purchase
192	अरुणाचल प्रदेश Arunachal Pradesh	पूर्वोत्तर क्षेत्र NER	8.67	2.35	1.97	0.46	10.63	2.81
193	असम Assam		48.57	65.03	22.11	42.34	70.68	107.37
194	मणिपुर Manipur		0.00	0.21	3.62	9.87	3.62	10.07
195	मेघालय Meghalaya		0.18	4.92	0.00	7.59	0.18	12.51
196	मिज़ोरम Mizoram		7.85	0.00	0.03	0.00	7.87	0.00
197	नागालैंड Nagaland		1.25	0.00	0.24	0.00	1.49	0.00
198	त्रिपुरा Tripura		3.89	0.84	6.82	10.60	10.71	11.43
199	अगरतला जीटीपीपी Agartala GTPP_AGO		0.00	0.00	0.00	0.00	0.00	0.00
200	असम जीबीपीपी Assam GBPP_KTO		0.00	0.00	0.05	0.00	0.05	0.00
201	पलाताना Palatana		10.42	0.00	14.92	0.00	25.34	0.00
202	Doyang HEP दोयॉंग ह्येय		0.00	0.00	0.00	0.00	0.00	0.00
203	बोंगाईगाँव Bongalgaon TPP		3.24	0.00	0.26	0.00	3.51	0.00
204	कमरेंग Kameng HEP		15.49	0.00	24.18	0.00	39.67	0.00
			4567	4566	2153	2153	6719	6719

19. INFORMATION ABOUT RENEWABLE ENERGY
CERTIFICATE MECHANISM

MONTH : APRIL 2023

RE Source & Unit wise break up (01.04.2023-30.04.2023)

Sr.No	Source Wise	Accreditation		Registration	
		Capacity (MW)	Unit	Capacity (MW)	Unit
1	Wind	0	0	101	1
2	Urban or Municipal Waste	0	0	0	0
3	Solar Thermal	0	0	0	0
4	Solar PV	1	1	0	0
5	Small Hydro	0	0	0	0
6	Others	0	0	0	0
7	Geothermal	0	0	0	0
8	Biomass	0	0	0	0
9	Bio-fuel cogeneration	4	1	4	1
	Total	5	2	105	2

RECs Issued (01.04.2023-30.04.2023)

Sr.No.	Non Solar	Solar	Total
1	159173	99061	258234

Redemption of REC (01.04.2023-30.04.2023)

Sr.No.	Non Solar	Solar	Total
1	288398	87734	376132

19. INFORMATION ABOUT RENEWABLE ENERGY
CERTIFICATE MECHANISM
MONTH : APRIL 2023

RE Source & Unit wise break up (Apr'23-Apr'23)

Sr.No	Source Wise	Accreditation		Registration	
		Capacity (MW)	Unit	Capacity (MW)	Unit
1	Wind	0	0	101	1
2	Urban or Municipal Waste	0	0	0	0
3	Solar Thermal	0	0	0	0
4	Solar PV	1	1	0	0
5	Small Hydro	0	0	0	0
6	Others	0	0	0	0
7	Geothermal	0	0	0	0
8	Biomass	0	0	0	0
9	Bio-fuel cogeneration	4	1	4	1
	Total	5	2	105	2

RECs Issued (Apr'23-Mar'24)

Sr.No.	Non Solar	Solar	Total
1	159173	99061	258234

Redemption of REC (Apr'23-Mar'24)

Sr.No.	Non Solar	Solar	Total
1	288398	87734	376132

19. INFORMATION ABOUT RENEWABLE ENERGY
CERTIFICATE MECHANISM

MONTH : APRIL 2023

RE Source & Unit wise break up Since Inception to Apr'23

Sr.No	Source Wise	Accreditation		Registration	
		Capacity (MW)	Unit	Capacity (MW)	Unit
1	Wind	2759	510	2603	510
2	Urban or Municipal Waste	0	0	0	0
3	Solar Thermal	0	0	0	0
4	Solar PV	1270	493	1185	465
5	Small Hydro	644	33	656	35
6	Others	4	2	3	1
7	Geothermal	0	0	0	0
8	Biomass	397	36	373	34
9	Bio-fuel cogeneration	813	89	379	54
	Total	5887	1163	5199	1099

RECs Issued since Inception to Apr'23

Sr.No.	Non Solar	Solar	Total
1	88039961	12509799	100549760

Redemption of REC since Inception to Apr'23

Sr.No.	Non Solar	Solar	Total
1	67816583	11716122	79532705

REC Closing balance as on 30.04.2023

Sr.No.	Non Solar	Solar	Total
1	20223378	793677	21017055

Details of Grid Events during the Month of April 2023

Western Region



Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	(GI 1or 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
1	GI-2	WR	05-Apr-23 06:36	05-Apr-23 07:42	01:06	180	-	0.003	-	66742	60725	At 06:36 Hrs/05-04-2023, MSLDC Kalwa issued code to diable A/R of 400 kV Koradi-Khaparkhedha 1. During execution of code, LBB mal-operated and resulted in tripping of all the elements connected to 400 kV Koradi Bus 1. Koradi Unit 6 (210 MW), 400/220 kV Koradi ICT-1, 400 kV Koradi- Bhusawal, 400 kV Koradi- Bhilai, 400 kV Koradi- Satpura and 400 kV Koradi Khaparkhedha Ckt 1 tripped along with 400 kV Koradi Bus 1. As intimated by MSLDC Kalwa, Generation loss of 180 MW occurred at 400 kV Koradi due to the event.	Tripping of 1. 400 kV Koradi- Bhusawal 2. 400 kV Koradi- Bhilai 3. 400 kV Koradi- Satpura 4. 400 kV Koradi- Khaparkhedha 1 5. 400/220 kV Koradi ICT 1 6. 210 MW koradi Unit 6
2	GI-2	WR	06-Apr-23 17:40	06-Apr-23 20:02	02:22	393	-	0.006	-	66412	61334	At 17:40 Hrs/06-04-2023, R-phase CT of 402 Bay failed at 400 kV MCCPL station. This failure resulted in tripping of 400kV MCCPL-Bilaspur line on Zone-IV (reverse) protection operation and MCCPL Unit-1 (300MW) generating 268MW on Teed differential protection operation. At the same time, ACBIL Unit-1 (135MW) generating 125MW also tripped on excitation loss. Generation loss of 393 MW occurred at MCCPL and ACBIL due to the event.	Tripping of 1. 400 kV MCCPL- Bilaspur 2. 300 MW MCCPL Unit 1 3. 135 MW ACBIL Unit 1
3	GI-1	WR	14-Apr-23 00:38	14-Apr-23 00:46	00:08	-	106	-	0.002	73160	63502	At 00:38 Hrs/14-04-2023, 220 kV Amona- Ponda 1 & 220 kV Mapusa- Amona tripped on B-E fault (both circuit in same tower) due to earth wire snapping at location no. 94. Due to the delayed clearance of fault from Ponda end, 220/110 kV Ponda ICTs 2&3 tripped on B/U E/F protection operation. There was a load loss of 106 MW due to the event.	Tripping of 1. 220 kV Amona- Ponda 1 2. 220 kV Mapusa- Amona 3. 220/110 kV Ponda ICTs 2&3
4	GI-2	WR	15-Apr-23 13:34	15-Apr-23 14:43	01:09	-	-	-	-	67899	63709	At 13:34 Hrs/15-04-2023, R phase CB pole of 400 kV Pachchham line blasted at 400 kV Chorania substation and resulted in tripping of all the elements connected to 400 kV Chorania Bus 2. There was no load loss due to the event.	Tripping of 1. 400 kV Chorania- Amrelli 2. 400 kV Chorania- Asoj 2 3. 400 kV Chorania- Charal 4. 400 kV Chorania- Mansar 5. 400 kV Chorania- Vadavi 1 7. 400 kV Chorania- Pachchham 6. 400/220 kV Chorania ICTs 1,2&3
5	GD-1	WR	15-Apr-23 15:56	15-Apr-23 18:41	02:45	20	-	0.000	-	73884	66997	At 15:56 Hrs/15-04-2023, 220 kV Bhuj- Kota Madh line tripped at Kota Madh end on O/C&E/F protection operation. As reported by site, Y-Phase CT Secondary connection found loose and the same was tightened. There was a generation loss of around 20 MW at 220 kV Kotda Madh (Alfanar) Wind Power Plant.	Tripping of 1. 220 kV Bhuj- Kotda Madh
6	GD-1	WR	17-Apr-23 17:24	17-Apr-23 19:50	02:26	100	-	0.001	-	74592	66077	At 17:24 Hrs/17-04-2023, 220 kV Bhuj-Dayapar-2 line tripped on B phase to earth fault. There was a generation loss of around 100 MW at 220 kV Dayapar (Inox) Wind Power Plant.	Tripping of 1. 220 kV Bhuj-Dayapar-2
7	GI-1	WR	22-Apr-23 15:12	22-Apr-23 16:34	01:22	125	-	0.002	-	68858	63771	At 15:12 Hrs/22-04-2023,400 kV Chandrapur-Bus-2 and all connected elements tripped on bus bar protection operation due to flash over in Y phase CT of 400 kV Chandrapur-Bhadrawati-2. There was a generation loss of around 125 MW at 400 kV Chandrapur due to the event.	Tripping of 1. 400 kV Chandrapur-Bus-2 2. 400 kV Chandrapur-Bhadrawati-1 & 2 3. 400 kV Chandrapur-Chandrapur(HVDC)-1 4. Chandrapur Unit-4 (210 MW)
8	GD-1	WR	22-Apr-23 21:32	22-Apr-23 22:58	01:26	-	96	-	0.002	69822	59253	At 21:32 Hrs/22-04-2023,220 kV Doma-Bus-1 & 2 and all connected elements tripped due to blasting of Y phase CT of bus coupler at Doma. 220 kV Raipur-Doma-1 & 2 tripped from Doma end only. There was a load loss of around 96 MW due to the event.	Tripping of 1. 220 kV Doma-Bus-1 & 2 2. 220 kV Raipur-Doma-1 & 2 3. 220/132 kV Doma-ICT-1 & 2
9	GI-1	WR	24-Apr-23 19:50	24-Apr-23 21:26	01:36	175	-	0.002	-	70069	60793	At 19:50 Hrs / 24-04-2023,132 kV ACBIL-Renki-1 tripped on R phase to earth fault. Due to delayed clearance of fault, 400/132 kV ACBIL-ICT-1 & 2 tripped on Back up Earth fault protection operation. Heavy thunderstorm reported during the event by ACBIL. There was a generation loss of around 175 MW at 132 kV ACBIL due to loss of evacuation path.	Tripping of 1. 132 kV ACBIL-Renki-1 2. 400/132 kV ACBIL-ICT-1 & 2

Details of Grid Events during the Month of April 2023
Western Region



Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	(GI 1or 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
10	GD-1	WR	25-Apr-23 19:54	26-Apr-23 02:38	06:44	117	-	0.002	-	70376	60415	At 19:54 Hrs/25-04-2023, 220 kV Bhuj- Dayapar-2 line tripped at Bhuj end only on B phase to earth fault . As reported by site, Rope found hanging at tower location 111. There was a generation loss of around 117 MW 220 kV Dayapar (Inox) Wind Power Plant.	Tripping of 1. 220 kV Bhuj- Dayapar-2
11	GD-1	WR	26-Apr-23 11:40	26-Apr-23 20:21	08:41	86	-	0.001	-	67822	64478	At 11:40 Hrs/26-04-2023, 220 kV Bhuj- Dayapar-2 line tripped at Bhuj end only on B phase to earth fault . As reported by site, rope found hanging at tower location 111 . There was a generation loss of around 86 MW 220 kV Dayapar (Inox) Wind Power Plant.	Tripping of 1. 220 kV Bhuj- Dayapar-2
12	GD-1	WR	28-Apr-23 15:58	28-Apr-23 17:51	01:53	149	-	0.002	-	65622	59495	At 15:58 Hrs/28-04-2023, 220 kV Indore(PG)-Pritamnagar(AWEMP1PL) line tripped on R phase to ground fault. There was a generation loss of around 149 MW at Pritamnagar (SBESS) Wind Power Plant.	Tripping of 1. Indore(PG)-Pritamnagar(AWEMP1PL)

Details of Grid Events during the Month of April 2023													
Southern Region													
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid		Brief details of the event (pre fault and post fault system conditions)	Name of Elements (Tripped/Manually opened)
	(GI for 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
1	GD-1	Karnataka	04-Apr-23 10:58	04-Apr-23 11:40	42mins	0	400	0.00%	0.68%	50576	59229	Complete Outage of 220kV/66kV Begur SS, 220kV/66kV KHWPK SS, 220kV/66kV Hosakote SS, Tripping of 220kV Bus-1 of 220kV/66kV DB Pura SS and Multiple trippings at 400kV/220kV Devanahalli SS of KPTCL: During antecedent conditions, 220kV/66kV DB Pura was operating under split bus condition with 220kV Begur DB Pura line feeding 220kV DB Pura Bus-1. 220kV/66kV Begur SS, 220kV/66kV KHWPK SS, 220kV/66kV Hosakote SS were being radially fed from 220kV Devanahalli KHWPK line-1&2 and 220kV Begur Hoody line. As per the reports submitted, the triggering incident was suspected 220kV Bus-1 and Bus-2 fault at Devanahalli SS during bus changeover activity. Fault was cleared by tripping of 400kV/220kV Devahalli ICT-1&2 on backup Earth Fault protection. This led to loss of supply at 220kV Devanahally Bus. Subsequently, 220kV Hoody Begur line tripped on RY fault. This led to complete outage of 220kV/66kV Begur SS, 220kV/66kV KHWPK SS, 220kV/66kV Hosakote SS and loss of supply to 220kV Bus-1 of 220kV/66kV DB Pura SS.	1. 400kV/220kV Devanahalli ICT-1,2 2. 220kV Begur KHWPK Line-1 3. 220kV Hoody Begur Line
2	GD-1	Kerala	04-Apr-23 16:24	04-Apr-23 17:08	44mins	0	86	0.00%	0.15%	46605	57669	Complete Outage of 220kV/66kV Kaniyampetta SS of KSEB and Tripping of 220kV Bus-2 of 220kV/66kV Hootagalli SS and 220kV Bus-2 of 220kV/66kV Kadakola SS of KPTCL: 220kV/33kV Kaniyampetta SS was operating with single bus at 220kV level. 220kV/66kV Hootagalli SS and 220kV/66kV Kadakola SS were operating under split bus conditions at 220kV level. 220kV Bus-2 of 220kV/66kV Kadakola SS was being radially fed from 220kV Kaniyampetta Kadakola line and 220kV Bus-2 of 220kV/66kV Hootagalli SS was being radially fed from 220kV Kadakola Hootagalli line. As per the reports submitted, the triggering incident was 220kV Bus BBP operation at Kaniyampetta SS during charging of 220kV/66kV 50MVA Transformer-1 at Kaniyampetta end. This led to complete outage of 220kV/33kV Kaniyampetta SS which further led to supply failure to 220kV Bus-2 at 220kV/66kV Kadakola SS and 220kV/66kV Hootagalli SS.	1. 220kV Kadakola Kaniyampetta 2. 220kV Kaniyampetta Kunnamangalam
3	GD-1	Karnataka	06-Apr-23 13:25	06-Apr-23 13:56	31mins	300	40	0.60%	0.07%	50155	59770	Complete Outage of 220kV Nagheri PH, 220kV Kodalalli PH, 220kV Kadra PH of KPCL and 220kV/110kV Karwar SS of KPTCL: During antecedent conditions, 220kV Nagheri PH was operating with single bus configuration at 220kV level. 220kV Kaiga Kadra and 220kV Kaiga Kodalalli were under outage. 220kV Kodalalli PH, 220kV Kadra PH and 220kV/110kV Karwar SS were being radially fed from 220kV Nagheri PH. As per the reports submitted, the triggering incident was B-N fault in 220kV Bus at Nagheri PH. The fault was cleared by tripping 220kV lines on remote ends on zone-2 protection and Units on Backup Earth fault protection. This led to complete outage of 220kV Nagheri PH, 220kV Kodalalli PH, 220kV Kadra PH and 220kV/110kV Karwar SS.	1. 220kV Nagheri Ambewadi line-1&2 2. 220kV Nagheri Hubli Line-1,2&3 3. 220kV Nagheri Bidnal 4. 220kV Nagheri Kodalalli Line-1&2
4	GD-1	Karnataka	09-Apr-23 12:03	09-Apr-23 12:30	27mins	0	245	0.00%	0.44%	48073	55134	Complete Outage of 220kV/66kV Hebbal SS, 220kV/66kV HBR Layout SS and Multiple trippings at 220kV/66kV Manyatha Tech Park SS and 220kV/66kV Hoody SS of KPTCL: During antecedent conditions, 220kV Hebbal Sahakarnagar and 220kV Manyatha Yelahanka line were under LC and there was bus split operation at 220kV Manyatha Tech Park SS. 220kV Hebbal SS was fed from 220kV Bus-1 of 220kV/66kV Manyatha Tech Park SS which was being fed from 220kV HBR Layout Manyatha Tech park line. 220kV/66kV HBR Layout SS was radially fed from 220kV/66kV Hoody SS. As per the reports submitted, the triggering incident was R-N fault in 220kV Hoody Begur line and the line tripped only at Begur end on DEF protection. At Hoody end, breaker failed to open and 220kV Bus sectionaliser of Bus-1 tripped. This led to loss of supply to 220kV/66kV Hebbal SS, 220kV/66kV HBR Layout SS and 220kV/66kV Manyatha Tech Park SS.	1. 220kV Hoody Begur
5	GD-1	Karnataka	13-Apr-23 10:15	13-Apr-23 10:30	15mins	0	30	0.00%	0.05%	52501	62126	Complete Outage of 220kV Kodalalli PH, 220kV Kadra PH of KPCL and 220kV/110kV Karwar SS of KPTCL: During antecedent conditions, 220kV Kaiga Kadra and 220kV Kaiga Kodalalli were under outage. 220kV Kadra PH and 220kV/110kV Karwar SS were being radially fed from 220kV Kodalalli PH. As per the reports submitted, the triggering incident was tripping of all connected lines at 220kV Kodalalli PH on operation of CTD due to loss of DC supply. This resulted in complete outage of 220kV Kodalalli PH, 220kV Kadra PH and 220kV/110kV Karwar SS.	1. 220kV Nagheri Kodalalli Line-1&2 2. 220kV Kadra Kodalalli
6	GD-1	Karnataka	15-Apr-23 18:01	15-Apr-23 19:09	1hr 8mins	19	0	0.05%	0.00%	40682	51170	Complete Outage of 220kV/66kV Tirumani SS-1, 220kV/66kV Tirumani SS-2 and 220kV/66kV Rychalu_1 SS of KSPDCL: As per the reports submitted, the triggering incident was the operation of over voltage protection of 220kV Pavagada Tirumani Line-1&2, 220kV Pavagada Rychalu line at Tirumani and Rychalu ends respectively. Since 220kV/66kV Tirumani SS-1, 220kV/66kV Tirumani SS-2 and 220kV/66kV Rychalu_1 SS are radially connected to Pavagada, tripping of these lines resulted in a complete outage of 220kV/66kV Tirumani SS-1, 220kV/66kV Tirumani SS-2 and 220kV/66kV Rychalu_1 SS. At the same time, 400kV Pavagada Mysore Line-1 and 400kV Nelamangala Hassan Lines tripped on over voltage protection at Pavagada and Hassan end	1. 400kV Pavagada Mysore-1 2. 220kV Pavagada Tirumani-1,2 3. 220kV Pavagada Rychalu_1 4. 400kV Nelamangala Hassan
7	GD-1	Karnataka	20-Apr-23 09:49	20-Apr-23 09:56	7mins	0	40	0.00%	0.06%	52446	61983	Complete Outage of 220kV Kodalalli PH, 220kV Kadra PH of KPCL and 220kV/110kV Karwar SS of KPTCL: During antecedent conditions, 220kV Kaiga Kadra and 220kV Kaiga Kodalalli were under outage. 220kV Kadra PH and 220kV/110kV Karwar SS were being radially fed from 220kV Kodalalli PH. As per the reports submitted, the triggering incident was tripping of all connected lines at 220kV Kodalalli PH on operation of CTD due to loss of DC supply. This resulted in complete outage of 220kV Kodalalli PH, 220kV Kadra PH and 220kV/110kV Karwar SS.	1. 220kV Nagheri Kodalalli Line-1&2 2. 220kV Kadra Kodalalli
8	GD-1	Tamil Nadu	22-Apr-23 14:27	22-Apr-23 15:26	59mins	160	230	0.34%	0.41%	47338	56401	Complete Outage of 230kV OPGC Alamathy and Tripping of 230kV Bus-1 & 2 at 400kV/230kV/110kV Alamathy SS of TANTRANSO: 230kV OPGC Alamathy is radially connected to 400kV/230kV/110kV Alamathy SS. As per the reports submitted, due to heavy wind and rain, all the 230kV lines connected to 230kV Bus-1 tripped on different faults from 13:55hrs to 14:37hrs. At 14:27hrs, an insulator connected to 230kV Alamathy OPGC Line-1 failed and fell on 230kV Bus-2 at 400kV/230kV/110kV Alamathy SS causing a bus fault. Immediately, the BBP of the 230kV Bus-2 operated and all the elements connected to the bus tripped. Subsequently, 400kV/230kV Alamathy ICT-5 tripped on over current protection leading to the outage of 230kV Bus-1 & 2 at 400kV/230kV/110kV Alamathy SS. This resulted in complete outage of 230kV Alamathy OPGC.	1. 400kV/230kV Alamathy ICT-3 & 5 2. 230kV Alamathy OPG Line-1&2 3. 230kV Manali Alamathy Line-1 & 2 4. 400kV Manali Alamathy 5. 230kV NCTPS Alamathy 6. 230kV Alamathy Thyruvedu 7. 230kV Alamathy Mosur

Details of Grid Events during the Month of April 2023													
Southern Region													
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid		Brief details of the event (pre fault and post fault system conditions)	Name of Elements (Tripped/Manually opened)
	(GI for 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
9	GD-1	Karnataka	22-Apr-23 15:46	22-Apr-23 16:10	24mins	0	170	0.00%	0.30%	45266	55773	Complete Outage of 220kV/66kV KIADB Harohalli SS and 220kV/66kV Kanakpura SS of KPTCL: During antecedent conditions, 220kV Kanakpura TK Halli Line was under shutdown. 220kV/66kV KIADB Harohalli SS and 220kV/66kV Kanakpura SS were being radially fed through 220kV Somanahalli Harohalli line. As per the reports submitted, the triggering incident was R-N fault in 220kV Somanahalli Harohalli line and the line tripped at both ends. Tripping of this line resulted in complete outage of Complete Outage of 220kV/66kV KIADB Harohalli SS and 220kV/66kV Kanakpura SS.	1. 220kV Somanahalli Harohalli
10	GD-1	Andhra Pradesh	23-Apr-23 06:35	23-Apr-23 10:22	3hr 47mins	0	0	0.00%	0.00%	38295	46307	Complete Outage of 400kV Gautami CCPP: During antecedent conditions, 400kV Vemagiri Gautami Line-2 was under idle charged condition from Vemagiri end. As per the reports submitted, the triggering incident was R-N fault in 400kV Vemagiri Gautami Line-1 and the line tripped. Tripping of the only connected line resulted in complete outage of 400kV Gautami CCPP.	1. 400kV Vemagiri Gautami Line-1
11	GD-1	Tamil Nadu	26-Apr-23 04:50	26-Apr-23 05:41	51mins	0	0	0.00%	0.00%	36240	41996	Complete Outage of 230kV/110kV Kadalangudi SS of TANTRANSCO: As per the reports submitted, the triggering incident was line to ground fault in 230kV Kadalangudi PP Nallur line. At Kadalangudi end, breaker failed to open causing 230kV LBB to operate and all the elements connected to the bus got tripped. This led to complete outage of 230kV/110kV Kadalangudi SS. 230kV Kadalangudi is under single bus operation.	1. 230kV Kadalangudi PP Nallur-1&2 2. 230kV Kadalangudi Neyveli TS-II 3. 230kV Kadalangudi Neyveli 4.230kV/110kV Kadalangudi Transformer-1&2
12	GD-1	Karnataka	27-Apr-23 16:34	27-Apr-23 18:08	1hr 34mins	963	0	2.18%	0.00%	44173	52305	Complete Outage of 400kV YTPS of KPCL: As per the reports submitted, the triggering incident was R-N fault in 400kV YTPS BPS line-1 and the line tripped. At the same time, 400kV YTPS BPS Line-2 also tripped. Tripping of both lines resulted in complete outage of 400kV YTPS.	1. 400kV YTPS BPS Line-1&2
13	GD-1	Karnataka	30-Apr-23 10:11	30-Apr-23 11:11	1hr	0	19	0.00%	0.04%	40489	45853	Complete outage of 220kV/66kV Guttur SAS SS and Tripping of 220kV Bus-1 of 400kV/220kV Guttur SS of KPTCL: As per the reports submitted, the triggering incident was the LBB maloperation of 220kV Guttur Guttur SASLine -1 . Immediately, all the elements connected to 220kV Bus-1 tripped. Since 220kV/66kV Guttur SAS was being radially fed from 400kV/220kV Guttur SS, this resulted in complete outage of 220kV/66kV Guttur SAS SS.	1.400kV/220kV Guttur ICT-2 2. 220kV Guttur Guttur SAS Line-1&2 3. 220kV Guttur Neelagunda 4. 220kV Guttur Davanagere Line-1&2
14	GI-2	Andhra Pradesh	01-Apr-23 15:32	01-Apr-23 23:47	8 hrs 15 mins	0	0	0.00%	0.00%	47186	58860	Tripping of 400kV Bus-1 of 400kV/220kV/11kV Guddigudem SS of APTRANSCO: As per the reports submitted, the triggering incident was 400kV Bus-1 BBP maloperation at 400kV/220kV/11kV Guddigudem SS resulting in the tripping of all the elements connected to Bus-1.	1. 400kV Guddigudem KV Kota Line-1&2 2. 400kV Guddigudem KV Hiduja Line-2
15	GI-1	Andhra Pradesh	29-Apr-23 14:24	29-Apr-23 14:59	25mins	400	0	0.87%	0.00%	46211	50290	Tripping of 220kV Bus-2 of 220kV VTPS Generating station of APGENCO: As per the reports submitted, the triggering incident was R-Y fault in 220kV VTPS Nuziveedu line-2. AT VTPS end, Y-pole of breaker failed to open causing LBB to operate and all the elements connected to the 220kV Bus-2 tripped.	1. 220kV VTPS Nuziveedu Line-2 2. 220kV VTPS Gunadala Line-2 3. 220kV VTPS Kondapalli Line-2 4. 220kV VTPS Tadikonda Line-2 5. 220kV VTPS Narsaraopet 6. 220kV VTPS Chilikallu Line-2 7. 220kV VTPS Rentachinthala 8. 220kV VTPS Piduguralla Line-2 9. VTPS Unit-2,3&6
16	GI-1	Tamil Nadu	30-Apr-23 16:53	30-Apr-23 17:45	52mins	0	50	0.00%	0.12%	35015	42436	Tripping of 230kV Bus at 230kV/110kV Acharapakkam SS of TANTRANSCO: 230kV/110kV Acharapakkam SS was operating with single bus configuration. As per the reports submitted, the triggering incident was Y-N fault in 230kV Kalpakkam Acharapakkam line. At Acharapakkam end, due to a discrepancy in breaker opening, LBB operated and all the elements connected to the bus tripped. 110kV level was intact during the event.	1. 230kV Acharapakkam Kalpakkam 2. 230kV Acharapakkam Villupuram 3. 230kV/110kV Acharapakkam Auto Transformer Line-2&3
17	GI-1	Telangana	30-Apr-23 21:55	01-May-23 00:16	2hrs 21mins	0	0	0.00%	0.00%	34779	41742	Tripping of 220kV Bus-1 of 220kV Upper Jurala PH of TSGENCO: During antecedent conditions, there was no generation at 220kV Upper Jurala PH. As per the reports submitted, the triggering incident was R-N fault in 220kV Jurala Raichur, KA Line-1. At the same time, the Bus Coupler tripped on over current protection. Tripping of only connected line and bus coupler resulted in de-energization of 220kV Bus-1 at 220kV Upper Jurala PH.	1. 220kV Jurala Raichur, KA Line-1 2. 220kV Bus coupler at 220kV Jurala PH

Details of Grid Events during the Month of April 2023



Eastern Region

Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t. Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	(GI 1 or 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
1	GD-1	Teesta-3, Dikchu	17.04.2023 21:33	17.04.2023 22:08	00:35	1234	0	3.85%	0.00%	32035	27275	At 21:33 Hrs, 400 kV Rangpo-Dikchu tripped due to B_N Fault leading to tripping of all running units at Teesta 3 and Dikchu due to loss of evacuation path as 400 kV Teesta 3-Rangpo already tripped at 20:53 Hrs due to Y_B_N fault. Around 1234 MW generation loss occurred (Teesta 3:1187 MW, Dikchu: 47 MW)	400 kV Teesta 3-Dikchu 400 kV Rangpo-Dikchu
2	GD-1	Teesta-3, Dikchu	17.04.2023 22:53	17.04.2023 23:21	00:28	1237	0	3.81%	0.00%	32446	27744	At 22:53 Hrs, 400 kV Rangpo-Dikchu tripped again due to B_N Fault leading to tripping of all running units at Teesta 3 and Dikchu due to loss of evacuation path as 400 kV Teesta 3-Rangpo was already under breakdown. Around 1237 MW generation loss occurred (Teesta 3:1188 MW, Dikchu: 49 MW)	400 kV Teesta 3-Dikchu 400 kV Rangpo-Dikchu
3	GD-1	Teesta-3, Dikchu	18.04.2023 03:27	18.04.2023 04:03	00:36	1096	0	3.58%	0.00%	30610	26595	At 03:27 Hrs, 400 kV Rangpo-Dikchu tripped again due to B_N Fault leading to tripping of all running units at Teesta 3 and Dikchu due to loss of evacuation path as 400 kV Teesta 3-Rangpo was already under breakdown. Around 1096 MW generation loss occurred (Teesta 3:1000 MW, Dikchu: 96 MW)	400 kV Teesta 3-Dikchu 400 kV Rangpo-Dikchu
4	GI-1	Tenughat	18.04.2023 13:19	18.04.2023 14:15	00:56	305	0	1.10%	0.00%	27802	29055	At 13:19 Hrs, B_ph CT of 220 kV Tenughat-Govindpur-2 burst at Tenughat. At the same time, both running units at Tenughat also tripped. Around 305 MW generation loss occurred at Tenughat.	U#1 and U#2 (210 MW each) at Tenughat 220 kV Tenughat-Govindpur-2
5	GD-1	Chandil	27.04.2023 07:12	27.04.2023 07:33	00:21	0	250	0.00%	1.15%	28581	21773	At 07:12 Hrs, 220 kV Bus PT at Chandil burst leading to tripping of all elements connected to 220 kV Bus at Chandil as bus bar protection is not available. This led to complete power failure at Chandil S/s and load loss of around 250 MW occurred at Rajkhasrawan, Chakradharapur, Jadugoda, Dalbhumgarh, Golmuri, Kendposi, Tamar, Khunti, Adityapur.	220 kV Ranchi-Chandil 220 kV Ramchandrapur-Chandil 220 kV Chandil-Santalidih

Details of Grid Events during the Month of April 2023												
North-East Region												
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM:SS)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t. Antecedent Generation/Load in the		Antecedent Generation/Load in the Regional Grid		Brief details of the event (pre fault and post fault system conditions)
	(G1 1or 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)	
1	GD 1	Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System	01-Apr-23 17:45	01-Apr-23 18:28	00:43:00	0	14	0.00%	0.58%	2278	2429	Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kV Along - Daporijo Line. At 17:45 Hrs on 01.04.2023, 132 kV Along - Daporijo Line tripped. Due to tripping of this element, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. 132 kV Along - Daporijo Line was declared faulty at 18:28 Hrs on 01.04.2023. Power supply was extended to Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System by charging 132 kV Along - Daporijo Line at 10:23 Hrs on 02.04.2023
2	GD 1	Lumshnong area of Meghalaya Power System	02-Apr-23 04:55	03-Apr-23 05:20	00:25:00	0	20	0.00%	1.52%	2077	1312	Lumshnong area of Meghalaya Power System were connected with the rest of NER Grid through 132 kV Panchgram-Lumshnong Line. 132 kV Khleihriat-Lumshnong Line was already under tripped condition since 04:36 Hrs on 02.04.2023. At 04:55 Hrs on 02.04.2023, 132 kV Panchgram-Lumshnong Line tripped. Due to tripping of this element, Lumshnong area of Meghalaya Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in this area. Power supply was extended to Lumshnong area of Meghalaya Power System by charging 132 kV Khleihriat-Lumshnong Line at 05:20 Hrs on 02.04.2023.
3	GD 1	Kohima, Meluri and Kiphire areas of Nagaland Power System	02-Apr-23 12:35	02-Apr-23 13:19	00:44:00	6	17	0.28%	0.98%	2133	1731	Kohima, Meluri and Kiphire areas of Nagaland Power System were connected with the rest of NER Grid through 132 kV Karong-Kohima & 132 kV Dimapur (PG) - Kohima Lines. 132 kV Kohima - Chephobozou Line was under state approved shutdown. At 12:35 Hrs on 02.04.2023, 132 kV Karong-Kohima and 132 kV Dimapur (PG) - Kohima Lines tripped. Due to tripping of these elements, Kohima, Meluri and Kiphire areas of Nagaland Power System were separated from the rest of NER Grid and subsequently collapsed due to load generation mismatch in these areas. Power supply was extended to Kohima, Meluri & Kiphire areas of Nagaland Power System by charging 132 kV Dimapur(PG)-Kohima Line at 13:19 Hrs on 02.04.2023.
4	GD 1	Kohima, Meluri and Kiphire areas of Nagaland Power System	02-Apr-23 16:28	02-Apr-23 16:42	00:14:00	0	24	0.00%	1.37%	2060	1747	Kohima, Meluri and Kiphire areas of Nagaland Power System were connected with the rest of NER Grid through 132 kV Karong-Kohim Line. 132 kV Kohima - Chephobozou Line was under planned shutdown and 132 kV Dimapur(PG)-Kohima Line was already under tripped condition since 15:59 Hrs on 02.04.2023. At 16:28 Hrs on 02.04.2023, 132 kV Karong-Kohima Line was hand tripped on emergency basis as fire detected in isolator. Due to tripping of this element, Kohima, Meluri and Kiphire areas of Nagaland Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. Power supply was extended to Kohima, Meluri & Kiphire areas of Nagaland Power System by charging 132 kV Dimapur(PG)-Kohima at 16:42 Hrs on 02.04.2023.
5	GD 1	Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System	02-Apr-23 17:35	02-Apr-23 17:45	00:10:00	0	14	0.00%	0.70%	2333	2012	Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kV Along - Pasighat Line. At 17:35 Hrs on 02.04.2023, 132 kV Along - Pasighat Line tripped. Due to tripping of this element, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. 132 kV Along - Pasighat Line was declared faulty at 17:45 Hrs on 02.04.2023. Power supply was extended to Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System by charging 132 kV Along - Pasighat Line at 14:45 Hrs on 03.04.2023
6	GD 1	Along, Pasighat, Roing, Tezu, Namsai areas of Arunachal Pradesh Power System	14-Apr-23 10:10	14-Apr-23 11:15	01:05	0	17	0%	1%	2187	2120	Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kV Along - Daporijo Line. At 10:10 Hrs on 14.04.2023, 132 kV Along - Daporijo Line tripped. Due to tripping of this element, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. 132 kV Along - Daporijo Line was declared faulty at 11:15 Hrs on 14.04.2023. Power supply was extended to Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System by charging 132 kV Along - Daporijo Line at 20:02 Hrs on 14.04.2023.

Details of Grid Events during the Month of April 2023

North-East Region



Sl No.	Category of Grid Event (G1 to 2/ GD-1 to GD-5)	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM:SS)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t. Antecedent Generation/Load in the		Antecedent Generation/Load in the Regional Grid		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	Generation Loss(MW)					Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)			
7	GD 1	Daporijo, Along, Pasighat, Roing, Tezu, Namsai areas of Arunachal Pradesh Power System	16-Apr-23 15:40	16-Apr-23 16:34	00:54	0	18	0%	1%	2062	2544	Daporijo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kV Ziro- Daporijo Line. At 15:40 Hrs on 16.04.2023, 132 kV Ziro - Daporijo Line tripped. Due to tripping of this element, Daporijo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. Power supply was extended to Daporijo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System by charging 132 kV Ziro- Daporijo Line at 16:34 Hrs on 16.04.2023.	132 kV Ziro - Daporijo Line
8	GD 1	Depota, Ghoramari, Dhekiajuli and Rowta areas of Assam Power System	18-Apr-23 19:36	18-Apr-23 19:46	00:10:00	0	120	0.00%	3.85%	2960	3114	Depota, Ghoramari, Dhekiajuli and Rowta areas of Assam Power System were connected with the rest of NER Grid through 132 kV Sonabil - Depota and 132 kV Sonabil - Ghoramari Line. 132 kV Sipajhar - Rowta & 132kV Tangla - Rowta Lines were under shutdown to control overloading of 220 kV Balipara-Sonabil Line. At 19:36 Hrs on 18.04.2023, 132 kV Sonabil - Depota and 132 kV Sonabil -Ghoramari Lines tripped. Due to tripping of these elements, Depota, Ghoramari,Dhekiajuli and Rowta areas of Assam Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. Power supply was extended to Depota, Ghoramari, Dhekiajuli and Rowta areas of Assam Power System by charging 132 kV Sonabil-Depota Line at 19:46 Hrs on 18.04.2023.	132 kV Sonabil - Depota and 132 kV Sonabil -Ghoramari Lines
	GD 1	Dhaligaon, Barpeta, Bornagar, Jogighopa and Gosaigaon areas of Assam Power System	19-Apr-23 01:50	19-Apr-23 01:59	00:09:00	0	122	0.00%	5.74%	2214	2127	Dhaligaon, Barpeta, Bornagar, Jogighopa and Gosaigaon areas of Assam Power System were connected with the rest of NER Grid through 132 kV BTPS(AS) - Dhaligaon D/C Lines. 132 kV Nalbari-Barpeta Line was under shutdown to avoid overloading of 132 kV BTPS-Dhaligaon D/C Lines, 132 kV Bornagar - Rangia Line was under shutdown to avoid overloading of Rangia ICTs and 132kV Gosaigaon -Gauripur Line was under shutdown to avoid overloading of 132 kV BTPS - Kokrajhar D/C Lines. At 01:50 Hrs on 19.04.2023, 132 kV BTPS(AS) - Dhaligaon D/C Lines tripped. Due to tripping of these elements, Dhaligaon, Barpeta, Bornagar, Jogighopa and Gosaigaon areas of Assam Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. Power supply was extended to Dhaligaon, Barpeta, Bornagar, Jogighopa and Gosaigaon areas of Assam Power System by charging 132 kV BTPS(AS) -Dhaligaon 1 Line at 01:59 Hrs on 19.04.2023.	132 kV BTPS(AS) - Dhaligaon D/C Lines
10	GD 1	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System	19-Apr-23 18:17	19-Apr-23 18:41	00:24:00	3	25	0.12%	0.85%	2603	2929	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kV Balipara - Tenga Line. At 18:17 Hrs on 19.04.2023, 132 kV 132 kV Balipara - Tenga Line tripped. Due to tripping of this element Tenga, Khupi areas & Dikshi HEP areas of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to load generation mismatch in these areas. Power supply was extended to Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System by charging 132 kV Balipara - Tenga Line at 18:41 Hrs on 19.04.2023.	132 kV Balipara - Tenga Line
11	GD 1	Ziro, Daporijo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System	21-Apr-23 03:27	21-Apr-23 03:58	00:31:00	0	15	0.00%	0.99%	1983	1516	Ziro, Daporijo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kV Ranganadi - Ziro Line. At 03:27 Hrs on 21.04.2023, 132 kV Ranganadi - Ziro Line tripped. Due to tripping of this element, Ziro, Daporijo, Along, Pasighat, Roing,Tezu and Namsai areas of Arunachal Pradesh Power System were separated from rest of NER Grid and subsequently collapsed due to no source available in these areas. Power supply was extended to Ziro, Daporijo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System by charging 132 kV Ranganadi - Ziro Line at 03:58 Hrs on 21.04.2023	132 kV Ranganadi - Ziro Line.
12	GD 1	Rokhia area of Tripura Power System	21-Apr-23 18:17	21-Apr-23 19:08	00:51	20	2	1%	0%	3050	2548	Rokhia area of Tripura Power System was connected with rest of NER grid through 132 kV Monarchak - Rokhia Line. 132 kV Rokhia -Agartala D/C Lines were already under tripped condition since 18:15 Hrs on 21.04.2023. At 18:17 Hrs on 21.04.2023, 132 kV Monarchak - Rokhia Line tripped. Due to tripping of this element, Rokhia area of Tripura Power System was separated from rest of NER Grid and subsequently collapsed due to load generation mismatch in this area. Power supply was extended to Rokhia area of Tripura Power System by charging 132 kV Rokhia -Agartala 1 Line at 19:08 Hrs on 21.04.2023.	132 kV Monarchak - Rokhia Line
13	GD 1	Kolasib, Bairabi areas and Tural HEP of Mizoram Power System	22-Apr-23 18:24	22-Apr-23 18:35	00:11	36	4	1%	0%	2793	2572	Kolasib, Bairabi areas of Mizoram Power System and Tural HEP were connected with rest of NER grid through 132 kV Badarpur-Kolasib and 132 kV Kolasib-Aizawl Lines. At 18:24 Hrs on 22.04.2023, 132 kV Badarpur-Kolasib, 132 kV Kolasib-Aizawl Lines tripped. Due to tripping of these elements, Kolasib, Bairabi areas and Tural HEP of Mizoram Power System were separated from rest of NER Grid and subsequently collapsed due to load generation mismatch in these areas. Power supply was extended to Kolasib, Bairabi areas and Tural HEP of Mizoram Power System by charging 132 kV Kolasib-Aizawl Line at 18:35 Hrs on 22.04.2023.	132 kV Badarpur-Kolasib, 132 kV Kolasib-Aizawl and 132 kV Kolasib - Tural Lines

Details of Grid Events during the Month of April 2023

North-East Region



Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM:SS)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the		Antecedent Generation/Load in the Regional Grid		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	(G1 1or 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss(MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
14	GD 1	Leshka Generating Stations of Meghalaya Power System	23-Apr-23 10:58	23-Apr-23 12:00	01:02	35	0	2%	0%	1788	1703	Leshka Generating Stations of Meghalaya Power System was connected with rest of NER grid through 132 kv Myntdu Leshka - Khleihriat D/C Lines. At 10:58 Hrs on 23.04.2023, 132 kv Myntdu Leshka - khleihriat D/C Lines tripped. Due to tripping of these elements, Leshka Generating Station of Meghalaya Power System was separated from rest of NER Grid and subsequently collapsed due to loss of evacuation path. Power supply was extended to Leshka Generating Station of Meghalaya Power System by charging 132 kv Myntdu Leshka - Khleihriat 1 Line at 12.00 Hrs on 23.04.2023	132 kv Myntdu Leshka - Khleihriat D/C Lines
15	GD 1	Lumshnong area of Meghalaya Power System	23-Apr-23 11:25	23-Apr-23 11:36	00:11	0	20	0%	1%	2000	1856	Lumshnong area of Meghalaya Power System was connected with rest of NER grid through 132 kv Khleihriat-Lumshnong Line. 132 kv Lumshnong-Panchgram Line was under Post OCC approved shutdown due to reconductoring with HTLS since 07:34 Hrs on 23.04.2023. At 11:25 Hrs on 23.04.2023, 132 kv Khleihriat-Lumshnong Line tripped. Due to tripping of this element, Lumshnong area of Meghalaya Power System was separated from rest of NER Grid and subsequently collapsed due to no source available in this area. Power supply was extended to Lumshnong area of Meghalaya Power System by charging 132 kv Khleihriat-Lumshnong Line at 11:36 Hrs on 23.04.2023.	132 kv Khleihriat-Lumshnong Line
16	GD 1	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System	24-Apr-23 10:04	24-Apr-23 11:00	00:56	4	27	0%	2%	1831	1781	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kv Balipara - Tenga Line. At 10:04 Hrs on 24.04.2023, 132 kv Balipara - Tenga Line tripped. Due to tripping of this element Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to load generation mismatch in these areas. Power supply was extended to Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System by charging 132 kv Balipara - Tenga Line at 11:00 Hrs on 24.04.2023.	132 kv Balipara - Tenga Line
17	GD 1	Daporizo, Along, Pasighat, Roing, Tezu and Namsai areas of Aruchanal Pradesh Power System	24-Apr-23 19:14	24-Apr-23 20:53	01:39	0	17	0%	1%	3066	2809	Daporizo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kv Ziro - Daporijo Line. At 19:14 Hrs on 24.04.23, 132 kv Ziro - Daporijo Line tripped. Due to tripping of this element, Daporizo, Along, Pasighat, Roing, Tezu and Namsai areas of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to no source available in these areas. 132 kv Ziro - Daporijo Line was declared faulty at 20:52 Hrs on 24.04.2023. Power supply was extended to Daporizo, Along, Pasighat, Roing, Tezu and Namsai areas of Aruchanal Pradesh Power System by charging 132 kv Ziro - Daporijo Line at 18:48 Hrs on 26.04.2023.	132 kv Ziro - Daporijo Line
18	GD 1	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System	27-Apr-23 21:17	27-Apr-23 21:49	00:32	4	29	0%	1%	2499	2453	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kv Balipara - Tenga Line. At 21:17 Hrs on 27.04.2023, 132 kv Balipara - Tenga Line tripped. Due to tripping of this element Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to load generation mismatch in these areas. Power supply was extended to Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System by charging 132 kv Balipara - Tenga Line at 21:49 Hrs on 27.04.2023.	132 kv Balipara - Tenga Line
19	GD 1	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System	28-Apr-23 17:40	28-Apr-23 18:07	00:27	4	27	0%	1%	2467	2538	Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were connected with the rest of NER Grid through 132 kv Balipara - Tenga Line. At 17:40 Hrs on 28.04.2023, 132 kv Balipara - Tenga Line tripped. Due to tripping of this element Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System were separated from the rest of NER Grid and subsequently collapsed due to load generation mismatch in these areas. Power supply was extended to Tenga, Khupi areas & Dikshi HEP of Arunachal Pradesh Power System by charging 132 kv Balipara - Tenga Line at 18:07 Hrs on 28.04.2023.	132 kv Balipara - Tenga Line

21. NEW ELEMENTS COMMISSIONED* IN APRIL 2023							
COMMISSIONING OF NEW GENERATING UNITS							
REGION	S.NO.	ENTITY	UNIT NAME / LOCATION	ADD. CAPACITY (MW)	UNIT NO.	INS. CAPACITY (MW)	DATE®
NR	1	UPRVUNL	Obra-C TPS (Thermal)/Uttar Pradesh	660	I	1200	23-04-2023
	2	UPRVUNL	Jawaharpur TPS (Thermal)/Uttar Pradesh	660	II	1200	29-04-2023
WR	3	ADANI	Adani Wind Energy Kutchh Four Ltd(Wind)/Gujarat	18.9	I	300	01-04-2023
	4	AEPL	Apraava Energy Private Limited (Wind)/Gujarat	52.5	I	250.8	08-04-2023
	5	ALFANAR NETRA VAYU	Alfanar Netra Vayu(Wind)/Gujarat	55	I	300	11-04-2023
	6	SHERISHA	Sherisha Raipur(Solar)/ Chhattisgarh	50	I	50	22-04-2023
SR	7	OSTRO	Ostro Kannada Pvt Ltd(Wind)/Karnataka	31.5	-	300.3	07-04-2023
	8	JSW RENEW TWO	JSW Renew Two(Wind)/Tamilnadu	51.3	-	78.3	22-04-2023
®RE (Solar & Wind generation added capacity FTC is in phases. Date mentioned is the date by which complete (Added) capacity							
COMMISSIONING OF NEW ICTS							
REGION	S.NO.	ENTITY	SUB-STATION	VOLTAGE (kV)	ICT NO.	CAPACITY (MVA)	DATE
NR	1	POWERGRID	Bikaner	765/400/33	III	1500	27-04-2023
	2	POWERGRID	Bhadla_II	400/220/33	VII	500	28-04-2023
SR	3	APTRANSCO	Guddigudem	400/220/33	I	315	21-04-2023
	4	APTRANSCO	Guddigudem	400/220/33	II	315	21-04-2023
	5	APTRANSCO	Jammalamadugu	400/220/33	III	500	27-04-2023
COMMISSIONING OF NEW TRANSMISSION LINES							
REGION	S.NO.	ENTITY	LINE NAME	CKT NO.	VOLTAGE (kV)	DATE	
LILO OF TRANSMISSION LINES							
REGION	S.NO.	ENTITY	LINE NAME (LILOed LINE)	LILO AT	VOLTAGE (kV)	DATE	
NR	1	PJFTL,UPRVUNL,WUPPTCL	765kV Mainpuri-Jawaharpur TPS Ckt-I (765kV Mainpuri-Greater Noida)	Jawaharpur	765	10-04-2023	
	2	PJFTL,UPRVUNL,WUPPTCL	765kV Greater Noida-Jawaharpur TPS Ckt-I (765kV Mainpuri-Greater Noida)	Jawaharpur	765	10-04-2023	
	3	OCBTL,UPPTCL,UPRVUNL	765kV Obra C TPS-Anpara D Ckt-I (765kV Anpara D- Unnao)	Obra C	765	12-04-2023	
	4	UPRVUNL,OCBTL,UPPTCL	765kV Obra C TPS-Unnao Ckt-I (765kV Anpara D- Unnao)	Obra C	765	19-04-2023	
COMMISSIONING OF BUS/LINE REACTORS							
REGION	S.NO.	ENTITY	SUB-STATION / LINE (@SUB-STATION)	VOLTAGE (kV)	CAPACITY (MVAR)	DATE	
NR	1	UPRVUNL	Bus Reactor-@Obra C TPS	765	189	21-04-2023	
	2	UPRVUNL,OCBTL,UPPTCL	Obra C-Unnao@Obra C TPS	765	330	19-04-2023	
WR	3	MSETCL	Bus Reactor-I@Akola	400	125	27-04-2023	
COMMISSIONING OF HVDC/FACTS DEVICE/SYSTEM							
REGION	S.NO.	NAME	SUB-STATION / CONSTITUENT	RATINGS	VOLTAGE (kV)	DATE	
*Includes first time charging (FTC) as well							

22.Voltage Profile

विद्युत विभव रूपरेखा माह - अप्रैल 2023

VOLTAGE PROFILE - APRIL 2023

Date of reporting: 04-May-23

क्र.स. Sl. No.	क्षेत्र REGION	उपकेंद्र SUBSTATION	VOLTAGE < V(lower)* (V=380,728 kV)	V(lower) < VOLTAGE < V(upper)*	VOLTAGE > V(upper)* (V=420,800 kV)	Voltage Deviation Index (%age of time voltage is outside range)	Number of hours voltage was outside IEGC band during month	उच्चतम (कि.वो.) Maximum(kV)	निम्नतम(कि.वो.) Minimum(kV)	औसत (कि.वो.) Average(kV)
1	पूर्वी क्षेत्र ER	अंगुल ANGUL	0%	100%	0%	0%	0	804	752	776
2		दालिपली DALLIPALI	0%	100%	0%	0%	0	797	766	781
3		गया GAYA	0%	100%	0%	0%	0	785	754	771
4		जेरत JEERAT	0%	100%	0%	0%	0	800	736	766
5		झारसुगड़ा JHARSUGUDA	0%	98%	2%	2%	15	808	773	790
6		मिदनापुर MEDINIPUR	0%	100%	0%	0%	0	799	750	771
7		रांची RANCHI	0%	100%	0%	0%	0	798	765	782
8		सासाराम SASARAM	0%	100%	0%	0%	0	791	729	765
1	उत्तरी क्षेत्र NR	आगरा AGRA	0%	100%	0%	0%	0	802	753	778
2		आगरा (फतेहाबाद) AGRA (FATEHABAD)	0%	100%	0%	0%	0	792	749	769
3		अजमेर AJMER	0%	100%	0%	0%	3	804	752	782
4		अलीगढ़ ALIGARH	0%	100%	0%	0%	0	799	750	774
5		अनपरा सी ANPARA-C	0%	100%	0%	0%	0	777	753	764
6		अनपरा डी ANPARA-D	0%	100%	0%	0%	0	778	751	763
7		अंता ANTA	0%	99%	1%	1%	8	806	767	788
8		बलिया BALLIA	0%	100%	0%	0%	0	793	735	765
9		बारा BARA	0%	100%	0%	0%	0	788	758	771
10		भादला BHADLA	0%	100%	0%	0%	0	803	744	774
11		भादला-2 BHADLA-2	0%	100%	0%	0%	0	809	745	773
12		भिवानी BHIWANI	0%	100%	0%	0%	1	806	757	780
13		बीकानेर BIKANER	0%	100%	0%	0%	0	803	751	775
14		बरेली BAREILLY	0%	99%	1%	1%	4	806	740	775
15		चित्तौड़गढ़ CHITTORGARH	0%	100%	0%	0%	2	806	748	780
16		फतेहगढ़-2 FATEHGARH-2	0%	100%	0%	0%	0	803	737	771
17		फतेहपुर FATEHPUR	0%	100%	0%	0%	0	795	735	771
18		ग्रेटर नोएडा GREATER NOIDA	0%	100%	0%	0%	1	802	750	778
19		हापड़ HAPUR	0%	100%	0%	0%	0	796	735	768
20		जवाहरपुर JAWAHARPUR	0%	99%	1%	1%	5	807	765	783
21		झाटिकरा JHATIKARA	0%	100%	0%	0%	0	800	754	776
22		कानपुर जीआईएस KANPUR GIS	0%	100%	0%	0%	0	797	740	771
23		खेतरी KHETRI	0%	100%	0%	0%	0	801	754	777
24		कोटेश्वर KOTESHWAR	0%	100%	0%	0%	2	805	755	779
25		लालितपुर LALITPUR	0%	100%	0%	0%	0	773	745	758
26		लखनऊ LUCKNOW	0%	100%	0%	0%	0	795	738	769
27		मैनपुरी MAINPURI	0%	100%	0%	0%	1	803	746	777
28		मेरठ MEERUT	0%	100%	0%	0%	3	807	754	780
29		मोहा MOHA	0%	100%	0%	0%	1	802	747	771
30		ओबरा सी OBRA C	0%	97%	3%	3%	22	817	738	768
31		उरई ORAI	0%	100%	0%	0%	2	805	761	784
32		फागी PHAGI	0%	100%	0%	0%	1	805	757	782
33		उन्नाव UNNAO	0%	100%	0%	0%	0	793	736	763
34		वाराणसी VARANASI	0%	100%	0%	0%	0	795	751	775
1	पश्चिमी क्षेत्र WR	अकोला AKOLA	0%	100%	0%	0%	0	798	754	772
2		औरंगाबाद AURANGABAD	0%	100%	0%	0%	1	804	749	779
3		भोपाल (बीडीटीसीएल) BHOPAL (BDTCL)	0%	100%	0%	0%	0	792	750	770
4		भुज BHUJ	0%	100%	0%	0%	1	801	747	773
5		भुज-2 BHUJ-II	0%	100%	0%	0%	0	796	746	769
6		बिलासपुर BILASPUR	0%	100%	0%	0%	0	788	759	772
7		बिना BINA	0%	100%	0%	0%	2	803	765	782
8		बनारस BANASKANTHA	0%	100%	0%	0%	1	803	765	782
9		चाण CHAMPA	0%	96%	4%	4%	26	807	776	782
10		धुले (बीडीटीसीएल) DHULE (BDTCL)	0%	100%	0%	0%	0	798	750	776
11		धर्मजगढ़ DHARAMJAGARH	0%	100%	0%	0%	0	793	762	777
12		रायपुर पूलिंग RAIPUR POOLING	0%	100%	0%	0%	0	798	767	784
13		एकतुनी EKTUNI	0%	100%	0%	0%	0	793	740	769
14		गदरवाड़ा GADARWARA	0%	99%	1%	1%	6	807	770	786
15		ग्वालियर GWALIOR	0%	100%	0%	0%	3	805	757	782
16		इंदौर INDORE	0%	100%	0%	0%	0	795	749	773
17		जबलपुर JABALPUR	0%	96%	4%	4%	28	810	773	789
18		खंडवा KHANDWA	0%	100%	0%	0%	0	793	753	775
19		कोरडी KORADI	0%	100%	0%	0%	0	785	757	769
20		लकाडिया LAKADIYA	0%	99%	1%	1%	9	808	756	780
21		रायगढ़ पूलिंग RAIGARH POOLING	0%	100%	0%	0%	0	801	776	789
22		पड़घे PADGHE	0%	100%	0%	0%	3	809	745	777
23		परली PARLI	0%	100%	0%	0%	2	808	751	780
24		पुणे PUNE	0%	99%	1%	1%	5	809	736	777
25		राजनन्दागांव RAJNANDGAON	0%	99%	1%	1%	7	806	772	789
26		सासन SASAN	0%	100%	0%	0%	0	793	766	779
27		सतना SATNA	0%	100%	0%	0%	3	805	767	784
28		सिवनी SEONI	0%	100%	0%	0%	0	793	758	777
29		सीपत SIPAT	0%	100%	0%	0%	0	788	761	773
30		सोलापुर SOLAPUR	0%	98%	2%	2%	11	811	754	784
31		तिरुठा TIRORA	0%	100%	0%	0%	0	777	756	765
32		तामना TAMNAR	0%	100%	0%	0%	0	800	774	788
33		वडोदरा VADODARA	0%	100%	0%	0%	3	803	744	777
34		विंध्याचल पूलिंग VINDHYACHAL PS	0%	100%	0%	0%	0	796	771	783
35		वर्धा WARDHA	0%	100%	0%	0%	1	804	762	783
36		वरार वावरा WARORA	0%	100%	0%	0%	0	801	759	780
1	दक्षिणी क्षेत्र SR	कडपा CUDDAPAH	0%	89%	11%	11%	81	819	752	787
2		चिक्लरीचिट्ट CHILAKALURIPETA	0%	92%	8%	8%	58	820	750	783
3		कुरुनैल KURNOOL	0%	100%	0%	0%	0	798	744	773
4		महेश्वरम MAHESHWARAM	0%	98%	2%	2%	18	808	737	777
5		निजामाबाद NIZAMABAD	0%	87%	13%	13%	92	812	748	786
6		नेल्लूर पूलिंग NELLORE PS	0%	100%	0%	0%	0	797	746	773
7		रायचूर RAICHUR	0%	100%	0%	0%	0	801	750	777
8		श्रीकाकुलम SRIKAKULAM	0%	98%	2%	2%	17	816	753	782
9		तिरुवलम THIRUVALEM	0%	99%	1%	1%	5	804	739	775
10		वेमगिरी VEMAGIRI	0%	96%	4%	4%	27	818	757	784
1	पूर्वोत्तर क्षेत्र NER	बिस्वनाथ चौरआलि BISWANATH CHARIALI (400 kV)	0%	100%	0%	0%	0	414	361	401
2		बोंगाईगांव BONGAIGAON (400 kV)	0%	100%	0%	0%	0	417	398	408
3		बोंगाईगांव टीपीएस BONGAIGAON TPS (400 kV)	0%	100%	0%	0%	0	420	400	410
4		इम्फाल IMPHAL (400 kV)	0%	100%	0%	0%	0	415	393	404
5		बर्निहाट BYRNHAT (400 kV)	0%	100%	0%	0%	0	419	401	411
6		कामेंग KAMENG (400 kV)	0%	100%	0%	0%	0	415	393	403
7		अज़ारा AZARA (400 kV)	0%	100%	0%	0%	0	402	391	398
8		मिसा MISA (400 kV)	0%	100%	0%	0%	0	414	392	403
9		न्यू मारियानी NEW MARIANI (400 kV)	0%	100%	0%	0%	0	418	392	405
10		न्यू कोहिमा NEW KOHIMA (400 kV)	0%	100%	0%	0%	0	420	394	406
11		पालाताना PALATANA (400 kV)	0%	100%	0%	0%	0	414	402	407
12		पुबेकचनबारी PK BARI (400 kV)	0%	100%	0%	0%	0	411	394	403
13		रंगानादी RANGANADI (400 kV)	0%	99%	1%	1%	4	422	400	410
14		सिलचर SILCHAR (400 kV)	0%	100%	0%	0%	0	417	398	408
16		सुर्ज्यामणिनगर SURJYAMANINAGAR (400 kV)	0%	100%	0%	0%	0	409	395	402
17		थोबाल THOUBAL (400 kV)	1%	99%	0%	1%	5	408	374	390

All listed stations are 765 kV stations unless otherwise mentioned

*Percentage is calculated w.r.t. Time of one month.

24. ALL TIME HIGHEST

30-04-2023

	Maximum Demand Met during the day (MW)	Demand Met during Evening Peak hrs(MW)	Energy Met (MU)	Hydro Gen. (MU)	Wind Gen. (MU)	Solar Gen. (MU)
NR	77091 28-06-2022	71909 09-09-2022	1737 28-06-2022	420 22-08-2022	78 09-06-2022	147 21-04-2023
WR	71321 27-12-2022	63593 18-04-2023 (20:00)	1539 18-04-2023	167 18-12-2014	272 22-05-2022	70.25 21-02-2023
SR	64314 15-03-2023	52366 18-04-2023 (20:00)	1329 19-04-2023	208 31-08-2018	297 12-07-2022	142.7 21-03-2023
ER	29302 19-04-2023 (23:20)	28579 18-04-2023 (20:00)	631 18-04-2023	157 14-09-2022	-	7 23-03-2023
NER	3603 17-08-2022	3510 12-08-2022	69 11-08-2022	41 01-08-2022	-	2 22-06-2022
All India	215882 18-04-2023 (14:44)	207956 18-04-2023 (20:00)	4836 18-04-2023	877 30-08-2022	555 22-05-2022	345 13-02-2023
Regions	States	Max. Demand Met during the day (MW)		Energy Consumption (MU)		
			As on date		As on date	
NR	Punjab	14267	22-08-2022	334.5	29-06-2022	
	Haryana	12540	28-06-2022	266.2	07-07-2021	
	Rajasthan	17097	23-01-2023	328.9	09-09-2022	
	Delhi	7770	29-06-2022	153.5	28-06-2022	
	UP	26002	10-09-2022	547.4	19-08-2022	
	Uttarakhand	2594	14-06-2022	54.3	15-06-2022	
	HP	2071	06-01-2023	39.6	05-06-2022	
	J&K(UT) and Ladakh(UT)	3044	02-02-2023	65.4	20-01-2023	
	Chandigarh	426	08-07-2021	8.4	08-07-2021	
Railways NR ISTS	-	-	-	-		
WR	Chhattisgarh	5642	18-04-2023 (16:00)	129.8	19-04-2023	
	Gujarat	21627	18-04-2023 (14:00)	461.7	18-04-2023	
	MP	17238	13-01-2023	329.3	10-01-2023	
	Maharashtra	28846	14-04-2022	627.8	28-04-2022	
	Goa	759	18-04-2023 (19:00)	16.6	18-04-2023	
	DD & DNH	1278	23-02-2023	29.6	19-04-2023	
	AMNSIL	977	18-08-2021	21.0	31-05-2022	
Balco	-	-	-	-		
SR	Andhra Pradesh*	12494	14-04-2023 (11:59)	247.8	20-04-2023	
	Telangana*	15497	30-03-2023	303.4	03-03-2023	
	Karnataka	16110	20-04-2023 (11:00)	309.5	20-04-2023	
	Kerala	5024	18-04-2023 (22:00)	103.3	19-04-2023	
	Tamil Nadu	19387	20-04-2023 (12:00)	415.4	20-04-2023	
	Pondy	485	29-06-2022	10.8	22-04-2023	
ER	Bihar	6990	06-08-2022	143.4	18-08-2022	
	DVC	3751	18-04-2023 (20:44)	81.2	22-04-2022	
	Jharkhand	1857	19-04-2023 (21:20)	37.0	16-04-2022	
	Odisha	7192	19-04-2023 (15:35)	145.5	25-09-2022	
	West Bengal	11868	18-04-2023 (14:43)	245.7	18-04-2023	
	Sikkim	137	03-02-2022	2.5	28-01-2020	
	Railways ER ISTS	-	-	-	-	
NER	Arunachal Pradesh	167	04-03-2023	2.9	15-07-2022	
	Assam	2376	12-08-2022	47.6	12-08-2022	
	Manipur	258	31-01-2022	3.7	10-02-2022	
	Meghalaya	415	09-02-2022	7.8	31-01-2022	
	Mizoram	157	16-01-2023	2.3	18-01-2023	
	Nagaland	169	27-08-2019	3.1	15-07-2022	
	Tripura	347	18-04-2023 (19:50)	6.8	22-06-2022	
*SR	Andhra Pradesh (Undivided)	13162	23-03-2014	284.8	22-03-2014	

25. System Reliability Indices Report for the month of April 2023

Percentage (%) of times ATC was violated

S.No.	Corridor	Number of Blocks Violated	Number of Hours Violated	%Violation
1	WR-NR	0	0.00	0.00
2	ER-NR	0	0.00	0.00
3	Import of NR	8	2.00	0.28
4	NEW-SR	1	0.25	0.03
5	NER Import	0	0.00	0.00

Percentage(%) of times (N-1) Criteria was violated

S.No.	Corridor	Number of Blocks Violated	Number of Hours Violated	%Violation
1	WR-NR	0	0.00	0.00
2	ER-NR	0	0.00	0.00
3	Import of NR	0	0.00	0.00
4	NEW-SR	1	0.25	0.03
4	NER Import	0	0.00	0.00

Remarks: Flows crossing Total Transfer Capability (TTC) on interregional corridors has been worked out as a proxy for (N-1) violation.



POWER SYSTEM OPERATION CORPORATION LIMITED

पावर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड

NATIONAL LOAD DESPATCH CENTRE – राष्ट्रीय भार प्रेषण केन्द्र

First floor, B-9, Qutab Institutional Area,
Katwaria Sarai, New Delhi-110016.