

कार्यालय : बी-9, प्रथम एवं द्वितीय तल, कुतुब इंस्टीट्यूशनल एरिया, कटवारिया सराय, नई दिल्ली - 110016
Office : 1st and 2nd Floor, B-9, Qutab Institutional Area, Katwaria Sarai, New Delhi -110016
CIN : U40105DL2009GOI188682, Website : www.grid-india.in, E-mail : gridindiacc@grid-india.in, Tel.: 011- 42785855

संदर्भ संख्या : - GRID-INDIA/NLDC/MR/

दिनांक : 24.01.2024

सेवा में,

वितरण सूची के अनुसार

विषय:- निष्पादन रिपोर्ट – दिसंबर 2023

महोदय,

आई०ई०जी०सी०-2010 के प्रावधान के अनुसार, दिसंबर 2023 माह की अखिल भारतीय प्रणाली की निष्पादन रिपोर्ट संलग्न है।

धन्यवाद

भवदीय



(सुरजीत बनर्जी)

मुख्य महाप्रबन्धक (प्रणाली प्रचालन)

(रा०भा०प्रे०के०)

संलग्नक : मासिक प्रणाली रिपोर्ट

वितरण सूची Distribution List

- 1 सचिव, के.वि.नि.आ. तीसरा एवं चौथा तल, चंद्रलोक भवन, 36, जनपथ, नई दिल्ली-110001
Secretary, CERC, 3rd & 4th Floor, Chanderlok Building, 36, Janpath, New Delhi-110001
- 2 मुख्य अभियंता (जी एम), के.वि.प्रा., सेवा भवन, आर. के. पुरम, नई दिल्ली-110066
Chief Engineer (GM), CEA, Sewa Bhavan, R.K.Puram, New Delhi-110066
- 3 सदस्य सचिव, उ. क्षेत्र. वि. स., 18/ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Member Secretary, NRPC, 18/A, SJSS Marg, Katwaria Sarai, New Delhi-110016
- 4 सदस्य सचिव, प. क्षेत्र. वि. स., एफ-3, एम आई डी सी क्षेत्र, अंधेरी (पूर्व), मुंबई - 400093
Member Secretary, WRPC, F-3, MIDC Area, Andheri (East), Mumbai-400093
- 5 सदस्य सचिव, द. क्षेत्र. वि. स., 29, रेस कोर्स क्रॉस रोड, बंगलूरु - 560009
Member Secretary, SRPC, 29, Race Course Cross Road, Bangalore-560009
- 6 सदस्य सचिव, पू. क्षेत्र. वि. स., 14, गोल्फ क्लब रोड, कोलकाता - 700033
Member Secretary, ERPC, 14, Golf Club Road, Kolkata-700033
- 7 सदस्य सचिव, उ. पू. क्षेत्र. वि. स., मेघालय राज्य आवासीय वित्त सहकारी समिति लिमिटेड भवन, नॉग्रिम हिल्स, शिलोंग - 793003
Member Secretary, NERPC, Meghalaya State Housing Finance Cooperative Society Ltd. Building, Nongrim Hills, Shillong -793003
- 8 मुख्य अभियंता, राष्ट्रीय विद्युत समिति, एनआरपीसी भवन, तृतीय तल, 18/ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Chief Engineer, National Power Committee, NRPC Building, 3rd floor, 18/A, SJSS Marg, Katwaria Sarai, New Delhi-110016
- 9 कार्यपालक निदेशक, पू. क्षेत्र. भा. प्रे. के., 14, गोल्फ क्लब रोड, कोलकाता - 700033
Executive Director, ERLDC, 14, Golf Club Road, Kolkata-700033
- 10 कार्यपालक निदेशक, प. क्षेत्र. भा. प्रे. के., एफ-3, एम आई डी सी क्षेत्र, अंधेरी (पूर्व), मुंबई - 400093
Executive Director, WRLDC, F-3, MIDC Area, Andheri (East), Mumbai-400093
- 11 कार्यपालक निदेशक, उ. क्षेत्र. भा. प्रे. के., 18/ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Executive Director, NRPC, 18/A, SJSS Marg, Katwaria Sarai, New Delhi-110016
- 12 कार्यपालक निदेशक, द. क्षेत्र. भा. प्रे. के., 29, रेस कोर्स क्रॉस रोड, बंगलूरु - 560009
Executive Director, SRLDC, 29, Race Course Cross Road, Bangalore-560009
- 13 मुख्य महाप्रबंधक, पू. क्षेत्र. भा. प्रे. के., डोंगतिह, लोअर नॉग्रह, लापलंग, शिलोंग- 793006
Chief General Manager, NERLDC, Dongtiah, Lower Nongrah, Laplang, Shillong-793006



ग्रिड-इंडिया
GRID-INDIA

GRID CONTROLLER OF INDIA LIMITED

Formerly Power System Operation Corporation Limited

ग्रिड कंट्रोलर ऑफ इंडिया लिमिटेड

NATIONAL LOAD DESPATCH CENTRE –राष्ट्रीय भार प्रेषण केन्द्र

मासिक ऑपरेशन रिपोर्ट

Monthly
Operation Report



दिसंबर 2023

ग्रिड कंट्रोलर ऑफ इंडिया लिमिटेड
राष्ट्रीय भार प्रेषण केंद्र, नई दिल्ली

GRID CONTROLLER OF INDIA LIMITED

Formerly Power System Operation Corporation Limited

NATIONAL LOAD DESPATCH CENTRE, NEW DELHI



ग्रिड-इंडिया
GRID-INDIA


माह दिसंबर 2023 के लिए प्रचालन निष्पादन रिपोर्ट
OPERATIONAL PERFORMANCE REPORT FOR THE
MONTH OF DECEMBER-2023

पृष्ठसूची CONTENTS


1	माह दिसंबर 2023 की सारांश रिपोर्ट Summary of report for the month of DECEMBER 2023	1-5
2	क्षेत्रवार स्थापित विद्युत क्षमता Region wise Installed Capacity	6
3	राष्ट्रीय स्तर पर सांध्यकालीन शिखर मांगपूर्ति Peak demand met at National level	7-8
4	राष्ट्रीय स्तर पर विद्युत ऊर्जा खपत Energy consumption at National level	9-10
5	फ्रिक्वेंसी रूपरेखा Frequency profile	11-12
6	राष्ट्रीय स्तर पर जल विद्युत ऊर्जा उत्पादन Hydro generation at National level	13-14
7	राष्ट्रीय स्तर पर पवन ऊर्जा उत्पादन Wind generation at National level	15
8	राष्ट्रीय स्तर पर सौर ऊर्जा उत्पादन Solar generation at National level	16
9	राष्ट्रीय स्तर पर दैनिक अधिकतम विद्युत मांग पूर्ति Daily maximum demand met at National level	17
10	29 दिसंबर के माँग एवं उत्पादन प्लॉट (अधिकतम मांग पूर्ति) व माँग का डाटा (15 मिनट अंतराल) Demand and generation plots for 29-DECEMBER (Max Demand Met) and Demand data (15-minute interval)	18-22
11	ऊर्जा आपूर्ति की वास्तविक स्थिति Actual power supply position	23
12	ऊर्जा आवश्यकता एवं आपूर्ति की पिछले वर्ष माह दिसंबर 2022 से तुलना Energy requirement and met comparison with DECEMBER 2022	24
13	शिखर मांग आवश्यकता एवं आपूर्ति की पिछले वर्ष माह दिसंबर 2022 से तुलना Peak demand requirement and met comparison with DECEMBER 2022	25

14	क्षेत्रीय स्तर पर शिड्यूल एवं ड्रावल Schedule & drawal at regional level	26
15	अंतर क्षेत्रीय विनिमय Inter-regional exchanges	27-36
16	अंतर राष्ट्रीय विद्युत विनिमय Inter-national exchanges	37-39
17	एसटीओए (द्विपक्षीय एवं सामूहिक) एवं यू आइ का ब्यौरा Bilateral and collective short-term open access & UI details	40
18	पावर मार्केट की सूचना Power market information	41-45
19	अक्षय ऊर्जा प्रमाण पत्र प्रक्रिया Renewable energy certificate mechanism	46-48
20	मुख्य घटनाएँ एवं डिस्टर्बेंस Important events/disturbances	49-53
21	नए कमीशंड पारेषण तत्व New elements commissioned	54
22	विभव रूपरेखा Voltage profile	55
23	अब तक उच्चतम (मांग व ऊर्जा) आंकड़े माह दिसंबर 2023 तक All Time Highest (Demand & Energy) figures: Till DECEMBER 2023	56
24	दिसंबर 2023 के लिए सिस्टम रिलाइबिलिटी सूचकांक System Reliability Indices for DECEMBER 2023	57


1. SUMMARY OF REPORT FOR THE MONTH OF DECEMBER-2023

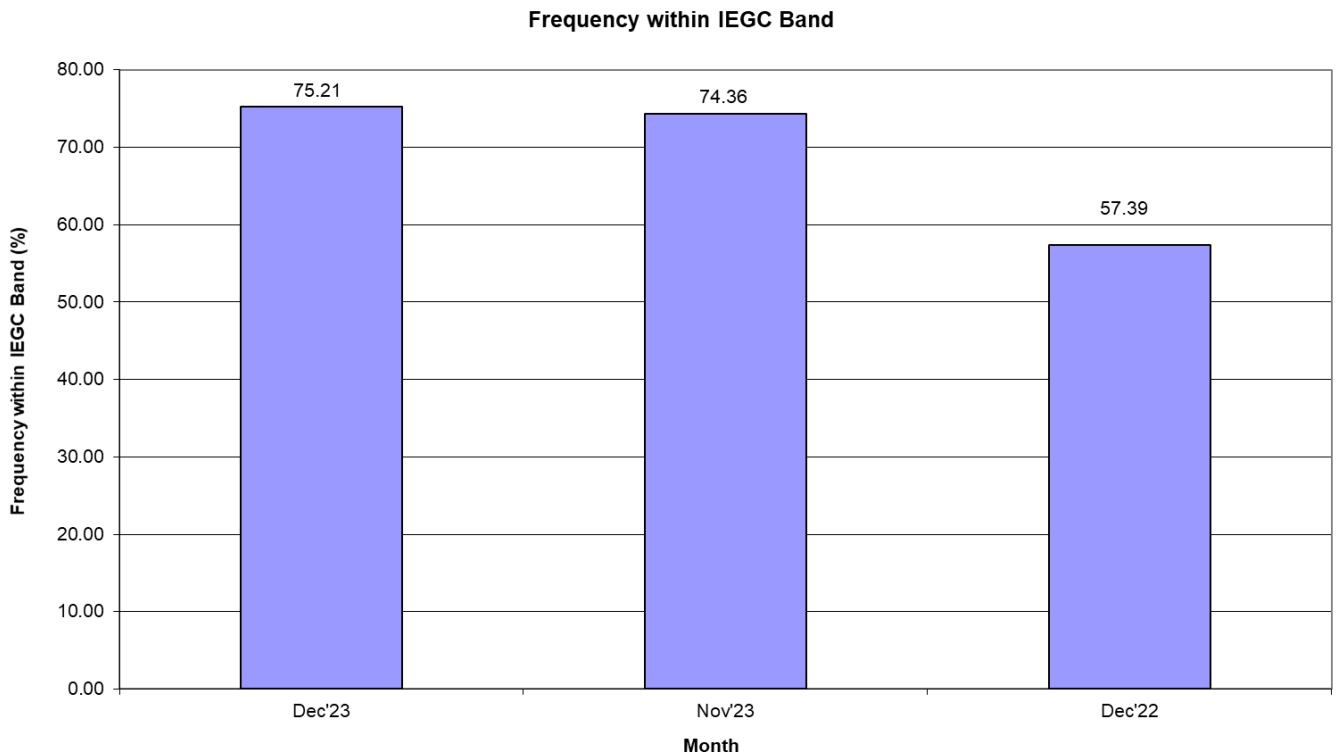


EVENING PEAK HOUR (at 1900hrs) DEMAND MET AT NATIONAL LEVEL (MW)

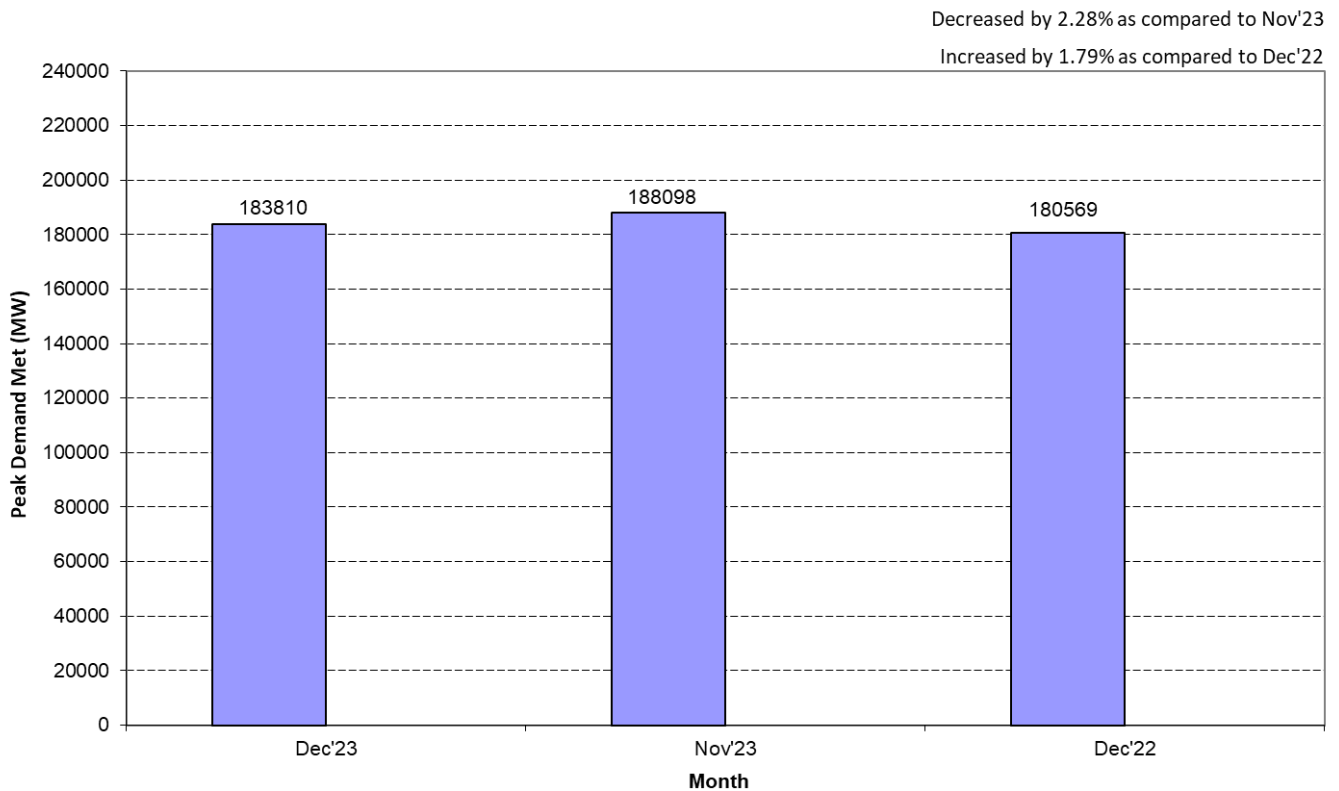


ENERGY MET AT NATIONAL LEVEL (MU)

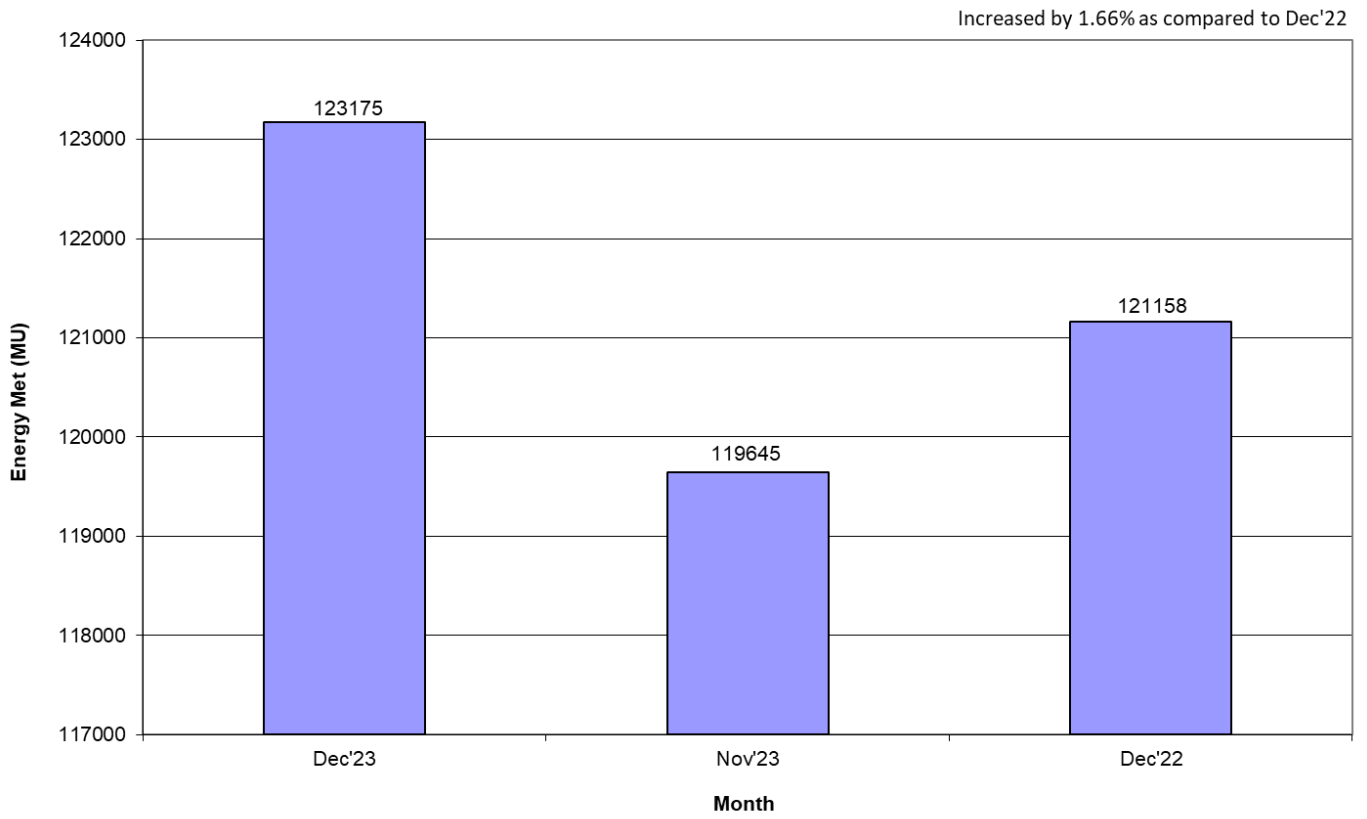


AVERAGE ENERGY MET AT NATIONAL LEVEL (MU/Day)

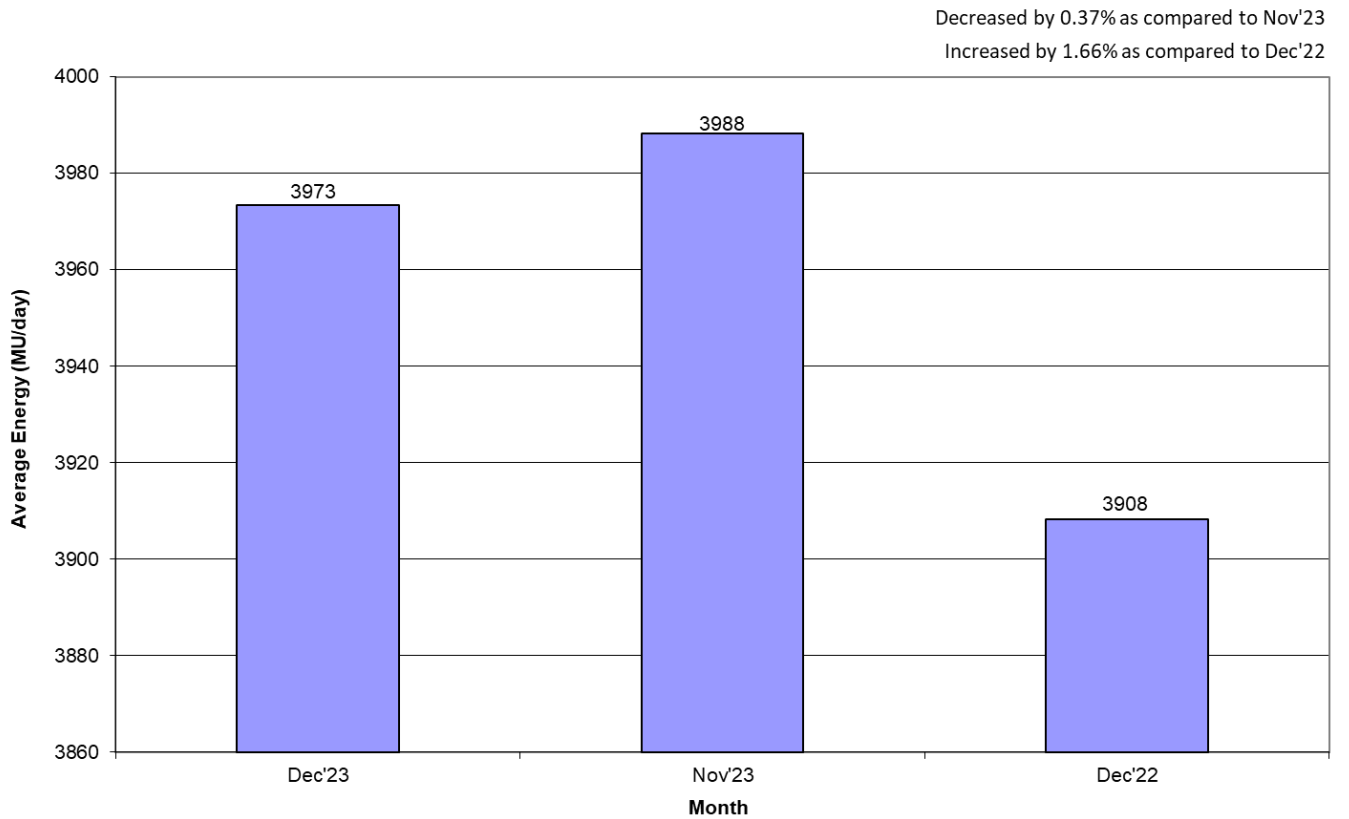


HYDRO GENERATION AT NATIONAL LEVEL (MU)

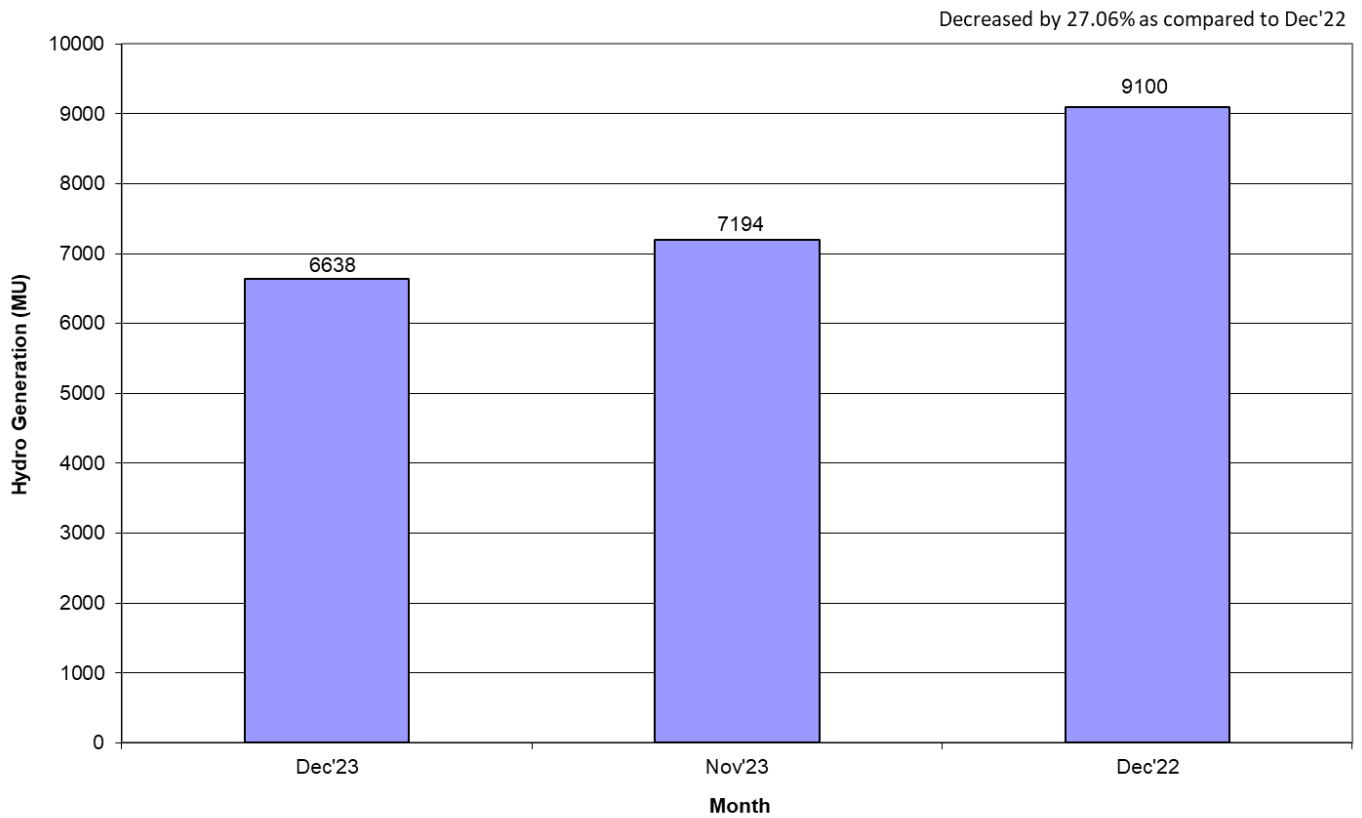


AVERAGE HYDRO GENERATION AT NATIONAL LEVEL (MU/Day)

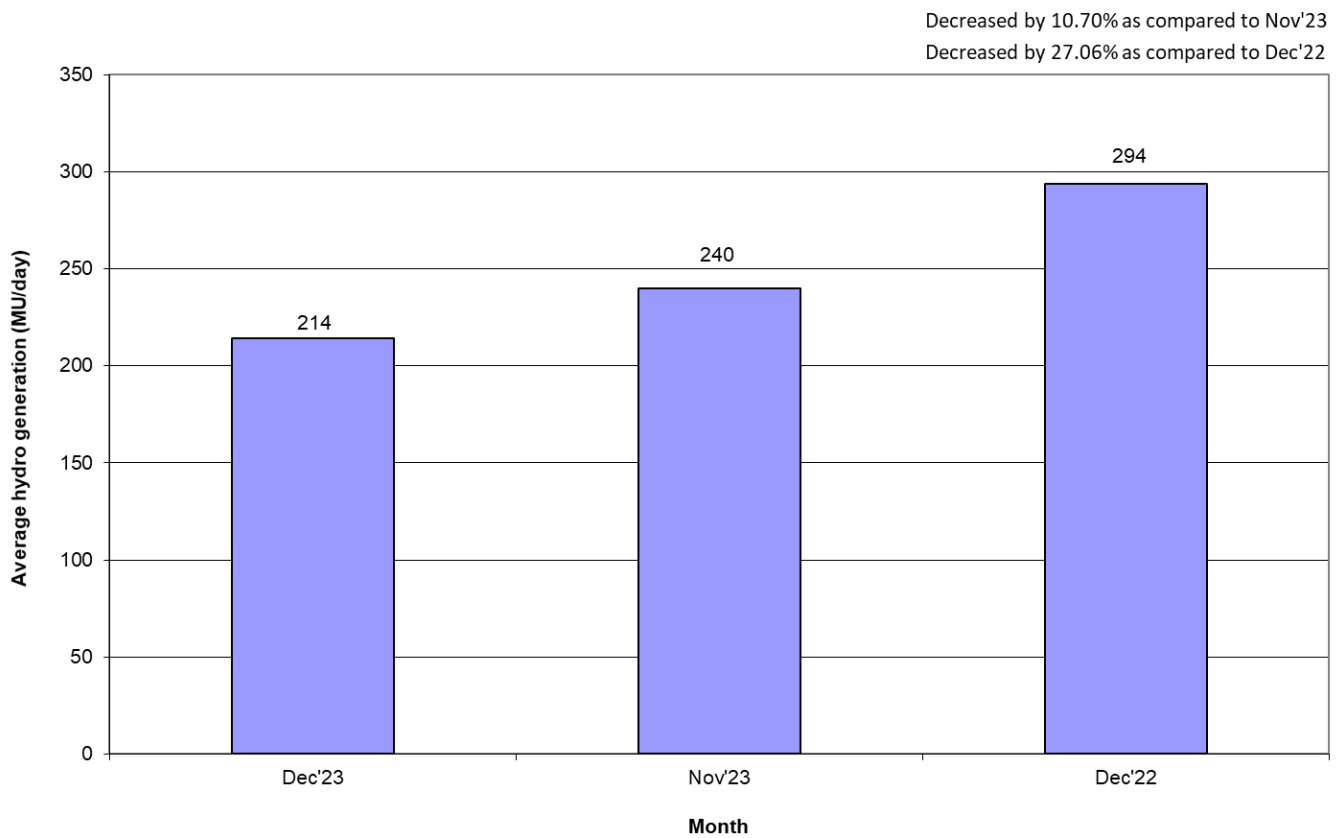


WIND GENERATION AT NATIONAL LEVEL (MU)

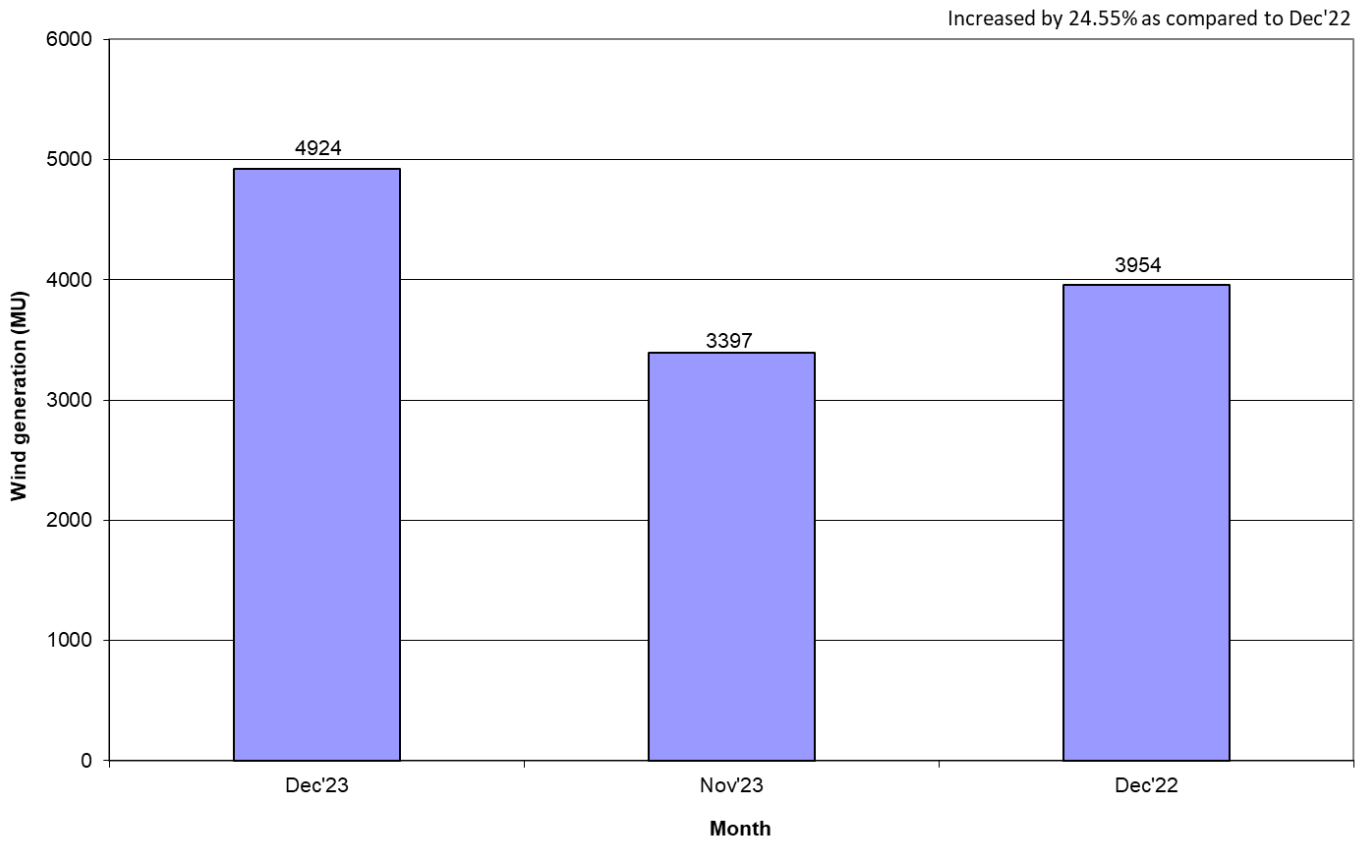


AVERAGE WIND GENERATION AT NATIONAL LEVEL (MU/Day)

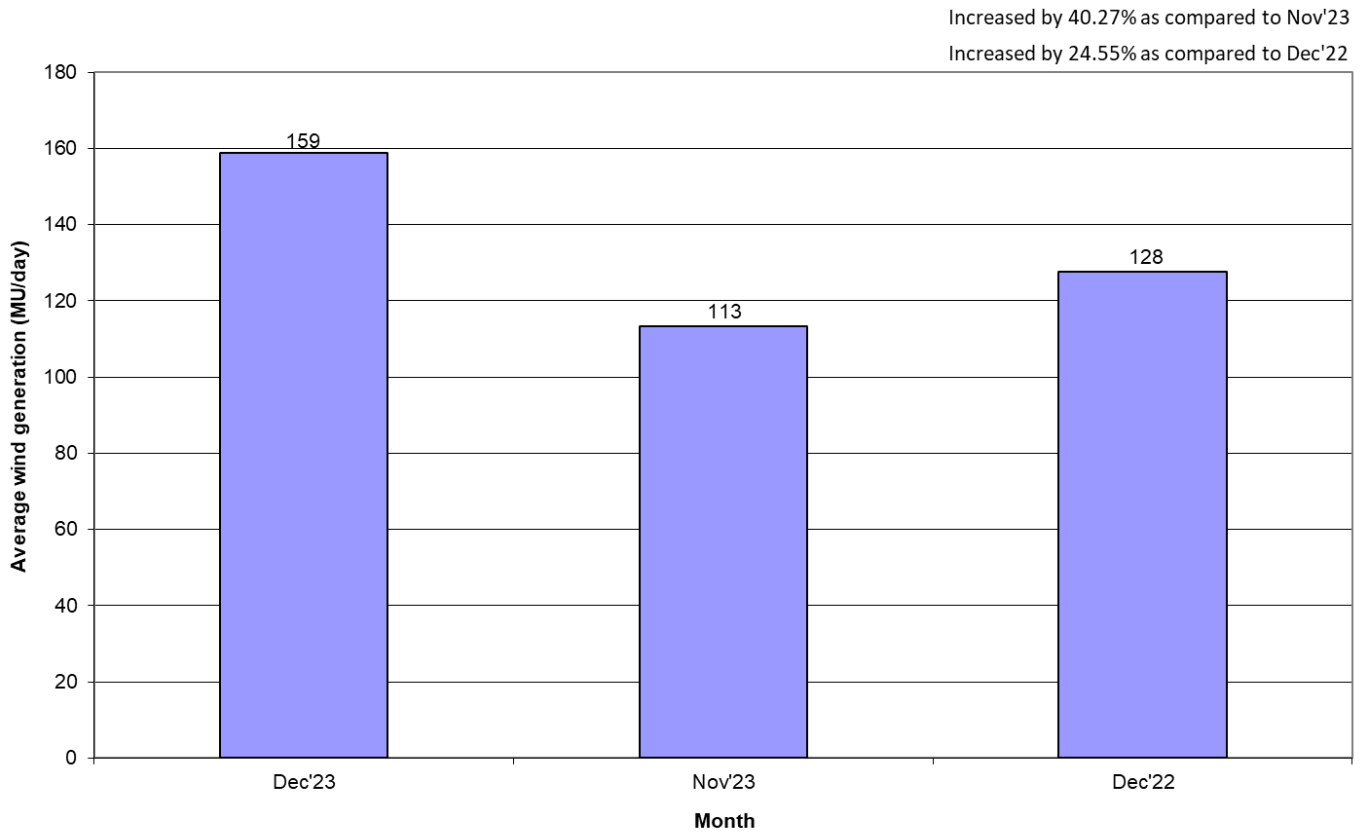

SOLAR GENERATION AT NATIONAL LEVEL (MU)

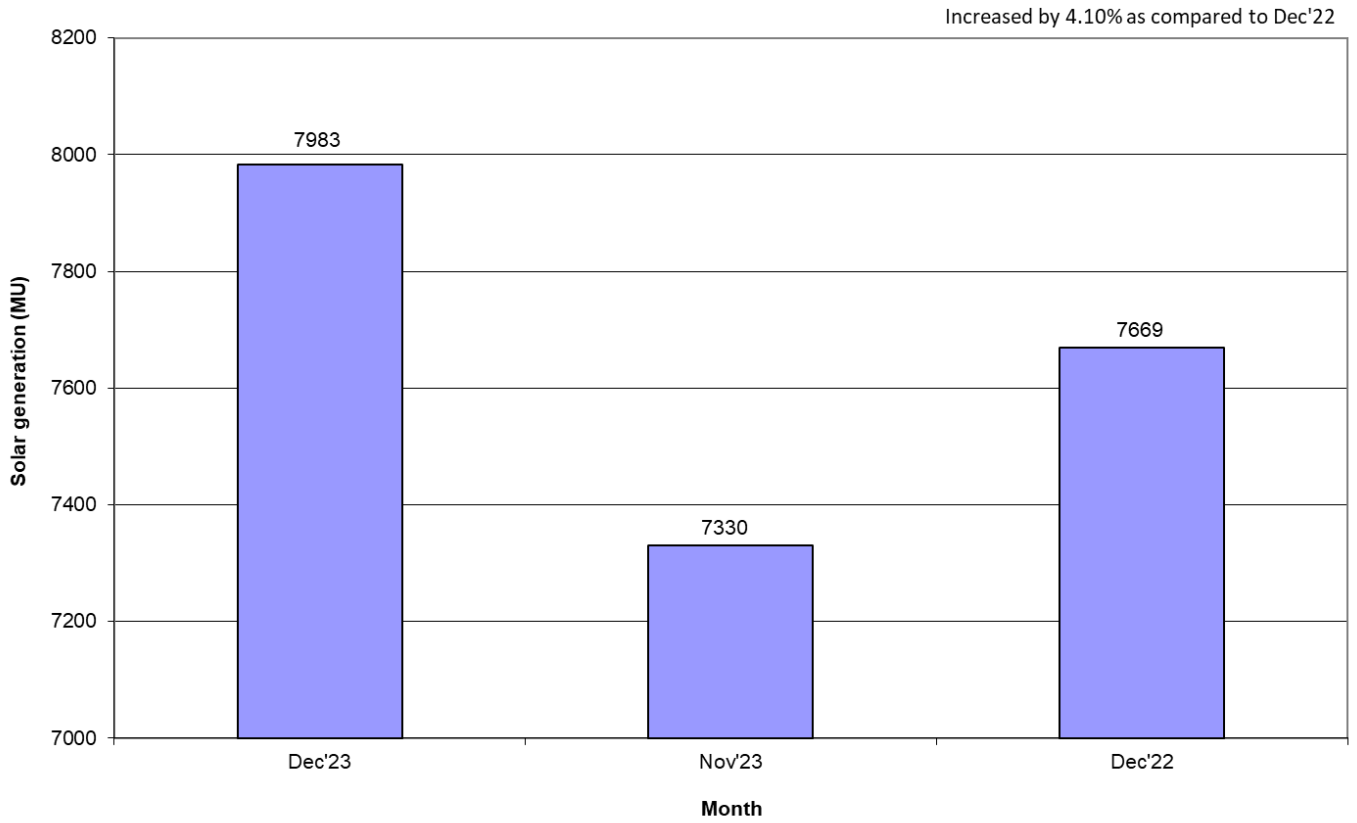

AVERAGE SOLAR GENERATION AT NATIONAL LEVEL (MU/Day)

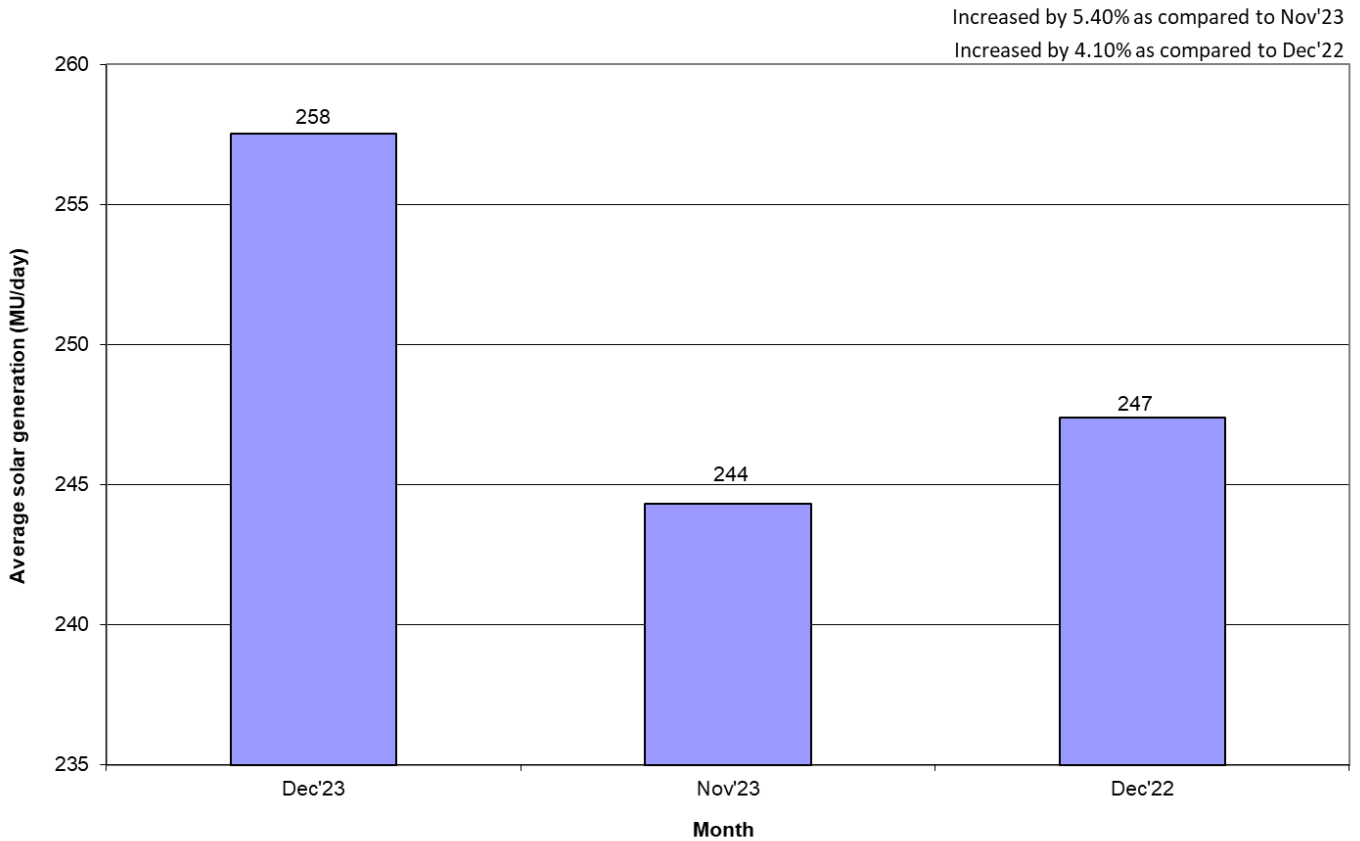

2. ALL INDIA REGIONWISE INSTALLED CAPACITY

As on 31.12.2023
(All figures are in MW)

S No	Region	THERMAL					NUCLEAR	HYDRO	RES @ MNRE	GRAND TOTAL
		COAL	LIGNITE	GAS	DIESEL	TOTAL				
1	NR	55338	1580	5995	0	62913	1620	20812	35361	120706
2	WR	74663	1400	10806	0	86869	2540	7563	43021	139993
3	SR	48680	3640	6492	434	59246	3320	11827	52985	127379
4	ER	28145	0	80	0	28225	0	4764	1904	34894
5	NER	949	0	1665	36	2650	0	1944	575	5169
6	ISLANDS	0	0	0	120	120	0	0	40	160
	ALL INDIA	207776	6620	25038	589	240023	7480	46910	133886	428299

Remarks: Data from CEA website

3. राष्ट्रीय स्तर पर संध्याकालीन शिखर विद्युत मांग पूर्ति
EVENING PEAK HOUR DEMAND MET AT NATIONAL LEVEL


माह: दिसंबर 2023 MONTH:- DEC 2023

सभी आंकड़े मेगावाट मे All figures in MW

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
1-Dec-23	48007	51667	46176	19655	2470	167975
2-Dec-23	47382	52005	45326	19766	2516	166995
3-Dec-23	43645	50891	39156	19093	2386	155171
4-Dec-23	47344	53370	39507	19333	2544	162098
5-Dec-23	48108	53116	40421	18933	2546	163124
6-Dec-23	47895	53656	43984	18799	2571	166905
7-Dec-23	48412	54239	44599	18068	2439	167757
8-Dec-23	49330	54989	44514	19344	2491	170668
9-Dec-23	48930	55439	43724	18745	2496	169334
10-Dec-23	46762	53254	39424	18454	2393	160287
11-Dec-23	50334	56805	44388	18758	2577	172862
12-Dec-23	50801	57526	44285	19535	2606	174753
13-Dec-23	50817	57694	44817	19724	2518	175570
14-Dec-23	51958	58214	44632	19877	2611	177292
15-Dec-23	51952	58196	44001	19257	2606	176012
16-Dec-23	52787	58479	43459	18780	2620	176125
17-Dec-23	50443	54587	38846	18880	2457	165213
18-Dec-23	54159	57593	42478	19479	2612	176321
19-Dec-23	54713	59225	43882	20223	2626	180669
20-Dec-23	55268	58649	44029	20337	2644	180927
21-Dec-23	55652	59813	44231	19656	2645	181997
22-Dec-23	55349	60055	44205	19224	2622	181455
23-Dec-23	54748	59494	43285	19307	2576	179410
24-Dec-23	51079	56111	39444	18751	2426	167811
25-Dec-23	53076	59433	41977	19431	2457	176374
26-Dec-23	54580	60088	44549	20053	2585	181855
27-Dec-23	56286	60003	44511	20143	2595	183538
28-Dec-23	54911	60405	45197	20320	2582	183415
29-Dec-23	55175	59827	44956	20277	2580	182815
30-Dec-23	56868	59394	44618	20347	2583	183810
31-Dec-23	54293	55425	41020	20501	2457	173696
उच्चतम MAXIMUM	56868	60405	46176	20501	2645	183810
निम्नतम MINIMUM	43645	50891	38846	18068	2386	155171
औसत AVERAGE	51647	56763	43214	19453	2543	173620
अब तक का उच्चतम All Time Max.	76274	65518	52366	28579	3510	215592
दिनांक Date	04.09.23	13.10.23	18.04.23	18.04.23	12.08.22	28.08.23

नोट : सभी आंकड़े 1900 बजे की मांगपूर्ति पर आधारित है ।
 Note: The above figures correspond to value at 1900 Hrs

EVENING PEAK HOUR DEMAND(at 1900hrs)MET DURING THE MONTH OF DECEMBER 2023

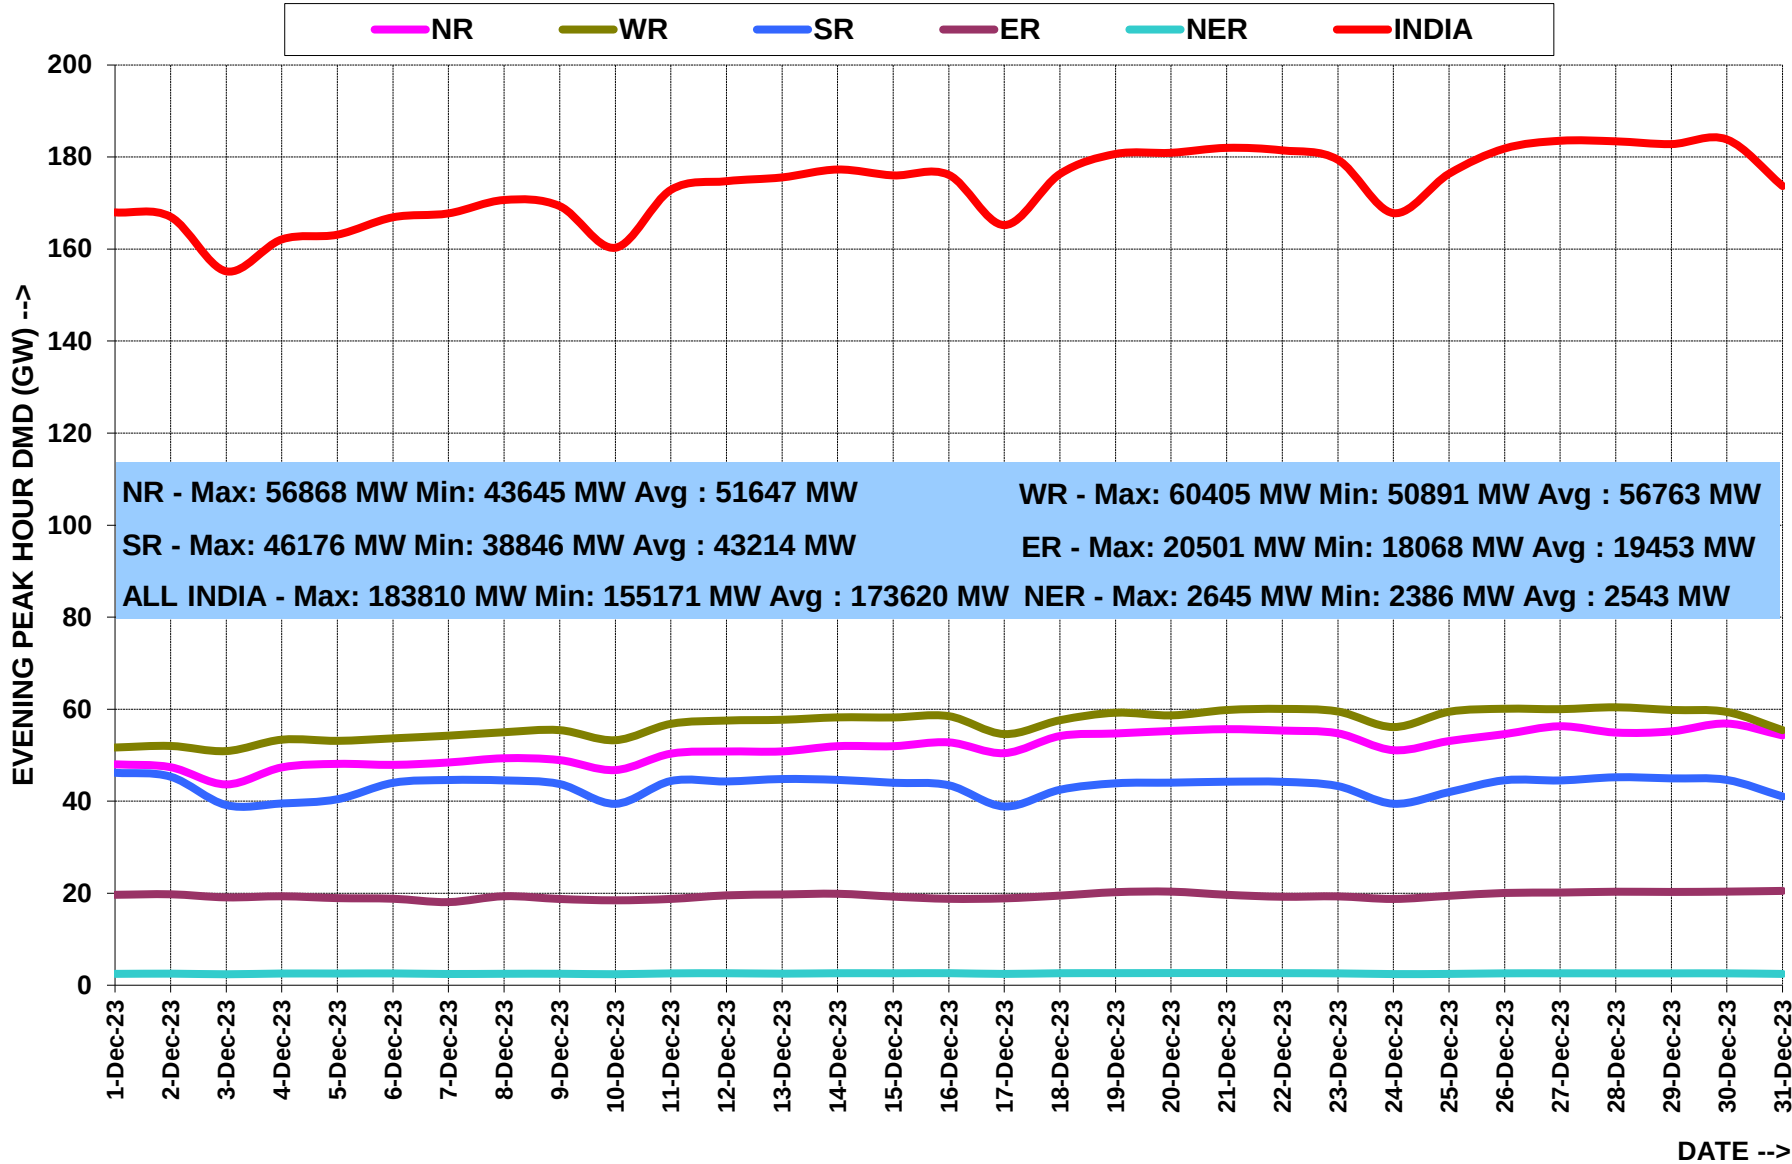


4. राष्ट्रीय स्तर पर विद्युत ऊर्जा आपूर्ति ENERGY MET AT NATIONAL LEVEL

माह: दिसंबर 2023 MONTH:- DEC 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Dec-23	1045	1198	1050	420	48	3761
02-Dec-23	1045	1204	1038	416	48	3750
03-Dec-23	1002	1207	949	403	46	3606
04-Dec-23	1014	1236	925	407	47	3630
05-Dec-23	1044	1244	903	408	48	3647
06-Dec-23	1063	1244	962	395	48	3711
07-Dec-23	1061	1247	1023	387	47	3765
08-Dec-23	1080	1265	1029	401	46	3821
09-Dec-23	1075	1283	1012	393	47	3809
10-Dec-23	1042	1276	959	383	46	3706
11-Dec-23	1084	1327	1030	395	47	3883
12-Dec-23	1096	1357	1053	414	46	3966
13-Dec-23	1117	1380	1064	413	46	4021
14-Dec-23	1129	1394	1070	414	47	4054
15-Dec-23	1151	1395	1073	406	47	4073
16-Dec-23	1144	1404	1047	402	47	4044
17-Dec-23	1124	1363	985	390	45	3908
18-Dec-23	1159	1394	1020	400	47	4020
19-Dec-23	1178	1412	1050	421	47	4108
20-Dec-23	1185	1411	1073	422	48	4139
21-Dec-23	1182	1431	1075	418	46	4151
22-Dec-23	1185	1454	1087	414	47	4187
23-Dec-23	1162	1441	1079	415	48	4145
24-Dec-23	1127	1409	1018	418	46	4017
25-Dec-23	1145	1420	1046	411	46	4068
26-Dec-23	1152	1445	1092	426	47	4161
27-Dec-23	1160	1448	1110	437	47	4203
28-Dec-23	1167	1456	1122	437	47	4230
29-Dec-23	1182	1462	1129	438	47	4258
30-Dec-23	1179	1455	1119	430	47	4231
31-Dec-23	1153	1409	1066	427	46	4102
कुल TOTAL	34633	42069	32261	12762	1451	123175
उच्चतम MAXIMUM	1185	1462	1129	438	48	4258
निम्नतम MINIMUM	1002	1198	903	383	45	3606
औसत AVERAGE	1117	1357	1041	412	47	3973
संचयी 2023-24 Cumulative 2023-24	367577	381931	309219	144884	15363	1218975
अब तक का उच्चतम All Time Max.	1796	1618	1329	639	72	5224
दिनांक Date	04.09.23	02.09.23	19.04.23	08.06.23	15.09.23	02.09.23

ENERGY MET DURING THE MONTH OF DECEMBER' 2023

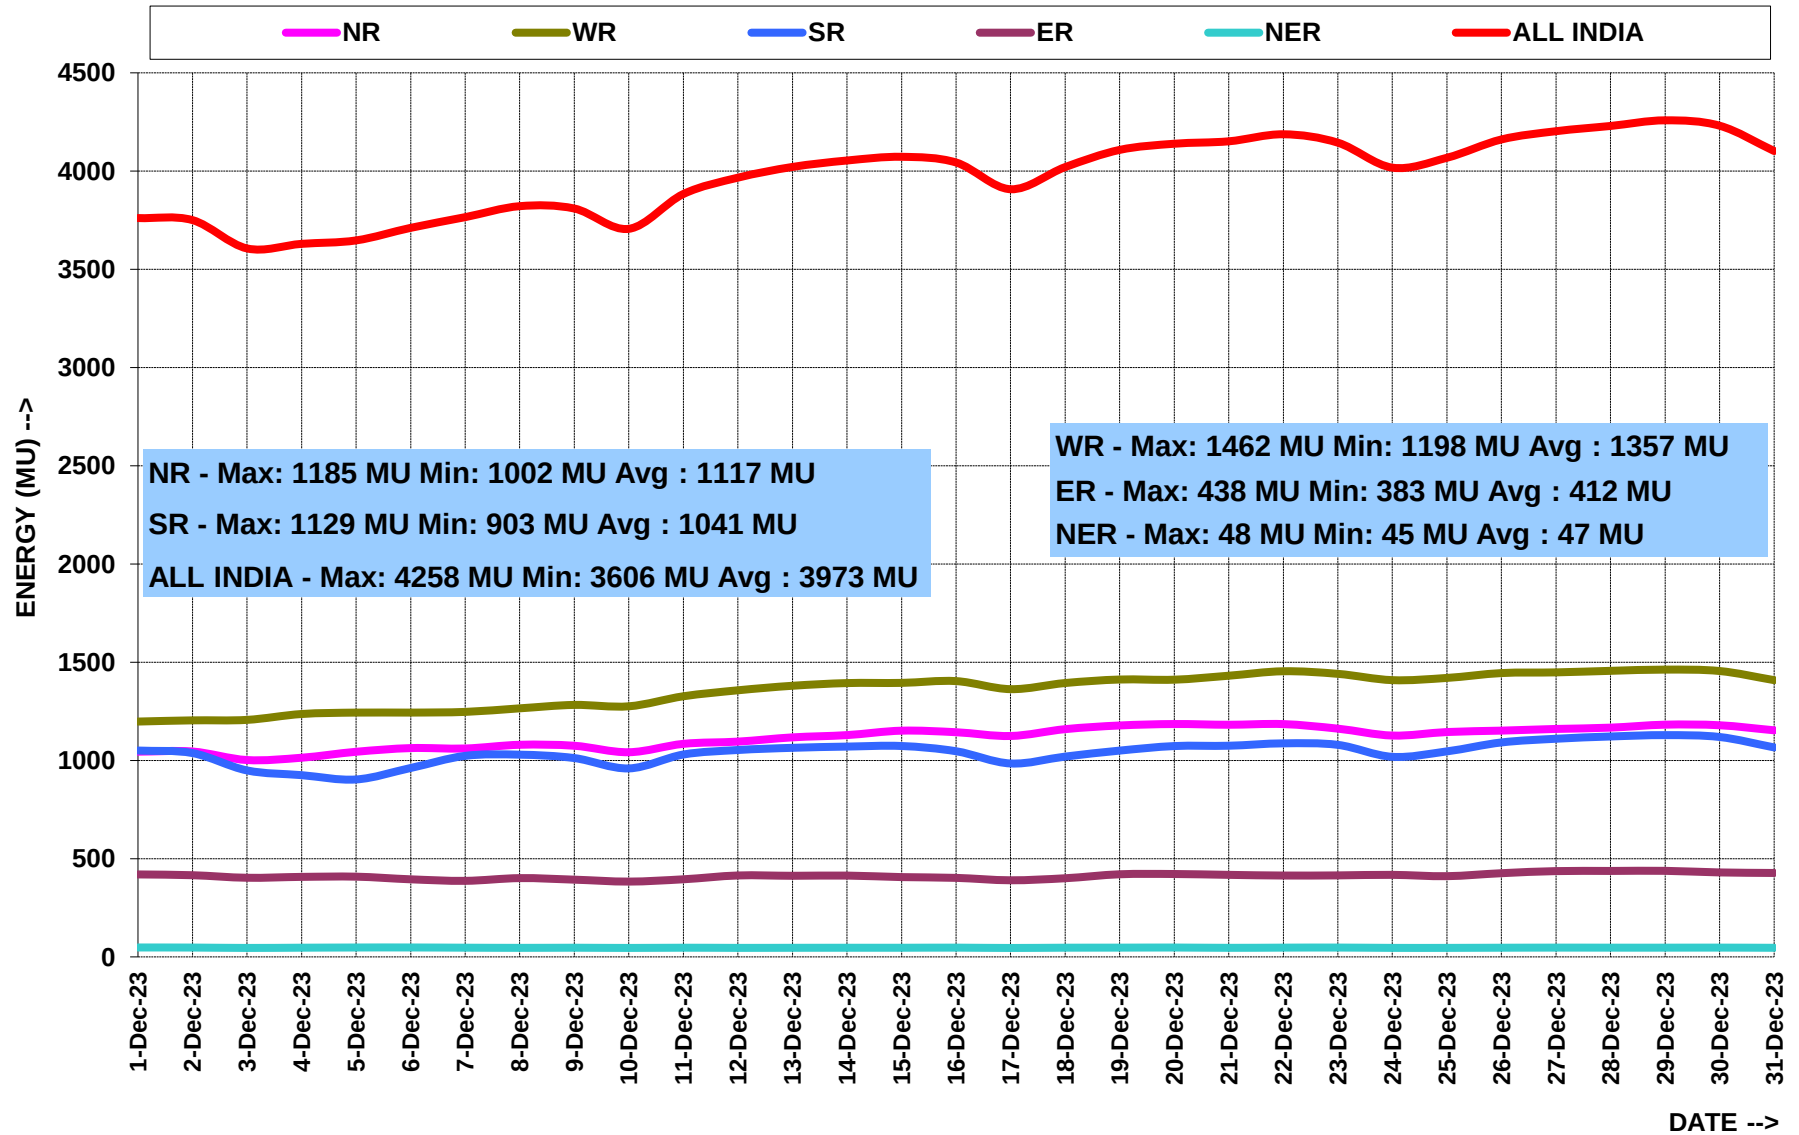

5. वर्ष 2023-24 के लिए आवृत्ति रूपरेखा FREQUENCY PROFILE FOR YEAR 2023-24

राष्ट्रीय ग्रीड NATIONAL GRID								
फ्रिक्वेंसी रूपरेखा (Hz)			<49.9	49.9-50.05	>50.05	उच्चतम फ्रिक्वेंसी	निम्नतम फ्रिक्वेंसी	औसत फ्रिक्वेंसी
% समय	Apr-23	All India Grid	10.54	67.90	21.56	50.33	49.49	49.99
	May-23	All India Grid	9.83	68.48	21.69	50.43	49.48	49.99
	Jun-23	All India Grid	6.47	67.82	25.71	50.41	49.51	50.01
	Jul-23	All India Grid	4.60	74.96	20.44	50.23	49.76	50.01
	Aug-23	All India Grid	7.08	77.28	15.63	50.20	49.74	50.00
	Sep-23	All India Grid	5.26	77.90	16.84	50.21	49.77	50.00
	Oct-23	All India Grid	8.87	74.42	16.71	50.21	49.71	49.99
	Nov-23	All India Grid	6.83	74.36	18.81	50.26	49.73	50.00
	Dec-23	All India Grid	7.83	75.21	16.96	50.26	49.71	49.99
	2023-24 (upto Dec)	All India Grid	7.48	73.17	19.35	50.43	49.48	50.00

5.1 दिसंबर 2023 के लिए आवृत्ति रूपरेखा FREQUENCY PROFILE FOR DECEMBER 2023

फ्रिक्वेंसी रूपरेखा (Hz)		<49.9	49.9-50.05	>50.05	उच्चतम फ्रिक्वेंसी	निम्नतम फ्रिक्वेंसी	औसत फ्रिक्वेंसी	एफ़.वी.आई.
% समय	01-Dec-23	10.45	73.60	15.95	50.31	49.75	49.99	0.06
	02-Dec-23	5.35	74.31	20.35	50.30	49.74	50.00	0.04
	03-Dec-23	5.38	77.01	17.60	50.26	49.76	50.00	0.04
	04-Dec-23	4.12	71.35	24.53	50.28	49.74	50.01	0.05
	05-Dec-23	9.26	72.41	18.33	50.24	49.71	49.99	0.05
	06-Dec-23	9.39	80.07	10.54	50.27	49.65	49.98	0.04
	07-Dec-23	13.14	68.90	17.96	50.33	49.53	49.99	0.09
	08-Dec-23	8.66	79.93	11.41	50.23	49.71	49.99	0.04
	09-Dec-23	5.17	82.48	12.35	50.29	49.74	50.00	0.03
	10-Dec-23	5.16	82.72	12.12	50.17	49.76	49.99	0.03
	11-Dec-23	3.59	76.82	19.59	50.19	49.77	50.00	0.03
	12-Dec-23	6.78	76.77	16.45	50.22	49.76	49.99	0.04
	13-Dec-23	6.27	76.99	16.74	50.24	49.61	50.00	0.04
	14-Dec-23	8.22	76.92	14.86	50.24	49.73	49.99	0.04
	15-Dec-23	14.11	66.89	19.00	50.23	49.66	49.98	0.08
	16-Dec-23	5.20	72.62	22.19	50.30	49.79	50.01	0.04
	17-Dec-23	2.60	66.70	30.69	50.41	49.82	50.03	0.05
	18-Dec-23	10.39	69.25	20.36	50.25	49.72	49.99	0.06
	19-Dec-23	7.74	68.69	23.56	50.27	49.74	50.00	0.05
	20-Dec-23	8.04	73.29	18.67	50.30	49.67	50.00	0.05
	21-Dec-23	12.80	75.07	12.13	50.24	49.62	49.98	0.07
	22-Dec-23	15.51	74.73	9.76	50.24	49.67	49.97	0.06
	23-Dec-23	5.34	80.41	14.26	50.28	49.78	50.00	0.04
	24-Dec-23	8.26	74.62	17.12	50.29	49.62	49.99	0.06
	25-Dec-23	15.87	72.33	11.81	50.22	49.71	49.97	0.07
	26-Dec-23	2.55	83.31	14.14	50.19	49.82	50.00	0.03
	27-Dec-23	3.62	78.50	17.88	50.27	49.82	50.01	0.03
	28-Dec-23	9.76	76.39	13.85	50.26	49.66	49.99	0.05
	29-Dec-23	3.83	81.53	14.64	50.21	49.82	50.00	0.03
	30-Dec-23	13.28	72.16	14.56	50.22	49.56	49.98	0.07
	31-Dec-23	2.89	74.62	22.49	50.26	49.73	50.01	0.04


6.राष्ट्रीय स्तर पर जल विद्युत उत्पादन
HYDRO GENERATION AT NATIONAL LEVEL

माह: दिसंबर 2023 MONTH:- DEC 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	ऊत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Dec-23	106	23	40	15	12	197
02-Dec-23	105	20	34	16	12	188
03-Dec-23	108	20	33	19	11	190
04-Dec-23	107	21	36	16	12	192
05-Dec-23	110	20	47	13	11	201
06-Dec-23	114	25	52	16	11	218
07-Dec-23	109	23	51	17	11	212
08-Dec-23	112	24	49	18	13	215
09-Dec-23	111	23	44	19	13	211
10-Dec-23	107	19	30	20	12	188
11-Dec-23	109	25	44	21	12	212
12-Dec-23	106	30	45	21	12	214
13-Dec-23	106	28	48	20	12	214
14-Dec-23	105	26	48	19	12	210
15-Dec-23	110	30	50	17	12	220
16-Dec-23	112	32	49	19	12	224
17-Dec-23	113	27	32	12	11	194
18-Dec-23	116	31	42	15	11	215
19-Dec-23	116	27	41	17	11	212
20-Dec-23	115	29	52	17	11	224
21-Dec-23	114	39	59	21	11	243
22-Dec-23	113	45	62	19	11	250
23-Dec-23	111	39	50	20	11	231
24-Dec-23	110	31	40	17	10	209
25-Dec-23	112	37	47	18	10	224
26-Dec-23	110	39	54	16	11	231
27-Dec-23	110	44	48	15	11	227
28-Dec-23	107	42	55	15	11	229
29-Dec-23	101	43	60	16	10	231
30-Dec-23	101	37	58	16	10	222
31-Dec-23	100	35	35	13	10	192
कुल TOTAL	3385	934	1435	534	350	6638
उच्चतम MAXIMUM	116	45	62	21	13	250
निम्नतम MINIMUM	100	19	30	12	10	188
औसत AVERAGE	109	30	46	17	11	214
संचयी 2023-24 Cumulative 2023-24	66529	13613	17158	20811	5846	123957
अब तक का उच्चतम All Time Max.	443	167	208	157	41	877
दिनांक Date	01.08.23	18.12.14	31.08.18	14.09.22	29.08.23	30.08.22

HYDRO ENERGY DURING THE MONTH OF DECEMBER' 2023

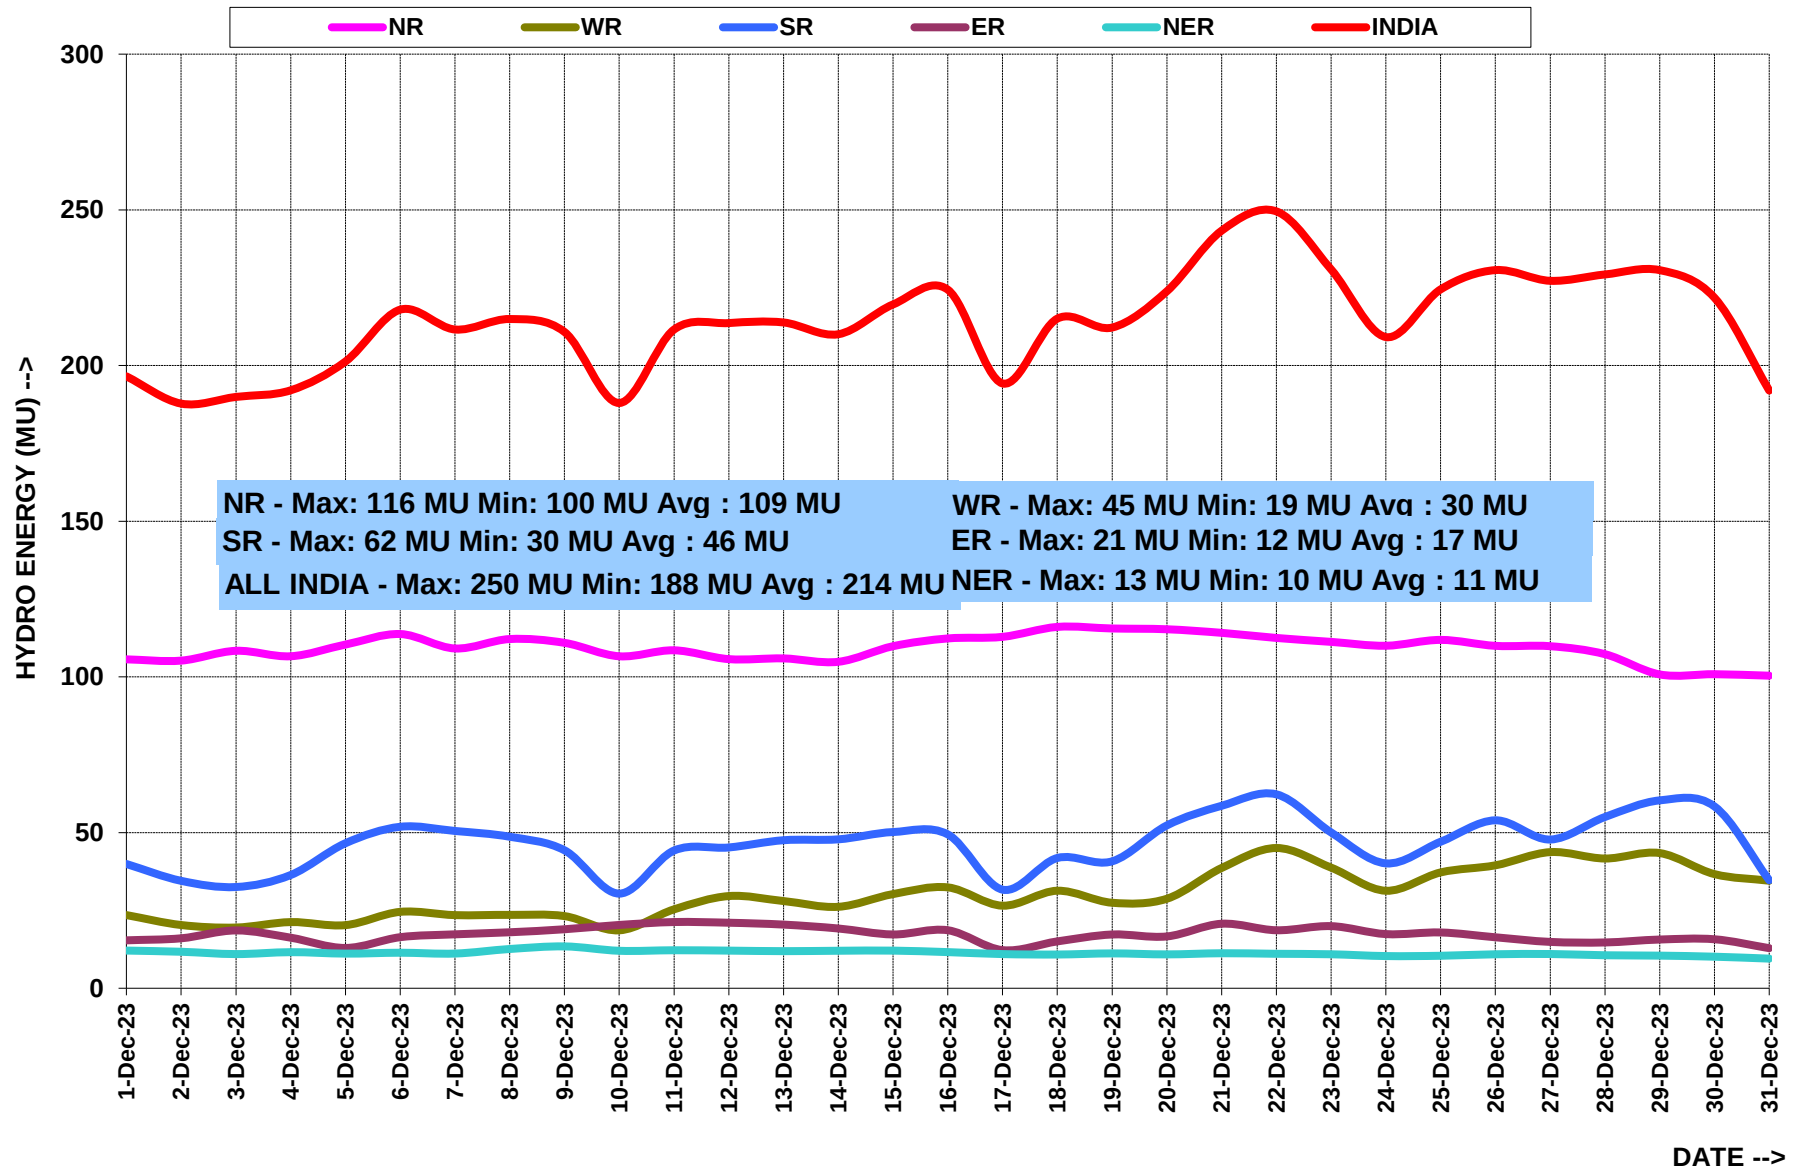

7. राष्ट्रीय स्तर पर पवन ऊर्जा उत्पादन
WIND GENERATION AT NATIONAL LEVEL

माह: दिसंबर 2023 MONTH:- DEC 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	उत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Dec-23	31	123	29	-----	-----	184
02-Dec-23	36	151	40	-----	-----	227
03-Dec-23	27	140	48	-----	-----	215
04-Dec-23	11	153	61	-----	-----	225
05-Dec-23	19	150	55	-----	-----	224
06-Dec-23	29	123	21	-----	-----	174
07-Dec-23	21	92	19	-----	-----	132
08-Dec-23	4	55	22	-----	-----	81
09-Dec-23	5	48	34	-----	-----	87
10-Dec-23	4	52	50	-----	-----	105
11-Dec-23	4	35	47	-----	-----	86
12-Dec-23	8	25	53	-----	-----	86
13-Dec-23	10	52	59	-----	-----	121
14-Dec-23	7	69	69	-----	-----	145
15-Dec-23	6	51	55	-----	-----	112
16-Dec-23	5	58	46	-----	-----	109
17-Dec-23	10	92	94	-----	-----	196
18-Dec-23	25	173	85	-----	-----	283
19-Dec-23	17	155	71	-----	-----	242
20-Dec-23	9	120	70	-----	-----	199
21-Dec-23	8	84	51	-----	-----	143
22-Dec-23	11	36	36	-----	-----	83
23-Dec-23	25	50	52	-----	-----	127
24-Dec-23	33	96	69	-----	-----	198
25-Dec-23	13	78	76	-----	-----	166
26-Dec-23	8	39	76	-----	-----	123
27-Dec-23	17	69	95	-----	-----	181
28-Dec-23	19	75	98	-----	-----	192
29-Dec-23	20	50	87	-----	-----	157
30-Dec-23	20	50	73	-----	-----	143
31-Dec-23	22	83	75	-----	-----	180
कुल TOTAL	484	2623	1816	-----	-----	4924
उच्चतम MAXIMUM	36	173	98	-----	-----	283
निम्नतम MINIMUM	4	25	19	-----	-----	81
औसत AVERAGE	16	85	59	-----	-----	159
संचयी 2023-24 Cumulative 2023-24	6844	30088	30114	-----	-----	67047
अब तक का उच्चतम All Time Max.	86	273	298	-----	-----	611
दिनांक Date	07.08.23	07.08.23	21.07.23	-----	-----	02.08.23

*Source: As reported by SLDCs. Limited visibility of embedded wind generator data.

8. राष्ट्रीय स्तर पर सौर ऊर्जा उत्पादन
SOLAR GENERATION AT NATIONAL LEVEL

माह: दिसंबर 2023 MONTH:- DEC 2023

सभी आंकड़े मिलियन यूनिट में All figures in MU

दिनांक Date	ऊत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL
01-Dec-23	86	41	94	2.0	1.2	225
02-Dec-23	102	45	99	2.2	1.0	250
03-Dec-23	109	47	80	4.6	1.0	242
04-Dec-23	109	47	60	4.5	1.1	222
05-Dec-23	111	44	67	3.4	0.6	227
06-Dec-23	108	46	77	0.6	0.9	232
07-Dec-23	109	44	86	1.0	0.3	241
08-Dec-23	112	55	82	1.7	0.4	251
09-Dec-23	113	60	83	2.1	0.7	260
10-Dec-23	112	63	98	2.2	0.8	276
11-Dec-23	116	62	99	5.6	1.0	284
12-Dec-23	107	60	109	5.5	0.2	282
13-Dec-23	110	61	108	2.8	0.9	283
14-Dec-23	112	62	111	3.0	0.8	289
15-Dec-23	109	56	82	2.7	0.9	250
16-Dec-23	108	53	56	2.6	1.0	221
17-Dec-23	110	57	58	2.6	1.2	229
18-Dec-23	110	57	67	2.7	1.2	238
19-Dec-23	105	59	87	5.6	1.2	258
20-Dec-23	105	57	89	5.5	1.2	258
21-Dec-23	114	53	88	2.9	1.2	259
22-Dec-23	99	48	102	3.1	1.2	253
23-Dec-23	109	60	113	1.8	0.7	285
24-Dec-23	93	60	107	2.3	0.9	264
25-Dec-23	98	57	112	2.3	1.1	271
26-Dec-23	98	60	117	2.3	1.1	279
27-Dec-23	99	58	120	5.2	1.1	284
28-Dec-23	109	55	108	5.4	1.1	278
29-Dec-23	104	54	105	3.3	1.2	267
30-Dec-23	89	53	109	3.1	1.2	255
31-Dec-23	96	55	118	2.3	1.2	273
कुल TOTAL	3273	1689	2895	97	29	7983
उच्चतम MAXIMUM	116	63	120	6	1.2	289
निम्नतम MINIMUM	86	41	56	1	0.2	221
औसत AVERAGE	106	54	93	3	0.9	258
संचयी 2023-24 Cumulative 2023-24	33187	14805	30109	879	265.5	79142
अब तक का उच्चतम All Time Max.	147	71	143	6.7	2.4	351
दिनांक Date	10.05.23	12.05.23	21.03.23	23.03.23	22.06.22	10.05.23

*Source: RLDCs for solar connected to ISTS; SLDCs for embedded solar. Limited visibility of embedded solar data.

9. राष्ट्रीय स्तर पर दैनिक अधिकतम विद्युत मांग पूर्ति
DAILY MAXIMUM DEMAND MET AT NATIONAL LEVEL

माह: दिसंबर 2023 MONTH:- DEC 2023

सभी आंकड़े मेगावाट में All figures in MW


दिनांक Date	ऊत्तरी क्षे. NR	पश्चिमी क्षे. WR	दक्षिणी क्षे. SR	पूर्वी क्षे. ER	पूर्वोत्तर क्षे. NER	कुल TOTAL	विभिन्नता फ़ैक्टर Diversity Factor*
01-Dec-23	54327	56715	50450	20966	2778	181216	1.022
02-Dec-23	53511	57942	48917	21330	2730	180646	1.021
03-Dec-23	52410	56413	46014	20413	2620	174165	1.021
04-Dec-23	51885	58964	44938	20964	2745	175512	1.023
05-Dec-23	53064	59915	43051	20771	2727	176479	1.017
06-Dec-23	55036	61054	45987	19301	2781	182116	1.011
07-Dec-23	53465	61008	48604	19482	2628	181948	1.018
08-Dec-23	56079	61746	49250	19941	2652	187684	1.011
09-Dec-23	55840	62626	47776	19887	2677	185527	1.018
10-Dec-23	55244	62373	45841	18936	2523	181865	1.017
11-Dec-23	56996	65973	50173	19869	2641	192307	1.017
12-Dec-23	57130	68021	50946	20413	2582	195651	1.018
13-Dec-23	58572	68205	51873	20560	2613	198520	1.017
14-Dec-23	58614	69471	52549	20655	2663	200564	1.017
15-Dec-23	60134	69174	53336	20682	2639	202697	1.016
16-Dec-23	58653	70532	52064	20185	2792	199275	1.025
17-Dec-23	58327	68116	50118	20078	2409	194911	1.021
18-Dec-23	60857	70819	51397	20575	2739	203058	1.016
19-Dec-23	61594	70457	52202	21636	2736	204239	1.021
20-Dec-23	61967	71051	53458	21312	2787	207427	1.015
21-Dec-23	59977	72174	53505	20359	2746	206140	1.013
22-Dec-23	60651	74125	55064	20211	2722	209760	1.014
23-Dec-23	59810	72274	54820	20497	2678	206815	1.016
24-Dec-23	58938	71268	51760	19225	2459	201253	1.012
25-Dec-23	59244	73231	53949	20636	2507	206421	1.015
26-Dec-23	59795	73947	55315	21156	2664	210024	1.014
27-Dec-23	59622	74085	56097	21629	2740	212097	1.010
28-Dec-23	59732	73989	56084	21292	2696	211417	1.011
29-Dec-23	60881	74115	57244	20997	2661	213620	1.011
30-Dec-23	60044	72764	56571	21433	2629	209381	1.019
31-Dec-23	60327	70759	53833	21730	2560	205249	1.019
उच्चतम MAXIMUM	61967	74125	57244	21730	2792	213620	1.025
निम्नतम MINIMUM	51885	56413	43051	18936	2409	174165	1.010
औसत AVERAGE	57830	67526	51393	20552	2662	196709	1.017
अब तक का उच्चतम All Time Max.	81220	74125	64314	29641	3712	239978	
दिनांक Date	04.09.23	22.12.23	15.03.23	28.07.23	04.09.23	01.09.23	

* Diversity factor = (Sum of regional max demands) / All India max demand


नोट : यह आंकड़े एनएलडीसी स्काडा प्रणाली में दर्ज दैनिक अधिकतम मांगपूर्ति दर्शाते हैं ।

Note: The above figures denote daily maximum demand met recorded in NLDC SCADA.


10. DEMAND AND GENERATION PLOTS FOR 29 DECEMBER (MAXIMUM DEMAND MET)

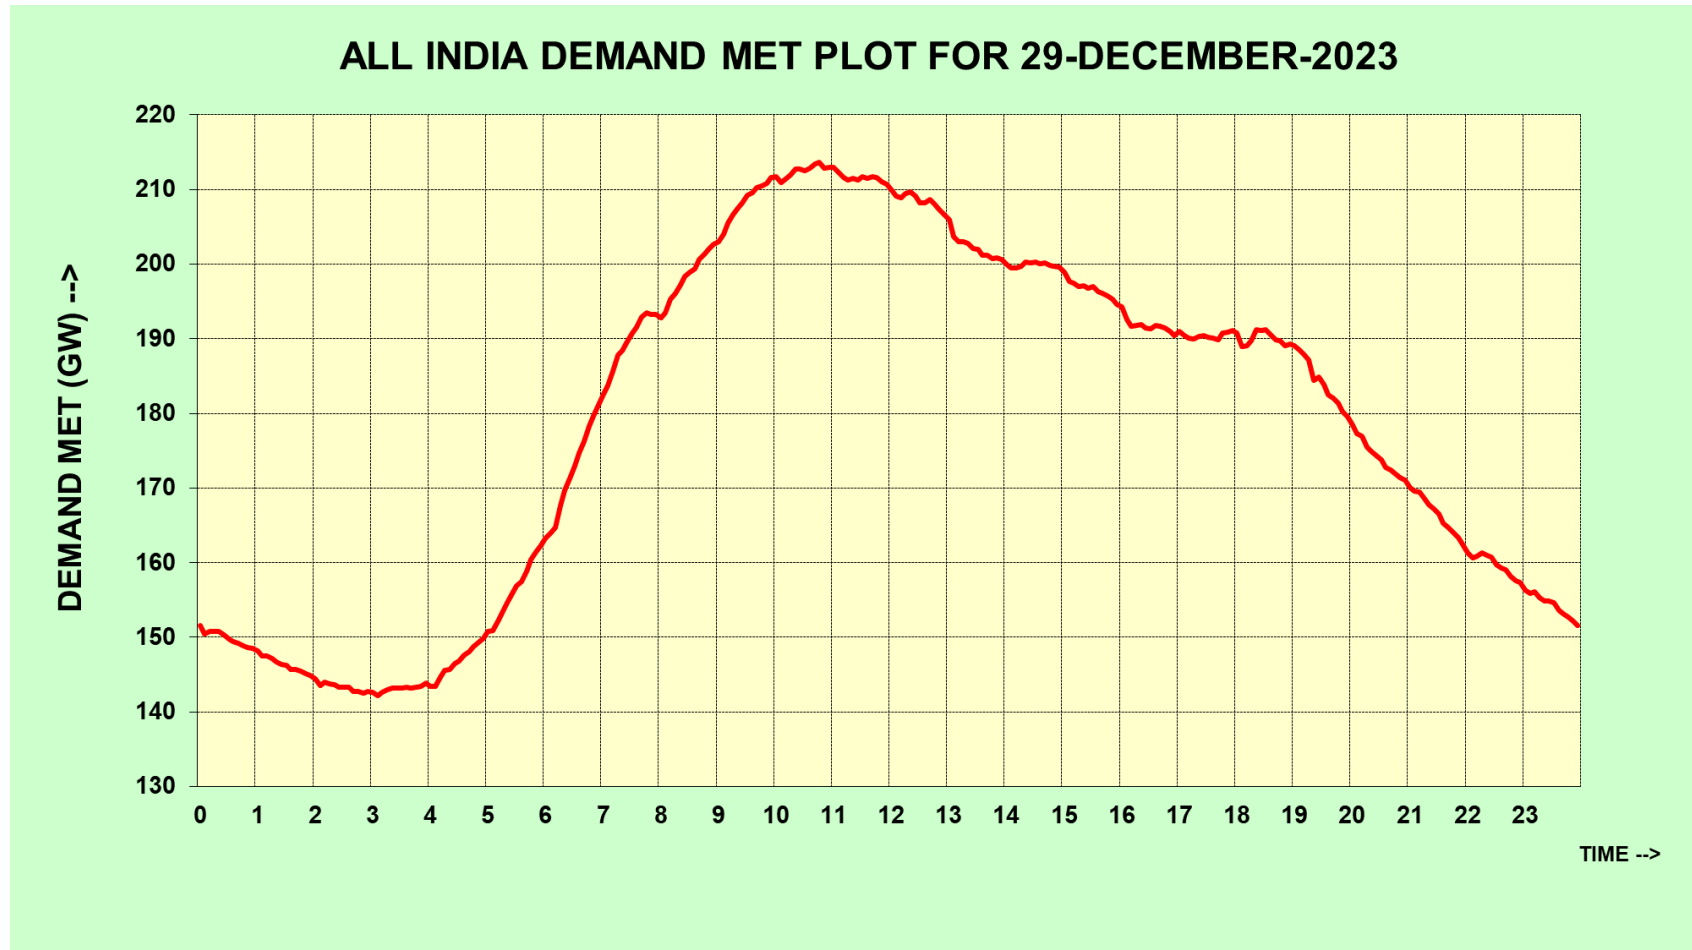


REGIONAL DEMAND MET PLOT FOR 29-DECEMBER-2023

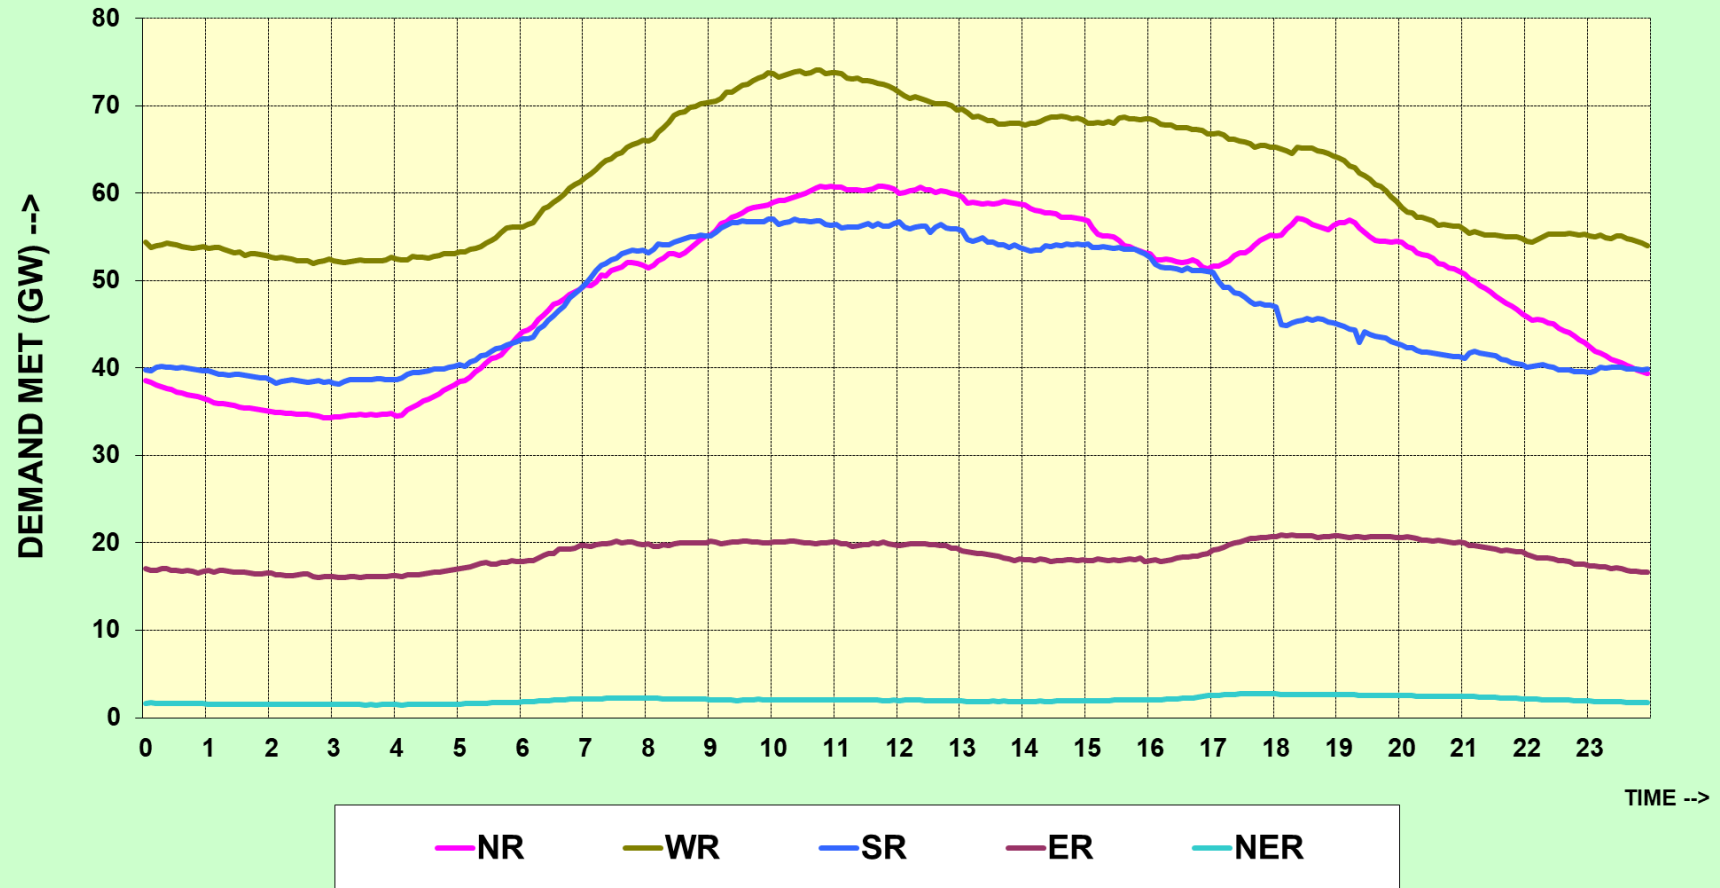

ALL INDIA GENERATION PLOT FOR 29-DECEMBER-2023

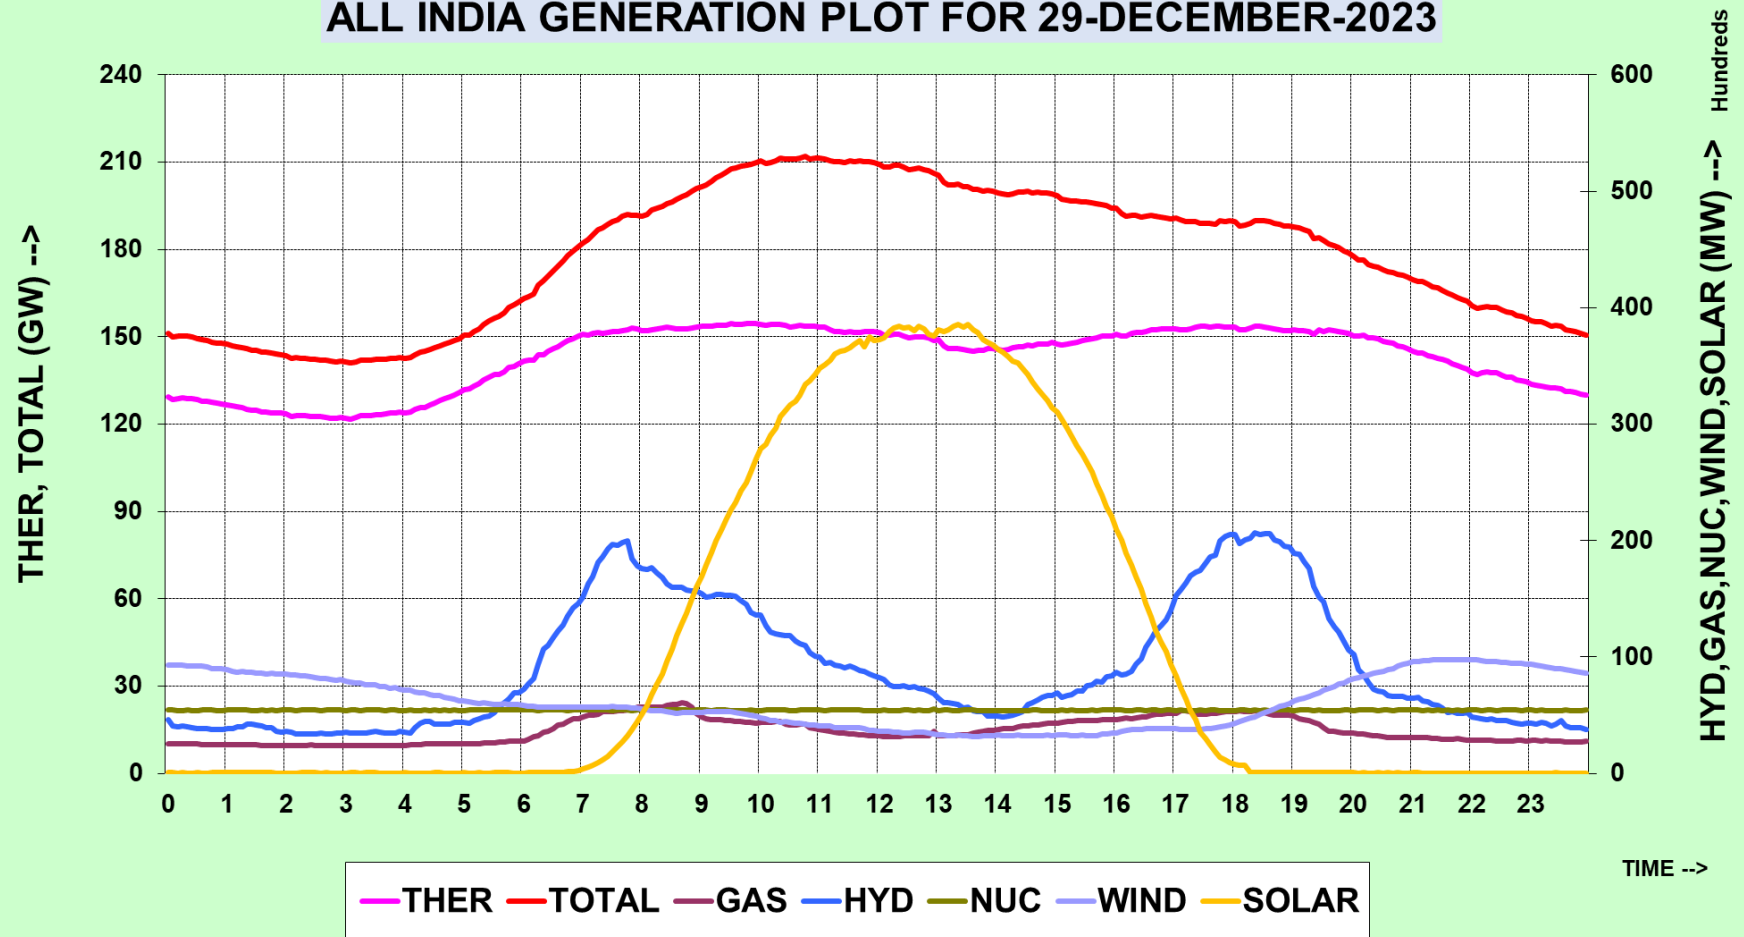

All India Fuel-wise Generation Patterns for 29-DECEMBER-2023

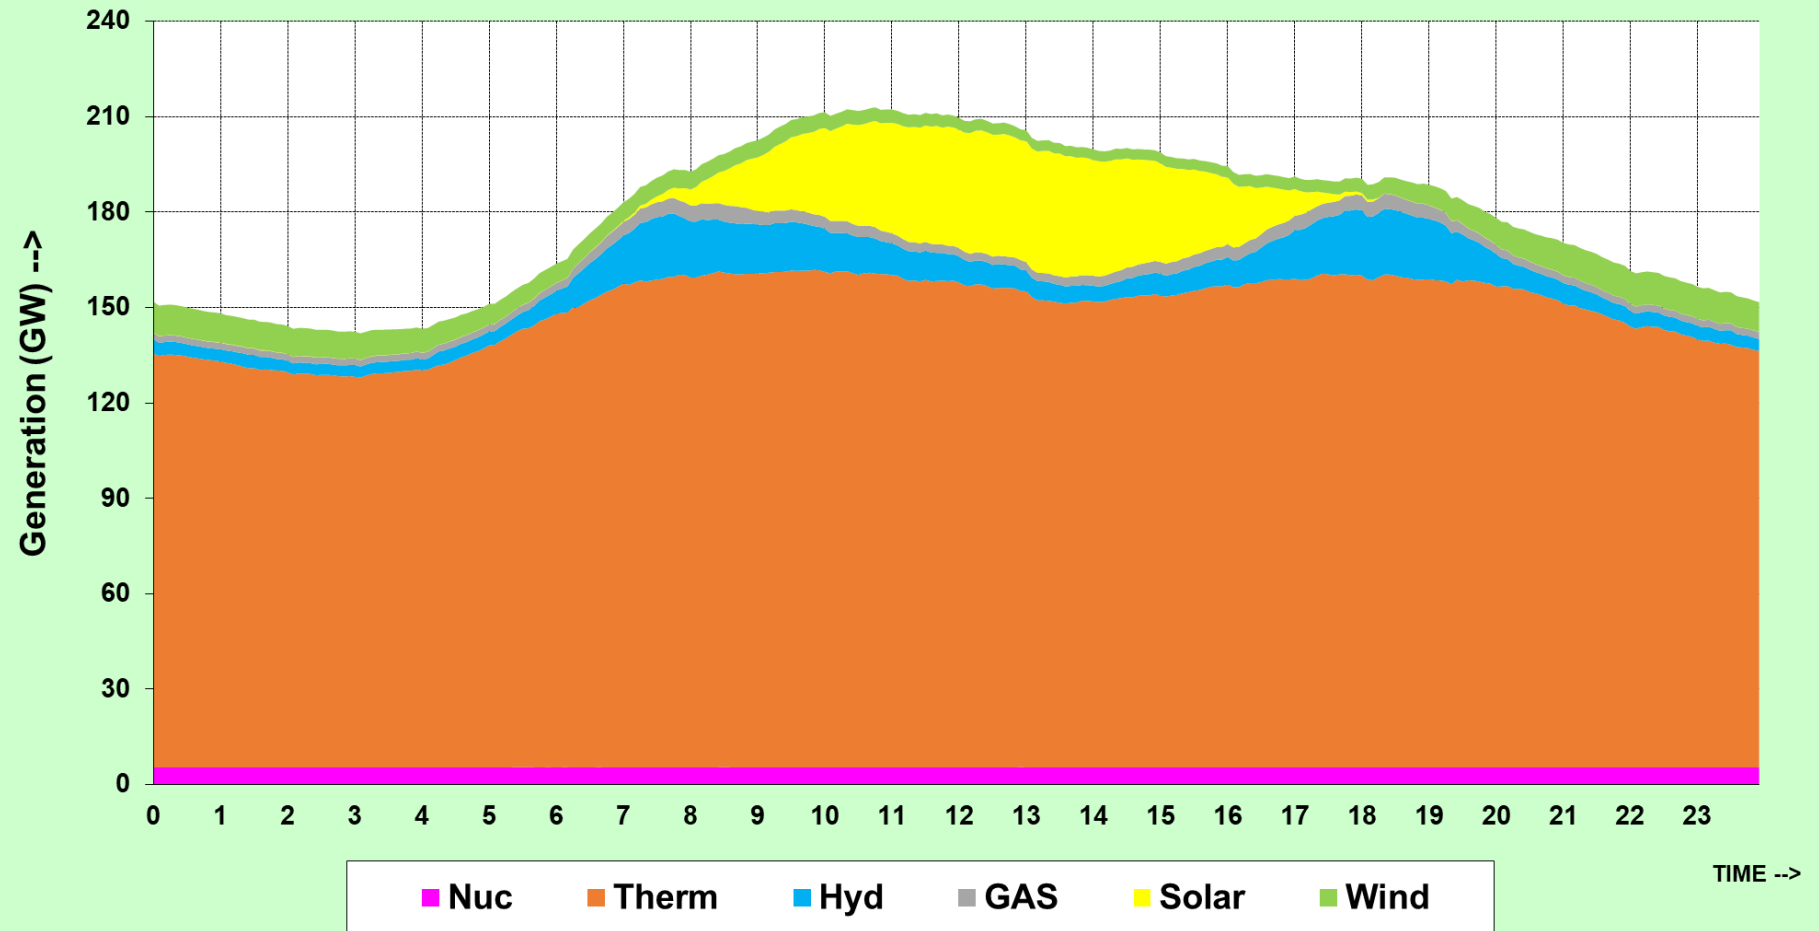

29 दिसंबर 2023 (अधिकतम माँग) की आल इंडिया माँग आपूर्ति
ALL INDIA DEMAND MET FOR 29 DECEMBER 2023 (MAXIMUM DEMAND*)

Time (hrs)	All India Demand (MW)		Time (hrs)	All India Demand (MW)
00:05	150400		12:05	209130
00:20	150751		12:20	209660
00:35	149429		12:35	208170
00:50	148595		12:50	207327
01:05	147544		13:05	203668
01:20	146696		13:20	202826
01:35	145664		13:35	201191
01:50	145068		13:50	200801
02:05	143589		14:05	199537
02:20	143672		14:20	200232
02:35	143265		14:35	199999
02:50	142558		14:50	199671
03:05	142223		15:05	197633
03:20	143169		15:20	197053
03:35	143263		15:35	196352
03:50	143424		15:50	195313
04:05	143456		16:05	192617
04:20	145714		16:20	191851
04:35	147579		16:35	191772
04:50	149285		16:50	190981
05:05	150878		17:05	190373
05:20	154579		17:20	190311
05:35	157508		17:35	190130
05:50	161481		17:50	190853
06:05	163872		18:05	188988
06:20	169734		18:20	191165
06:35	174687		18:35	190487
06:50	179718		18:50	189067
07:05	183752		19:05	188497
07:20	188360		19:20	184476
07:35	191565		19:35	182443
07:50	193278		19:50	180260
08:05	193431		20:05	177232
08:20	197210		20:20	174944
08:35	199386		20:35	172790
08:50	202144		20:50	171377
09:05	204001		21:05	169551
09:20	207508		21:20	167790
09:35	209597		21:35	165327
09:50	210784		21:50	163328
10:05	210973		22:05	160635
10:20	212730		22:20	160979
10:35	212815		22:35	159303
10:50	212906		22:50	157628
11:05	212340		23:05	155896
11:20	211490		23:20	154806
11:35	211447		23:35	153571
11:50	211012		23:50	152094
Maximum Demand of 213620 MW met@10:45 hrs (from 1 min. interval SCADA DATA)				

* 15 minute interval SCADA DATA of instantaneous demand

11. ACTUAL POWER SUPPLY POSITION - DECEMBER 2023

REGION	STATE	Requirement/Availability in MU/DAY			Requirement/Availability in MU				Peak Demand/Peak Met in MW			
		Requirement	Energy met	Surplus(+)/ Deficit(-)	Requirement	Energy met	Surplus(+)/ Deficit(-)	% Shortage	Requirement	Peak Demand Met	Surplus(+)/ Deficit(-)	% Shortage
NR	Chandigarh	4	4	0.0	117	117	0	0.0	201	201	0	0.0
	Delhi	71	71	0.0	2211	2211	0	0.0	4582	4582	0	0.0
	Haryana	143	143	0.0	4447	4446	-1	0.0	8225	8225	0	0.0
	Himachal Pradesh	36	36	-0.1	1128	1125	-2	-0.2	2162	2162	0	0.0
	J&K(UT) and Ladakh(UT)	59	58	-0.4	1822	1809	-13	-0.7	2904	2904	0	0.0
	Punjab	142	142	0.0	4402	4402	0	0.0	8041	8041	0	0.0
	Rajasthan	301	301	-0.1	9343	9339	-4	0.0	17570	17570	0	0.0
	Uttar Pradesh	316	316	-0.1	9803	9799	-4	0.0	19874	19874	0	0.0
	Uttarakhand	41	41	-0.1	1280	1277	-3	-0.3	2417	2417	0	0.0
	Railway	3	3	0.0	106	106	0	0.0	218	218	0	0.0
	NFL	0	0	0.0	2	2	0	0.0	4	4	0	0.0
	TOTAL	1118	1117	-0.9	34661	34634	-27	-0.1	61380	61380	0	0.0
WR	Gujarat	386	386	0.0	11959	11958	-1	0.0	21430	21408	-22	-0.1
	Madhya Pradesh	283	283	0.0	8772	8772	0	0.0	17819	17819	0	0.0
	Chhattisgarh	90	90	0.0	2782	2782	0	0.0	4836	4833	-3	-0.1
	Maharashtra	526	526	0.0	16295	16295	0	0.0	27755	27755	0	0.0
	Goa	13	13	0.0	414	414	0	0.0	704	704	0	0.0
	DNHDDPDCL	28	28	0.0	881	881	0	0.0	1281	1281	0	0.0
	AMNSIL	19	19	0.0	587	587	0	0.0	901	901	0	0.0
	BALCO	12	12	0.0	386	386	0	0.0	532	532	0	0.0
	TOTAL	1357	1357	0.0	42077	42076	-1	0.0	74483	74431	-52	-0.1
SR	Andhra Pradesh	187	186	-1.6	5807	5756	-51	-0.9	12085	12085	0	0.0
	Telangana	212	211	-1.9	6586	6526	-60	-0.9	11857	11857	0	0.0
	Karnataka	257	255	-1.9	7952	7892	-60	-0.8	15005	15005	0	0.0
	Kerala	83	82	-0.6	2566	2547	-19	-0.8	4275	4275	0	0.0
	Tamil Nadu	302	299	-2.5	9356	9278	-78	-0.8	16099	16099	0	0.0
	Puducherry	9	8	-0.1	265	263	-2	-0.8	418	418	0	0.0
	TOTAL	1049	1041	-8.7	32532	32261	-270	-0.8	57245	57245	0	0.0
ER	Bihar	84	84	-0.3	2599	2589	-10	-0.4	4963	4963	0	0.0
	Jharkhand	32	30	-2.0	984	923	-61	-6.2	1827	1827	0	0.0
	DVC	70	70	0.0	2181	2181	0	0.0	3493	3493	0	0.0
	Odisha	96	96	0.0	2961	2961	0	0.0	5578	5578	0	0.0
	West Bengal	131	131	0.0	4053	4053	0	0.0	7096	7096	0	0.0
	Sikkim	2	2	0.0	52	52	0	0.0	115	115	0	0.0
	Railways_ER ISTS	0	0	0.0	4	4	0	0.0	27	27	0	0.0
	TOTAL	414	412	-2.3	12833	12762	-71	-0.6	22011	22011	0	0.0
NER	Arunachal Pradesh	3	3	0.0	83	83	0	0.0	163	163	0	0.0
	Assam	26	26	0.0	816	816	0	0.0	1553	1553	0	0.0
	Manipur	3	3	0.0	91	91	0	0.0	235	235	0	0.0
	Meghalaya	6	6	0.0	198	198	0	0.0	349	349	0	0.0
	Mizoram	2	2	0.0	52	52	0	0.0	140	140	0	0.0
	Nagaland	2	2	0.0	72	72	0	0.0	162	157	-5	-3.1
	Tripura	4	4	0.0	121	121	0	0.0	239	239	0	0.0
	TOTAL	46	46	0.0	1433	1433	0	0.0	2769	2769	0	0.0
ALL INDIA		3985	3973	-11.9	123537	123167	-370	-0.3				

NOTE: BASED ON THE DATA FURNISHED BY ENTITIES ON DAILY BASIS

12. ENERGY COMPARISON OF DECEMBER 2023 vs DECEMBER 2022

REGION	STATE	Energy Requirement (MU)					Energy Met (MU)				
		Dec-22	Dec-23	Difference	% Change	Average MU/day for Dec-23	Dec-22	Dec-23	Difference	% Change	Average MU/day for Dec-23
NR	Chandigarh	116	117	1	1	4	116	117	1	1	4
	Delhi	2177	2211	35	2	71	2177	2211	35	2	71
	Haryana	4332	4447	115	3	143	4320	4446	126	3	143
	Himachal Pradesh	1069	1128	58	5	36	1065	1125	60	6	36
	J&K(UT) and Ladakh(UT)	1798	1822	23	1	59	1787	1809	21	1	58
	Punjab	4325	4402	77	2	142	4325	4402	77	2	142
	Rajasthan	9617	9343	-273	-3	301	9479	9339	-139	-1	301
	Uttar Pradesh	9803	9803	0	0	316	9782	9799	16	0	316
	Uttarakhand	1254	1280	26	2	41	1237	1277	40	3	41
	Railway/NFL	112	108	-3	-3	3	112	108	-3	-3	3
	TOTAL	34603	34661	59	0	1118	34400	34634	234	1	1117
WR	Gujarat	12061	11959	-101	-1	386	12061	11958	-102	-1	386
	Madhya Pradesh	9746	8772	-973	-10	283	9746	8772	-973	-10	283
	Chhattisgarh	2983	2782	-200	-7	90	2982	2782	-200	-7	90
	Maharashtra	16821	16295	-527	-3	526	16821	16295	-526	-3	526
	Goa	402	414	12	3	13	401	414	13	3	13
	DNHDDPDCL	843	881	38	5	28	843	881	38	5	28
	AMNSIL	532	587	56	10	19	532	587	56	10	19
	BALCO	172	386	214	125	12	172	386	214	125	12
	TOTAL	43558	42077	-1481	-3	1357	43557	42076	-1481	-3	1357
SR	Andhra Pradesh	5568	5807	240	4	187	5568	5756	188	3	186
	Telangana	6148	6586	438	7	212	6207	6526	319	5	211
	Karnataka	6285	7952	1666	27	257	6346	7892	1546	24	255
	Kerala	2285	2566	281	12	83	2306	2547	240	10	82
	Tamil Nadu	8754	9356	601	7	302	8836	9278	442	5	299
	Puducherry	250	265	15	6	9	252	263	11	4	8
	TOTAL	29291	32532	3241	11	1049	29516	32261	2746	9	1041
ER	Bihar	2575	2599	24	1	84	2565	2589	23	1	84
	Jharkhand	1002	984	-18	-2	32	897	923	26	3	30
	DVC	2181	2181	0	0	70	2181	2181	0	0	70
	Odisha	2906	2961	55	2	96	2906	2961	55	2	96
	West Bengal	3772	4053	281	7	131	3771	4053	282	7	131
	Sikkim	56	52	-4	-7	2	56	52	-4	-7	2
	Railways_ER ISTS		4	-	-	0		4	-	-	0
	TOTAL	12492	12833	341	3	414	12376	12762	385	3	412
NER	Arunachal Pradesh	80	83	3	3	3	80	83	3	3	3
	Assam	795	816	21	3	26	795	816	21	3	26
	Manipur	100	91	-9	-9	3	100	91	-9	-9	3
	Meghalaya	216	198	-19	-9	6	216	198	-19	-9	6
	Mizoram	64	52	-11	-18	2	64	52	-11	-18	2
	Nagaland	71	72	1	2	2	71	72	1	2	2
	Tripura	115	121	6	5	4	115	121	6	5	4
	TOTAL	1442	1433	-9	-1	46	1442	1433	-8	-1	46
ALL INDIA		121386	123537	2151	2	3985	121291	123167	1876	2	3973

13. DEMAND COMPARISON OF DECEMBER 2023 vs DECEMBER 2022

REGION	STATE	Peak Requirement (MW)				Peak Met (MW)			
		Dec-22	Dec-23	Difference	% Change	Dec-22	Dec-23	Difference	% Change
NR	Chandigarh	282	201	-81	-28.7	282	201	-81	-28.7
	Delhi	4964	4582	-382	-7.7	4964	4582	-382	-7.7
	Haryana	8137	8225	88	1.1	8137	8225	88	1.1
	Himachal Pradesh	2004	2162	158	7.9	2004	2162	158	7.9
	J&K(UT) and Ladakh(UT)	2831	2904	73	2.6	2831	2904	73	2.6
	Punjab	8008	8041	33	0.4	8008	8041	33	0.4
	Rajasthan	16777	17570	793	4.7	16612	17570	958	5.8
	Uttar Pradesh	19970	19874	-96	-0.5	19970	19874	-96	-0.5
	Uttarakhand	2389	2417	28	1.2	2389	2417	28	1.2
	Railway/NFL	163	222	59	35.9	163	222	59	35.9
WR	Gujarat	20146	21430	1284	6	20111	21408	1297	6.4
	Madhya Pradesh	17141	17819	678	4	17111	17819	708	4.1
	Chhattisgarh	4814	4836	22	0	4804	4833	29	0.6
	Maharashtra	27234	27755	521	2	27234	27755	521	1.9
	Goa	689	704	15	2	689	704	15	2.1
	DNHDDPDCL	1228	1281	53	4.3	1228	1281	53	4.3
	AMNSIL	827	901	75	9.0	827	901	75	9.0
	BALCO	519	532	13	2.6	519	532	13	2.6
SR	Andhra Pradesh	10268	12085	1817	17.7	10268	12085	1817	17.7
	Telangana	14034	11857	-2177	-15.5	14016	11857	-2159	-15.4
	Karnataka	13149	15005	1856	14.1	13149	15005	1856	14.1
	Kerala	3997	4275	278	7.0	3997	4275	278	7.0
	Tamil Nadu	15663	16099	436	2.8	15663	16099	436	2.8
	Puducherry	396	418	22	5.6	396	418	22	5.6
ER	Bihar	5047	4963	-84	-1.7	5047	4963	-84	-1.7
	Jharkhand	1983	1827	-156	-7.9	1578	1827	249	15.8
	DVC	3307	3493	186	5.6	3307	3493	186	5.6
	Odisha	4788	5578	790	16.5	4788	5578	790	16.5
	West Bengal	7027	7096	69	1.0	7027	7096	69	1.0
	Sikkim	132	115	-17	-12.9	132	115	-17	-12.9
	Railways_ER ISTS*		27	27	-		27	27	-
NER	Arunachal Pradesh	145	163	18	12.6	145	163	18	12.6
	Assam	1590	1553	-37	-2.3	1590	1553	-37	-2.3
	Manipur	247	235	-12	-5.0	247	235	-12	-5.0
	Meghalaya	395	349	-46	-11.6	395	349	-46	-11.6
	Mizoram	143	140	-3	-2.3	143	140	-3	-2.3
	Nagaland	152	162	11	6.9	152	157	6	3.6
	Tripura	241	239	-2	-1.0	241	239	-2	-1.0

14. SCHEDULE AND DRAWAL OF CONSTITUENTS - DECEMBER 2023

REGION	STATE	SCHEDULE (MU)	ACTUAL DRAWAL (MU)	Over drawal(+)/ Under Drawal(-) (MU)	% OD/UD	SCHEDULE (MU/DAY)	ACTUAL DRAWAL (MU/DAY)	Over drawal(+)/ Under Drawal(-) (MU/DAY)
NR	Chandigarh	118.26	120.55	2.29	1.94	3.81	3.89	0.07
	Delhi	1925.14	1913.97	-11.17	-0.58	62.10	61.74	-0.36
	Haryana	2898.74	2867.49	-31.25	-1.08	93.51	92.50	-1.01
	Himachal Pradesh	908.36	914.98	6.62	0.73	29.30	29.52	0.21
	J&K(UT) and Ladakh(UT)	1662.52	1672.25	9.73	0.59	53.63	53.94	0.31
	Punjab	1438.46	1383.64	-54.82	-3.81	46.40	44.63	-1.77
	Rajasthan	3641.35	3566.89	-74.46	-2.04	117.46	115.06	-2.40
	Uttar Pradesh	3361.25	3311.92	-49.33	-1.47	108.43	106.84	-1.59
	Uttarakhand	907.42	912.71	5.29	0.58	29.27	29.44	0.17
	Railway	106.34	106.11	-0.24	-0.22	3.43	3.42	-0.01
	NFL	2.23	2.07	-0.16	-7.24	0.07	0.07	-0.01
	Total	16970.08	16772.58	-197.49	-1.16	547.42	541.05	-6.37
WR	Gujarat	5161.72	5130.04	-31.69	-0.61	166.51	165.49	-1.02
	Madhya Pradesh	5351.37	5221.07	-130.30	-2.43	172.62	168.42	-4.20
	Chhattisgarh	1045.23	1018.12	-27.11	-2.59	33.72	32.84	-0.87
	Maharashtra	5465.29	5392.00	-73.29	-1.34	176.30	173.94	-2.36
	Goa	402.67	397.44	-5.23	-1.30	12.99	12.82	-0.17
	DNHDDPDCL	881.52	881.15	-0.37	-0.04	28.44	28.42	-0.01
	AMNSIL	289.65	288.46	-1.19	-0.41	9.34	9.31	-0.04
	BALCO*	387.51	385.82	-1.69	-0.44	12.50	12.45	-0.05
	Total	18984.96	18714.09	-270.87	-1.43	612.42	603.68	-8.74
SR	Andhra Pradesh	2116.08	2089.27	-26.81	-1.27	68.26	67.40	-0.86
	Telangana	3007.92	3003.19	-4.73	-0.16	97.03	96.88	-0.15
	Karnataka	3353.28	3311.05	-42.23	-1.26	108.17	106.81	-1.36
	Kerala	2055.22	2092.81	37.59	1.83	66.30	67.51	1.21
	Tamil Nadu	5203.97	5188.89	-15.08	-0.29	167.87	167.38	-0.49
	Puducherry	251.45	242.41	-9.04	-3.60	8.11	7.82	-0.29
	Goa (SR)	65.11	62.33	-2.78	-4.27	2.10	2.01	-0.09
	Total	16053.03	15989.95	-63.08	-0.39	517.84	515.80	-2.03
ER	Bihar	2399.02	2413.13	14.11	0.59	77.39	77.84	0.46
	Jharkhand	744.20	739.42	-4.78	-0.64	24.01	23.85	-0.15
	DVC	-1321.01	-1307.76	13.25	-1.00	-42.61	-42.19	0.43
	Odisha	1056.60	1004.20	-52.40	-4.96	34.08	32.39	-1.69
	West Bengal	667.55	583.97	-83.58	-12.52	21.53	18.84	-2.70
	Sikkim	53.08	51.79	-1.29	-2.43	1.71	1.67	-0.04
	Railways_ER ISTS*	3.64	3.78	0.14	3.76	0.12	0.12	0.00
	Total	3603.08	3488.53	-114.55	-3.18	116.23	112.53	-3.70
NER	Arunachal Pradesh	87.00	83.00	-4.00	-4.60	2.81	2.68	-0.13
	Assam	637.20	642.90	5.70	0.89	20.55	20.74	0.18
	Manipur	94.00	91.50	-2.50	-2.66	3.03	2.95	-0.08
	Meghalaya	157.20	152.70	-4.50	-2.86	5.07	4.93	-0.15
	Mizoram	55.30	46.40	-8.90	-16.09	1.78	1.50	-0.29
	Nagaland	72.60	67.70	-4.90	-6.75	2.34	2.18	-0.16
	Tripura	105.00	101.50	-3.50	-3.33	3.39	3.27	-0.11
	Total	1208.30	1185.70	-22.60	-1.87	38.98	38.25	-0.73
All India Total		56819.45	56150.86	-668.59	-1.18	1832.89	1811.32	-21.57

15. INTER REGIONAL EXCHANGES 2023-24 (All figures in MU)										
	Apr'23	May'23	June'23	July'23	Aug'23	Sep'23	Oct'23	Nov'23	Dec'23	Fin. Year 2023-24
Name of Line										
Import of NR from WR (WR-NR)										
WR - NR 765 kV Gwalior - Agra 2x5/C	635.95	996.71	863.68	972.77	772.12	902.82	479.75	675.87	1109.33	7409.00
WR-NR 765 kV Gwalior - Phagi 2x5/C	553.05	453.93	342.56	671.61	397.70	687.31	582.69	906.94	1039.97	5635.76
WR-NR 765 kV Jabalpur-Orai D/C	430.29	804.53	778.33	964.77	658.94	991.15	602.03	622.44	986.15	6838.63
WR-NR 765 kV Satna-Orai	505.37	598.85	574.83	615.77	543.29	593.66	548.69	623.24	692.79	5296.49
WR-NR 765 kV Gwalior-Orai	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WR - NR HVDC Champa - Kurukshetra	804.26	1126.68	2069.11	2235.18	1955.13	2230.56	739.22	674.04	450.87	12285.05
WR - NR HVDC Vindhyachal	0.49	3.23	3.13	94.78	21.55	7.26	50.51	28.33	18.10	227.38
WR - NR 400 kV Zerda Kankroli	0.00	0.00	1.48	15.36	13.10	8.58	0.00	1.30	3.11	42.93
WR - NR 400 kV Zerda Bhinmal	0.00	0.00	0.00	12.54	13.56	23.81	0.34	3.28	11.42	64.95
WR - NR 400 kV RAPP C - Shujalpur D/C	2.28	31.04	16.05	164.49	80.51	147.53	18.12	25.82	78.97	564.81
WR - NR 220 kV Bhanpura - Ranpur	9.67	65.53	68.13	70.02	74.29	61.03	65.71	43.01	33.94	491.33
WR - NR 220 kV Bhanpura - Modak	0.00	0.00	0.00	0.00	0.00	38.00	62.92	72.56	72.98	246.46
WR - NR 220 kV Auraiya - Malanpur/Mehgaon	0.00	0.15	0.00	0.00	0.00	0.00	0.00	0.00	0.71	0.86
WR - NR 400 kV Vindhyachal-Rihand D/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WR - NR HVDC Mundra - Mohindergarh	132.55	340.75	234.27	124.89	667.23	827.57	920.93	511.53	563.55	4323.27
WR-NR 765 kV Banaskata-Chittorgarh D/C	0.00	3.26	16.02	169.31	260.02	66.60	0.00	4.54	27.97	547.72
WR-NR 765 kV Varanasi-Vindhyachal	1030.05	1663.34	1854.30	1854.38	1551.38	1697.01	1174.50	1049.13	1321.93	13196.02
Total WR - NR	4103.96	6088.00	6821.89	7965.87	7008.82	8282.89	5245.41	5242.03	6411.79	57170.66
Export of NR to WR (NR-WR)										
NR - WR 765 kV Gwalior - Agra 2x5/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - WR 765 kV Gwalior - Phagi 2x5/C	0.00	5.41	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.41
NR - WR 765 kV Jabalpur-Orai D/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - WR 765 kV Satna-Orai	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - WR 765 kV Gwalior-Orai	440.87	385.11	301.32	367.88	368.83	385.80	399.85	459.18	533.25	3642.09
NR - WR HVDC Champa - Kurukshetra	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - WR HVDC Vindhyachal	289.83	273.88	267.04	184.43	225.73	180.86	26.34	219.10	161.65	1828.86
NR - WR 400 kV Zerda Kankroli	185.75	94.43	108.34	24.78	31.17	41.36	96.48	75.31	44.39	702.01
NR - WR 400 kV Zerda Bhinmal	282.42	181.64	200.56	73.76	74.62	64.65	158.50	60.27	38.76	1135.18
NR - WR 400 kV RAPP C - Shujalpur D/C	85.74	45.64	45.64	0.00	3.36	0.00	46.93	23.25	0.00	250.56
NR - WR 220 kV Bhanpura - Ranpur	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - WR 220 kV Bhanpura - Modak	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - WR 220 kV Auraiya - Malanpur/Mehgaon	56.56	28.58	50.82	47.16	97.78	68.03	111.08	74.65	30.32	564.98
NR-WR 400 kV Rihand-Vindhyachal D/C	644.30	672.49	642.32	664.33	653.25	658.85	669.33	655.41	657.92	5918.20
NR - WR HVDC Mundra - Mohindergarh	243.86	54.36	36.25	94.16	0.00	0.00	0.00	0.00	0.00	428.63
NR - WR 765 kV Banaskata-Chittorgarh D/C	976.83	428.19	421.52	94.53	51.63	180.84	597.81	524.56	292.98	3568.89
NR-WR 765 kV Varanasi-Vindhyachal	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total NR - WR	3206.16	2169.73	2073.81	1551.03	1506.37	1580.39	2106.32	2091.73	1759.27	18044.81

	Apr'23	May'23	June'23	July'23	Aug'23	Sep'23	Oct'23	Nov'23	Dec'23	Fin. Year 2023-24
Name of Line										
Import of NR from ER (ER-NR)										
ER - NR 765 kV Sasaram - Fatehpur	166.02	114.36	82.57	74.16	131.29	131.20	192.41	301.01	254.85	1447.87
ER - NR 765 kV Gaya - Varanasi 2*S/C	224.56	107.46	28.46	47.20	75.64	115.88	182.55	439.13	474.87	1695.75
ER - NR 765 kV Gaya - Balia	246.38	335.46	321.28	300.74	224.31	332.43	250.12	325.32	373.66	2709.70
ER - NR HVDC Alipurduar - Agra	0.00	0.00	375.05	784.99	444.13	750.81	497.43	168.00	0.00	3020.41
ER-NR 400 kV Patna - Balia D/C	219.16	246.32	242.35	242.23	300.66	262.01	203.70	186.43	90.17	1993.03
ER - NR 400 kV Muzaffarpur - Gorakhpur D/C	127.03	223.63	277.35	376.44	415.21	330.20	255.04	312.10	270.56	2587.56
ER - NR 400 kV Biharshariff - Balia D/C	22.11	72.32	102.97	92.77	101.30	90.47	56.79	138.97	145.18	822.88
ER - NR 400 kV Motihari - Gorakhpur D/C	156.88	188.70	180.09	228.59	251.16	190.46	142.10	216.07	233.85	1787.90
ER - NR 400 kV Biharshariff - Varanasi D/C	67.56	47.21	34.66	24.65	44.14	47.88	63.00	164.47	171.28	664.85
ER - NR 400 kV Sasaram -Varanasi	74.99	38.68	46.09	55.64	28.71	57.56	16.47	4.09	2.63	324.86
ER - NR 400 kV Sasaram -Allahabad	51.91	33.39	21.29	28.77	17.25	52.61	27.20	32.87	36.28	301.57
ER - NR 220 kV Sahupuri-Karamnasa	78.64	82.22	82.32	43.45	51.19	29.26	36.16	53.46	34.10	490.80
ER - NR 132 kV Sahupuri - Karamnasa	1.92	0.00	0.96	1.12	0.96	2.02	3.28	5.11	1.62	16.99
ER - NR 132 kV 132 kV Rihand - Nagar Untari	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
ER - NR 132 kV Rihand - Garhwa	0.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.18	0.64
ER-NR 400 kV Naubatpur - Balia D/C	211.13	243.59	239.56	236.53	300.12	264.57	198.04	328.08	343.58	2365.20
Total ER-NR	1648.75	1733.34	2035.00	2537.28	2386.07	2657.36	2124.29	2675.11	2432.81	20230.01
Import of NR from NER (NER-NR)										
NER-NR HVDC Biswanath Chariali - Agra	0.00	0.00	153.62	339.28	465.76	447.38	470.05	190.40	0.00	2066.49
Total NER - NR	0.00	0.00	153.62	339.28	465.76	447.38	470.05	190.40	0.00	2066.49
Export of NR to ER (NR-ER)										
NR - ER 765 kV Sasaram - Fatehpur	0.00	2.65	7.74	3.45	0.00	4.62	0.00	0.00	0.00	18.46
NR - ER 765 kV Gaya - Varanasi 2*S/C	0.30	38.74	102.98	45.94	11.70	32.51	8.41	1.45	0.00	242.03
NR - ER 765 kV Gaya - Balia	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - ER HVDC Alipurduar - Agra	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - ER 400 kV Patna - Balia 2xD/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - ER 400 kV Muzaffarpur - Gorakhpur D/C	3.47	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.47
NR - ER 400 kV Biharshariff - Balia D/C	17.15	4.18	13.06	0.00	0.00	3.12	4.14	0.75	0.00	42.40
ER - NR 400 kV Motihari - Gorakhpur D/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - ER 400 kV Biharshariff - Varanasi D/C	2.90	7.31	20.53	10.39	0.22	12.39	4.69	0.00	0.00	58.43
NR - ER 400 kV Sasaram -Varanasi	0.00	0.00	0.00	0.00	1.67	0.00	0.85	5.47	4.05	12.04
NR - ER 400 kV Sasaram -Allahabad	2.25	0.00	0.00	0.82	2.28	0.00	0.23	0.00	0.00	5.58
NR - ER 220 kV Sahupuri-Karamnasa	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
NR - ER 132 kV Sahupuri - Karamnasa	0.01	0.96	0.48	0.96	0.00	0.58	0.48	0.00	1.44	4.91
NR - ER 132 kV 132 kV Rihand - Nagar Untari	1.74	2.20	1.08	3.37	2.39	3.46	1.80	2.75	0.00	18.79
ER - NR 132 kV Rihand - Garhwa	10.23	8.48	19.67	18.35	14.38	11.19	11.51	8.39	4.64	106.84
NR-ER 400 kV Balia- Naubatpur D/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total NR - ER	38.05	64.52	165.54	83.28	32.64	67.87	32.11	18.81	10.13	512.95
Export of NR to NER (NER-NR)										
NR-NER HVDC Biswanath Chariali - Agra	261.93	291.71	104.47	0.00	0.00	0.00	0.00	257.02	0.00	915.13
Total NR - NER	261.93	291.71	104.47	0.00	0.00	0.00	0.00	257.02	0.00	915.13

	Apr'23	May'23	June'23	July'23	Aug'23	Sep'23	Oct'23	Nov'23	Dec'23	Fin. Year 2023-24
Name of Line										
Export of WR to ER (WR-ER)										
WR - ER 765 kV Ranchi - Dharamjaygarh 2xS/C	139.81	504.96	673.15	734.00	331.39	537.29	228.34	42.77	55.89	3247.60
WR - ER 765 kV Dharamjaygarh - Jharsuguda 2xD/C	652.31	469.82	490.99	593.61	768.89	177.22	238.94	52.91	224.71	3669.40
WR - ER 765 kV Durg - Jharsuguda D/C	0.00	0.64	1.75	26.78	7.42	1.32	0.00	0.00	0.00	37.91
WR - ER 400 kV Sipat - Ranchi D/C	15.97	93.84	118.29	133.75	52.57	87.51	30.29	8.20	13.05	553.47
WR - ER 400 kV Raigarh - Jharsuguda 2xD/C	0.44	6.23	8.79	6.26	28.69	11.41	0.82	0.78	0.99	64.42
WR - ER 220 kV Korba - Budhipadar D/C	36.08	80.04	73.19	22.96	28.75	29.18	26.25	36.70	47.92	381.08
WR - ER 220 kV Raigarh - Budhipadar	0.15	0.57	1.17	0.00	0.35	0.34	0.00	0.08	2.74	5.39
Total WR - ER	844.75	1156.11	1367.33	1517.34	1218.07	844.29	524.64	141.44	345.30	7959.27
Import of WR from ER (ER - WR)										
ER - WR 765 kV Ranchi - Dharamjaygarh 2xS/C	144.10	11.95	15.57	10.81	83.69	14.84	62.72	294.10	166.96	804.75
ER - WR 765 kV Dharamjaygarh - Jharsuguda 2XD/C	25.46	58.29	33.08	15.65	2.33	214.83	131.20	338.83	241.82	1061.49
ER - WR 765 kV Durg - Jharsuguda D/C	394.08	204.42	148.02	71.84	73.64	163.98	298.15	464.99	456.27	2275.39
ER - WR 400 kV Sipat - Ranchi D/C	55.56	5.71	9.07	7.22	29.65	8.91	40.59	105.31	60.55	322.56
ER - WR 400 kV Raigarh - Jharsuguda 2xD/C	248.78	148.94	125.69	125.00	127.87	110.94	267.35	221.93	208.02	1584.51
ER - WR 220 kV Korba - Budhipadar D/C	1.45	0.00	0.14	6.23	1.99	1.46	3.18	3.22	2.35	20.02
ER - WR 220 kV Raigarh - Budhipadar	55.98	38.46	41.41	66.29	74.76	49.37	81.54	41.32	24.30	473.42
Total ER - WR	925.41	467.76	372.98	303.04	393.92	564.32	884.73	1469.71	1160.27	6542.15
Export of ER to NER (ER - NER)										
ER - NER 400 kV Binaguri - Bongaigaon D/C	6.99	16.15	105.81	142.19	71.19	215.10	134.98	60.68	0.64	753.73
ER - NER 400 kV Alipurduar - Bongaigaon D/C	4.62	34.31	135.94	83.03	84.82	161.59	95.15	85.48	0.00	684.94
ER - NER 220 kV Birpara - Salakati D/C	0.54	3.12	31.19	37.25	25.19	47.94	25.71	15.50	0.00	186.43
Total ER - NER	12.16	53.58	272.93	262.48	181.20	424.63	255.83	161.66	0.64	1625.10
Import of ER from NER (NER - ER)										
NER - ER 400 kV Binaguri - Bongaigaon D/C	52.83	40.19	37.75	2.10	10.62	0.07	5.53	48.07	75.32	272.48
NER - ER 400 kV Alipurduar - Bongaigaon D/C	182.37	135.22	72.81	20.59	29.76	3.08	23.52	172.08	294.27	933.70
NER - ER 220 kV Birpara - Salakati D/C	34.59	31.32	10.78	0.62	2.83	0.14	2.65	38.72	64.62	186.26
Total NER - ER	269.78	206.73	121.33	23.31	43.22	3.29	31.70	258.87	434.22	1392.44
Export of ER to SR (ER - SR)										
ER - SR HVDC Gazuwaka	375.93	395.23	208.61	178.44	321.36	201.99	378.26	352.24	239.96	2652.01
ER - SR HVDC Talchar - Kolar	1233.20	1204.28	984.75	977.61	1284.58	1076.42	1294.48	1214.02	1257.33	10526.66
ER - SR 765 kV Angul- Srikakulam D/C	1683.42	1561.33	1412.42	1184.37	1380.27	1160.32	1534.32	1466.97	1513.04	12896.48
Total ER - SR	3292.55	3160.85	2605.77	2340.42	2986.21	2438.74	3207.06	3033.23	3010.33	26075.15
Import of ER from SR (SR - ER)										
SR - ER HVDC Gazuwaka	0.00	0.00	55.34	114.11	32.48	0.00	0.00	6.03	0.00	207.97
SR - ER HVDC Talchar - Kolar	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01
SR - ER 765 kV Angul- Srikakulam D/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total SR - ER	0.00	0.00	55.34	114.11	32.48	0.00	0.00	6.03	0.00	207.97

	Apr'23	May'23	June'23	July'23	Aug'23	Sep'23	Oct'23	Nov'23	Dec'23	Fin. Year 2023-24
Name of Line										
Export of WR to SR (WR-SR)										
WR - SR HVDC Bhadrawati	544.41	411.52	171.68	139.64	464.81	222.80	593.89	435.49	593.74	3577.99
WR - SR 765 kV Sholapur - Raichur 2xS/C	417.69	222.76	146.07	83.93	451.70	125.10	226.89	116.70	185.60	1976.45
WR - SR 765 kV Wardha - Nizamabad D/C	1323.51	873.44	1018.25	852.05	1313.80	864.24	1099.04	930.66	873.02	9148.02
WR - SR 400KV Kolhapur-Kudgi D/C	0.00	0.00	0.00	0.00	0.06	0.00	0.00	0.00	0.00	0.06
WR-SR HVDC Raigarh-Pugalur	3004.35	1791.86	1182.91	885.62	2135.69	1450.16	2583.88	1858.37	1697.06	16589.89
WR-SR 220kV Xeldem - Ambewadi S/C	77.16	70.18	68.17	61.74	68.61	67.55	69.49	67.29	61.47	611.65
WR-SR 220kV Ponda - Ambewadi S/C	0.29	1.54	0.28	0.16	5.23	0.04	0.08	0.97	0.04	8.62
Total WR - SR	5367.41	3371.30	2587.37	2023.14	4439.89	2729.89	4573.27	3409.48	3410.93	31912.67
Import of WR from SR (SR - WR)										
SR - WR HVDC Bhadrawati	4.11	25.09	178.09	308.60	10.36	114.86	0.00	0.00	0.00	641.13
SR - WR 765 kV Raichur - Sholapur 2xS/C	29.13	205.27	344.82	478.51	54.56	420.76	215.80	334.15	175.90	2258.89
SR - WR 765 kV Wardha - Nizamabad D/C	0.00	3.90	0.32	18.33	0.00	19.87	0.03	0.89	0.00	43.35
SR - WR 400KV Kolhapur-Kudgi D/C	623.59	719.30	784.98	796.02	623.43	850.54	765.68	701.36	642.95	6507.86
SR-WR HVDC Pugalur-Raigarh	0.00	3.73	14.87	16.65	0.00	0.09	0.00	0.00	0.00	35.33
WR-SR 220kV Ambewadi - Xeldem S/C	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
WR-SR 220kV Ambewadi-Ponda S/C	0.00	0.00	0.01	0.00	0.01	0.01	0.02	0.01	0.02	0.09
Total SR - WR	656.84	957.30	1323.09	1618.10	688.36	1406.13	981.53	1036.41	818.88	9486.64
TOTAL ALL INDIA	20628	19721	20060	20679	21383	21447	20437	19992	19795	184141
*In case of mutiple ckt / DC pole year corres. to the commissioning of final element										

Date	15.1 Import-Export of NR with WR during December 2023																	
	Import of NR from WR (WR-NR)																	
	WR - NR 765 kV Gwalior - Agra 2x5/C	WR-NR 765 kV Gwalior-Phagi 2x5/C	WR-NR 765 kV Jabalpur- Orai D/C	WR-NR 765 kV Satna- Orai	WR-NR 765 kV Gwalior-Orai	WR - NR HVDC Champa- Kurukshetra	WR - NR HVDC Vindhyachal	WR - NR 400 kV Zerd- Kankroli	WR - NR 400 kV Zerd- Bhinmal	WR-NR 400 kV RAPP C - Shujalpur D/C	WR - NR 220 kV Bhanpura - Ranpur	WR - NR 220 kV Bhanpura - Modak	WR - NR 220 kV Auraiya - Malanpur / Mehgaon	WR-NR 400 kV Rihand Vindhyachal D/C	WR - NR HVDC Mundra - M'garh	WR -NR 765 kV Banaskata - Chittorgarh D/C	WR-NR 765 kV Varanasi- Vindhyachal	Total WR - NR
1-Dec-23	31.62	24.03	22.78	20.07	0.00	46.71	0.00	0.25	0.13	0.84	1.09	2.30	0.00	0.00	6.13	1.32	45.44	202.71
2-Dec-23	33.62	21.82	24.25	21.14	0.00	46.82	0.00	0.00	0.00	0.74	1.01	2.33	0.00	0.00	6.13	4.15	36.65	198.66
3-Dec-23	34.50	22.28	23.00	20.34	0.00	43.82	0.00	0.00	0.00	0.61	0.82	1.93	0.00	0.00	6.13	0.00	44.36	197.79
4-Dec-23	34.98	24.10	28.56	20.86	0.00	35.24	0.00	0.00	1.03	1.12	0.69	1.56	0.13	0.00	6.10	2.02	40.09	196.48
5-Dec-23	36.95	26.39	27.89	21.82	0.00	35.90	0.00	0.00	0.00	1.32	0.73	2.01	0.58	0.00	6.11	0.26	45.32	205.28
6-Dec-23	35.70	30.56	31.21	22.91	0.00	35.12	0.00	0.00	0.00	2.26	0.83	1.75	0.00	0.00	6.11	0.00	42.98	209.43
7-Dec-23	34.01	32.24	25.27	22.36	0.00	35.53	0.00	0.00	0.00	2.47	0.79	1.84	0.00	0.00	5.94	0.00	39.72	200.17
8-Dec-23	31.98	36.65	28.99	23.19	0.00	34.98	0.00	0.00	0.00	2.44	0.82	1.99	0.00	0.00	13.90	0.00	40.09	215.03
9-Dec-23	31.59	38.20	26.47	23.24	0.00	35.01	0.00	0.00	0.00	2.12	0.83	2.05	0.00	0.00	16.58	0.00	36.48	212.57
10-Dec-23	33.06	35.39	29.44	23.19	0.00	27.55	0.00	0.00	0.00	2.68	0.88	2.11	0.00	0.00	13.16	0.00	38.73	206.19
11-Dec-23	31.53	35.32	24.51	22.22	0.00	38.50	0.00	0.00	0.00	2.36	0.98	2.33	0.00	0.00	12.26	0.00	38.34	208.35
12-Dec-23	36.63	37.43	32.12	23.20	0.00	23.40	0.00	0.00	0.00	2.83	1.06	2.16	0.00	0.00	14.58	0.00	38.39	211.80
13-Dec-23	38.10	39.13	34.75	23.79	0.00	12.29	0.00	0.00	0.00	3.27	1.14	2.22	0.00	0.00	19.78	0.00	42.09	216.56
14-Dec-23	34.97	35.12	36.19	23.68	0.00		2.66	0.00	0.00	2.12	1.21	2.42	0.00	0.00	19.20	0.00	42.82	200.39
15-Dec-23	31.84	36.14	32.62	21.48	0.00		0.23	0.00	0.00	0.97	1.25	2.42	0.00	0.00	23.08	0.00	37.84	187.87
16-Dec-23	34.02	36.62	29.57	21.86	0.00		0.00	0.00		1.77	1.29	2.31	0.00	0.00	18.69	0.00	42.21	188.34
17-Dec-23	38.65	36.23	36.47	21.80	0.00	0.00	0.00	0.00	2.28	3.28	1.39	2.43	0.00	0.00	12.50	0.00	51.60	206.63
18-Dec-23	40.04	30.18	33.94	22.58	0.00		0.00	1.43	2.97	2.37	1.37	2.45	0.00	0.00	12.17	10.04	49.08	208.62
19-Dec-23	41.01	33.23	35.42	23.42	0.00		0.00	1.31	3.83	3.70	1.52	2.58	0.00	0.00	18.48	8.73	50.84	224.07
20-Dec-23	40.17	36.35	36.54	23.44	0.00	0.00	0.00	0.12	0.48	4.02	0.67	2.49	0.00	0.00	19.16	1.45	48.57	213.46
21-Dec-23	33.64	33.24	34.50	22.86	0.00	0.00	2.41	0.00	0.00	1.92	0.61	2.66	0.00	0.00	24.23	0.00	43.81	199.88
22-Dec-23	32.97	36.87	34.85	23.82	0.00		2.42	0.00	0.00	2.39	1.48	2.60	0.00	0.00	24.23	0.00	42.22	203.85
23-Dec-23	31.41	32.01	33.51	20.86	0.00		2.42	0.00	0.00	1.67	1.48	2.65	0.00	0.00	25.96	0.00	41.88	193.85
24-Dec-23	35.58	30.21	30.85	21.33	0.00		2.41	0.00	0.00	1.32	1.35	2.62	0.00	0.00	21.40	0.00	46.56	193.63
25-Dec-23	38.78	33.56	35.34	20.75	0.00		2.42	0.00	0.70	3.83	1.30	2.57	0.00	0.00	18.98	0.00	38.05	196.28
26-Dec-23	34.69	37.95	33.29	21.53	0.00		2.42	0.00	0.00	3.52	1.26	2.54	0.00	0.00	26.63	0.00	34.29	198.12
27-Dec-23	39.32	36.94	35.06	22.86	0.00		0.71	0.00	0.00	3.65	1.01	2.63	0.00	0.00	37.27	0.00	42.45	221.90
28-Dec-23	38.20	34.07	33.39	22.38	0.00		0.00	0.00	0.00	3.16	1.22	2.80	0.00	0.00	34.58	0.00	44.86	214.66
29-Dec-23	38.80	38.15	36.02	22.64	0.00		0.00	0.00	0.00	4.16	1.28	2.79	0.00	0.00	32.08	0.00	41.44	217.36
30-Dec-23	39.92	42.42	38.93	23.58	0.00		0.00	0.00	0.00	5.38	1.28	2.79	0.00	0.00	25.71	0.00	45.92	225.93
31-Dec-23	41.05	37.14	40.42	23.59	0.00		0.00	0.00	0.00	4.68	1.30	2.65	0.00	0.00	36.29	0.00	48.81	235.93
Total	1109.33	1039.97	986.15	692.79	0.00	450.87	18.10	3.11	11.42	78.97	33.94	72.98	0.71	0.00	563.55	27.97	1321.93	6411.79
Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day																		

Date	15.1 Import-Export of NR with WR during December 2023																	
	Export of NR to WR (NR- WR)																	
	NR - WR 765 kV Gwalior - Agra 2x5/C	NR-WR 765 kV Gwalior-Phagi 2x5/C	NR-WR 765 kV Jabalpur- Orai D/C	NR-WR 765 kV Satna- Orai	NR-WR 765 kV Gwalior-Orai	NR - WR HVDC Champa- Kurukshetra	NR - WR HVDC Vindhyachal	NR - WR 400 kV Zerda- Kankroli	NR - WR 400 kV Zerda- Bhinmal	NR-WR 400 kV RAPP C - Shujalpur D/C	WR - NR 220 kV Bhanpura - Ranpur	WR - NR 220 kV Bhanpura - Modak	NR - WR 220 kV Auraiya - Malanpur / Mehgaon	NR-WR 400 kV Rihand- Vindhyachal D/C	NR - WR HVDC Mundra - M'garh	NR - WR 765 kV Banaskata - Chittorgarh D/C	NR-WR 765 kV Varanasi- Vindhyachal	Total NR - WR
1-Dec-23	0.00	0.00	0.00	0.00	14.36	0.00	3.64	0.00	0.00	0.00	0.00	0.00	0.98	21.56	0.00	0.00	0.00	40.54
2-Dec-23	0.00	0.00	0.00	0.00	14.60	0.00	7.38	0.21	0.21	0.00	0.00	0.00	1.07	21.05	0.00	0.00	0.00	44.52
3-Dec-23	0.00	0.00	0.00	0.00	15.32	0.00	8.97	1.04	0.41	0.00	0.00	0.00	0.72	21.98	0.00	0.24	0.00	48.68
4-Dec-23	0.00	0.00	0.00	0.00	13.73	0.00	6.72	0.60	0.00	0.00	0.00	0.00	0.00	20.83	0.00	0.00	0.00	41.88
5-Dec-23	0.00	0.00	0.00	0.00	14.70	0.00	7.34	0.07	1.07	0.00	0.00	0.00	0.00	20.64	0.00	0.00	0.00	43.82
6-Dec-23	0.00	0.00	0.00	0.00	15.55	0.00	7.29	1.93	1.68	0.00	0.00	0.00	0.31	21.62	0.00	5.95	0.00	54.33
7-Dec-23	0.00	0.00	0.00	0.00	15.89	0.00	7.28	2.52	2.85	0.00	0.00	0.00	0.61	22.10	0.00	12.90	0.00	64.15
8-Dec-23	0.00	0.00	0.00	0.00	17.43	0.00	7.28	3.10	2.35	0.00	0.00	0.00	0.65	22.10	0.00	20.82	0.00	73.73
9-Dec-23	0.00	0.00	0.00	0.00	17.87	0.00	7.28	2.55	1.77	0.00	0.00	0.00	0.80	21.53	0.00	20.58	0.00	72.38
10-Dec-23	0.00	0.00	0.00	0.00	16.73	0.00	7.26	2.90	1.37	0.00	0.00	0.00	0.65	22.27	0.00	19.89	0.00	71.07
11-Dec-23	0.00	0.00	0.00	0.00	17.18	0.00	7.28	2.72	2.20	0.00	0.00	0.00	0.79	21.84	0.00	21.52	0.00	73.53
12-Dec-23	0.00	0.00	0.00	0.00	17.46	0.00	10.68	2.87	1.73	0.00	0.00	0.00	0.57	22.28	0.00	21.14	0.00	76.73
13-Dec-23	0.00	0.00	0.00	0.00	18.13	0.00	4.34	2.54	1.18	0.00	0.00	0.00	0.64	22.29	0.00	18.91	0.00	68.03
14-Dec-23	0.00	0.00	0.00	0.00	17.12		2.72	2.05	0.16	0.00	0.00	0.00	1.02	22.26	0.00	15.90	0.00	61.23
15-Dec-23	0.00	0.00	0.00	0.00	17.50		2.58	2.40	0.75	0.00	0.00	0.00	1.29	22.10	0.00	14.85	0.00	61.47
16-Dec-23	0.00	0.00	0.00	0.00	18.90		6.05	1.82		0.00	0.00	0.00	1.02	22.10	0.00	14.03	0.00	63.92
17-Dec-23	0.00	0.00	0.00	0.00	17.63	0.00	6.06	0.10	0.00	0.00	0.00	0.00	0.82	21.55	0.00	3.60	0.00	49.76
18-Dec-23	0.00	0.00	0.00	0.00	16.11		6.13	0.00	0.00	0.00	0.00	0.00	0.88	20.44	0.00	0.00	0.00	43.56
19-Dec-23	0.00	0.00	0.00	0.00	16.03		6.11	0.00	0.00	0.00	0.00	0.00	0.90	22.00	0.00	0.00	0.00	45.04
20-Dec-23	0.00	0.00	0.00	0.00	17.91	0.00	1.18	0.00	0.00	0.00	0.00	0.00	1.08	21.80	0.00	0.00	0.00	41.97
21-Dec-23	0.00	0.00	0.00	0.00	16.11	0.00	0.00	1.74	2.11	0.00	0.00	0.00	1.41	22.54	0.00	8.67	0.00	52.58
22-Dec-23	0.00	0.00	0.00	0.00	17.87		0.00	1.89	2.29	0.00	0.00	0.00	1.73	22.60	0.00	12.64	0.00	59.02
23-Dec-23	0.00	0.00	0.00	0.00	19.43		0.00	1.80	3.80	0.00	0.00	0.00	1.65	22.10	0.00	11.11	0.00	59.89
24-Dec-23	0.00	0.00	0.00	0.00	17.69		0.00	1.23	2.71	0.00	0.00	0.00	1.20	18.33	0.00	6.65	0.00	47.81
25-Dec-23	0.00	0.00	0.00	0.00	17.87		0.00	0.11	0.00	0.00	0.00	0.00	1.09	10.84	0.00	2.78	0.00	32.69
26-Dec-23	0.00	0.00	0.00	0.00	18.86		0.00	1.93	1.55	0.00	0.00	0.00	1.64	15.41	0.00	15.26	0.00	54.65
27-Dec-23	0.00	0.00	0.00	0.00	19.36		8.17	1.56	1.53	0.00	0.00	0.00	1.44	22.18	0.00	10.78	0.00	65.02
28-Dec-23	0.00	0.00	0.00	0.00	18.17		12.22	1.80	2.06	0.00	0.00	0.00	1.21	22.46	0.00	12.08	0.00	70.00
29-Dec-23	0.00	0.00	0.00	0.00	19.16		7.93	1.78	2.46	0.00	0.00	0.00	1.57	22.45	0.00	12.66	0.00	68.01
30-Dec-23	0.00	0.00	0.00	0.00	20.41		4.87	0.91	1.29	0.00	0.00	0.00	1.57	22.40	0.00	8.26	0.00	59.71
31-Dec-23	0.00	0.00	0.00	0.00	18.17		4.89	0.22	1.23	0.00	0.00	0.00	1.01	22.27	0.00	1.76	0.00	49.55
Total	0.00	0.00	0.00	0.00	533.25	0.00	161.65	44.39	38.76	0.00	0.00	0.00	30.32	657.92	0.00	292.98	0.00	1759.27

Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day

Date	15.2 Import-Export of NR with ER & NER during December 2023																		
	Import of NR from ER (ER-NR)																	Import of NR from NER (NER-NR)	
	ER - NR 765 kV Sasaram - Fatehpur	ER - NR 765 kV Gaya - Varanasi 2*5/C	ER - NR 765 kV Gaya Balia	ER - NR HVDC Alipurduar - Agra	ER-NR 400 kV Patna - Balia D/C	ER - NR 400 kV Muzaffarpur - Gorakhpur D/C	ER - NR 400 kV Biharshariff - Balia D/C	ER - NR 400 kV Motihari - Gorakhpur D/C	ER - NR 400 kV Biharshariff - Varanasi D/C	ER-NR 400 kV Sasaram - Varanasi	ER-NR 400 kV Sasaram - Allahabad	ER - NR 220 kV Sahupuri-Karamnasa	ER - NR 132 kV Sahupuri - Karamnasa	ER - NR 132 kV Rihand - Nagar Untari	NR - ER 132 kV Rihand - Garhwa	ER-NR 400 kV Naubatpur - Balia D/C	Total ER - NR	NER-NR HVDC Biswanath Chariali - Agra	Total NER-NR
1-Dec-23	7.17	10.01	12.84		0.00	7.67	4.99	5.93	4.92	0.10	1.10	0.99			0.18	12.41	68.31		0.00
2-Dec-23	6.34	11.99	10.81			7.84	3.61	5.93	4.64	0.49	0.63	0.93				9.70	62.91		0.00
3-Dec-23	6.28	9.63	10.62			7.67	3.59	5.91	3.71	0.27	0.90	0.90	0.00			9.40	58.88		0.00
4-Dec-23	6.75	13.09	11.76			7.69	4.70	5.82	3.19	0.00	1.25	0.90	0.00			10.52	65.67		0.00
5-Dec-23	7.35	13.67	10.63			7.81	3.05	6.05	4.88	0.00	1.54	1.05	0.00			9.43	65.46		0.00
6-Dec-23	8.37	15.16	10.71			8.58	4.05	6.47	5.50	0.00	1.42	0.99				9.14	70.39		0.00
7-Dec-23	9.44	15.18	12.00			8.02	4.65	7.04	6.42	0.03	1.45		1.14			11.70	77.07		0.00
8-Dec-23	9.51	16.87	12.67			9.01	5.24	7.45	4.83	0.00	1.27	1.25				12.82	80.92		0.00
9-Dec-23	9.77	18.42	12.84		0.01	9.36	5.33	7.65	5.19	0.13	1.05	1.14				12.52	83.41		0.00
10-Dec-23	8.71	16.84	12.06			9.30	5.08	7.33	4.60	0.20	1.03	1.03				12.11	78.29		0.00
11-Dec-23	9.22	16.49	12.28			9.20	4.86	7.60	4.60	0.28	0.93	1.10				11.71	78.27		0.00
12-Dec-23	10.50	19.85	13.77			9.34	5.93	7.79	5.25	0.00	1.18	1.27	0.48			12.64	88.00		0.00
13-Dec-23	10.30	18.37	14.02			8.85	5.10	7.84	5.54	0.00	1.27	1.13				13.10	85.52		0.00
14-Dec-23	9.61	17.73	13.51		0.00	8.07	5.12	7.25	4.97	0.00	1.25	0.99			0.00	12.21	80.71		0.00
15-Dec-23	9.54	17.93	12.89			7.73	4.98	7.08	4.91	0.26	0.90	1.50	0.00			12.33	80.05		0.00
16-Dec-23	7.66	15.74	12.33			9.31	5.66	7.41	3.28	0.27	0.89	1.10	0.00		0.00	12.63	76.28		0.00
17-Dec-23	5.15	12.18	12.42	0.00	0.00	8.83	5.03	6.93	3.20	0.16	1.01	0.32				9.88	65.11		0.00
18-Dec-23	6.38	14.13	13.13			8.79	5.48	7.14	6.43	0.00	1.30	0.80				11.00	74.58		0.00
19-Dec-23	7.63	14.92	13.06			9.01	5.77	7.42	6.25	0.00	1.27	1.00				11.15	77.48		0.00
20-Dec-23	8.28	14.77	14.99		0.02	8.92	6.38	9.69	8.04	0.00	1.54	1.18				14.89	88.70		0.00
21-Dec-23	8.83	17.17	13.43			10.56	6.76	9.49	7.12	0.00	1.50	1.52			0.00	15.67	92.05		0.00
22-Dec-23	9.16	18.76	13.43		3.80	9.49	6.05	9.49	8.36	0.00	1.52				0.00	13.65	93.71		0.00
23-Dec-23	8.58	12.41	9.20		10.60	7.01	5.20	7.40	6.70	0.14	0.95	1.50			0.00	9.90	79.59		0.00
24-Dec-23	7.48	11.06	10.25		9.29	7.70	3.81	7.31	5.39	0.09	1.06	1.39	0.00		0.00	9.71	74.54		0.00
25-Dec-23	8.40	16.75	11.59		10.03	9.06	4.97	8.60	7.10	0.00	1.18	1.66			0.00	11.39	90.73		0.00
26-Dec-23	9.93	19.76	12.36		12.24	9.98	5.26	9.12	7.32	0.12	1.02	1.18	0.00		0.00	9.42	97.71		0.00
27-Dec-23	3.58	15.97	12.05		11.84	9.58	4.82	9.04	6.68	0.01	1.05	2.10	0.00		0.00	9.05	85.77		0.00
28-Dec-23	8.10	13.47	9.66		7.76	7.38	1.16	7.37	4.95	0.08	1.05	0.78	0.00		0.00	7.96	69.72		0.00
29-Dec-23	9.07	14.45	10.60		7.61	8.83	2.22	7.40	6.06	0.00	1.14	1.56	0.00		0.00	7.77	76.71		0.00
30-Dec-23	9.32	16.51	10.84		8.61	10.08	2.74	8.39	5.26	0.00	1.17	1.40	0.00		0.00	8.82	83.14		0.00
31-Dec-23	8.44	15.59	10.91		8.36	9.89	3.59	8.51	5.99	0.00	1.46	1.44			0.00	8.95	83.13		0.00
Total	254.85	474.87	373.66	0.00	90.17	270.56	145.18	233.85	171.28	2.63	36.28	34.10	1.62	0.00	0.18	343.58	2432.81	0.00	0.00
Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day																			

Date	15.2 Import-Export of NR with ER & NER during December 2023																		
	Export of NR to ER (NR- ER)																	Export of NR to NER (NR-NER)	
	NR - ER 765 kV Sasaram - Fatehpur	NR - ER 765 kV Gaya - Varanasi 2*5/C	NR - ER 765 kV Gaya Ballia	NR - ER HVDC Alipurduar - Agra	NR-ER 400 kV Patna - Ballia D/C	NR - ER 400 kV Muzaffarpur - Gorakhpur D/C	NR - ER 400 kV Biharshariff - Ballia D/C	NR - ER 400 kV Motihari - Gorakhpur D/C	NR - ER 400 kV Biharshariff - Varanasi D/C	NR-ER 400 kV Sasaram - Varanasi	NR-ER 400 kV Sasaram - Allahabad	NR - ER 220 kV Sahupuri- Karamnasa	NR - ER 132 kV Sahupuri - Karamnasa	NR - ER 132 kV Rihand - Nagar Untari	NR - ER 132 kV Rihand - Garhwa	NR-ER 400 kV Ballia- Naubatpur D/C	Total NR - ER	NR-NER HVDC Biswanath Chariali - Agra	Total NR-NER
1-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00	0.00		0.00
2-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00	0.00				0.00	0.00		0.00
3-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00		0.00
4-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.10	0.00	0.00	0.48			0.00	0.58		0.00
5-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.35	0.00	0.00	0.00			0.00	0.35		0.00
6-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.40	0.00	0.00				0.00	0.40		0.00
7-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00		0.00			0.00	0.00		0.00
8-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.13	0.00	0.00				0.00	0.13		0.00
9-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				0.00	0.00		0.00
10-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00	0.00				0.00	0.00		0.00
11-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00	0.00				0.00	0.00		0.00
12-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.49	0.00	0.00	0.00			0.00	0.49		0.00
13-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.33	0.00	0.00	0.00			0.00	0.33		0.00
14-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.23	0.00	0.00			0.75	0.00	0.98		0.00
15-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00		0.00
16-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.48		0.00	0.00	0.48		0.00
17-Dec-23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				0.00	0.00		0.00
18-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.15	0.00	0.00				0.00	0.15		0.00
19-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.17	0.00	0.00				0.00	0.17		0.00
20-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.43	0.00	0.00				0.00	0.43		0.00
21-Dec-23	0.00	0.00	0.00			0.00	0.00	0.00	0.00	0.39	0.00	0.00			0.03	0.00	0.42		0.00
22-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.41	0.00				0.07	0.00	0.48		0.00
23-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			0.40	0.00	0.40		0.00
24-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.48		0.43	0.00	0.91		0.00
25-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.04	0.00	0.00			0.42	0.00	0.46		0.00
26-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.42	0.00	0.42		0.00
27-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.36	0.00	0.36		0.00
28-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.45	0.00	0.45		0.00
29-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		0.29	0.00	0.29		0.00
30-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.09	0.00	0.00	0.00		0.55	0.00	0.64		0.00
31-Dec-23	0.00	0.00	0.00		0.00	0.00	0.00	0.00	0.00	0.34	0.00	0.00			0.47	0.00	0.81		0.00
Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.05	0.00	0.00	1.44	0.00	4.64	0.00	10.13	0.00	0.00
Disclaimer:- Blank entry if the line under outage/shutdown on corresponding day																			

Date	15.3 Import and Export of ER with WR & NER during December 2023																							
	Export of WR to ER (WR-ER)								Import of WR from ER (ER - WR)								Export of ER to NER (ER-NER)				Import of ER from NER (NER-ER)			
	WR - ER 765 kV Dharamjaygarh - Ranchi 2x5/C	WR - ER 765 kV Dharamjaygarh - Jharsuguda Q/C	WR - ER 765 kV Durg - Jharsuguda D/C	WR - ER 400 kV Sipat - Ranchi D/C	WR - ER 400 kV Raigarh - Jharsuguda- 2xb/C	WR - ER 220 kV Korba - Budhipadar D/C	WR - ER 220 kV Raigarh - Budhipadar	Total WR - ER	ER - WR 765 kV Dharamjaygarh - Ranchi 2x5/C	ER-WR 765 kV Dharamjaygarh - Jharsuguda D/C	ER-WR 765 kV Durg - Jharsuguda D/C	ER - WR 400 kV Sipat - Ranchi D/C	ER - WR 400 kV Raigarh - Jharsuguda- 2xD/C	ER - WR 220 kV Korba - Budhipadara D/C	ER - WR 220 kV Raigarh - Budhipadar	Total ER - WR	ER - NER 400 kV Binaguri - Bongaigaon D/C	ER - NER 400 kV Alipurduar - Bongaigaon D/C	ER - NER 220 kV Birpara - Salakati D/C	Total ER - NER	NER - ER 400 kV Binaguri - Bongaigaon D/C	NER - ER 400 kV Alipurduar - Bongaigaon 2xD/C	NER - ER 220 kV Birpara - Salakati D/C	Total NER - ER
1-Dec-23	1.0	1.6	0.0	0.5	0.1	0.8	0.0	3.95	5.2	4.7	16.2	2.2	6.2	0.4	1.2	35.95	0.00	0.00	0.00	0.00	2.41	9.39	2.19	13.99
2-Dec-23	1.0	0.4	0.0	0.3	0.0	1.6	0.0	3.30	7.6	7.0	17.6	2.4	6.6	0.0	0.6	41.83	0.00	0.00	0.00	0.00	2.37	9.12	2.15	13.64
3-Dec-23	0.5	0.6	0.0	0.4	0.0	2.5	0.0	4.10	4.9	8.1	10.2	1.2	4.4	0.0	0.4	29.24	0.00	0.00	0.00	0.00	2.43	9.28	2.18	13.88
4-Dec-23	1.7	0.6	0.0	0.5	0.0	2.1	0.0	4.91	4.6	4.9	10.8	1.9	6.1	0.0	0.7	29.06	0.00	0.00	0.00	0.00	2.39	9.36	2.09	13.84
5-Dec-23	2.7	0.0	0.0	0.6	0.0	1.3	0.1	4.73	3.0	8.6	12.2	1.7	9.1	0.1	0.7	35.36	0.02	0.00	0.00	0.02	1.85	8.09	1.93	11.86
6-Dec-23	1.6	0.9	0.0	0.3	0.0	1.2	0.0	4.03	4.8	11.4	13.9	2.2	9.9	0.1	1.0	43.23	0.01	0.00	0.00	0.01	2.06	8.63	2.03	12.71
7-Dec-23	0.6	1.4	0.0	0.2	0.0	1.8	0.0	3.99	9.6	10.7	14.4	3.1	7.4	0.0	1.6	46.73	0.01	0.00	0.00	0.01	2.00	8.35	2.03	12.38
8-Dec-23	0.1	0.0	0.0	0.0	0.0	1.4	0.0	1.53	8.7	13.6	14.6	3.0	8.4	0.0	1.7	49.98	0.00	0.00	0.00	0.00	2.75	10.32	2.34	15.41
9-Dec-23	0.0	0.0	0.0	0.0	0.0	1.4	0.0	1.43	10.4	20.3	15.7	3.6	9.7	0.1	1.1	60.85	0.00	0.00	0.00	0.00	2.47	9.66	2.22	14.35
10-Dec-23	0.4	1.5	0.0	0.1	0.0	2.1	0.0	4.05	8.4	10.3	13.3	2.5	5.7	0.0	0.7	40.90	0.00	0.00	0.00	0.00	2.34	9.08	2.15	13.57
11-Dec-23	0.1	0.4	0.0	0.1	0.0	2.1	0.0	2.68	9.2	10.9	12.8	2.5	4.3	0.0	1.2	40.92	0.00	0.00	0.00	0.00	2.68	10.12	2.26	15.06
12-Dec-23	0.4	1.9	0.0	0.0	0.0	1.9	0.0	4.24	7.2	6.2	12.4	1.5	4.1	0.0	1.7	33.09	0.06	0.00	0.00	0.06	2.03	8.42	2.05	12.49
13-Dec-23	1.2	5.7	0.0	0.4	0.3	1.9	0.0	9.58	5.4	6.8	12.1	1.7	3.5	0.0	1.8	31.38	0.18	0.00	0.00	0.18	1.55	6.69	1.99	10.23
14-Dec-23	2.3	11.1	0.0	0.8	0.1	1.5	0.0	15.83	4.2	6.3	11.9	1.4	3.2	0.1	1.5	28.72	0.23	0.00	0.00	0.23	1.55	6.70	1.76	10.02
15-Dec-23	1.3	10.0	0.0	0.5	0.1	1.4	0.1	13.45	5.0	10.1	12.9	1.7	5.0	0.1	1.1	35.93	0.03	0.00	0.00	0.03	1.60	7.35	1.83	10.77
16-Dec-23	2.9	12.1	0.0	0.8	0.0	2.0	0.3	18.04	3.4	5.2	12.5	1.5	6.8	0.0	0.2	29.67	0.00	0.00	0.00	0.00	2.87	10.51	2.20	15.58
17-Dec-23	8.5	10.0	0.0	1.8	0.0	1.8	0.4	22.42	0.5	7.7	12.0	0.5	7.8	0.1	0.2	28.68	0.00	0.00	0.00	0.00	2.74	9.74	1.96	14.44
18-Dec-23	3.9	5.7	0.0	0.8	0.0	1.5	0.2	12.16	4.2	10.9	12.6	1.8	10.2	0.2	0.6	40.53	0.00	0.00	0.00	0.00	2.55	9.62	2.07	14.24
19-Dec-23	2.6	4.3	0.0	0.9	0.0	1.6	0.0	9.46	4.5	17.1	12.8	1.3	6.5	0.0	1.1	43.41	0.00	0.00	0.00	0.00	2.45	9.68	2.17	14.30
20-Dec-23	0.9	3.2	0.0	0.4	0.0	1.7	0.0	6.25	5.3	15.7	13.7	1.7	6.7	0.0	1.3	44.40	0.00	0.00	0.00	0.00	2.49	10.02	2.29	14.80
21-Dec-23	0.0	7.4	0.0	0.0	0.0	1.8	0.1	9.32	8.8	9.8	14.0	2.8	8.0	0.0	0.6	43.99	0.00	0.00	0.00	0.00	2.71	10.58	2.40	15.70
22-Dec-23	0.5	11.2	0.0	0.1	0.0	0.9	0.1	12.77	7.2	4.6	16.6	3.1	9.8	0.2	0.5	41.99	0.00	0.00	0.00	0.00	2.74	10.66	2.36	15.76
23-Dec-23	2.9	14.9	0.0	0.6	0.0	1.4	0.4	20.22	2.7	3.9	18.3	1.2	6.3	0.1	0.2	32.72	0.02	0.00	0.00	0.02	2.45	9.74	2.13	14.33
24-Dec-23	4.0	12.1	0.0	0.9	0.0	1.1	0.3	18.52	2.9	6.6	18.8	1.3	6.3	0.2	0.1	36.21	0.00	0.00	0.00	0.00	2.74	10.66	2.18	15.59
25-Dec-23	1.7	16.5	0.0	0.4	0.0	0.8	0.1	19.55	3.7	1.8	17.2	1.8	6.9	0.3	0.3	32.04	0.00	0.00	0.00	0.00	2.98	11.06	2.08	16.13
26-Dec-23	0.2	17.5	0.0	0.0	0.0	0.7	0.1	18.44	7.6	1.4	18.2	2.8	6.8	0.2	0.5	37.48	0.00	0.00	0.00	0.00	2.59	10.00	1.84	14.44
27-Dec-23	0.9	13.0	0.0	0.0	0.0	1.7	0.1	15.72	5.6	3.7	18.5	2.1	5.2	0.0	0.2	35.39	0.00	0.00	0.00	0.00	2.60	9.77	1.85	14.22
28-Dec-23	1.7	13.6	0.0	0.2	0.2	2.0	0.1	17.79	3.2	3.4	18.3	1.5	5.0	0.0	0.5	31.74	0.00	0.00	0.00	0.00	2.59	10.20	1.91	14.70
29-Dec-23	2.4	19.1	0.0	0.2	0.1	1.5	0.1	23.54	3.8	0.5	16.6	2.0	5.7	0.0	0.3	29.01	0.00	0.00	0.00	0.00	2.94	10.95	2.07	15.96
30-Dec-23	3.2	15.5	0.0	0.3	0.0	1.1	0.1	20.21	3.2	3.3	17.6	1.8	7.8	0.1	0.2	34.09	0.01	0.00	0.00	0.01	2.78	10.55	2.00	15.33
31-Dec-23	4.5	12.5	0.0	0.8	0.0	1.2	0.0	19.12	2.2	6.4	17.5	1.0	8.3	0.0	0.3	35.77	0.06	0.00	0.00	0.06	2.60	9.97	1.92	14.49
Total	55.89	224.71	0.00	13.05	0.99	47.92	2.74	345.30	166.96	241.82	456.27	60.55	208.02	2.35	24.30	1160.27	0.64	0.00	0.00	0.64	75.32	294.27	64.62	434.22

Date	15.4 Import and Export of SR with ER & WR during December 2023																							
	Export of ER to SR (ER - SR)				Import of ER from SR (SR - ER)				Export of WR to SR (WR-SR)							Import of WR from SR (SR - WR)								
	ER - SR HVDC Gazuwaka	ER - SR HVDC Talchar -Kolar	ER-SR 765 kV Angul- Srikakulam D/C	Total ER - SR	SR - ER HVDC Gazuwaka	SR - ER HVDC Talchar -	SR-ER 765 kV Angul- Srikakulam D/C	Total SR - ER	WR - SR HVDC Bhadrawati	WR - SR 765 kV Sholapur - Raichur 2x5/C	WR-SR 765 kV Wardha - Nizamabad D/C	WR-SR 400KV Kolhapur-Kudgi D/C	WR-SR 220kV Xeldem - Ambewadi S/C	WR-SR 220kV Ponda - Ambewadi S/C	Total WR - SR	SR - WR HVDC Bhadrawati	SR - WR 765 kV Raichur - Sholapur 2x5/C	SR-WR 765 kV Wardha - Nizamabad D/C	SR-WR 400KV Kolhapur- Kudgi D/C	SR-WR HVDC Raigarh- Puglur	WR-SR 220kV Xeldem - Ambewadi S/C	WR-SR 220kV Ponda - Ambewadi S/C	Total SR - WR	
1-Dec-23	16.17	46.27	50.40	112.84	0.00	0.00	0.00	0.00	14.35	11.46	37.32	0.00	56.52	2.15	0.00	121.80	0.00	1.11	0.00	15.00	0.00	0.00	0.00	16.11
2-Dec-23	16.16	48.14	49.05	113.35	0.00	0.00	0.00	0.00	23.91	8.92	34.49	0.00	69.71	2.14	0.00	139.18	0.00	3.41	0.00	17.97	0.00	0.00	0.00	21.38
3-Dec-23	16.18	47.69	45.07	108.94	0.00	0.00	0.00	0.00	23.38	7.69	29.98	0.00	67.31	2.14	0.00	130.50	0.00	7.51	0.00	19.27	0.00	0.00	0.00	26.78
4-Dec-23	16.27	39.73	47.38	103.38	0.00	0.00	0.00	0.00	11.34	6.70	35.85	0.00	42.67	2.17	0.00	98.73	0.00	0.78	0.00	16.61	0.00	0.00	0.00	17.40
5-Dec-23	16.35	39.61	48.28	104.24	0.00	0.00	0.00	0.00	7.27	10.92	34.41	0.00	27.77	2.12	0.00	82.49	0.00	0.21	0.00	14.68	0.00	0.00	0.00	14.89
6-Dec-23	16.29	36.98	49.67	102.94	0.00	0.00	0.00	0.00	8.38	12.06	33.67	0.00	39.19	2.15	0.00	95.45	0.00	1.84	0.00	16.08	0.00	0.00	0.00	17.93
7-Dec-23	14.34	47.76	51.10	113.20	0.00	0.00	0.00	0.00	20.52	11.23	33.55	0.00	64.41	2.07	0.00	131.78	0.00	4.88	0.00	17.60	0.00	0.00	0.00	22.47
8-Dec-23	12.35	46.54	49.44	108.33	0.00	0.00	0.00	0.00	23.51	8.17	29.00	0.00	57.37	2.14	0.00	120.21	0.00	3.01	0.00	18.69	0.00	0.00	0.00	21.70
9-Dec-23	12.35	38.24	51.62	102.21	0.00	0.00	0.00	0.00	21.04	8.60	29.97	0.00	55.87	2.25	0.00	117.72	0.00	2.20	0.00	18.62	0.00	0.00	0.00	20.82
10-Dec-23	12.37	34.06	47.22	93.65	0.00	0.00	0.00	0.00	15.04	4.70	27.04	0.00	46.09	2.15	0.00	95.01	0.00	6.26	0.00	20.01	0.00	0.00	0.00	26.27
11-Dec-23	12.37	40.62	44.68	97.67	0.00	0.00	0.00	0.00	13.42	3.16	25.86	0.00	63.23	2.18	0.00	107.86	0.00	6.68	0.00	21.00	0.00	0.00	0.00	27.68
12-Dec-23	12.36	40.31	45.56	98.22	0.00	0.00	0.00	0.00	21.00	1.45	24.26	0.00	58.18	2.18	0.00	107.07	0.00	8.57	0.00	22.99	0.00	0.00	0.00	31.56
13-Dec-23	12.35	32.59	43.65	88.59	0.00	0.00	0.00	0.00	22.89	1.72	23.04	0.00	61.66	2.08	0.00	111.39	0.00	10.56	0.00	23.94	0.00	0.00	0.00	34.50
14-Dec-23	12.35	39.67	44.95	96.97	0.00	0.00	0.00	0.00	23.96	2.45	23.92	0.00	57.57	2.07	0.00	109.96	0.00	10.63	0.00	24.60	0.00	0.00	0.00	35.23
15-Dec-23	12.35	46.86	47.32	106.52	0.00	0.00	0.00	0.00	24.14	3.36	24.17	0.00	66.59	2.08	0.00	120.34	0.00	6.41	0.00	22.88	0.00	0.00	0.00	29.29
16-Dec-23	12.30	46.91	52.47	111.69	0.00	0.00	0.00	0.00	24.13	8.43	33.92	0.00	23.34	1.59	0.00	91.41	0.00	1.76	0.00	18.86	0.00	0.00	0.00	20.61
17-Dec-23	12.25	43.61	47.66	103.51	0.00	0.00	0.00	0.00	24.12	2.30	27.87	0.00	10.31	0.88	0.00	65.47	0.00	6.44	0.00	20.50	0.00	0.00	0.00	26.94
18-Dec-23	4.58	41.36	47.77	93.70	0.00	0.00	0.00	0.00	24.12	4.43	25.27	0.00	53.00	0.61	0.00	107.44	0.00	5.08	0.00	20.77	0.00	0.00	0.00	25.85
19-Dec-23	0.04	43.74	44.45	88.23	0.00	0.00	0.00	0.00	24.17	2.01	21.01	0.00	88.79	1.98	0.00	137.97	0.00	9.38	0.00	22.90	0.00	0.00	0.00	32.29
20-Dec-23	0.04	39.76	48.73	88.53	0.00	0.00	0.00	0.00	16.78	2.73	26.31	0.00	80.01	2.08	0.00	127.91	0.00	5.88	0.00	23.05	0.00	0.00	0.00	28.93
21-Dec-23	0.04	38.65	46.39	85.08	0.00	0.00	0.00	0.00	20.90	2.67	25.16	0.00	86.39	2.16	0.00	137.28	0.00	7.54	0.00	23.15	0.00	0.00	0.00	30.69
22-Dec-23	0.03	40.84	51.46	92.32	0.00	0.00	0.00	0.00	22.39	6.00	30.23	0.00	56.90	2.15	0.00	117.67	0.00	4.87	0.00	21.01	0.00	0.00	0.00	25.88
23-Dec-23	0.04	41.22	51.16	92.42	0.00	0.00	0.00	0.00	21.43	4.37	29.18	0.00	65.06	2.13	0.00	122.17	0.00	5.58	0.00	22.11	0.00	0.00	0.00	27.69
24-Dec-23	0.04	36.16	50.23	86.42	0.00	0.00	0.00	0.00	22.49	2.83	22.37	0.00	54.03	2.06	0.00	103.78	0.00	5.68	0.00	24.01	0.00	0.00	0.00	29.69
25-Dec-23	0.00	33.08	55.54	88.61	0.00	0.00	0.00	0.00	13.34	10.18	28.68	0.00	25.30	1.93	0.00	79.43	0.00	3.13	0.00	19.98	0.00	0.00	0.00	23.11
26-Dec-23	0.00	30.13	54.89	85.01	0.00	0.00	0.00	0.00	12.14	8.99	31.01	0.00	39.24	1.94	0.00	93.32	0.00	3.99	0.00	20.94	0.00	0.00	0.00	24.94
27-Dec-23	0.00	42.10	49.90	92.00	0.00	0.00	0.00	0.00	21.93	3.91	24.41	0.00	65.33	1.89	0.00	117.48	0.00	9.85	0.00	24.69	0.00	0.00	0.00	34.55
28-Dec-23	0.00	38.03	49.53	87.56	0.00	0.00	0.00	0.00	16.79	4.76	28.88	0.00	64.91	1.90	0.00	117.24	0.00	6.84	0.00	24.02	0.00	0.00	0.00	30.86
29-Dec-23	0.00	39.47	50.10	89.56	0.00	0.00	0.00	0.00	11.53	7.61	31.46	0.00	45.03	1.89	0.00	97.52	0.00	6.27	0.00	22.40	0.00	0.00	0.00	28.67
30-Dec-23	0.00	39.76	50.62	90.38	0.00	0.00	0.00	0.00	19.15	7.84	19.43	0.00	49.42	2.15	0.00	97.98	0.00	7.85	0.00	22.65	0.00	0.00	0.00	30.50
31-Dec-23	0.00	37.44	46.78	84.23	0.00	0.00	0.00	0.00	24.21	3.96	21.32	0.00	55.82	2.07	0.00	107.37	0.00	11.71	0.00	21.99	0.00	0.00	0.00	33.70
TOTAL	239.96	1257.33	1513.04	3010.33	0.00	0.00	0.00	0.00	593.74	185.60	873.02	0.00	1697.06	61.47	0.04	3410.93	0.00	175.90	0.00	642.95	0.00	0.00	0.02	818.88

16. भूटान , नेपाल, बांग्लादेश एवं म्यान्मार के साथ अंतरराष्ट्रीय विद्युत विनिमय

अप्रैल 2023 से मार्च 2024 April 2023 to March 2024

अंतरराष्ट्रीय विद्युत विनिमय [भारत 'से निर्यात'/'को आयात']

Transnational Exchange ('Export from'/'Import to' India)

माह MONTH	भूटान BHUTAN		नेपाल NEPAL		बांग्लादेश BANGLADESH		म्यान्मार MYANMAR	
	Energy Exported (In MU)	Energy Imported (In MU)	Energy Exported (In MU)	Energy Imported (In MU)	Energy Exported (In MU)	Energy Imported (In MU)	Energy Exported (In MU)	Energy Imported (In MU)
अप्रैल 2023 APR'23	19.40	41.40	357.99	0.00	687.30	0.00	0.73	0.00
मई 2023 MAY'23	2.27	117.99	271.80	0.34	775.10	0.00	0.61	0.00
जून 2023 JUN'23	0.00	626.15	80.00	88.86	743.92	0.00	0.77	0.00
जुलाई 2023 JUL'23	0.00	1291.66	0.00	223.72	780.77	0.00	1.02	0.00
अगस्त 2023 AUG'23	0.00	1244.52	0.00	281.61	767.79	0.00	0.94	0.00
सितंबर 2023 SEP'23	0.00	924.25	0.00	323.59	754.88	0.00	0.77	0.00
अक्टूबर 2023 OCT'23	0.00	588.64	0.00	460.97	755.92	0.00	0.84	0.00
नवंबर 2023 NOV'23	51.41	36.77	0.00	271.72	628.24	0.00	0.72	0.00
दिसम्बर 2023 DEC'23	212.51	0.00	88.76	5.09	593.51	0.00	0.70	0.00
कुल Total	285.59	4871.38	798.54	1655.89	6487.43	0.00	7.10	0.00

* Based on daily operational data

Date	16.1 Import from neighbouring countries during December 2023													
	(All figures in MU)													
	Import from Bhutan								Import from Bangladesh		Import from Nepal			Import from Myanmar
	400 kV Tala-Binaguri I,II & IV	400 kV Binaguri-Malbase	220 kV Birpara-Chuka D/C	220 kV Birpara-Malbase	400 kV Punatsanchu-Alipurwar D/C*	400 kV Jigmeling-Alipurwar D/C	132 kV Rangia-Motanga	132 kV Salakati-Gelephu	400 kV Behrampur-Bheramara 1,2,3&4	132 kV Surjyamaninagar-Comilla D/C	132 kV Tanakpur-Mahendranagar	400 kV Muzaffarpur-Dhalkebar	From BIHAR Source	11 kV Moreh-Tamu
1-Dec-23	6.11	0.00	0.00	0.00	0.00	0.00	0.05	0.00	0.00	0.00	0.10	1.23	0.00	0.00
2-Dec-23	6.25	0.00	0.00	0.00	0.00	0.00	0.06	0.00	0.00	0.00	0.36	1.47	0.00	0.00
3-Dec-23	6.58	0.00	0.00	0.00	0.00	0.00	0.07	0.00	0.00	0.00	0.30	0.89	0.00	0.00
4-Dec-23	6.18	0.00	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.13	0.00	0.00	0.00
5-Dec-23	5.35	0.00	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.14	0.00	0.00
6-Dec-23	5.16	0.00	0.00	0.00	0.00	0.00	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00
7-Dec-23	5.88	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8-Dec-23	5.58	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
9-Dec-23	6.50	0.00	0.00	0.00	0.00	0.00	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00
10-Dec-23	5.90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
11-Dec-23	3.34	0.00	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12-Dec-23	1.36	0.47	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00
13-Dec-23	1.02	0.22	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00
14-Dec-23	0.75	0.00	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00
15-Dec-23	0.85	0.12	0.00	0.00	0.00	0.00	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00
16-Dec-23	1.27	0.63	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
17-Dec-23	1.37	0.79	0.00	0.00	0.00	0.00	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00
18-Dec-23	1.01	0.33	0.00	0.00	0.00	0.00	0.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00
19-Dec-23	1.42	0.63	0.00	0.00	0.00	0.00	0.22	0.00	0.00	0.00	0.00	0.00	0.00	0.00
20-Dec-23	0.99	0.21	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00
21-Dec-23	0.93	0.17	0.00	0.00	0.00	0.00	0.12	0.00	0.00	0.00	0.00	0.00	0.00	0.00
22-Dec-23	1.12	0.35	0.00	0.00	0.00	0.00	0.12	0.00	0.00	0.00	0.00	0.00	0.00	0.00
23-Dec-23	0.78	0.07	0.00	0.00	0.00	0.00	0.12	0.00	0.00	0.00	0.00	0.00	0.00	0.00
24-Dec-23	0.30	0.00	0.00	0.00	0.00	0.00	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00
25-Dec-23	0.08	0.00	0.00	0.00	0.00	0.00	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00
26-Dec-23	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
27-Dec-23	0.04	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00
28-Dec-23	0.00	0.00	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00
29-Dec-23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
30-Dec-23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
31-Dec-23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total	76.20	3.98	0.00	0.00	0.00	0.00	1.79	0.00	0.00	0.00	0.89	3.73	0.00	0.00
Based on SEM/Energy meter data for links where available (*Mangdechu generation receipt at APD through a bypassed arrangement at 400kV Punatsanchu station)														

Date	16.2 Export to neighbouring countries during December 2023													
	(All figures in MU)													
	Export to Bhutan								Export to Bangladesh		Export to Nepal			Export to Myanmar
	400 kV Tala-Binaguri I,II & IV	400 kV Binaguri-Malbase	220 kV Birpara-Chuka D/C	220 kV Birpara-Malbase	400 kV Punatsanchu-Alipurwar D/C*	400 kV Jigmeling-Alipurwar D/C	132 kV Rangia-Motanga	132 kV Salakati-Gelephu	400 kV Behrampur-Bheramara 1,2,3&4	132 kV Surjyamaninagar-Comilla D/C	132 kV Tanakpur-Mahendranagar	400 kV Muzaffarpur-Dhalkebar	From BIHAR Source	11 kV Moreh-Tamu
1-Dec-23	0.00	2.93	3.29	2.78	0.92	0.84	0.00	0.56	19.95	2.35	0.00	0.00	0.00	0.02
2-Dec-23	0.00	2.91	3.25	2.81	1.48	0.00	0.00	0.56	12.29	2.47	0.00	0.00	0.00	0.02
3-Dec-23	0.00	2.90	3.32	2.87	1.55	0.00	0.00	0.56	10.92	2.44	0.00	0.00	0.00	0.03
4-Dec-23	0.00	2.75	3.41	2.64	1.89	0.00	0.00	0.60	10.57	2.65	0.00	0.33	0.00	0.02
5-Dec-23	0.00	3.08	3.42	2.88	2.39	0.00	0.00	0.59	10.62	2.42	0.03	0.00	0.00	0.02
6-Dec-23	0.00	2.57	3.51	2.20	2.10	0.00	0.00	0.59	14.49	2.16	0.24	0.48	0.00	0.02
7-Dec-23	0.00	2.93	3.27	2.45	1.90	0.00	0.09	0.55	19.77	2.13	0.39	1.77	0.00	0.02
8-Dec-23	0.00	2.75	3.08	2.60	1.99	0.00	0.02	0.63	15.40	1.86	0.30	1.70	0.00	0.02
9-Dec-23	0.00	2.87	3.17	2.66	2.07	0.00	0.00	0.61	18.45	2.06	0.39	0.55	0.00	0.02
10-Dec-23	0.00	2.92	3.30	2.79	1.76	0.00	0.01	0.58	20.05	2.07	0.45	0.94	0.00	0.02
11-Dec-23	0.00	0.25	3.14	2.52	2.10	0.00	0.00	0.49	19.42	2.00	0.45	1.19	0.00	0.02
12-Dec-23	0.00	0.00	3.14	2.36	2.48	0.00	0.00	0.61	19.28	2.00	0.52	1.63	0.00	0.02
13-Dec-23	0.00	0.00	3.14	2.29	2.63	0.00	0.00	0.06	18.82	1.89	0.61	2.90	0.00	0.02
14-Dec-23	0.00	0.03	3.28	2.53	2.42	0.00	0.00	0.41	18.49	1.96	0.92	2.87	0.00	0.02
15-Dec-23	0.00	0.00	3.24	2.42	2.49	0.00	0.00	0.44	14.57	1.78	0.91	2.81	0.00	0.02
16-Dec-23	0.00	0.00	2.63	2.34	1.11	0.68	0.03	0.55	16.47	1.81	0.81	1.91	0.00	0.02
17-Dec-23	0.00	0.00	1.83	2.17	0.56	0.80	0.00	0.48	18.94	1.96	0.90	2.47	0.00	0.02
18-Dec-23	0.00	0.00	2.58	2.31	0.77	1.12	0.00	0.52	18.23	2.14	0.91	3.60	0.00	0.02
19-Dec-23	0.00	0.00	3.06	2.36	0.35	1.98	0.00	0.57	17.98	2.16	0.94	4.15	0.00	0.02
20-Dec-23	0.00	0.00	3.35	2.50	0.00	2.60	0.00	0.56	17.41	1.99	0.44	4.49	0.00	0.02
21-Dec-23	0.00	0.00	3.39	2.57	0.00	2.64	0.00	0.60	17.10	2.07	0.00	4.92	0.00	0.02
22-Dec-23	0.00	0.00	3.38	2.49	0.00	2.69	0.00	0.62	14.41	2.08	0.00	5.03	0.00	0.02
23-Dec-23	0.00	0.00	3.33	2.41	0.00	2.68	0.00	0.60	16.99	2.30	0.05	3.63	0.00	0.02
24-Dec-23	0.00	0.58	3.07	1.86	0.00	3.16	0.00	0.67	19.19	2.42	0.38	3.81	0.00	0.02
25-Dec-23	0.00	0.95	2.75	1.41	0.72	2.24	0.00	0.56	17.09	2.14	1.22	3.37	0.00	0.01
26-Dec-23	0.00	0.97	2.60	1.37	1.16	1.70	0.13	0.79	18.96	2.29	1.03	2.81	0.00	0.02
27-Dec-23	0.00	1.01	2.71	1.46	1.27	1.91	0.00	0.68	18.91	2.34	0.86	2.83	0.00	0.02
28-Dec-23	0.08	1.12	2.80	1.42	1.32	1.97	0.00	0.70	18.79	2.17	0.97	3.82	0.00	0.02
29-Dec-23	0.01	1.03	2.70	1.46	1.16	1.71	0.17	0.73	15.18	1.91	1.11	3.54	0.00	0.02
30-Dec-23	0.02	1.07	2.78	1.47	1.24	1.85	0.10	6.80	16.80	2.02	0.85	2.83	0.00	0.02
31-Dec-23	0.22	1.27	2.85	1.55	1.30	1.93	0.11	0.70	19.30	2.06	0.98	3.26	0.00	0.02
Total	0.33	36.87	94.78	69.96	41.15	32.49	0.66	23.97	524.83	66.11	16.64	73.65	0.02	0.70

Based on SEM/Energy meter data for links where available (*Mangdechu generation receipt at APD through a bypassed arrangement at 400kV Punatsanchu station)

17. एसटीओए (द्विपक्षीय एवं सामूहिक) एवं डी एस एम बिलिंग का ब्योरा – दिसंबर 2023

STOA (BILATERAL AND COLLECTIVE) & DSM BILLING DETAILS - NOVEMBER 2023

द्विपक्षीय एसटीओए BILATERAL SHORT TERM OPEN ACCESS

दिसंबर 2023	DECEMBER 2023		Apr'23- DEC'23	
नोडल क्षे.भा.प्रे.के. का नाम Name of Nodal RLDC	अनुमोदित लेन – देनों की संख्या No. of Approved Transactions	अनुमोदित ऊर्जा (मि.यु.) Energy Approved(MU)	अनुमोदित लेन – देनों की संख्या No. of Approved Transactions	अनुमोदित ऊर्जा (मि.यु.) Energy Approved (MU)
ऊ. क्षे. NR	129	1204	8100	32774
प.क्षे. WR	368	1353	8362	17403
द.क्षे. SR	307	840	7543	19580
पू.क्षे. ER	131	217	5254	6382
पूर्वोत्तर क्षे. NER	98	35	1115	502
कुल TOTAL	1033	3649	30374	76641

एसटीओए SHORT TERM OPEN ACCESS

	सामूहिक एसटीओए Collective STOA		द्विपक्षीय एसटीओए Bilateral STOA	
माह MONTH	क्रेताओं / विक्रेताओं की सं. NO. of Buyers/Sellers	अनुमोदित ऊर्जा (मि.यु.) Approved Energy (MU)	अनुमोदित लेन – देनों की संख्या No. of Approved Transactions	अनुमोदित ऊर्जा (मि.यु.) Approved Energy (MU)
अप्रैल 2023 Apr'23	5580	6941	3322	9714
मई 2023 May'23	5798	6626	3469	8418
जून 2023 Jun'23	5783	6966	3925	10583
जुलाई 2023 Jul'23	6428	6719	3872	10780
अगस्त 2023 Aug'23	5954	6805	4841	12338
सितंबर 2023 Sep'23	6440	6506	4481	12402
अक्टूबर 2023 Oct'23	6571	7388	4658	5866
नवंबर 2023 Nov'23	7848	7741	773	2892
दिसम्बर 2023 Dec'23	8441	7397	1033	3649
कुल TOTAL	58843	63089	30374	76641

मासिक डी एस एम बिलिंग का ब्योरा* 2023-24
MONTHLY DSM BILLING DETAILS* 2023-24

अनंतिम आँकड़े
Provisional data
subject to change
करोड़ रु. में (RS. IN CRORES)

क्षेत्र REGION →	उत्तरी क्षेत्र NORTH	पश्चिमी क्षेत्र WEST	दक्षिणी क्षेत्र SOUTH	पूर्वी क्षेत्र EAST	पूर्वोत्तर क्षेत्र NORTH EAST
सप्ताह WEEK ↓					
27.11.23 to 03.12.23	78.08	173.17	221.92	163.23	47.71
04.12.23 to 10.12.23	94.15	149.60	185.43	145.45	52.18
11.12.23 to 17.12.23	103.24	203.74	259.81	208.91	63.37
18.12.23 to 24.12.23	137.03	210.17	233.03	202.20	70.20
25.12.23 to 31.12.23	109.60	207.64	252.42	219.33	75.55

* Amount shown is Payable to DSM pool ^Provisional Data

18. पावर मार्केट की सूचना (स्रोत : आई.ई.एक्स. एवं पी.एक्स.आई.एल.)
POWER MARKET INFORMATION (Source IEX & PXIL)
पावर एक्स्चेंज के माध्यम से विनिमय – माह:- दिसंबर 2023
EXCHANGES THROUGH POWER EXCHANGES - DECEMBER 2023

क्र. स. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU	
			(DAM+HP DAM+RTM)	
1	Chandigarh (UT)	उत्तरी क्षेत्र NR	52.59	8.54
2	Delhi		417.67	573.98
3	Haryana		359.12	485.80
4	Himachal Pradesh		383.07	128.91
5	Jammu Kashmir		125.57	1348.72
6	North Central Railway Prayagraj		0.00	124.17
7	Punjab		26.37	2180.42
8	Rajasthan		1284.89	509.81
9	SHREE CEMENT LIMITED TPS		54.79	0.00
10	Uttar Pradesh		2974.12	1849.32
11	Uttarakhand		78.94	702.76
12	NEPAL ELECTRICITY AUTHORITY TANAKPUR		9.03	48.05
13	ALTRA XERGI POWER PRIVATE LIMITED		37.43	0.00
14	AD HYDRO POWER LIMITED		64.32	0.00
15	ADANI SOLAR ENERGY JAISALMER TWO PRIVATE LIMITED(Project-2)		60.17	0.00
16	ADANI SOLAR ENERGY JODHPUR TWO LIMITED		37.64	0.00
17	Budhil HEP (Greenko Budhil Hydro Power Pvt. Ltd.)		2.65	0.00
18	IGSTPS JHAJJAR		8.28	0.00
19	KARCHAM WANGTOO HYDRO ELECTRIC PLANT.		79.52	0.00
20	NEA Nepal Upper Chameliya Hydropower Project		0.00	0.00
21	NEA Nepal Upper Kalangagad Hydropower Project		0.00	0.00
22	NTPC Dadri Stage I		26.84	0.00
23	NTPC Dadri Stage II		10.93	0.00
24	NTPC Rihand stage I		66.98	0.00
25	NTPC Rihand stage II		48.68	0.00
26	NTPC Rihand stage III		60.82	0.00
27	NTPC Singrauli		31.90	0.00
28	NTPC Tanda Stage II		15.13	0.00
29	NTPC Unchahar Stage I		0.14	0.00
30	NTPC Unchahar Stage II		7.39	0.00
31	NTPC Unchahar Stage III		1.62	0.00
32	NTPC Unchahar Stage IV		9.57	0.00
33	PARBATI II HE PROJECT		0.00	0.00
34	ReNew Surya Ravi Private Limited		134.14	0.00
35	Sainj HEP		27.16	0.06
36	Singoli Bhatwari HEP		37.56	0.00
37	Sorang HEP (Himachal Sorang Power Pvt. Ltd.))		35.92	0.00
38	Amp Energy Green Six Private Limited		21.31	0.00

18. पावर मार्केट की सूचना (स्रोत : आई.ई.एक्स. एवं पी.एक्स.आई.एल.)
POWER MARKET INFORMATION (Source IEX & PXIL)
पावर एक्स्चेंज के माध्यम से विनिमय – माह:- दिसंबर 2023
EXCHANGES THROUGH POWER EXCHANGES - DECEMBER 2023

क्र. स. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU	
			(DAM+HP DAM+RTM)	
39	ACB (INDIA) LIMITED	पश्चिमी क्षेत्र WR	422.05	1.06
40	Adani Power Limited-Raipur TPP		503.53	2.53
41	ArcelorMittal Nippon Steel India Limited		0.00	702.28
42	BHARAT ALUMINIUM COMPANY LTD (Bulk Consumer)		0.00	61.50
43	Chhattisgarh		2880.60	29.59
44	Daman and Diu - Dadra and Nagar Haveli		4.96	360.99
45	Goa WR		14.28	51.15
46	Gujarat		550.59	2968.77
47	Jhabua Power Limited		146.26	0.00
48	Jindal Power Limited, Stage-1		373.50	0.00
49	Jindal Power Limited, Stage-2		432.07	6.01
50	Jindal Steel & Power Ltd , DCP		260.12	22.52
51	Madhya Pradesh		3084.33	302.00
52	MAHAN ENERGEN LIMITED.		1831.44	8.50
53	Maharashtra		630.54	2107.32
54	Maruti Clean Coal and Power Limited		50.21	0.99
55	MB POWER (MADHYA PRADESH) LIMITED		50.97	107.31
56	NTPC Jhanor Gandhar GPS		0.00	4.08
57	NTPC Kawas GPS		0.00	2.75
58	Ratnagiri Gas & Power Private Limited		0.00	3.08
59	SKS Power Generation Chhattisgarh Limited		169.07	0.01
60	NTPC SOLAPUR SOLAR PV Station		1.94	0.00
61	Adani Power Limited - Raigarh TPP		987.82	0.00
62	ADANI WIND ENERGY KUTCHH FOUR Ltd. Nakhatrana		236.69	0.00
63	BHARAT ALUMINIUM COMPANY LTD		48.42	0.00
64	CONTINUUM POWER TRADING (TN) PRIVATE LIMITED		54.54	0.00
65	D B Power Limited		812.73	0.00
66	Dhariwal ISTS		5.94	0.04
67	DHARIWAL STU OTH		0.00	0.00
68	GMR Warora Energy Limited		56.88	0.00
69	INOX GREEN ENERGY SERVICES LIMITED		6.35	0.00
70	Jaypee Nigrie Super Thermal Power Plant		345.27	4.86
71	NREL-Dayapar Wind		22.45	0.00
72	NTPC Gadawara		27.58	0.00
73	NTPC khargone		22.02	0.00
74	NTPC Korba Stage I &II		4.24	0.00
75	NTPC Korba Stage III		0.91	0.00
76	NTPC Lara Stage I		5.07	0.00

18. पावर मार्केट की सूचना (स्रोत : आई.ई.एक्स. एवं पी.एक्स.आई.एल.)
POWER MARKET INFORMATION (Source IEX & PXIL)
पावर एक्स्चेंज के माध्यम से विनिमय – माह:- दिसंबर 2023
EXCHANGES THROUGH POWER EXCHANGES - DECEMBER 2023

क्र. स. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU	
			(DAM+HP DAM+RTM)	
77	NTPC Mouda Stage I		15.20	0.00
78	NTPC Mouda Stage II		22.68	0.00
79	NTPC SAIL POWER COMPANY LIMITED		0.21	0.00
80	NTPC Sipat Stage I		17.06	0.00
81	NTPC Sipat Stage II		11.79	0.00
82	NTPC Solapur		20.95	0.00
83	NTPC Vindhyachal Stage I		21.58	0.00
84	NTPC Vindhyachal Stage II		21.31	0.00
85	NTPC Vindhyachal Stage III		19.12	0.00
86	NTPC Vindhyachal Stage IV		22.74	0.00
87	NTPC Vindhyachal Stage V		18.32	0.00
88	R.K.M POWERGEN PRIVATE LIMITED		47.15	0.00
89	Sasan Power Limited		24.98	0.00
90	The Tata Power Co Ltd (MTPS)		29.95	0.00
91	TRN ENERGY PRIVATE LIMITED		40.70	0.00
92	WIND FIVE RENERGY LIMITED		30.38	0.00
93	Andhra Pradesh	दक्षिणी क्षेत्र SR	242.60	1933.32
94	Goa SR		0.00	7.91
95	Karnataka		0.90	464.08
96	Kerala		37.22	1524.96
97	NLC INDIA LIMITED NEYVELI NEW THERMAL POWER STATION		5.28	0.00
98	SIMHAPURI ENERGY LIMITED		42.31	116.54
99	Tamil Nadu		251.21	1498.68
100	Telangana		241.01	5541.23
101	COASTAL ENERGEN PRIVATE LIMITED		0.00	0.00
102	IL&FS TAMIL NADU POWER COMPANY LIMITED		32.13	0.00
103	NLC INDIA LIMITED THERMAL POWER STATION I EXPANSION		2.54	0.00
104	NLC INDIA LIMITED THERMAL POWER STATION II EXPANSION		7.44	0.00
105	NLC INDIA LIMITED THERMAL POWER STATION II STAGE I		10.68	0.00
106	NLC INDIA LIMITED THERMAL POWER STATION II STAGE II		9.96	0.00
107	NLC Tamilnadu Power Limited		46.41	0.00
108	NTECL VALLUR		12.58	0.05
109	NTPC KUDGI		14.58	0.00
110	NTPC Ramagundam Stage I &II		19.68	0.00
111	NTPC Ramagundam Stage III		7.48	0.00
112	NTPC Simhadri Stage I		0.96	0.00
113	NTPC Simhadri Stage II		10.08	0.00
114	NTPC Talcher Super Thermal Power Station Stage II		12.44	0.00

18. पावर मार्केट की सूचना (स्रोत : आई.ई.एक्स. एवं पी.एक्स.आई.एल.)
POWER MARKET INFORMATION (Source IEX & PXIL)
पावर एक्स्चेंज के माध्यम से विनिमय – माह:- दिसंबर 2023
EXCHANGES THROUGH POWER EXCHANGES - DECEMBER 2023

क्र. स. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU	
			(DAM+HP DAM+RTM)	
115	OSTRO KANNADA POWER PRIVATE LIMITED		85.41	0.00
116	Pondicherry UT		277.07	0.00
117	Ramagundam Floating solar		24.13	0.00
118	RENEW SURYA ROSHNI PRIVATE LIMITED Koppal PS		92.81	0.00
119	SEIL ENERGY INDIA LIMITED		0.00	0.00
120	SEIL Energy India Limited Project II		488.14	0.00
121	Simhadri Floating solar (10 MW)		5.05	0.00
122	Simhadri FSP 15 MW		6.20	0.00
123	NTPC Telangana		3.10	0.00
124	Ayana Renewable Power Six Private Limited		30.74	0.00
125	Bihar	पूर्वी क्षेत्र ER	1759.34	3.88
126	Damodar Valley Corporation		161.85	581.92
127	Jharkhand		193.72	106.40
128	Odisha		1297.82	809.57
129	Sikkim		51.92	17.86
130	West Bengal		653.42	737.21
131	ADHUNIK POWER & NATURAL RESOURCES LIMITED		19.05	0.00
132	Basochhu Hydropower Plant Bhutan		0.00	0.00
133	Chilime Hydro Power Project NEPAL ELECTRICITY AUTHORITY		0.00	0.00
134	Chuzachen HEP		0.00	0.00
135	DEVIGHAT NEPAL ELECTRICITY AUTHORITY		0.00	0.00
136	GMR KAMALANGA ENERGY LTD-CTU		0.12	0.00
137	Jindal India Thermal Power Limited		1163.51	0.00
138	JORETHANG LOOP HEP, DANS ENERGY PRIVATE LIMITED		0.00	0.00
139	Druk Green Power Corporation Limited (DGPC- Bhutan)		0.00	1019.29
140	Kabeli B-1 Hydro Power Project NEPAL ELECTRICITY AUTHORITY		0.00	0.00
141	KALI GANDAKI NEPAL ELECTRICITY AUTHORITY		0.00	0.00
142	KANTI BIJLEE UTPADAN NIGAM LIMITED		5.60	0.00
143	LIKHU-IV NEA		0.00	0.00
144	Lower Modi Hydro Power Project NEPAL ELECTRICITY AUTHORITY		0.00	0.00
145	MARSYANGDI NEPAL ELECTRICITY AUTHORITY		0.00	0.00
146	NABINAGAR POWER GENERATING COMPANY LIMITED		76.05	0.00
147	NEA Nepal Upper Dordi A Hydropower Project		0.00	0.00
148	NEPAL ELECTRICITY AUTHORITY-MIDDLE MARSYANGDI		0.00	0.00
149	NEPAL ELECTRICITY AUTHORITY MUZAFFARPUR		41.40	296.47
150	NTPC BARH Stage I		24.36	0.00
151	NTPC BARH Stage II		171.13	0.00
152	NTPC Darlipali		30.74	0.00

18. पावर मार्केट की सूचना (स्रोत : आई.ई.एक्स. एवं पी.एक्स.आई.एल.)
POWER MARKET INFORMATION (Source IEX & PXIL)
पावर एक्स्चेंज के माध्यम से विनिमय – माह:- दिसंबर 2023
EXCHANGES THROUGH POWER EXCHANGES - DECEMBER 2023

क्र. स. S. No.	क्षेत्रीय इकाई Regional Entity	क्षेत्र Region	पावर एक्स्चेंज के माध्यम से (मि.यु. मे) Through Power Exchange in MU	
			(DAM+HP DAM+RTM)	
153	NTPC Farakka stage I		38.87	0.00
154	NTPC Farakka stage III		32.69	0.00
155	NTPC Kahalgaon stage I		40.73	0.00
156	NTPC Kahalgaon stage II		43.09	0.00
157	NTPC North Karanpura STPS		0.33	0.00
158	NTPC Talcher Stage I		3.45	0.00
159	Solu Hydropower Project NEPAL ELECTRICITY AUTHORITY		0.00	0.00
160	Tashiding HEP, Shiga Energy Private Limited		0.00	0.00
161	TRISHULI NEPAL ELECTRICITY AUTHORITY		0.00	0.00
162	Tashiding HEP; Shiga Energy Private Limited		1.02	0.00
163	JORETHANG LOOP HEP; DANS ENERGY PRIVATE LIMITED		3.02	0.00
164	NTPC North Karanpura STPS infirm (UNIT # 2)		24.38	0.00
165	AGARTALA GAS BASED POWER STATION	पूर्वोत्तर क्षेत्र NER	0.00	0.00
166	Arunachal Pradesh		25.99	23.35
167	Assam		404.76	25.25
168	KAMENG HYDRO POWER STATION		40.54	0.00
169	Manipur		9.00	15.65
170	Meghalaya		22.29	149.50
171	Tripura		134.42	1.57
172	ASSAM GAS BASED POWER STATION		6.42	0.00
173	Bongaigaon Thermal Power Station NTPC		25.28	0.00
174	Doyang HPS, NEEPCO		0.00	0.00
175	Kopili 1 IN		0.00	0.00
176	Kopili Power Station NEEPCO		2.07	0.00
177	Mizoram		8.36	0.00
178	Nagaland		16.58	3.78
179	Palatana Plant		31.84	0.00
180	Pare Hydro Power Station		0.33	0.00
181	Ranganadi Hydro Power Station		0.01	0.00
182	Doyang HPS; NEEPCO		1.02	0.00
Total			29586	29586

19. INFORMATION ABOUT RENEWABLE ENERGY
CERTIFICATE MECHANISM

MONTH : DECEMBER 2023

RE Source & Unit wise break up (01.12.2023-31.12.2023)

Sr.No	Source Wise	Accreditation		Registration	
		Capacity (MW)	Unit	Capacity (MW)	Unit
1	Wind	0	0	6	2
2	Urban or Municipal Waste	0	0	0	0
3	Solar Thermal	0	0	0	0
4	Solar PV	0	0	173	3
5	Small Hydro	0	0	0	0
6	Others	0	0	0	0
7	Geothermal	0	0	0	0
8	Biomass	0	0	0	0
9	Bio-fuel cogeneration	0	0	0	0
	Total	0	0	179	5

RECs Issued (01.12.2023-31.12.2023)

Sr.No.	Non Solar	Solar	Total
1	13158078	62782	13220860

Redemption of REC (01.12.2023-31.12.2023)

Sr.No.	Non Solar	Solar	Total
1	1229245	52228	1281473

19. INFORMATION ABOUT RENEWABLE ENERGY
CERTIFICATE MECHANISM

MONTH : DECEMBER 2023

RE Source & Unit wise break up (Apr'23-Dec'23)

Sr.No	Source Wise	Accreditation		Registration	
		Capacity (MW)	Unit	Capacity (MW)	Unit
1	Wind	366	21	455	21
2	Urban or Municipal Waste	0	0	0	0
3	Solar Thermal	0	0	0	0
4	Solar PV	316	51	241	8
5	Small Hydro	101	8	42	7
6	Others	0	0	0	0
7	Geothermal	0	0	0	0
8	Biomass	5	1	5	1
9	Bio-fuel cogeneration	8	2	23	5
	Total	796	83	766	42

RECs Issued (Apr'23-Dec'23)

Sr.No.	Non Solar	Solar	Total
1	18868923	848684	19717607

Redemption of REC (Apr'23-Dec'23)

Sr.No.	Non Solar	Solar	Total
1	5770224	667600	6437824

19. INFORMATION ABOUT RENEWABLE ENERGY
CERTIFICATE MECHANISM

MONTH : DECEMBER 2023

RE Source & Unit wise break up Since Inception to Dec'23

Sr.No	Source Wise	Accreditation		Registration	
		Capacity (MW)	Unit	Capacity (MW)	Unit
1	Wind	3079	526	2909	523
2	Urban or Municipal Waste	0	0	0	0
3	Solar Thermal	0	0	0	0
4	Solar PV	1585	543	1426	473
5	Small Hydro	745	41	698	42
6	Others	4	2	3	1
7	Geothermal	0	0	0	0
8	Biomass	402	37	378	35
9	Bio-fuel cogeneration	823	91	383	55
	Total	6638	1240	5797	1129

RECs Issued since Inception to Dec'23

Sr.No.	Non Solar	Solar	Total
1	106749063	13259422	120008485

Redemption of REC since Inception to Dec'23

Sr.No.	Non Solar	Solar	Total
1	73298409	12295988	85594397

REC Closing balance as on 31.12.2023

Sr.No.	Non Solar	Solar	Total
1	33450654	963434	34414088

20.Details of Grid Events during the Month of December 2023													
Northern Region													
Sl No.	Category of Grid Event (GI for GI 2/ GD-1 to GD-5)	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t. Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
						Generation Loss(MW)	Load Loss (MW)	% Generation Loss (MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
1	GI-2	Rajasthan	03-Dec-23 13:31	04-Dec-23 00:08	10:37	106	0	0.265	0.000	39981	46164	i) Total MW generation of Avada Surve, Avada RJH and Avada Sustainable are pooled at 400kV Avada pooling and total generation is evacuated through 400 KV Avada Pooling SL_BKN_PG (AEP/L)-Bikaner(PG) (AEP/L) Ckt. During antecedent condition, 400/33 kV 150 MVA ICT 7 at Avada Pooling SL_BKN_PG (AEP/L) was carrying approx. 106MW. ii) As reported, at 13:31hrs, 400/33 kV 150 MVA ICT 7 at Avada Pooling SL_BKN_PG (AEP/L) tripped due to main LV Feeder-352 LA failure. iii) As per PMU at Avada(P), Y-N phase to earth fault with fault clearance time of 80ms is observed in the system. iv) As per PMU, generation loss of approx. 106MW at Avada Pooling(P) is observed.	1) 400/33 kV 150 MVA ICT 7 at Avada Pooling SL_BKN_PG (AEP/L)
2	GD-1	J&K	10-Dec-23 15:57	10-Dec-23 23:00	07:03	127	0	0.347	0.000	36626	42183	i) During antecedent condition, only 130MW Unit-2 at Dulhasti HEP was running (generating approx. 127MW) and power was evacuating through 400kV Dulhasti-Kishenpur ckt-1 only. 400kV Dulhasti-Kishenpur ckt-2 was already under planned outage due to stringing work. ii) As reported, at 15:57hrs, 400kV Dulhasti-Kishenpur ckt-1 tripped on Y-N phase to earth fault. At the same time, 130MW Unit-2 at Dulhasti HEP also tripped due to loss of evacuation path. iii) As per PMU at Kishenpur (PG), Y-N phase to earth fault with unsuccessful A/R operation is observed. Fault was of permanent nature and fault current was ~4KA. iv) As per SCADA, generation loss of approx. 127MW is observed at Dulhasti HEP.	1) 400 KV Dulhasti(NH)-Kishenpur(PG) (PG) Ckt-1 2) 130MW Unit-2 at Dulhasti HEP
3	GD-1	Rajasthan	13-Dec-23 13:03	13-Dec-23 13:35	00:32	0	550	0.000	1.023	44848	53773	i) During antecedent condition, MVA loadings of 400/220 kV 315 MVA ICT-1 & 2 at Hinduan(RS) were 227 and 243 MVA respectively. ii) At 13:03 hrs, 220kV Hinduan/220 kV(Hinduan) ckt (carrying ~78MW) tripped which further resulted into overloading of 220kV Hinduan/400-Hinduan/220(RS) ckt (carrying ~95MW) and 400/220kV 315MVA ICTs at Hinduan(RS). Subsequently, 400/220kV 315MVA ICT-1&2 at Hinduan tripped on overcurrent protection operation. iii) As per PMU, no fault is observed in the system. iv) As per SCADA, load loss of approx. 550 MW is observed in Rajasthan control area.	1) 400/220 kV 315 MVA ICT -1 at Hinduan(RS) 2) 400/220 kV 315 MVA ICT -2 at Hinduan(RS)
4	GD-1	Rajasthan	17-Dec-23 13:01	17-Dec-23 23:22	10:21	1600	0	3.285	0.000	48712	55964	i) During antecedent condition, 220/33kV 100MVA ICT-1, 2 & 3 at Rising Sun(RSDCL4) were carrying 57MW, 57MW and 53MW respectively. ii) As reported, at 13:01hrs, 400 KV Bikaner-Bhadra (RS) Ckt-1 tripped on Y-B phase to phase fault with fault distance of 70.52km from Bhadra(RS) end, conductor found broken between tower location no. 243-244. As per DR at Bikaner(RS) end, fault was in zone-1, fault current was 4.53kA and 5.46kA on Y & B phase respectively and fault clearing time was 50ms. iii) At the same time, 220/33kV 100MVA ICT-1 & 3 at Rising Sun(RSDCL4) tripped due to relay mal-operation (exact reason yet to be shared). Due to this tripping, 220/33kV 100MVA ICT-2 at Rising Sun(RSDCL4) also tripped due to over-loading. iv) Again, at 13:14hrs, 400 KV Bikaner-Bhadra (RS) Ckt-2 tripped on Y-B phase to phase fault with fault distance of 30.61km from Bhadra(RS) end, conductor found broken between tower location no. 107-108. As per DR at Bikaner(RS) end, fault was in zone-1, fault current was 3.14kA and 4.36kA on Y & B phase respectively and fault clearing time was 40ms. v) As per PMU at Bhadra(P), Y-B phase to phase fault is observed with fault clearing time of 80ms. vi) As per SCADA, generation loss of approx. 1600 MW is observed in total NR Solar generation which was recovered within 3 minutes.	1) 400 KV Bikaner-Bhadra (RS) Ckt-1 2) 220/33kV 100MVA ICT-1 at Rising Sun(RSDCL4) 3) 220/33kV 100MVA ICT-2 at Rising Sun(RSDCL4) 4) 220/33kV 100MVA ICT-2 at Rising Sun(RSDCL4) 5) 400 KV Bikaner-Bhadra (RS) Ckt-2
5	GI-2	Uttar Pradesh	24-Dec-23 05:36	24-Dec-23 14:06	08:30	0	0	0.000	0.000	33070	42165	i) During antecedent condition, 765/400 kV 1500 MVA ICT 1 & 2 at Meerut_PMSLT (UP) were carrying approx. 120MW each. ii) As reported, at 05:36hrs, 765 KV Hapur-Meerut_PMSLT (UP) Ckt tripped on R-N phase to earth fault with fault location of 9.104km from Hapur end due to OPGW conductor broken at fault location. iii) As per DR at Hapur end, zone-1 distance protection operated and fault current was 6.194kA from Hapur end. As per DR at Meerut end, zone-1 distance protection operated (unsuccessful A/R), LBB operated and fault current was 5.632kA from Meerut end. iv) Due to issue in opening of R-phase CB at Meerut end of 765 KV Hapur-Meerut_PMSLT (UP) Ckt, LBB operated at Meerut end which led to tripping of 765/400 kV 1500 MVA ICT 2 at Meerut_PMSLT (UP) also and 765 KV Meerut_PMSLT (UP) - Bus 1 became dead. v) As per PMU at Meerut(P), multiple R-N phase to earth fault with fault clearance time of 80ms and 280ms are observed. vi) As per SCADA, no change in demand is observed in UP control area.	1) 765 KV Hapur-Meerut_PMSLT (UP) Ckt 2) 765/400 kV 1500 MVA ICT 2 at Meerut_PMSLT (UP) 3) 765 KV Meerut_PMSLT (UP) - Bus 1
6	GI-2	Delhi	24-Dec-23 11:42	24-Dec-23 15:46	04:04	400	0	0.823	0.000	48608	57489	i) As reported, at 11:42 Hrs, 400 KV Jhatikara(PG)-Mundka(DV) (DTL) Ckt-2 tripped on Y-B-N double phase to ground fault with fault current of 19.062kA and fault location of 4.202km from Jhatikara end. ii) As per DR at Mundka end, zone-1 distance protection operated, fault current was 13.14kA and 14.28kA in Y and B phase respectively and fault clearing time was approx. 40ms. iii) During the same time, 400 KV Bawana-Mundka (DV) (Ckt-1 & 2 also tripped from Mundka end only. iv) As per SCADA, sudden dip in solar generation of approx. 400MW is observed which revived within 2 minutes. v) As per PMU, sudden dip in generation is observed in some RE plants, e.g., AHJZL1 (~70MW), NTPC Devkot (~110MW), RSWPL (~140MW) and RSULP (~70MW). vi) As per PMU, Y-B-N double phase to ground fault with fault clearing time of 120ms is observed. vii) As per SCADA, no change in demand is observed in Delhi control area.	1) 400 KV Jhatikara(PG)-Mundka(DV) (DTL) Ckt-2 2) 400 KV Bawana-Mundka (DV) Ckt-1 3) 400 KV Bawana-Mundka (DV) Ckt-2
7	GD-1	Rajasthan	31-Dec-23 09:29	31-Dec-23 13:15	03:46	315	310	0.734	0.546	42911	56822	i) During antecedent condition, MVA loadings of 400/220 kV 500 MVA ICT - 2 & 3 at Ramgarh(RS) were 188 and 191 MVA respectively. 400/220 kV 500 MVA ICT -1 at Ramgarh(RS) was not under working condition. ii) As reported by SLDC Rajasthan (Bhadra(RS) end), at 09:29 hrs, 400kV Ramgarh(RS)-Bhadra(RS) Ckt-1 tripped on R-Y phase to phase fault with fault clearing time of 332ms, fault distance of 152.3km and fault current of ~3.25kA and ~3.13kA in R and Y phase respectively from Bhadra(RS) end (Phase sequence issue at Bhadra(RS) end); fault was observed in zone-2 at Bhadra(RS) end. 400kV Ramgarh(RS)-Bhadra(RS) Ckt-2 tripped from Ramgarh(RS) end only, no tripping occurred at Bhadra(RS) end. iii) As per DR at Ramgarh(RS) end, bus bar protection operated at Ramgarh(RS) end during the same time (exact reason yet to be shared). iv) As per DR, 400 KV Akal-Ramgarh(end) (RS) Ckt-1 tripped on Y-B phase to phase fault with fault clearing time of 520ms and fault current of ~3.63kA and ~3.46kA in Y and B phase respectively from Ramgarh(RS) end; fault was observed in zone-4 at Ramgarh(RS) end. v) As per DR, 400 KV Akal-Ramgarh(end) (RS) Ckt-2 tripped on Y-B phase to phase fault with fault clearing time of 220ms and fault current of ~3.72kA and ~3.52kA in Y and B phase respectively from Ramgarh(RS) end; fault was observed in zone-4 at Ramgarh(RS) end. vi) Due to tripping of all the elements, 400/220kV Ramgarh(RS) S/s became dead. vii) As per PMU, Y-B phase to phase fault with delayed fault clearance time of 520ms is observed. viii) As per SCADA, change in demand of approx. 310 MW is observed in Rajasthan control area. ix) As per SCADA, loss of wind generation of approx. 315 MW is observed in Rajasthan control area.	1) 400kV Ramgarh(RS)-Bhadra(RS) Ckt-1 2) 400kV Ramgarh(RS)-Bhadra(RS) Ckt-2 3) 400kV Ramgarh(RS)-Akal(RS) Ckt-1 4) 400kV Ramgarh(RS)-Akal(RS) Ckt-2
8	GD-1	Rajasthan	31-Dec-23 12:35	31-Dec-23 13:38	01:03	0	1560	0.000	2.612	49584	59724	i) As reported, at 12:35 hrs, B-phase conductor of main bus isolator of 220kV Bhawad(RS)-Bhopalgarh(RS) Ckt-1 snapped which led to bus bar protection operation at 220kV Bhawad(RS). All the elements connected to 220kV Bus-1 & 2 at Bhawad(RS) tripped and 220/132kV Bhawad(RS) S/s became dead. ii) Due to shifting of total load of Bhopalgarh on 400/220kV Merta(RS), 400/220kV 315MVA ICT-1 & 2 at Merta(RS) tripped at the same time due to over-loading. iii) As 400/220kV Kankani(RS) and Jodhpur(RS) started to cater the nearby load of Bhopalgarh area, 400/220kV 315MVA ICT-1 & 2 at Kankani(RS) and 220/132kV 100MVA ICT at Jodhpur(RS) also tripped during the same time due to over-loading. iv) As per DR at Kankani(RS), current in 400/220kV 315MVA ICT-1 at Kankani(RS) were Ia=578.72A, Ib=577.98kA and Ic=589.22kA and current in 400/220kV 500MVA ICT-2 at Kankani(RS) were Ia=1348.41A, Ib=1352.59kA and Ic=1381.58kA respectively. Over-current protection operated in both the ICTs. v) As per SCADA SDE, 220kV Nagpur(RS)-Barangarh(RS) Ckt, 220kV Merta(RS)-Jethu(RS) Ckt and 400kV Merta(RS)-Kankani(RS) Ckt also tripped during the same time (Exact reason of the same yet to be shared). vi) As per PMU, no fault is observed in the system. vii) As per SCADA, load loss of approx. 1560 MW is observed in Rajasthan control area.	1) 220kV Bhawad(RS)-Bhopalgarh(RS) Ckt-1 2) 220kV Bhawad(RS)-Bhopalgarh(RS) Ckt-2 3) 220kV Bhawad(RS)-Jodhpur(RS) Ckt-1 4) 220kV Bhawad(RS)-Jodhpur(RS) Ckt-2 5) 220kV Bhawad(RS)-Bathwas(RS) Ckt-1 6) 220kV Bhawad(RS)-Bathwas(RS) Ckt-2 7) 220/132kV 100MVA ICT-1 at Bhawad(RS) 8) 220/132kV 100MVA ICT-2 at Bhawad(RS) 9) 400/220kV 315MVA ICT-1 at Merta(RS) 10) 400/220kV 315MVA ICT-2 at Merta(RS) 11) 220/132kV 100MVA ICT at Jodhpur(RS) 12) 400/220kV 315MVA ICT-1 at Kankani(RS) 13) 400/220kV 500MVA ICT-2 at Kankani(RS)

20.Details of Grid Events during the Month of December 2023															
Western Region															
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped		
	(GI 1or GI 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss (MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)				
1	GD-1	WR	20:43 / 02-12-2023	22:32 / 02-12-2023	01:49	273	-	0.53%	-	51643	50209	At 20:43 Hrs/ 02-12-2023, 220/33 kV Pitamnagar-ICT-1&2 tripped on Over current protection operation. During inspection no abnormalities were found. 220/33 kV Pitamnagar ICT-3 was under planned shutdown w.e.f. 02:56 Hrs/ 20-12-2023. 273 MW generation loss occurred at 220 kV Pitamnagar s/s due to the event.	Tripping of following elements- 1. 220/33 kV Pitamnagar-ICT-1&2		
2	GD-1	WR	03:50 / 09-12-2023	04:00 / 09-12-2023	00:10	-	35	-	0.08%	53385	45279	At 03:50 Hrs/ 09-12-2023, 220 kV Sabalgarh-Shivpur-2 tripped on R-E fault from Shivpur end only. The breaker didn't open at Sabalgarh end and all lines connected to 220 kV Sabalgarh tripped on 2-3 protection operation from remote ends and handtripped by site at Sabalgarh end.Total supply failed at 220 kV Sabalgarh, 220 kV Sheopurkala and adjoining 132 kV Substations (132 kV Vijaypura,132 kV Kailash, 132 kV Barotaj). 35 MW load loss occurred at the mentioned area due to the event.	Tripping of following elements- 1. 220 kV Sabalgarh-Shivpur-1&2 2. 220 kV Sabalgarh-Sheopurkala-1&2 3. 220 kV Sabalgarh-Morena(MP)-1 4. 220 kV Sabalgarh-Morena(Adani)-1 5. 220/132 kV Sabalgarh-ICT-1&2 (160 MVA) 6. 220 kV Sabalgarh-Bus-1&2		
3	GD-1	WR	06:43 / 14-12-2023	08:03 / 14-12-2023	01:20	-	240	-	0.41%	66358	58234	At 06:43 Hrs/14.12.2023, 220 kV bus 2 at Raipur PG station tripped due to bus bar protection operation which led to tripping of 220 kV Raipur-Doma-1, 220 kV Raipur-Borjara, 220 kV Raipur-Bhilal, 220 kV Raipur-Sheriha, 400/220 kV ICT-2 and 400/220 kV ICT-3 at Raipur PG. Around 240 MW load loss occurred during the event.	Tripping of following elements- 1. 220 kV Raipur PG-Bus-2 2. 220 kV Raipur-Doma-1 3. 220 kV Raipur-Borjara 4. 220 kV Raipur-Bhilal 5. 400/220 kV ICT-2 6. 400/220 kV ICT-3 7. 220 kV Raipur-Sheriha		
4	GD-1	WR	14:08 / 20-12-2023	17:30 / 20-12-2023	03:22	-	79	-	0.12%	71313	65600	At 14:08 Hrs/20.12.2023, 220 kV Bhuj- Gadhisra Ckt tripped on Bph-E fault resulting in loss of generation due to loss of evacuation path. 79 MW generation loss reported.	Tripping of following elements- 1. 220 kV Bhuj- Gadhisra Ckt		
5	GD-1	WR	22:05 / 23-12-2023	23:00 / 23-12-2023	00:55	-	373	-	0.70%	64371	53512	At 22:05 Hrs/23.12.2023, Y-phase CT of 220kV Bus Coupler blasted at Kharadpada SS. Due to which all Ckts at 220kV Kharadpada SS tripped. 220kV Vapi-Bhilosa Ckt also tripped on Zone-2 protection operation at the same time at 220 kV Bhilosa end only. Load loss of 373 MW is reported at 220kV Kharadpada SS and 220kV Bhilosa SS.	Tripping of following elements- 1. 220 kV Kharadpada- New Kharadpada Ckt 1 & 2 2. 220kV Kharadpada-Vapi 3. 220kV Kharadpada-Bhilosa 4. 220kV Bhilosa Vapi		
7	GD-1	WR	14:55 / 29-12-2023	15:13 / 29-12-2023	00:18	-	37	-	0.05%	75086	68504	At 14:55 Hrs/27.12.2023, 220 kV Kalwa- Bagaon tripped on 3-Ph fault due to wave trap jumper snapped at Kalwa end. 220 kV Ghatgar- Bhaagaon tripped from Ghatgar end only at same time and 220kV Bagaon s/s got dead. Load loss of 37 MW was reported.	Tripping of following elements- 1.220 kV Ghatgar Bagaon Ckt 2. 220 kV Kalwa Bagaon Ckt 3. 50 MVA X-MER-1&2		

20.Details of Grid Events during the Month of December 2023													
Southern Region													
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (H:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	(GI for GI 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss (MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
1	GD-1	Tamil Nadu	04-12-2023 07:14	04-12-2023 08:23	1 hr min	0	0	0.00%	0.00%	35704	43674	Complete Outage of 400kV Manali and Pullyanthope SS of TANTRANSO: During antecedent conditions, 400V Pullyanthope SS was being radially fed from 400kV Manali SS. As per the reports submitted,during Michaug cyclone, due to moisture ingress in the Manali GIS, 400kV Manali NCTPS line tripped at 04:52hrs and 400kV Alamathy Manali line tripped at 07:14hrs. Tripping of the both the source feeders resulted in complete outage of 400kV Manali and Pullyanthope SS.	1. 400kV Manali NCTPS 2. 400kV Manali Alamathy
2	GD-1	Karnataka	08-12-2023 14:37	08-12-2023 14:48	11mins	510	600	1.32%	1.28%	38764	46956	Complete Outage of 400kV Talaguppa SS, 220kV Shimoga SS, Chikamangalore SS, Heggurje SS, Kadur SS, Shiralkoppa SS, Siri SS, Arasilere SS and 220kV Bus-2 of Honnali SS of KPCL and 220kV Varahi and Sharavathy SS of KPCL: As per the reports submitted, the triggering incident was R-N fault in 220kV Sharavathy Shimoga Line-1. Sharavathy end failed to clear the fault causing LBB to operate and all the elements connected to the East wing of the bus tripped. Subsequently, other units tripped on Under frequency protection. Consequently, 220kV Hassan Chikamangalore line was hand tripped due to arcing and 220kV Hassan Anthrasanahalli and 220kV Hassan Shimoga lines tripped on PSE operation. After these trippings, 400kV Talaguppa Hassan and 400kV Talaguppa Nelamangala lines tripped on overvoltage protection. This resulted in complete outage of 400kV Talaguppa SS, 220kV Shimoga SS, Chikamangalore SS, Heggurje SS, Kadur SS, Shiralkoppa SS, Siri SS, Arasilere SS and 220kV Bus-2 of Honnali SS and 220kV Varahi and Sharavathy SS.	1. 400kV Talaguppa Nelamangala 2. 400kV Talaguppa Hassan 3. 220kV Sharavathy Shimoga Line-1 4. 220kV Hassan Chikamangalore 5. 220kV Hassan Shimoga
3	GD-1	Karnataka	25-12-2023 14:48	25-12-2023 19:02	4hrs 14mins	0	0	0.00%	0.00%	46612	50813	Complete Outage of 230kV GRT Station: As per the reports submitted, the triggering incident was LBB relay maloperation at 230kV GRT Bay of 400kV/230kV TTGS station causing tripping of the line. Tripping of the only connected line led to complete outage of 230kV GRT station.	1. 230kV TTGS GRT line

20.Details of Grid Events during the Month of December 2023													
Eastern Region													
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*		Brief details of the event (pre fault and post fault system conditions)	Elements Tripped
	(GI for GI 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss (MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)		
1	GD-1	Rengali, Rengali PH	04.12.2023 10:49	04.12.2023 11:33	0.030556	0	0	0.00%	0.00%	25910	18653	On 04th December 2023 at 10:49 Hrs, Due to flashover in bus isolator, all the emanating lines from Rengali (OPTCL) were hand tripped at 10:49 hrs causing bus dead in the S/S.	220KV Bus#1 at Rengali (OPTCL) 220KV Bus#2 at Rengali (OPTCL) 220KV-RENGALI(PG)-RENGALI(OPTCL)-1 220KV-RENGALI(PG)-RENGALI(OPTCL)-2 220KV-RENGALI(PH)-RENGALI(OPTCL)-1 220KV-RENGALI(PH)-RENGALI(OPTCL)-2
2	GD-1	Tenughat	06.12.2023 07:04	06.12.2023 07:27	0.015972	330	0	1.25%	0.00%	26413	18257	At 07:04 Hrs on 06.12.2023, all emanating lines at 400/220 kV Tenughat S/s tripped leading to loss of evacuation path for its 2 running units (2*210 MW). Consequently, 220 kV Tenughat S/s became dead and 330 MW generation loss occurred.	220 kV Tenughat-Govindpur-1 220 kV Tenughat-Govindpur-2 220 kV Tenughat-Biharsharif-1 2*210 MW Units at Tenughat
3	GD-1	Purnea	14.12.2023 11:58	14.12.2023 13:41	0.071528	0	0	0.00%	0.00%	24244	18023	At 11:58 Hrs on 14th December 2023, 220 kV Bus-1&2 at 220/132 kV Purnea S/s tripped leading to total power interruption. No load loss or generation loss occurred.	220 kV Bus#1 at Purnea 220 kV Bus#2 at Purnea 220 kV Purnea-New Purnea-1 220 kV Purnea-New Purnea-2 220 kV Purnea-Dalkhola-2
4	GD-1	Therubali	28.12.2023 12:32	28.12.2023 15:51	0.138194	0	75	0.00%	0.38%	25522	19838	At 12:32 Hrs on 28th December 2023, a fire incident occurred in 132 kV Panel of 220/132 kV ATR-1 at Therubali, leading to failure of DC supply. Consequently, total power failed at Therubali S/s. Around 75 MW load loss occurred at Kashipur, Jaypatna	220KV Therubali-Laxmipur D/c 220KV Therubali-Bhanjanagar D/c 220KV Therubali-Kaipur-1 220KV Therubali-Indrawati T/c 220KV Therubali-Gunupur-1 220KV Therubali-Narendrapur-1

20.Details of Grid Events during the Month of December 2023											
North-East Region											
Sl No.	Category of Grid Event	Affected Area	Time and Date of occurrence of Grid Event	Time and Date of Restoration	Duration (HH:MM)	Loss of generation / loss of load during the Grid Event		% Loss of generation / loss of load w.r.t Antecedent Generation/Load in the Regional Grid during the Grid Event		Antecedent Generation/Load in the Regional Grid*	
	(GI for GI 2/ GD-1 to GD-5)					Generation Loss(MW)	Load Loss (MW)	% Generation Loss (MW)	% Load Loss (MW)	Antecedent Generation (MW)	Antecedent Load (MW)
1	GD-I	Lakwa area of Assam Power System	06-12-2023 14:19	06-12-2023 16:38	02:19:00	100	0	5.69%	0.00%	1756	1918
Lakwa area of Assam Power system, LTFS & LRPP generation was connected with the rest of the grid by 132 kV LTFS-Nazra D/C, 132 kV LTFS-Moran, 132 kV LTFS-Sonari, 132 kV LTFS-NTPS and 132 kV LTFS-Mariani(AS) lines. At 14:19 Hrs of 06/12/2023, 132 kV LTFS-Nazra D/C, 132 kV LTFS-Moran, 132 kV LTFS-Sonari, 132 kV LTFS-NTPS and 132 kV LTFS-Mariani(AS) lines tripped and LTFS & LRPP generation of Assam Power system got separated from rest of the grid due to load generation mismatch in this area. Power was extended to Lakwa area of Assam Power system by charging 132 kV LTFS-NTPS line at 16:38 Hrs.											
2	GD-I	Umiyam Stg-II of Meghalaya Power System	09-12-2023 12:12	09-12-2023 12:40	00:28:00	4	0	0.23%	0.00%	1703	1847
Umiyam Stg-II area of Meghalaya Power system was connected with the rest of the grid by 132 kV Umiyam Stage 1 – Umiyam Stage 2 line. At 12:12 Hrs of 09/12/2023, 132 kV Umiyam Stage 1 – Umiyam Stage 2 line tripped and Umiyam Stg-II generation of Meghalaya Power system got separated from rest of the grid due to load generation mismatch in this area. Power was extended to Umiyam Stg-II area of Meghalaya Power system by charging 132 kV Umiyam Stage 1 – Umiyam Stage 2 line at 12:40 Hrs.											
3	GD-I	Kohima area of Nagaland Power System	11-12-2023 09:52	11-12-2023 10:16	00:24:00	6	20	0.30%	1.01%	2007	1979
Kohima area of Nagaland Power system was connected with the rest of the grid by 132 kV Kohima-Dimapur(PG), 132 kV Kohima-Karong, 132 kV Kohima-Meluri & 132 kV Kohima-Chiphobozou lines. 132 kV Kohima-Chiphobozou line and 132 kV Kohima-Meluri was under shutdown. At 09:52 Hrs of 11/12/2023, 132 kV Dimapur(PG)-Kohima & 132 kV Karong-Kohima lines tripped. Due to these trippings, Kohima area of Nagaland power system got separated from rest of the grid. Power was extended to Kohima area of Nagaland Power system by charging 132 kV Kohima-Karong line at 10:16 Hrs.											
4	Near Miss	Kopili S/S of NEEPCO power system	13-12-2023 16:58	13-12-2023 19:53	02:55:00	50	0	1.83%	0.00%	2732	2470
Kopili HEP of NEEPCO Power system was connected with the rest of the grid by 220 kV Misa-Kopili I, II & III lines. Also, connected with 132 kV Khandong- Kopili & 132 kV Khlehmrat- Kopili Lines. At 16:58 Hrs of 13/12/2023, 220 kV Bus-II tripped on operation of LBB. Due to this tripping, Kopili S/S of NEEPCO power system got separated from rest of the grid due to load generation mismatch in this area. Power was extended to Kopili area of NEEPCO Power system by charging 220 kV Misa-Kopili I line at 17:22 Hrs.											
5	GD-I	Kopili S/S of NEEPCO power system	14-12-2023 16:31	14-12-2023 17:22	00:51:00	50	0	2.28%	0.00%	2195	2257
Kopili HEP of NEEPCO Power system was connected with the rest of the grid by 220 kV Misa-Kopili I, II & III lines. Also, connected with 132 kV Khandong- Kopili & 132 kV Khlehmrat- Kopili Lines. At 16:31 Hrs of 14/12/2023, 220 kV Bus-I & II at Kopili tripped on operation of LBB. Due to this tripping, Kopili S/S of NEEPCO power system got separated from rest of the grid due to load generation mismatch in this area. Power was extended to Kopili area of NEEPCO Power system by charging 220 kV Misa-Kopili I line at 17:22 Hrs.											

21. NEW ELEMENTS COMMISSIONED* IN DECEMBER 2023

COMMISSIONING OF NEW GENERATING UNITS

REGION	S.NO.	ENTITY	UNIT NAME / LOCATION	ADD. CAPACITY (MW)	UNIT NO.	INS. CAPACITY (MW)	DATE®
NR	1	AMP ENERGY GREEN SIX PRIVATE LTD.	AMP Green Six Private Ltd.(Solar)/Rajasthan	100	-	100	07-12-223
	2	ALTRA XERGI POWER PVT LTD	Altra Xergi Power Pvt Ltd(Solar)/Rajasthan	259.6	-	380	20-12-2023
WR	3	ADANI WIND ENERGY KUTCHH FOUR LTD.	Adani Wind Energy Kutchh Four Ltd.(Wind)/Gujarat	14.7	I	189	11-12-2023
SR	4	APGENCO	Vijayawada TPS(Thermal)/Andhra Pradesh	800	VIII	800	20-12-2023
	5	RENEW SURYA ROSHINI	Renew Surya Roshini(Solar)/Karnataka	20.79	-	221.76	21-12-2023
	6	JSW RENEW ENERGY LTD	JSW Renew Energy Ltd	54	-	54	16-12-2023
	7	JSW RENEW ENERGY LTD	JSW Renew Energy Ltd	10.8	-	64.8	21-12-2023
	8	AYANA RENEWABLE SIX	Ayana Renewable Six(Wind)/Karnataka	54	-	151.2	11-12-2023
®RE (Solar & Wind generation added capacity FTC is in phases. Date mentioned is the date by which complete (Added) capacity							

COMMISSIONING OF NEW ICTs

REGION	S.NO.	ENTITY	SUB-STATION	VOLTAGE (kV)	ICT NO.	CAPACITY (MVA)	DATE
NR	1	PBTS	Bikaner_2	400/220	I	500	23-12-2023
	2	UPPTCL	Mainpuri	765/400	II	1000	27-12-2023
WR	3	KBTL	Khavda PS1	765/400	I	1500	31-12-2023
SR	4	PGCIL	Palakkad	400/220	III	500	12-12-2023
	5	PGCIL	TTGS	400/230	IV	500	22-12-2023
	6	ANDHRA PRADESH	Hindupur	400/220	IV	315	09-12-2023
	7	TAMILNADU	Suryapet	400/220	III	500	30-12-2023
	8	TAMILNADU	Vellalaviduthi	400/230	III	315	15-12-2023
	9	TAMILNADU	Ariyalur	765/400	II	1500	27-12-2023
ER	10	JUSNL	Latehar	400/220	II	315	02-12-2023
NER	11	POWERGRID	Kopili	220/132	I	160	10-12-2023
	12	POWERGRID	Kopili	220/132	II	160	11-12-2023

COMMISSIONING OF NEW TRANSMISSION LINES

REGION	S.NO.	ENTITY	LINE NAME	CKT NO.	VOLTAGE (kV)	DATE
NR	1	PRTL	400kV Fatehgarh_III- Fatehgarh_II	I	400	20-12-2023
	2	PRTL	400kV Fatehgarh_III- Fatehgarh_II	II	400	20-12-2023
WR	3	KBTL	765kV Khavda PS-I-Bhuj-1	I	765	30-12-2023
SR	4	TAMILNADU	765kV Thiruvallam-Ariyalur	II	765	27-12-2023
	5	TAMILNADU	400kV Ottapidaram-Udangudi	D/C	400	15-12-2023
NER	6	POWERGRID	400kV Biswanath Chariali-Lower Subansiri III	III	400	22-12-2023
	7	MePTCL	220kV Killing-Mawngap	I	220	23-12-2023
	8	MePTCL	220kV Killing - Mawngap	II	220	23-12-2023

LILO OF TRANSMISSION LINES

REGION	S.NO.	ENTITY	LINE NAME (LILOed LINE)	LILO AT	VOLTAGE (kV)	DATE

COMMISSIONING OF BUS/LINE REACTORS

REGION	S.NO.	ENTITY	SUB-STATION / LINE (@SUB-STATION)	VOLTAGE (kV)	CAPACITY (MVAR)	DATE
NR	1	UPRVUNL	Bus Reactor-I@Obra C TPS	400	125	08-12-2023
	2	RRVUNL	SSCTPS - Babai I@Suratgarh SCTPS	400	80	07-12-2023
	3	RRVUNL	SSCTPS - Babai II@Suratgarh SCTPS	400	80	07-12-2023
SR	4	KPTCL	Bus Reactor-I@Hebbanahalli	400	125	01-12-2023
	5	TN	Bus Reactor-I@Ariyalur	765	240	27-12-2023
	6	TN	Bus Reactor-II@Ariyalur	765	240	27-12-2023
	7	TN	Thiruvallam-Ariyalur II@Ariyalur	765	240	27-12-2023
ER	8	JUSNL	Bus Reactor-I@Latehar	400	-	19-12-2023

COMMISSIONING OF HVDC/FACTS DEVICE/SYSTEM

REGION	S.NO.	NAME	SUB-STATION / CONSTITUENT	RATINGS	VOLTAGE (kV)	DATE

*Includes first time charging (FTC) as well

22. Voltage Profile

विद्युत विभव रूपरेखा माह - दिसम्बर 2023

VOLTAGE PROFILE - DECEMBER 2023

Date of reporting: 05-Dec-23

क्र.स. Sl. No.	क्षेत्र REGION	उपकेंद्र SUBSTATION	VOLTAGE < V(lower)* (V=380,728 kV)	V(lower) < VOLTAGE < V(upper)*	VOLTAGE > V(upper)* (V=420,800 kV)	Voltage Deviation Index (%age of time voltage is outside range)	Number of hours voltage was outside IEGC band during month	उच्चतम (कि.वो.) Maximum(kV)	निम्नतम(कि.वो.) Minimum(kV)	औसत (कि.वो.) Average(kV)
1	पूर्वी क्षेत्र ER	अंगल ANGUL	100%	100%	0%	0%	0	795	742	773
2		दार्लिपाली DARIIPALI	0%	100%	0%	0%	0	790	757	775
3		गया GAYA	0%	100%	0%	0%	0	787	750	769
4		जेरत JEERAT	0%	100%	0%	0%	0	786	730	756
5		झारसगुडा JHARSUGUDA	0%	100%	0%	0%	0	800	763	783
6		मिदनापुर MEDINIPUR	0%	100%	0%	0%	0	787	742	766
7		रांची RANCHI	0%	100%	0%	0%	0	795	758	778
8		सासाराम SASARAM	2%	98%	0%	2%	14	787	715	761
1	उत्तरी क्षेत्र NR	आगरा AGRA	0%	100%	0%	0%	0	800	743	775
2		आगरा (फतेहाबाद) AGRA (FATEHABAD)	0%	100%	0%	0%	0	792	736	770
3		अजमेर AJMER	0%	100%	0%	0%	0	802	746	778
4		अलीगढ़ ALIGARH	0%	100%	0%	0%	0	794	738	771
5		अनपरा सी ANPORA-C	0%	100%	0%	0%	0	781	753	769
6		अनपरा डी ANPORA-D	0%	100%	0%	0%	0	781	753	767
7		अंता ANTA	0%	100%	0%	0%	0	798	755	778
8		बालिया BALLIA	0%	100%	0%	0%	0	788	742	767
9		बारा BARA	0%	100%	0%	0%	0	787	753	770
10		भादला BHADLA	0%	100%	0%	0%	0	794	734	772
11		भादला-2 BHADLA-2	0%	100%	0%	0%	0	799	744	775
12		भिवानी BHIWANI	0%	100%	0%	0%	0	802	750	777
13		बिकानेर BIKANER	0%	100%	0%	0%	0	801	742	774
14		बरैली BAREILLY	0%	100%	0%	0%	1	803	739	776
15		चित्तौड़गढ़ CHITTORGARH	0%	100%	0%	0%	1	801	745	780
16		फतेहगढ़-2 FATEHGARH-2	0%	100%	0%	0%	0	797	732	775
17		फतेहपुर FATEHPUR	0%	100%	0%	0%	0	795	741	768
19		ग्रेटर नोएडा GREATER NOIDA	0%	100%	0%	0%	0	799	742	776
20		हापड़ HAPUR	0%	100%	0%	0%	1	807	735	776
21		जवाहरपुर JAWAHARPUR	0%	100%	0%	0%	2	801	741	773
22		झाटिका JHATIKARA	0%	100%	0%	0%	0	799	746	774
23		कानपुर जेआइएस KANPUR GIS	0%	100%	0%	0%	0	793	742	771
24		खेतरी KHETRI	0%	100%	0%	0%	0	805	748	776
25		कोटेश्वर KOTESHWAR	0%	100%	0%	0%	0	802	744	772
26		ललितपुर LALITPUR	0%	100%	0%	0%	0	781	737	759
27		लखनऊ LUCKNOW	0%	100%	0%	0%	0	795	743	772
28		मैनपुरी MAINPURI	0%	100%	0%	0%	0	799	739	770
29		मेरठ MEERUT	0%	100%	0%	0%	1	806	745	776
30		मेरठ(UP) MEERUT (UP)	0%	100%	0%	0%	1	802	737	775
31		मोगा MOGA	0%	100%	0%	0%	0	808	731	767
32		ओबरा सी OBRA C	0%	100%	0%	0%	0	779	748	765
33		उरई ORAI	0%	99%	1%	1%	6	807	752	782
34		फागी PHAGI	0%	100%	0%	0%	0	803	746	778
35		रामपुर RAMPUR	0%	100%	0%	0%	3	804	723	760
36		उन्नाव UNNAO	0%	100%	0%	0%	0	791	737	767
37		वाराणसी VARANASI	0%	100%	0%	0%	0	793	751	774
1	पश्चिमी क्षेत्र WR	अकोला AKOLA	0%	100%	0%	0%	0	796	736	772
2		औरंगाबाद AURANGABAD	0%	100%	0%	0%	0	799	740	775
3		भोपाल (बीडीटीसीएल) BHOPAL (BDTCL)	0%	100%	0%	0%	0	798	739	771
4		भुज BHUJ	0%	100%	0%	0%	0	795	746	776
5		भुज-2 BHUJ-II	0%	100%	0%	0%	0	789	746	770
6		बिलासपुर BILASPUR	0%	100%	0%	0%	0	785	745	764
7		बोना BINA	0%	100%	0%	0%	0	801	750	778
8		बनसकंठा BANASKANTHA	0%	100%	0%	0%	0	801	753	783
9		चांपा CHAMPA	0%	99%	1%	1%	6	805	761	782
10		धुल (बीडीटीसीएल) DHULE (BDTCL)	0%	100%	0%	0%	0	798	742	776
11		धर्मजयगढ़ DHARAMJAGARH	0%	100%	0%	0%	0	784	746	767
12		रायपुर पूलिंग RAIPUR POOLING	0%	100%	0%	0%	0	792	745	772
13		एकतुनी EKTUNI	0%	100%	0%	0%	0	796	738	770
14		गदरवाड़ा GADARWARA	0%	99%	1%	1%	7	804	757	782
15		ग्वालियर GWALIOR	0%	100%	0%	0%	3	804	746	779
16		इंदौर INDORE	0%	100%	0%	0%	0	795	745	773
17		जबलपुर JABALPUR	0%	97%	3%	3%	19	806	761	783
18		खडवा KHANDWA	0%	100%	0%	0%	0	796	748	776
19		कोरडी KORADI	0%	100%	0%	0%	0	784	745	766
20		लकाडिया LAKADIYA	0%	100%	0%	0%	0	800	752	781
21		रायगढ़ पूलिंग RAIGARH POOLING	0%	100%	0%	0%	0	797	763	780
22		पड़रु PADGHE	0%	100%	0%	0%	2	806	742	777
23		पारली PARLI	0%	98%	2%	2%	15	805	752	781
24		पुणे PUNE	0%	99%	1%	1%	5	807	738	779
25		राजनंगांव RAJNANDGAON	0%	99%	1%	1%	5	805	748	779
26		सानास SASAN	0%	100%	0%	0%	5	791	746	776
27		सतना SATNA	0%	100%	0%	0%	4	801	756	781
28		सिवनी SEONI	0%	100%	0%	0%	0	794	744	770
29		सोपट SIPAT	0%	100%	0%	0%	0	785	748	765
30		सोलापुर SOLAPUR	0%	96%	4%	4%	28	806	751	785
31		तिरंगा TIRORA	0%	100%	0%	0%	0	782	748	764
32		तामनार TAMNAR	0%	100%	0%	0%	0	796	766	780
33		वडादरा VADODARA	0%	100%	0%	0%	4	804	740	777
34		विंध्याचल पूलिंग VINDHYACHAL PS	0%	100%	0%	0%	0	795	764	779
35		वर्धा WARDHA	0%	100%	0%	0%	0	797	736	773
36		वरौरा WARORA	0%	99%	1%	1%	4	802	737	779
1	दक्षिणी क्षेत्र SR	अरियलूर ARIYALUR	0%	99%	1%	1%	8	810	729	757
2		कुडपा CUDDAPAH	0%	92%	8%	8%	58	811	743	785
3		चिल्कलुरिपेट CHILAKALURIPETA	0%	99%	1%	1%	9	809	733	780
4		कुरुनल KURNOOL	0%	100%	0%	0%	0	800	736	774
5		महेश्वर MAHESWARAM	0%	92%	8%	8%	61	810	741	785
6		निज़ामाबाद NIZAMABAD	0%	93%	7%	7%	56	814	744	785
7		नेल्लूर पूलिंग NELLORE PS	0%	100%	0%	0%	0	795	744	773
8		रायचूर RAICHUR	0%	100%	0%	0%	2	802	742	778
9		श्रीकाकुलम SRIKAKULAM	0%	97%	3%	3%	21	811	742	783
10		थिरुवल्लम THIRUVALEM	0%	100%	0%	0%	1	800	722	772
11		वेमागिरी VEMAGIRI	0%	95%	5%	5%	35	808	742	781
12		वारंगल WARANGAL	0%	96%	4%	4%	33	805	740	784
1	पूर्वोत्तर क्षेत्र NER	बिस्वनाथ चरिआल BISWANATH CHARIALI (400 kV)	0%	100%	0%	0%	0	421	364	408
2		बोंगाईगांव BONGAIGAON (400 kV)	0%	100%	0%	0%	0	416	396	408
3		बोंगाईगांव टीपीएस BONGAIGAON TPS (400 kV)	0%	100%	0%	0%	0	418	398	410
4		इम्फाल IMPHAL (400 kV)	0%	100%	0%	0%	0	417	395	406
5		बर्निहाट BYRNHAT (400 kV)	0%	100%	0%	0%	0	421	398	411
6		कामेंग KAMENG (400 kV)	0%	100%	0%	0%	0	413	390	403
7		अज़ारा AZARA (400 kV)	0%	100%	0%	0%	0	402	391	397
8		मिसा MISA (400 kV)	0%	100%	0%	0%	0	414	391	403
9		न्यू मारियानी NEW MARIANI (400 kV)	0%	100%	0%	0%	0	417	395	406
10		न्यू कोहिमा NEW KOHIMA (400 kV)	0%	100%	0%	0%	0	420	395	407
11		पालाताना PALATANA (400 kV)	0%	100%	0%	0%	0	414	402	408
12		पूबकेचनबारी PK BARI (400 kV)	0%	100%	0%	0%	0	412	390	403
13		रंगानादी RANGANADI (400 kV)	0%	100%	0%	0%	1	422	398	409
14		सिलचर SILCHAR (400 kV)	0%	100%	0%	0%	0	418	397	408
15		सूर्यजमाननगर SURJAMANINAGAR (400 kV)	0%	100%	0%	0%	0	410	388	402
17		थोबाल THOUBAL (400 kV)	0%	100%	0%	0%	0	414	390	403

All listed stations are 765 kV stations unless otherwise mentioned
*Percentage is calculated w.r.t. Time of one month.

23. ALL TIME HIGHEST

31-12-2023

	Maximum Demand Met during the day (MW)	Demand Met during Evening Peak hrs(MW)	Energy Met (MU)	Hydro Gen. (MU)	Wind Gen. (MU)	Solar Gen. (MU)
NR	81220 04-09-2023	76274 04-09-2023	1796 04-09-2023	443 01-08-2023	86 07-08-2023	147 10-05-2023
WR	74125 22-12-2023	65518 13-10-2023	1618 02-09-2023	167 18-12-2014	273 07-08-2023	70.69 12-05-2023
SR	64314 15-03-2023	52366 18-04-2023	1329 19-04-2023	208 31-08-2018	298 21-07-2023	142.7 21-03-2023
ER	29641 28-07-2023	28579 18-04-2023	639 08-06-2023	157 14-09-2022	-	7 23-03-2023
NER	3712 04-09-2023	3510 12-08-2022	72 15-09-2023	41 29-08-2023	-	2 22-06-2022
All India	239978 01-09-2023	215592 28-08-2023	5224 02-09-2023	877 30-08-2022	611 02-08-2023	351 10-05-2023
Regions	States	Max. Demand Met during the day (MW)		Energy Consumption (MU)		
			As on date		As on date	
NR	Punjab	15237	23-06-2023	343.5	24-06-2023	
	Haryana	12692	18-08-2023	273.1	18-08-2023	
	Rajasthan	17772	02-09-2023	371.6	04-09-2023	
	Delhi	7770	29-06-2022	153.5	28-06-2022	
	UP	28553	25-07-2023	580.0	03-09-2023	
	Uttarakhand	2594	14-06-2022	55.8	17-06-2023	
	HP	2162	27-12-2023	40.7	22-08-2023	
	J&K(UT) and Ladakh(UT)	3636	29-06-2023	65.4	20-01-2023	
	Chandigarh	426	08-07-2021	8.4	08-07-2021	
Railways NR ISTS	-	-	-	-		
WR	Chhattisgarh	5832	02-09-2023	133.5	28-08-2023	
	Gujarat	24544	01-09-2023	511.6	02-09-2023	
	MP	17819	29-12-2023	335.9	10-11-2023	
	Maharashtra	28846	14-04-2022	636.1	21-06-2023	
	Goa	776	07-06-2023	17.1	08-06-2023	
	DD & DNH	1327	17-08-2023	30.9	10-08-2023	
	AMNSIL	977	18-08-2021	21.0	31-05-2022	
	Balco	-	-	-	-	
SR	Andhra Pradesh*	13039	19-10-2023	263.8	16-06-2023	
	Telangana*	15497	30-03-2023	303.4	03-03-2023	
	Karnataka	16950	25-08-2023	309.5	20-04-2023	
	Kerala	5024	18-04-2023	103.3	19-04-2023	
	Tamil Nadu	19387	20-04-2023	415.4	20-04-2023	
	Pondy	512	17-05-2023	11.6	18-05-2023	
ER	Bihar	7578	27-07-2023	161.3	28-07-2023	
	DVC	3751	18-04-2023	81.2	22-04-2022	
	Jharkhand	1923	16-06-2023	43.3	17-06-2023	
	Odisha	7192	19-04-2023	145.5	25-09-2022	
	West Bengal	11868	18-04-2023	245.7	18-04-2023	
	Sikkim	137	03-02-2022	2.5	28-01-2020	
	Railways ER ISTS	-	-	-	-	
NER	Arunachal Pradesh	179	16-09-2023	3.2	04-09-2023	
	Assam	2498	16-09-2023	50.0	15-09-2023	
	Manipur	258	31-01-2022	3.7	10-02-2022	
	Meghalaya	415	09-02-2022	7.8	31-01-2022	
	Mizoram	157	16-01-2023	2.3	18-01-2023	
	Nagaland	179	28-09-2023	3.29	05-09-2023	
	Tripura	370	07-06-2023	7.0	06-06-2023	
*SR	Andhra Pradesh (Undivided)	13162	23-03-2014	284.8	22-03-2014	

24.System Reliability Indices Report for the month of December 2023

Percentage (%) of times ATC was violated

S.No.	Corridor	Number of Blocks Violated	Number of Hours Violated	%Violation
1	WR-NR	12	3.00	0.40
2	ER-NR	0	0.00	0.00
3	Import of NR	0	0.00	0.00
4	NEW-SR	0	0.00	0.00
5	NER Import	0	0.00	0.00

Percentage(%) of times (N-1) Criteria was violated

S.No.	Corridor	Number of Blocks Violated	Number of Hours Violated	%Violation
1	WR-NR	1	0.25	0.03
2	ER-NR	0	0.00	0.00
3	Import of NR	0	0.00	0.00
4	NEW-SR	0	0.00	0.00
4	NER Import	0	0.00	0.00

Remarks: Flows crossing Total Transfer Capability (TTC) on interregional corridors has been worked out as a proxy for (N-1) violation.



POWER SYSTEM OPERATION CORPORATION LIMITED

पावर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड

NATIONAL LOAD DESPATCH CENTRE – राष्ट्रीय भार प्रेषण केन्द्र

First floor, B-9, Qutab Institutional Area,
Katwaria Sarai, New Delhi-110016.