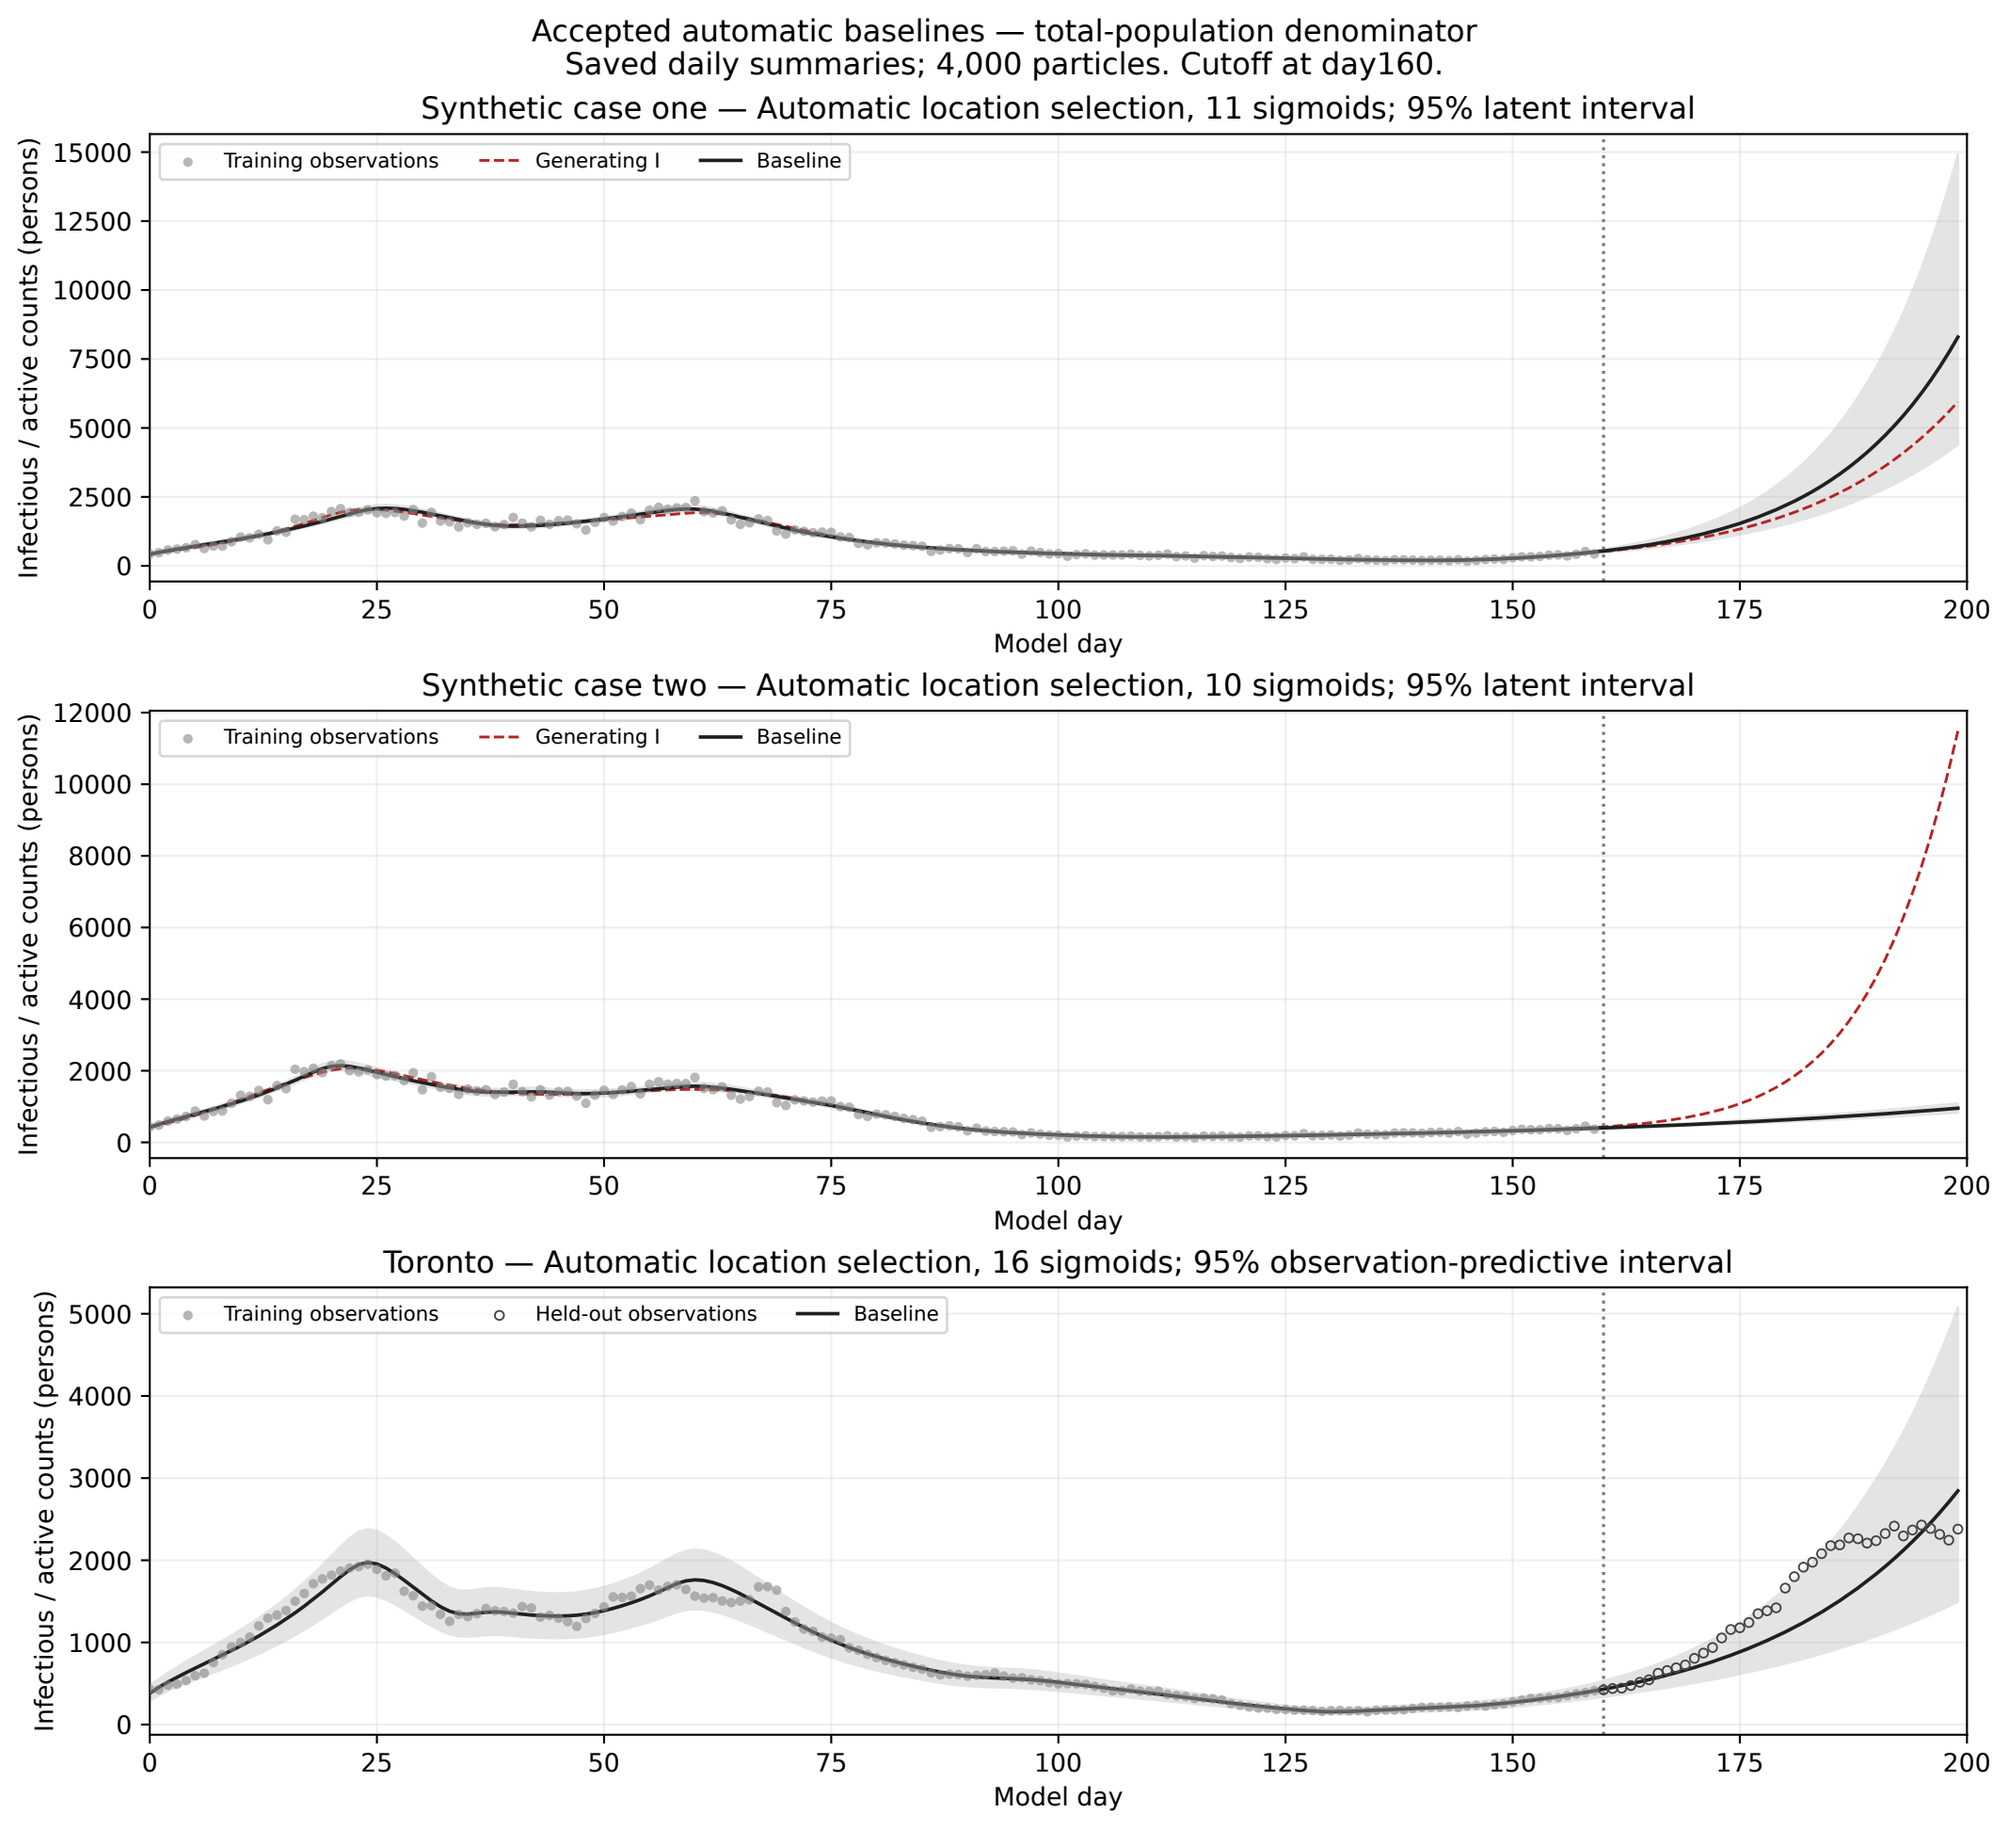
Accepted automatic baselines — total-population denominator
Saved daily summaries; 4,000 particles. Cutoff at day160.
Synthetic case one — Automatic location selection, 11 sigmoids; 95% latent interval
Training observations
Generating I
Baseline
Infectious / active counts (persons)
Model day
Synthetic case two — Automatic location selection, 10 sigmoids; 95% latent interval
Training observations
Generating I
Baseline
Infectious / active counts (persons)
Model day
Toronto — Automatic location selection, 16 sigmoids; 95% observation-predictive interval
Training observations
Held-out observations
Baseline
Infectious / active counts (persons)
Model day