


1 2 3 4 5 6 20

R a b c d e

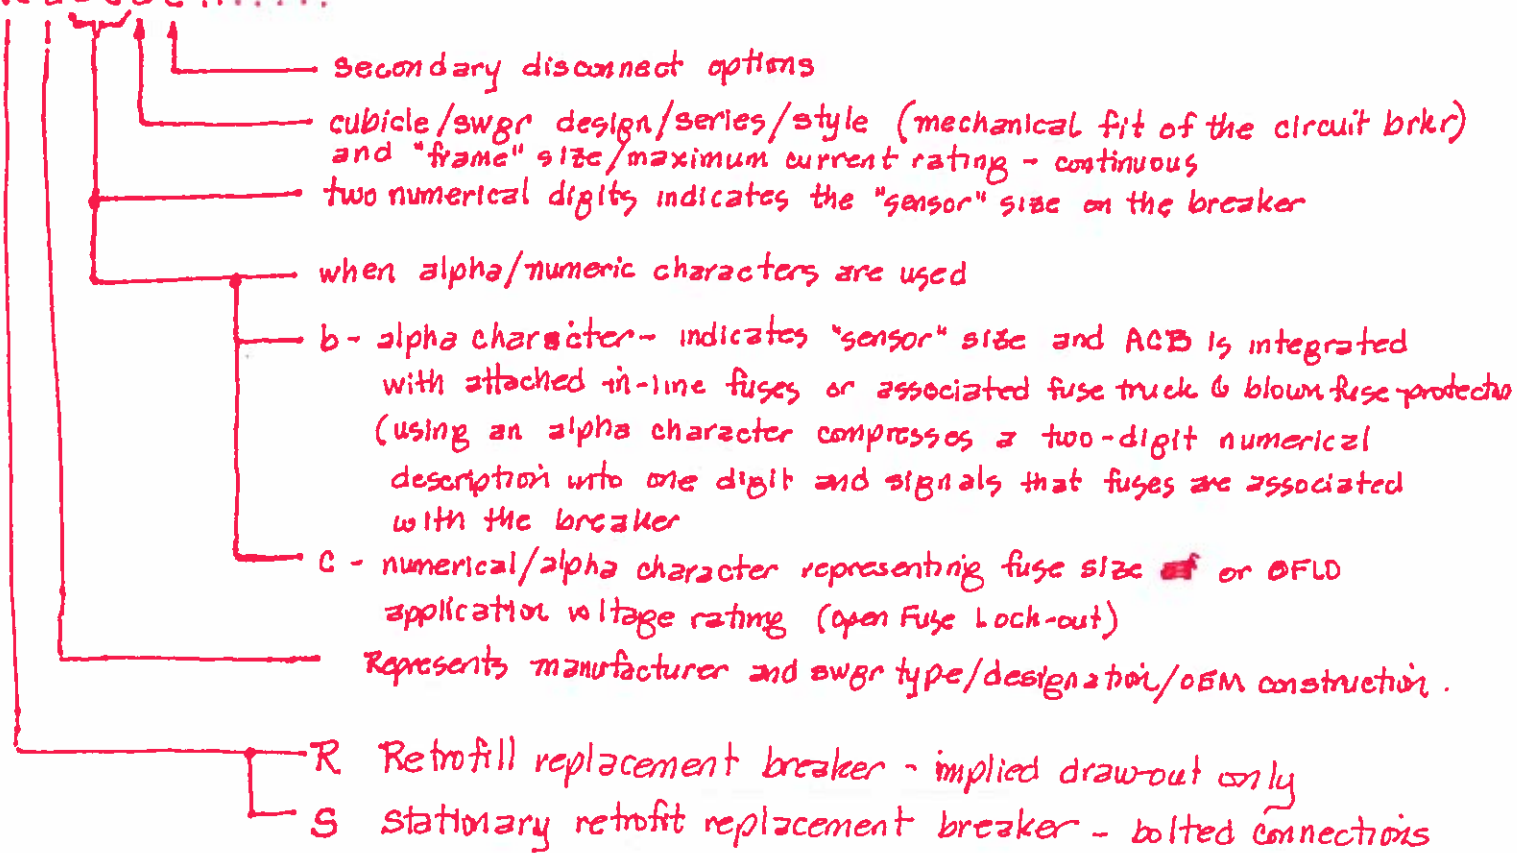

Digits 7-20 are tables describing various options on the ACB.

Table for Digit 10 (UV device, needs to be expanded to show UV1/ST3 - undervoltage device 1, and shunt trip 3)

Digit 15 Table needs to be updated to latest and greatest.

¹⁶
Digit ₁ is always "L"

Digit 20 ratings plug is dependent/limited by numerical combo 3&4 or alpha listing of digit 3.

Interrupting Ratings / Withstand Ratings etc are buried look-up tables.

These need to be able to be updated or new ones made to "point" to various retrofit circuit breaker applications -

dmlh/ADB
2019-05-03