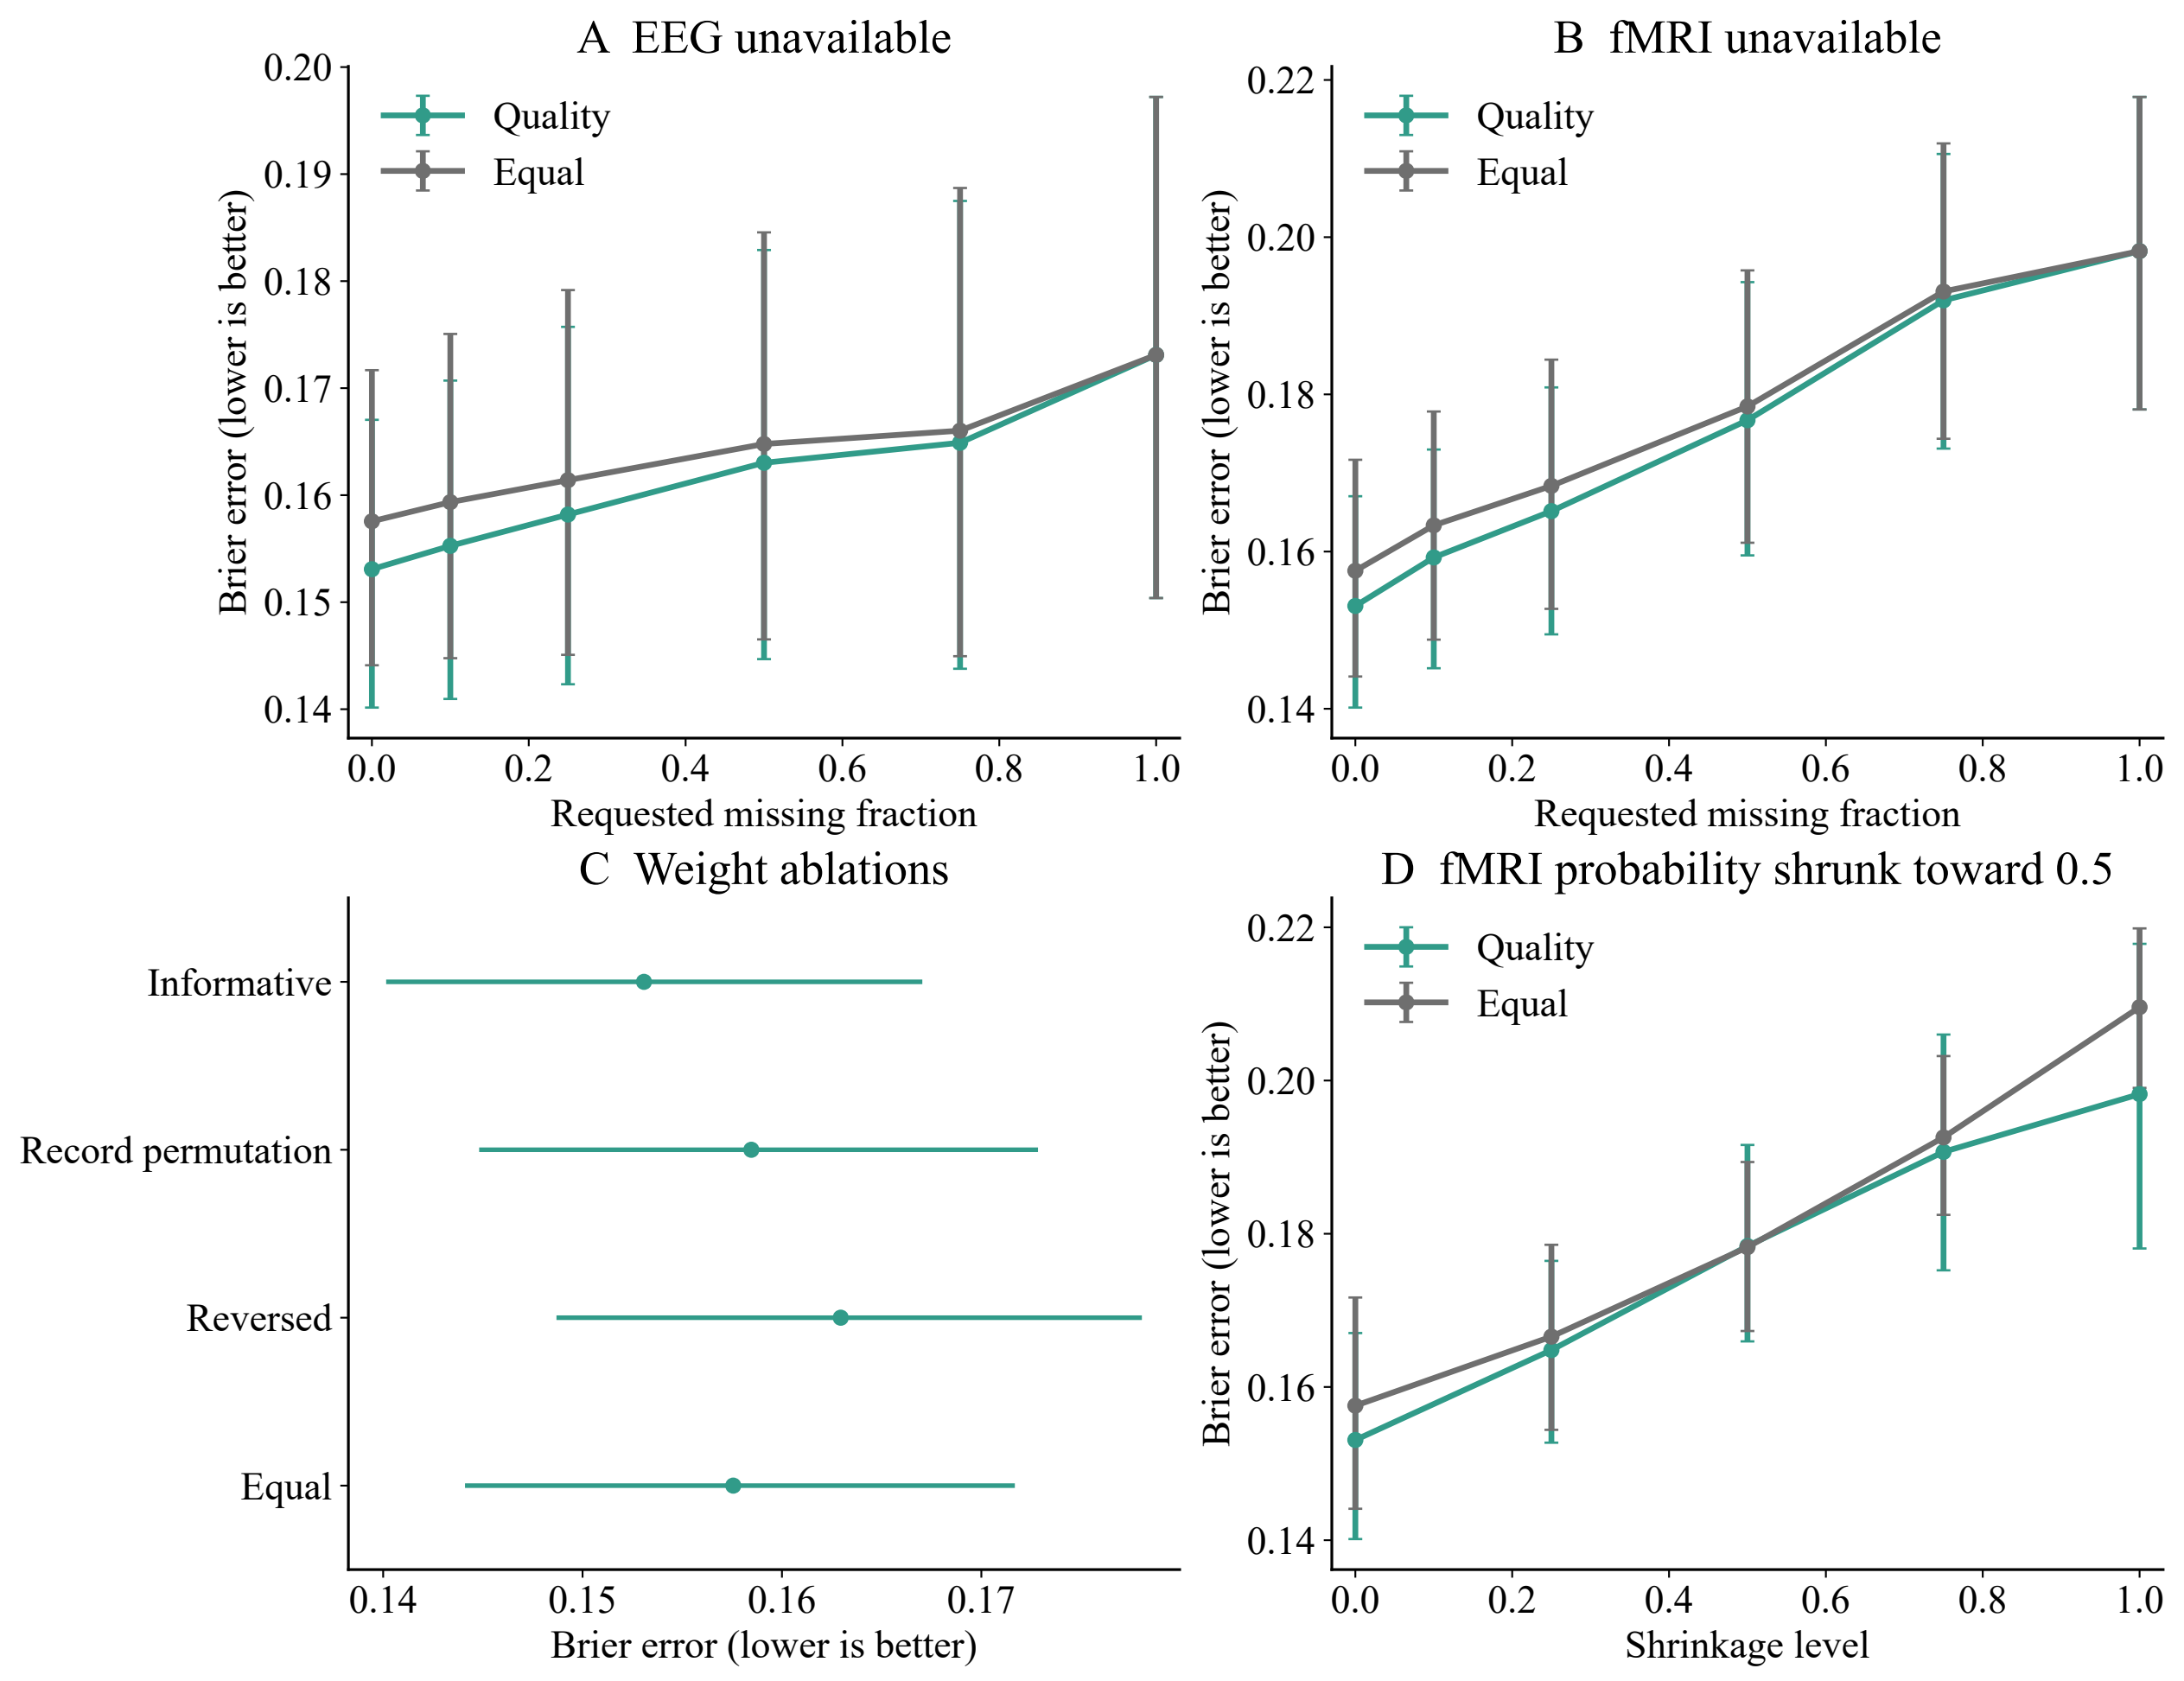
A EEG unavailable
Quality
Equal
Brier error (lower is better)
0.20
0.19
0.18
0.17
0.16
0.15
0.14
0.0
0.2
0.4
0.6
0.8
1.0
Requested missing fraction
B fMRI unavailable
Quality
Equal
Brier error (lower is better)
0.22
0.20
0.18
0.16
0.14
0.0
0.2
0.4
0.6
0.8
1.0
Requested missing fraction
C Weight ablations
Informative
Record permutation
Reversed
Equal
0.14
0.15
0.16
0.17
Brier error (lower is better)
D fMRI probability shrunk toward 0.5
Quality
Equal
Brier error (lower is better)
0.22
0.20
0.18
0.16
0.14
0.0
0.2
0.4
0.6
0.8
1.0
Shrinkage level