Tower Q: UDCPR compliance check

Automated check of architectural drawings against selected UDCPR (Maharashtra) regulations. Report date 06 Oct 2026.

Drawings checked

Drawing	Source file	Scale	Checked on
Unit plan	2028.09.23_TOWER Q_UNIT PLANS-Model-5.pdf	0.0477 m/pt, fitted to labelled room dimensions	01 Oct 2026
Parking P1	2026.09.23_TOWER Q - PARKING FLOOR PLANS-Model.pdf (P1 at +554.10)	0.1704 m/pt; RERA AREA dimension 16.2 pt labelled 2.76 m (lift lobby); cross-check: lift doors 0.89-0.90 m	01 Oct 2026

Summary

Drawing	Rule	Requirement	Result
Unit plan	**UDCPR-9.20.1**	Natural lighting of habitable rooms and kitchens	**5 PASS**, **1 FAIL**, **2 REVIEW**, **6 CANNOT DETERMINE**
Parking P1	**UDCPR-8.1.1**	car bay ≥ 2.5 x 5.0 m (64 bays)	**PASS (at limit)**
Parking P1	**UDCPR-8.1.1**	drive width ≥ 3.0 m (Drive aisle)	**PASS**
Parking P1	**UDCPR-8.1.1**	2W bay ≥ 1.0 x 2.0 m (2W spaces)	**CANNOT DETERMINE**
Parking P1	**UDCPR-9.12.2**	ramp width ≥ 3.0 m (West exit ramp)	**PASS**
Parking P1	**UDCPR-9.12.2**	ramp slope ≤ 1:8 (Ramps)	**PASS (annotation only)**
Parking P1	**UDCPR-9.12.2**	number of ramps (Ramps)	**CANNOT DETERMINE**

Result meanings

PASS requirement met on the measured geometry. **FAIL** requirement not met. **REVIEW** a judgement is needed that the drawing alone cannot settle. **CANNOT DETERMINE** the drawing does not contain the data the rule needs; this is never reported as PASS. A qualifier in brackets, e.g. PASS (at limit), limits the PASS and is explained in the detail column.

Basis and limitations

Rule values are draft records taken from a summary of UDCPR regulations, not yet verified against the notified text; some conditions (e.g. small-plot exceptions) are not encoded. Geometry is extracted automatically from plotted PDF drawings; lengths carry the scale uncertainty stated per drawing. This report is an aid to plan scrutiny and does not replace review by the competent authority.

1. Unit plan: UDCPR 9.20.1 natural lighting

Each habitable room and kitchen needs openings of at least 1/10 of its floor area to the exterior or an open deck (opening_ratio), and no part of the room may be more than 7.5 m from such an opening (depth).

14 checks: **5 PASS**, **1 FAIL**, **2 REVIEW**, **6 CANNOT DETERMINE**

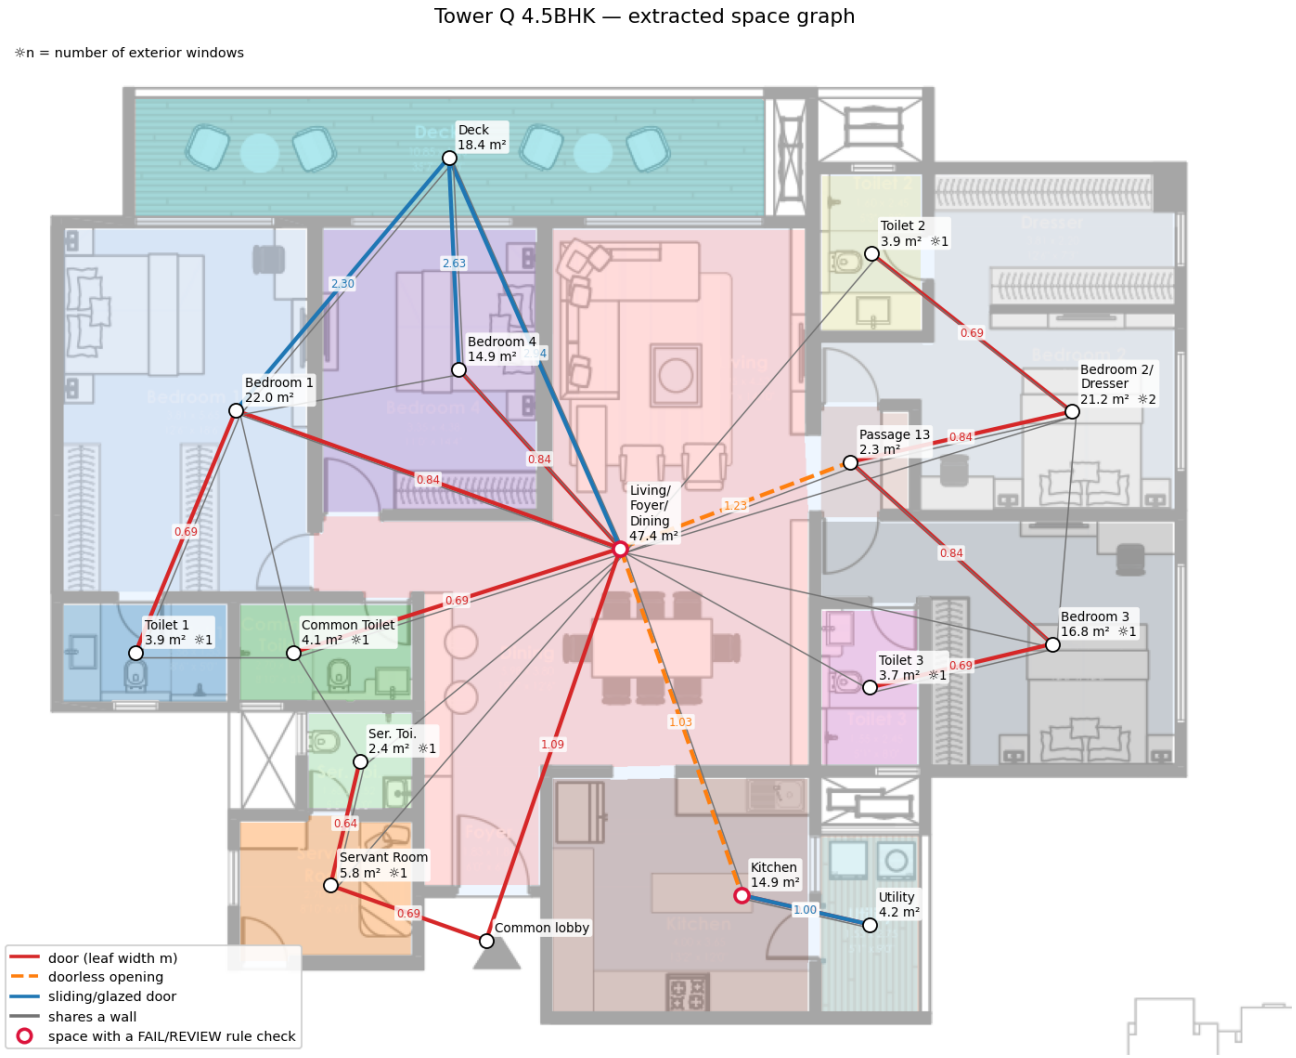


Figure 1. Extracted rooms and connections. Rooms circled in red have a FAIL or REVIEW result. Edge labels are door leaf widths or glazing widths in metres.

Results by room

Room	Area m²	Check	Result	Detail
Bedroom 1	22.04	opening ratio	**CANNOT DETERMINE**	needs 2.20 m2 of openings (0.1 x 22.04 m2); glazed width 2.30 m, so openings must be at least 0.96 m high on average - opening head/sill heights are not in the drawing; via glazed door to Deck 2.30 m
Bedroom 1		depth	**PASS**	farthest floor point 5.7 m from the nearest opening (limit 7.5 m)
Servant Room	5.83	opening ratio	**CANNOT DETERMINE**	needs 0.58 m2 of openings (0.1 x 5.83 m2); glazed width 0.98 m, so openings must be at least 0.59 m high on average - opening head/sill heights are not in the drawing; via window to exterior 0.98 m
Servant Room		depth	**PASS**	farthest floor point 2.6 m from the nearest opening (limit 7.5 m)
Living / Foyer / Dining	47.42	opening ratio	**CANNOT DETERMINE**	needs 4.74 m2 of openings (0.1 x 47.42 m2); glazed width 2.94 m, so openings must be at least 1.61 m high on average - opening head/sill heights are not in the drawing; via glazed door to Deck 2.94 m

Room	Area m²	Check	Result	Detail
Living / Foyer / Dining		depth	**FAIL**	farthest floor point 10.5 m from the nearest opening (limit 7.5 m); 19% of the floor is beyond the limit
Bedroom 4	14.92	opening ratio	**CANNOT DETERMINE**	needs 1.49 m2 of openings (0.1 x 14.92 m2); glazed width 2.63 m, so openings must be at least 0.57 m high on average - opening head/sill heights are not in the drawing; via glazed door to Deck 2.63 m
Bedroom 4		depth	**PASS**	farthest floor point 4.3 m from the nearest opening (limit 7.5 m)
Kitchen	14.91	opening ratio	**REVIEW**	no glazing to exterior/open_deck; only glazed door to Utility 1.00 m - decide whether that space counts as a light source
Kitchen		depth	**REVIEW**	no glazing to exterior/open_deck; only glazed door to Utility 1.00 m - decide whether that space counts as a light source
Bedroom 3	16.77	opening ratio	**CANNOT DETERMINE**	needs 1.68 m2 of openings (0.1 x 16.77 m2); glazed width 2.58 m, so openings must be at least 0.65 m high on average - opening head/sill heights are not in the drawing; via window to exterior 2.58 m
Bedroom 3		depth	**PASS**	farthest floor point 5.4 m from the nearest opening (limit 7.5 m)
Bedroom 2 / Dresser	21.25	opening ratio	**CANNOT DETERMINE**	needs 2.12 m2 of openings (0.1 x 21.25 m2); glazed width 2.89 m, so openings must be at least 0.74 m high on average - opening head/sill heights are not in the drawing; via window to exterior 1.96 m, window to exterior 0.93 m
Bedroom 2 / Dresser		depth	**PASS**	farthest floor point 5.3 m from the nearest opening (limit 7.5 m)

Data needed to resolve CANNOT DETERMINE: window and door head and sill heights (elevations or a window schedule). The minimum average opening height each room needs is given in the detail column.

2. Parking level P1: UDCPR 8.1.1 and 9.12.2

64 car bays detected; drive aisle clear width 6.02 m typical, 3.58 m minimum.

6 checks: **4 PASS**, **2 CANNOT DETERMINE**



Figure 2. Parking level P1. Yellow: drive aisle clear area; the line along the aisle is its centreline, coloured by clear width; the narrowest point is marked in metres. Bay shading is a drawing-review aid and is not a rule result.

Results

Rule	Requirement	Item	Result	Detail
UDCPR-8.1.1	car bay ≥ 2.5 x 5.0 m	64 bays	**PASS (at limit)**	all bays 2.49-2.50 x 4.99-4.99 m; scale uncertainty about ±0.2%
UDCPR-8.1.1	drive width ≥ 3.0 m	Drive aisle	**PASS**	typical clear width 6.02 m (two-way); narrowest 3.58 m at the NE taper
UDCPR-8.1.1	2W bay ≥ 1.0 x 2.0 m	2W spaces	**CANNOT DETERMINE**	2W parking drawn as labelled zones ('SPACE FOR TWO WHEELER PARKING') without individual bays
UDCPR-9.12.2	ramp width ≥ 3.0 m	West exit ramp	**PASS**	hatched ramp strip 3.63 m between edges
UDCPR-9.12.2	ramp slope ≤ 1:8	Ramps	**PASS (annotation only)**	annotated 1:10 (exit) and 1:12 (two south ramps); geometric slope not verifiable: south ramps run off this sheet and level tags need the section
UDCPR-9.12.2	number of ramps	Ramps	**CANNOT DETERMINE**	needs all parking levels + plot area for the ≤1000/≤2000 sq.m exceptions

Data needed to resolve CANNOT DETERMINE: plans of all parking levels, building sections with ramp levels, plot area, and individual two-wheeler bays.