

WITT INDIA

www.wittindia.com



STORAGE, ERECTION, OPERATION AND MAINTENANCE MANUAL FOR Banana JET FAN

MODEL – JF - 315

Witt India Private Limited

VII Floor, Block-A, Q-City, Gachibowli, Nanakramguda, Hyderabad – 500 032. India

Tel: +40-4488 1800 Fax: +40-4488 1811

E-mail: info@wittindia.com website: www.wittindia.com

• Mumbai Mobile: 09322295348 • Chennai Ph: +44-22791476 • Kolkata Ph: +033-32958050
• New Delhi Ph: +1244271065 • Bangalore Ph: +080-41610597

WITT INDIA

CONTENTS

- 1 SAFETY**
 - 1.1 General
 - 1.2 Description of symbols and pictograms
 - 1.3 Start – Up
 - 1.4 Servicing
 - 1.5 Cleaning
 - 1.6 Electrical
 - 1.7 Description of labels and plates
- 2 APPLICATION**
 - 2.1 Design Conditions
 - 2.2 Warranty
- 3 DESCRIPTION**
 - 3.1 Design
 - 3.2 Options
- 4 ASSEMBLY AND INSTALLATION**
 - 4.1 Scope of Supplies
 - 4.2 Transport
 - 4.3.1 Storage
 - 4.3.2 Stand – by Operation
 - 4.4 Installation Site
 - 4.5 Electrical Connection
 - 4.6 Inspection
 - 4.6.1. Mechanical Testing
 - 4.6.2 Electrical Testing
- 5 START-UP**
 - 5.1 Putting the fan into operation
 - 5.2 Putting the fan out of operation
 - 5.3 Transient behavior
 - 5.3.1 General
 - 5.3.2 Direct starting
 - 5.3.3 Star delta starting
- 6 CARE AND MAINTENANCE**
 - 6.1 Lubrication
 - 6.1.1 Drive motor
 - 6.2 Troubleshooting
 - 6.3 Queries / Spare parts order

WITT INDIA

SAFETY PRECAUTIONS

The operation and maintenance of machinery of any kind require the person to be cautious and aware of the damages that exist. In order to avoid injuries to personal and damage to machinery, the following precautions are necessary.

1. Never apply power to the fan motor for any reason until the fan has been completely installed in its system, and the system inspected to make sure that no debris has been left in the fan and ducts, and it is known that the inspection doors at the inlet and outlet of the air passages are shut. The usual procedure is to remove the fuses from the disconnect switch and open its safety isolation switch until the installation is complete and fully inspected.
2. Start the fan momentarily and disconnect it. Observe rotation of the wheel and make sure that the drive rotation is correct. Do not allow the fan to run backward except only momentarily.
3. Do not open or access the inspection doors while the fan is running.
4. Always open the disconnect switch and lock-it in the open position with a padlock before doing any service or maintenance work on the fan.
5. After service of any kind, make certain that all adjustments have been properly made and tightened, inspection doors closed, there is no debris in the air passages and all tools have been removed before unlocking the disconnect switch to place the fan in operation.
6. Make a periodic inspection of the fan wheel, bearings and coupling to be sure that corrosion has not set in to weaken them. Where there are signs of corrosion there is a possible danger of mechanical failure. Corroded parts should be replaced.
7. Always use caution in every maintenance or operational procedure.

WITT INDIA

1.1 GENERAL


The fan meets the technical safety standards applicable at the time of delivery. The rules and regulations for the prevention of accidents applicable at the time of delivery were taken into account in the fan design.

It is not allowed to modify the original condition of the fan without the approval of Witt India. The warranty expires when parts other than original Witt India spare parts and/ or purchased parts not corresponding to the original parts are used.

The operating manual and any required supplementary manuals must be available to the operator.


It must be ensured that fans which are installed at high levels can only be reached via means of access especially installed for this purpose.


All devices and installations provided to prevent noxious substances from escaping must be checked before the fan is put into operation.

-  Do not bypass, loosen or remove guards and protective devices.
Do not open inspection ports and/ or other openings when the fan is in operation.

1.2 Description of Symbols and Pictograms

-  This symbol draws your attention to dangerous situations. The operation concerned may endanger persons and cause injuries.


-  This symbol is used to indicate that the work must be carried out by a trained and qualified electrician.

-  This symbol is followed by supplementary information.

1.3 Start-Up

The fan may only be put into operation (also for testing) when the inlet and outlet ports are provided with suitable guards/plate shutters or when pipes are connected to them.

Before the fan is started the housing and all pipes connected to it must be checked. They must be dry and free of screws, bolts, tools and other foreign substances.

-  Disregarding the above instructions may cause accidents and destroy the fan.
Observe the safety regulations for electrical machines and equipment.

→ (Electrical safety)

WITT INDIA

1.4 Servicing

The fan may only be serviced when the electrical system is dead, i.e;

- Turn off the electrical machines and ensure that they cannot be switched on again.
- Wait until the rotor has come to a standstill,
- Remove the motor fuse,
- Disconnect the power supply cable for the motor.

After servicing, guards and protective devices must be installed and all pipes must be connected again. All bolts and nuts must be tightened. Close all inspection openings and tighten the bolts and nuts.


The fan can then be put into operation again

1.5 Cleaning

Do not clean moving parts when the fan is in operation.

Before cleaning, the fan must be put out of operation. Ensure that the fan cannot be switched on again accidentally.

Only use suitable detergents and cleaning materials.

 If material is sticking to the impeller or the impeller is worn out, the fan may be seriously damaged by unbalance. It is therefore recommended to clean and check the fan for unusual vibrations at regular intervals.

1.6 Electrical Safety

The user has to ensure that the fan is only connected and serviced by a qualified electrician in accordance with the rules and regulations applying to electrical equipment.

The user must also ensure that the fan is operated in accordance with electro-technical rules and regulations.


Do not touch/work on live parts.

- Interrupt the power supply to the fan and use mechanical means to ensure that power supply cannot be switched on again.
- Use a voltage tester to check that the circuit is dead.
- Connect and short the work site to earth.
- Only use the fuses indicated in the electric circuit diagram.
- Check the condition of the visible cables before the fan is started.
- Replace damaged cables.

Damaged and/or defective electrical equipment must be repaired or replaced immediately. If the damaged equipment represents a risk, the fan may not be put into operation before the defect is repaired.

WITT INDIA

JET Fans

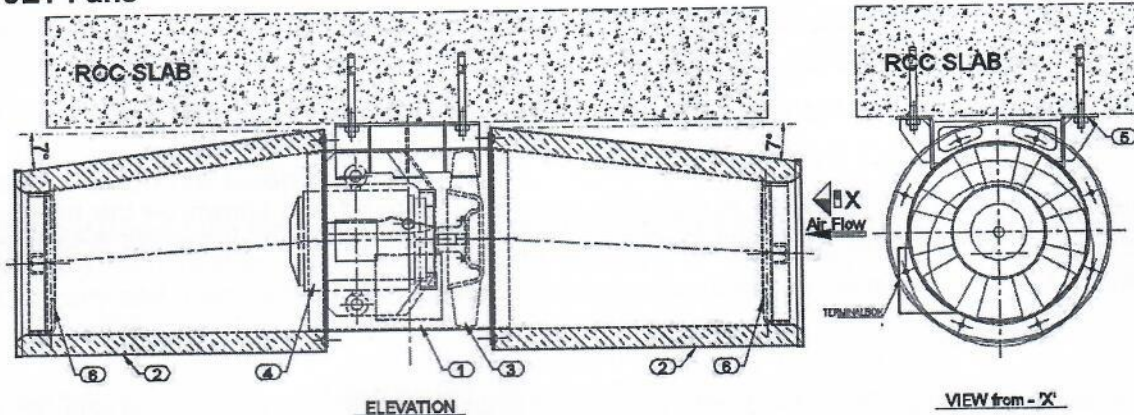

A Jet Fan consists of the following Parts:

1. Fan Assembly
2. Silencer
3. Impeller
4. Motor
5. Support Structure
6. Bird Screen

1.7 Description of Labels and Plates

The following plates are attached to the fan:

a. Nameplate

The nameplate indicates

WITT & SOHN			
Order No. : ..	Designation		
Model No. : ..			
Equip. No. : ..	Year	: ..	
V m ³ /h : ..	p Kg/m ³	: ..	
P _{st} Pa : ..	P _w kW	: ..	
n 1/min : ..	t °C	: ..	
Position : ..			
MOTOR			
Size : ..	U	: .. V	
No. of Poles : ..	Frequency	: .. Hz	
Design : ..	Insulation	: ..	
Rated Power : .. kW	Protection	: ..	
Classification : ..			
WITT INDIA VII Floor, Block - A, Q-City, Gachibowli Nanakramguda, HYDERABAD, India.			

- b. Company Logo
- c. Motor nameplate

WITT INDIA

2. APPLICATION

2.1 Design Conditions

The fan is designed, tested and supplied in accordance with the instructions given in the purchase order.

The basic instructions indicated in the order have been entered and shown on the name plate of the fan. It is not permitted to change the conditions under which the fan is to be used.

2.2 Warranty


The warranted data refer to the single values and testing conditions in accordance with the applicable standards and/or codes of practice. The special characteristics and local conditions of the plant in which the fan is to be incorporated must be taken into account by the plant designer and/or planning engineer in his order.

He has to base his order on the actual operating conditions.

3. DESCRIPTION

3.1 Design

The JET fans are driven directly by motor and the Cast Aluminium Impeller is mounted on motor extended shaft.

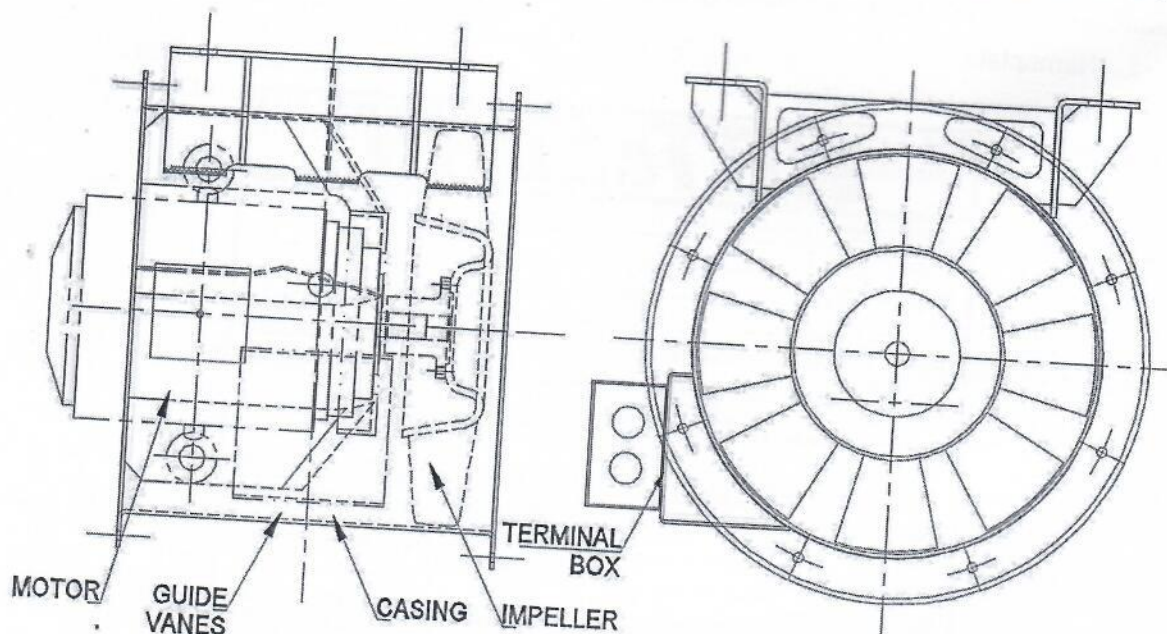

WITT INDIA

3.2 Options

Accessories are available to adapt the fan to certain specific plant characteristics.

4. ASSEMBLY


4.1 Scope of Supplies

When delivered the fan and accessories must be checked for damage caused by damaged packing. Immediately report any transport damage to the forwarding agent, insurance company and manufacturer. Any claim on transportation damages is not entertained by the fan supplier.

Check that everything indicated on the delivery note has been delivered.
In all other respects please refer to our terms and conditions for sale and delivery.


4.2 Transport

Only transport the fan with transport facilities which are appropriate for the conditions on the site where the fan is to be installed.

 Observe the applicable rules and regulations for the prevention of accidents.

For lifting and transporting the fan, only ropes and/or fork lift trucks with a sufficient lifting capacity may be used.

Only attach ropes to the Lifting Lug especially provided for lifting the fan.

 Do not sling lifting ropes to the inlet / outlet parts or motor. Do not use the eyelet on the motor for transporting the fan.

Warranty claims or claims for compensation for any damage caused by the use of unsuitable means of transport or caused by improper handling will not be accepted.

4.3.1 Storage

If the fan is not installed and / or put into operation immediately, it must be stored in a dry place which is free of vibrations.

In case of long-term storage please note the storage and preservation instructions for motors.

4.3.2 Stand-by Operation

In case of prolonged standstill periods, please note the relevant instructions for the storage of motors.

4.4 Installation Site

The installation site must be level and shall have a sufficient load bearing capacity. There must be enough space for assembly and maintenance work.

WITT INDIA

4.5 Electrical Connection



The fan may only be connected up to the electrical system by a qualified electrician. The drive motors are usually installed by the purchaser. The works warranty does not apply if the customer installs the motor.

The motor is connected in accordance with the circuit diagram inside the terminal box.

→ (Chap. Electrical safety)

The operating instructions of the motor manufactures must be observed.

The customer has to check that his power network and the switch gear and monitoring devices are sufficiently dimensioned to cope with the transient behavior and current peaks. It must be ensured that the supply of cooling air. To the electric motor is not hindered.

- The power supply cable for fan must be installed in accordance with the applicable legal stipulations
- Compare the local mains voltage with the voltage indicated on the rating plate of the fan.
- Connect the fan as shown on the circuit diagram inside the terminal box
- Earth the fan in accordance with the regulations issued by the local power supply company.
- Check the speed and sense of rotation.
- Check the transient behavior and starting time
- Provide for a motor protection system.

4.6 Inspection

4.6.1 Mechanical Testing

Check the fan after it has been assembled and installed.

- Check the attachment of the fan to the foundation
- Check if the impeller rotates freely (turn it with the hand).
- Remove any foreign objects from the fan housing.
- Check all bolted connections.

4.6.2 Electrical Testing

The electrical system of the fan may only be tested by a qualified electrician.

- Check the operating voltage.
- Check the earthing.
- Check the size of the fuses.

If the fan is not put into operation immediately after it has been assembled and installed, it must be secured against unauthorized used and covered with a tarpaulin

WITT INDIA

5. START-UP

5.1 Putting the fan into operation



The fan may only be put into operation by qualified and skilled staff. Before the fan is put into operation the staff must check that the fan is in good working order.

The rules and regulations for putting electrical machines into operation must be observed.

- Check the safety systems.
- Close the choking elements (if provided)
- Switch on the master controller.
- Switch on the fan.



The fan may only be switched on when the pipes are connected and when it is certain that there will be a sufficient plant resistance after the fan motor has reached its full operating speed.

- Check the sense of rotation of motor when the fan has started up for the first time (the motor must rotate in the direction indicated by the arrow)
- Check the power consumption. The maximum permissible power consumption must not be exceeded.

5.2 Putting the fan out of operation

- Switch off the fan.
- Turn master controller to "OFF" and secure it against unauthorized use.

5.3 Transient behavior

5.3.1 General

The fan can only be started when a sufficiently high moment of acceleration is available from the moment when the nominal speed is reached.


It is recommended to start the fan with the damper closed.



The customer has to check that his power network, switch gear, monitoring devices (if available) and cable cross sections are dimensioned to cope with the transient behavior and current peaks.

5.3.2 Direct starting


Direct starting of the fan motor not only causes a high starting torque but also a high starting current.

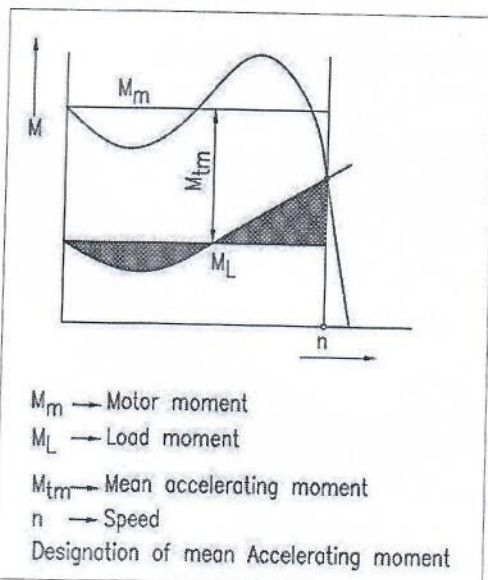

WITT INDIA

During start up the starting current may be 6 to 8 times as high as the nominal current (depending on the type of rotor)

This high power input must be taken into account when the fuse sizes are determined.

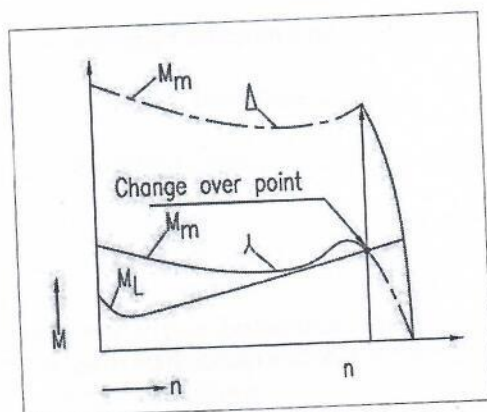

5.3.3 Star-delta starting

During star-delta starting the drive motor only provides for 1/3 of the starting torque in the star connection. At ascertain starting speed the load moment of the fan exceeds the starting torque of the motor. The motor does not accelerate. At this point the motor has to be changed over to the delta connection. The current peak which is then obtained is clearly lower than the one occurring during direct starting.

6. CARE AND MAINTENANCE

6.1 Lubrication

⚠ The fan must be checked at regular intervals (depending on the operating conditions) for proper lubrication.

6.2 Drive motor

The motor must be serviced in accordance with the motor's lubricating instructions.

WITT INDIA

6.3 Troubleshooting

Malfunction	Possible Cause	Action
Unsteady operation of fan	Material sticking to impeller blades	Carefully clean impeller
	Worn impeller	Replace impeller
	Impeller deformed by heat	Replace Impeller
	Fan distorted because of uneven foundation	Remove fan from foundation and level foundation again
	Incorrect setting of rubber metal buffers or spring isolators	Correct setting
	Strain exerted by connected pipes	Use flexible pipe connections (compensators)
Fan produces a grinding noise	Impeller rubs against housing	Loosen housing cover and re-align, check and correct pipe if necessary
The power input indicated on the rating plate is constantly exceeded	Motor noise	Check if bearings are damaged and replace bearings if necessary
	Air volume too much	Reduce air volume using choking element until the permissible power input is reached
		Check frequency
Fan does not accelerate	Different speed with 60 Hz mains	Check connection
	Improper connection of drive motor	Shorten change-over time from Star to Delta
	Motor does not change from Star to Delta connection	Close choking elements or install additional plate shutters
	Fan operates against insufficient plant resistance	Cable cross section and protective system must withstand starting current during acceleration.
	Motor protection system is not strong enough	

Contd.....

WITT INDIA

Malfunction	Possible Cause	Action
	Starting time is too long	Close choking elements, check starting torque of M_A/M_N motor
	Faulty drive motor	Check motor and replace if necessary
	Starting/re-starting when fan is hot	Switching frequency too high let motor run through (control via choking element)
	Starting current too high	Wrong voltage Provide Star-Delta starting, local mains not strong enough

6.4 Queries / Spare Parts order

If you have any queries or want to order for spare parts, & please ensure furnishing the following details to Witt India Private Limited.

- Model No. of the fan (Number indicated on name plate of the fan)
- Witt India Job Order No.
- Purchase order No. and date of supply.

An exact description will allow us to help you more quickly and efficiently. Information sent out by FAX or E-mail will be very much appreciated.

Witt India is committed to provide quality after sales service at economical price by experienced service personal. Please contact Witt India Private Limited, for their per-diem rates for supervision of erection, commissioning and repairs.

Please contact:

Witt India Pvt. Ltd.

VII Floor, Block - A, **Q-City**
Gachibowli, Nanakramguda
Hyderabad- 500 046
Tel: +040 4488 1800
Fax: +040 4488 1811

E-mail: info@wittindia.com website: www.wittindia.com

☎ **Bangaluru** : +88863 11337
☎ **Chennai** : +93810 63065
☎ **Kolkata** : +94330 32474

☎ **Mumbai** : +93222 95348
☎ **New Delhi** : +9873312255

Middle East Office:

☎ **Witt Middle East, UAE** : +971 50 17 95200
☎ **Witt South East Asia** : +0065 98 503415

WITT INDIA

Axial Fans

Industrial design, DN 250-2800 mm, adjustable vanes, tubular housing and wall mounted installation.

Fan accessories

Protecting grille, inlet nozzles, compensators, metal vibration buffers, circular filters, duct filters, counter flange, transition pieces, and suction boxes.

Special fan designs

Resistant to acid, heat and cold, gas-sealed, spark proof, impact resistant, low-wear, heat insulated and for direct pumping. Fans with special wear resistant lining on the impeller and rubber lining casings. Complete Fans with stainless steel construction for special duty conditions.

Throttle units

Torsion regulators, throttle valves, throttle blends, positioning motors.

Sound Protection

Fan sound insulation, carriage sound absorbers, tubular sound absorbers, sound-proof booths, sound insulated walls, disc sound absorbers.

Services

- Project specific engineering
- Installation of the fan into the system
- Existing fan performance
- Collecting data and evaluation
- Replacement parts
- Retrofit of Witt India impeller into others fan casing for improvement of efficiency
- Maintenance and inspection

Witt India Fans are providing reliable service throughout various sectors of industry:

- Cement
- Power station engineering
- Chemical, fertilizer and pharmaceuticals
- Paper & pulp, sugar industry
- Mining and Metallurgical industries
- Dust extraction systems
- Food / dairy industry
- Smelting, steel and rolling mills
- Waster incarnation plants
- Glass industry
- Petrochemical and Refineries
- Ventilation and gas humidification plants

Product mix

- Radial Fans
- Special Fan designs
- Fan accessories
- Throttle elements
- Acoustics and sound Protection

We undertake

- Incorporation of fan into the overall system.
- Engineering tailored to project requirements
- Fan performances review and maintenance/inspection, Energy savings.
- Retrofitting of high efficiency impellers into the existing fans.