

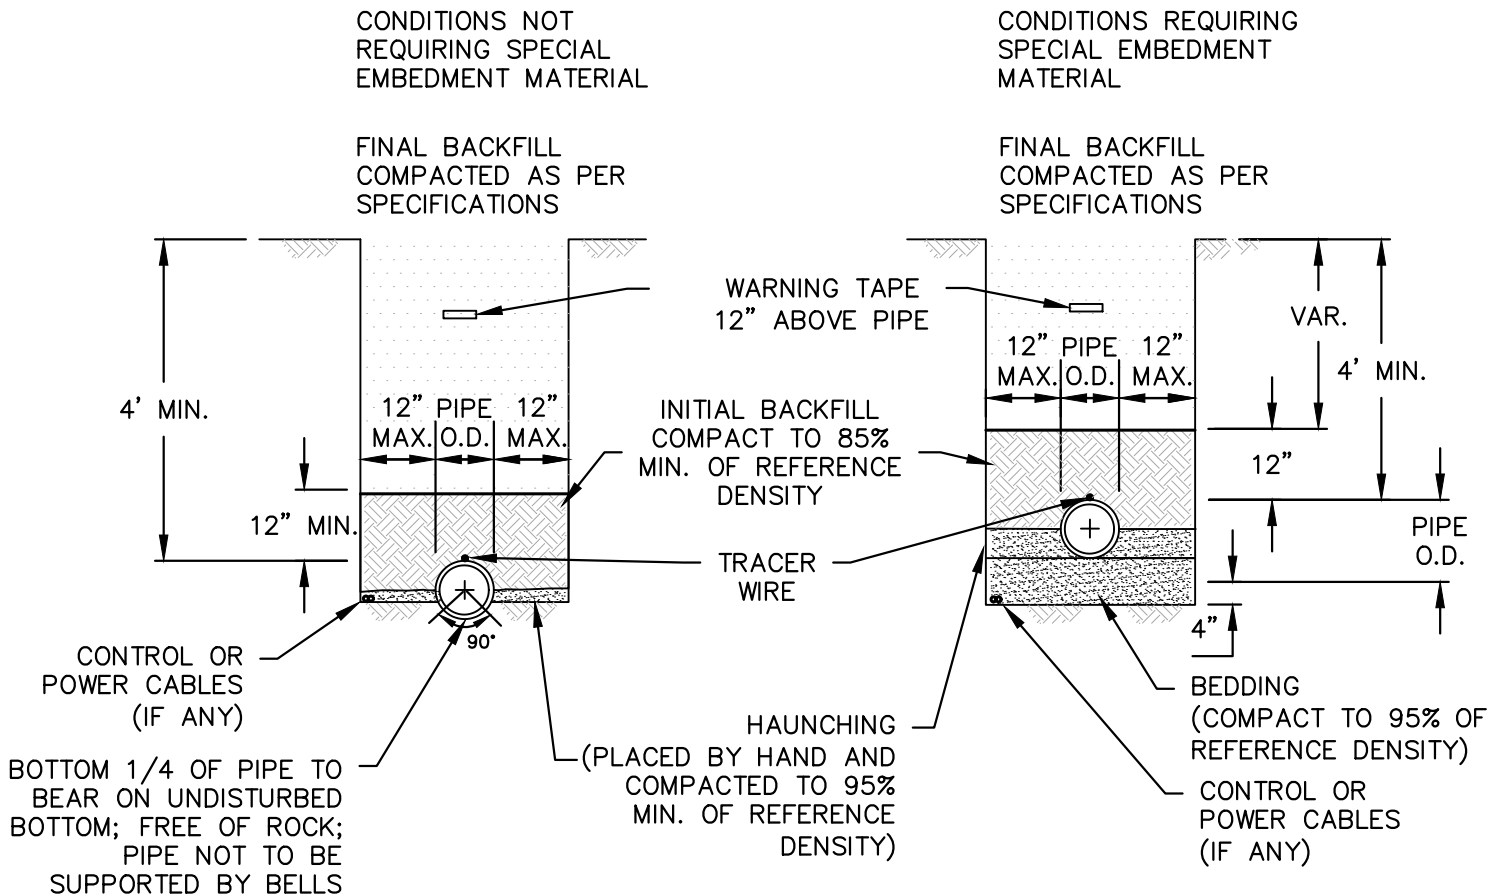


NOTES:

1. SPECIAL IMPORTED BEDDING AND HAUNCHING MATERIAL SHALL MEET THE CRITERIA OF THE UNIFIED SOILS CLASSIFICATION SYSTEM FOR GW, GP, SW OR SP SOILS.
2. ATTACH TRACER WIRE TO PIPE 3 TIMES PER 20' PIPE LENGTH, MINIMUM.
3. TRACER WIRE IS REQUIRED ON WATER MAINS, WATER SERVICE LINES AND SEWER FORCE MAINS PER TP-04, TP-05 AND TP-43.

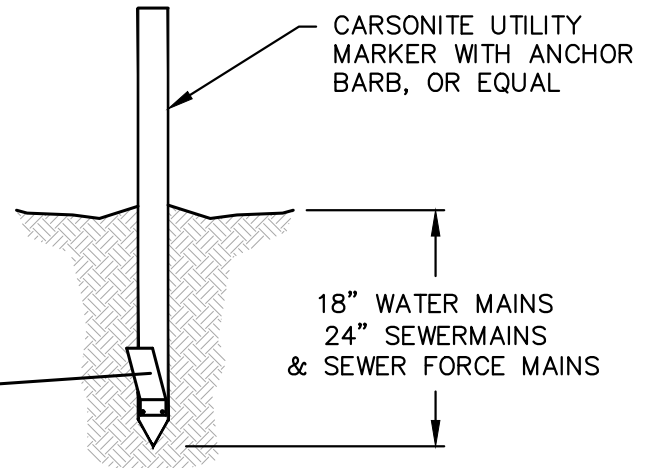

1A TYPICAL TRENCH SECTION
NTS

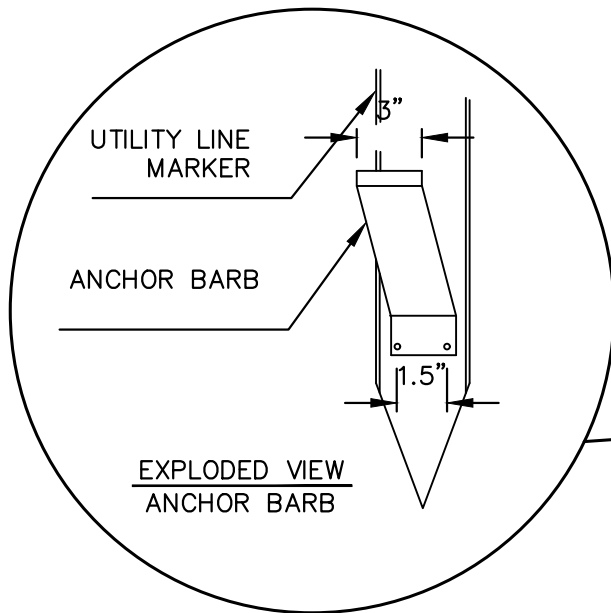


NOTE:

1. WATER MAIN MARKERS SHALL BE BLUE, 66" TALL, MARKED "CAUTION WATER PIPELINE"
2. SEWERMAIN & SEWER FORCE MAIN MARKERS SHALL BE GREEN, 72" TALL, MARKED "CAUTION SEWER PIPELINE"
3. MARKERS SHALL BE PLACED EVERY 500 L.F. ALONG THE SPAN OF UTILITY LINE.

1B

UTILITY LINE MARKER DETAIL

NTS

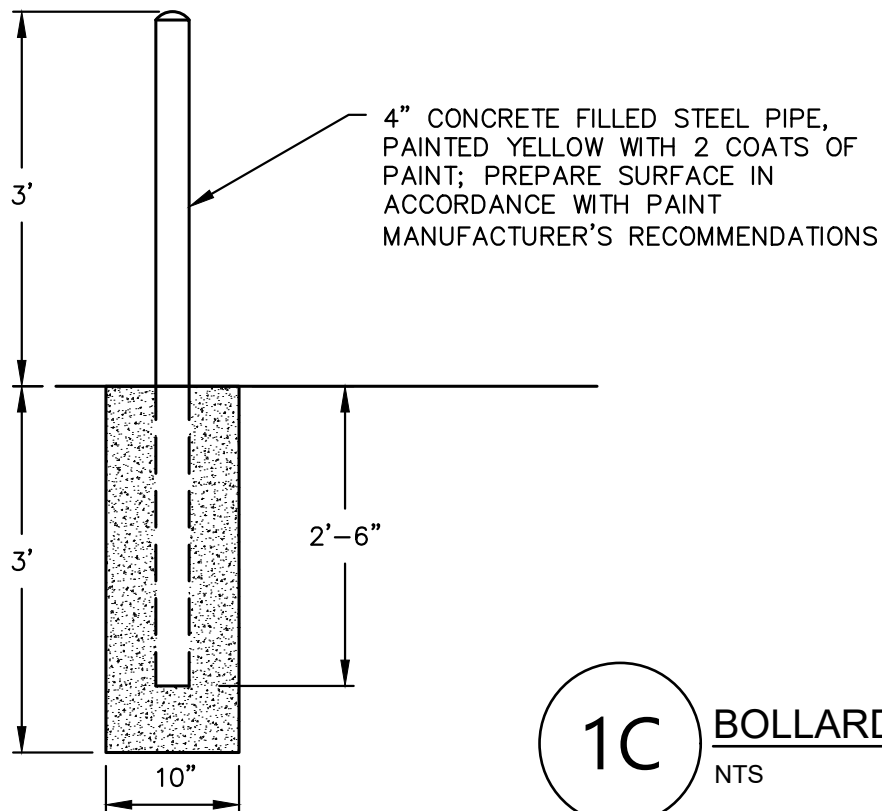


1C

BOLLARD DETAIL

NTS


NOTES:

1. WATERSTOP GASKET GROUTED INSIDE MANHOLE WALL REQUIRED FOR PIPE CONNECTIONS.
2. RING & COVER SHALL BE CENTERED ON THE SEWER LINE ON THE UPSTREAM SIDE OF THE MANHOLE.
3. IN NON-TRAFFIC AREAS: MANHOLE RIM SHALL EXTEND APPROX. 6" ABOVE FINISHED SURFACE.
4. IN TRAFFIC AREAS: RIM SHALL BE FLUSH WITH FINISHED TRAFFIC WAY/ROADWAY SURFACE.

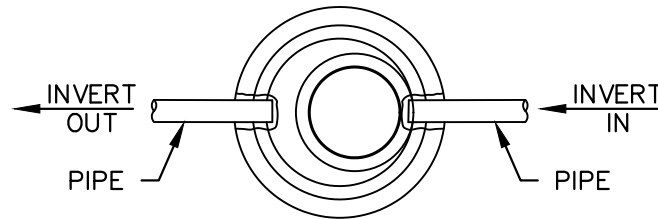


PLAN VIEW

NOTE:
MIN. DROP ACROSS MH SHALL BE 0.1'

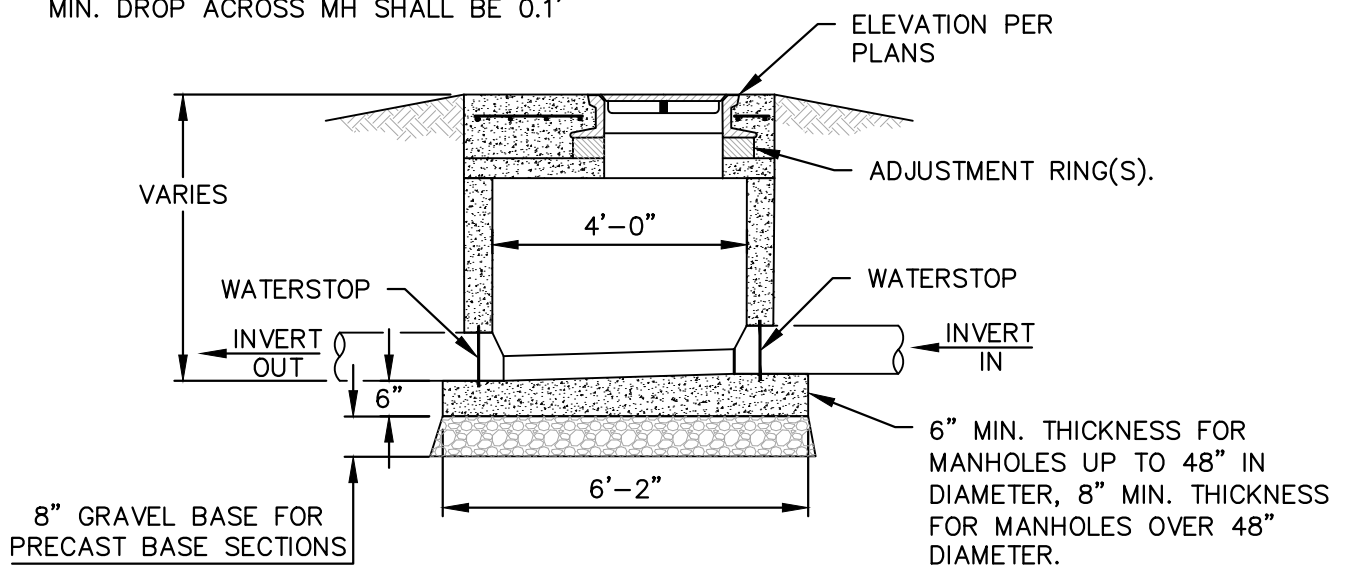

NOTES:


1. WATERSTOP GASKET GROUTED INSIDE MANHOLE WALL REQUIRED FOR PIPE CONNECTIONS.
2. CONE SHALL BE CENTERED ON THE SEWER LINE ON THE UPSTREAM SIDE OF THE MANHOLE.

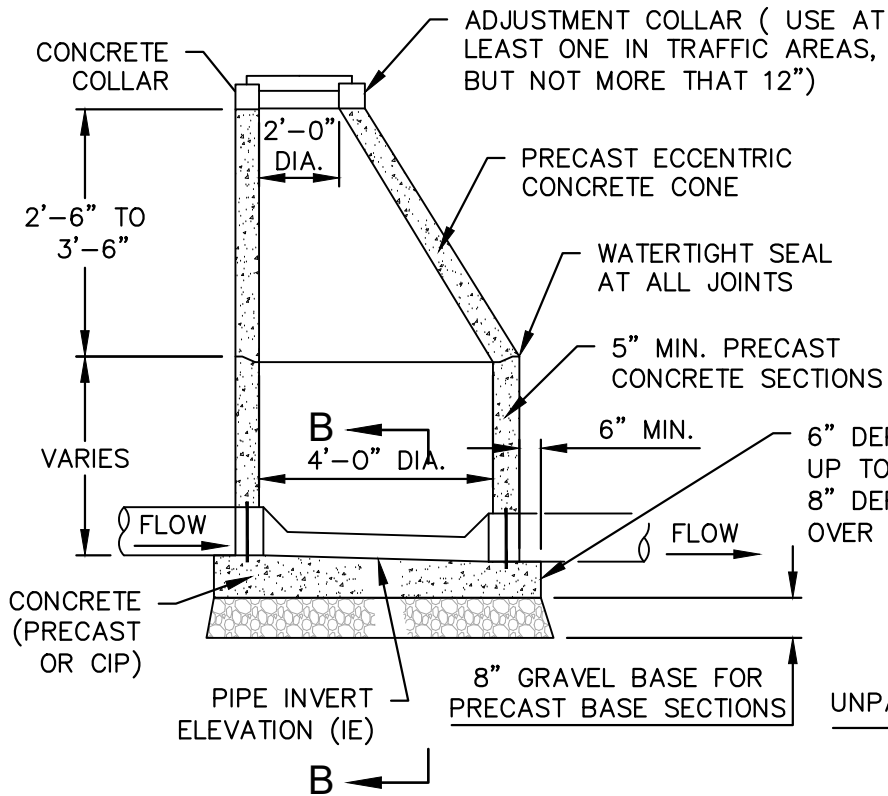

6B


STANDARD MANHOLE

NTS

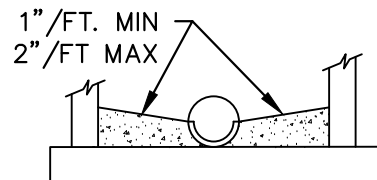


SECTION B-B


REINF. W/8 #4 PLACED AS SHOWN 2" COVER AT ENDS AND BOTTOM

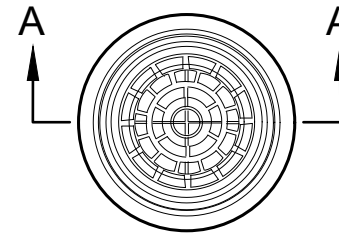


PLAN VIEW

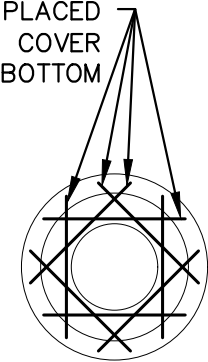

BAR PLACEMENT

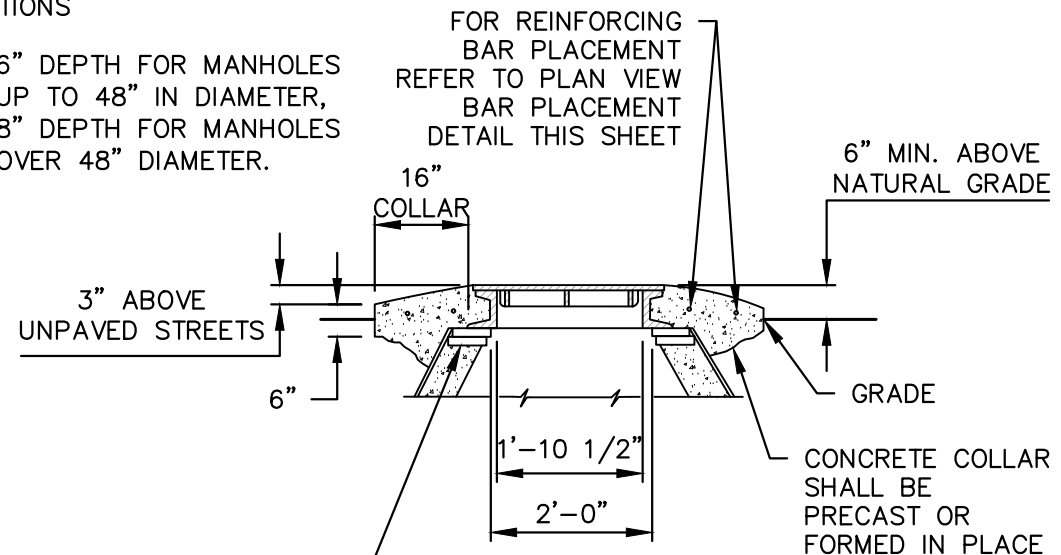


SECTION A-A

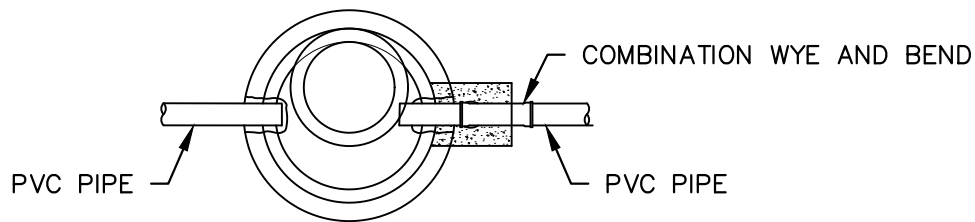

PLAN VIEW

NOTE:
OFFSET CONE AS SHOWN FOR DROP
MANHOLES ONLY. ALL OTHERS SHALL
BE CENTERED ON THE SEWER LINE ON
THE UPSTREAM SIDE OF THE
MANHOLE.

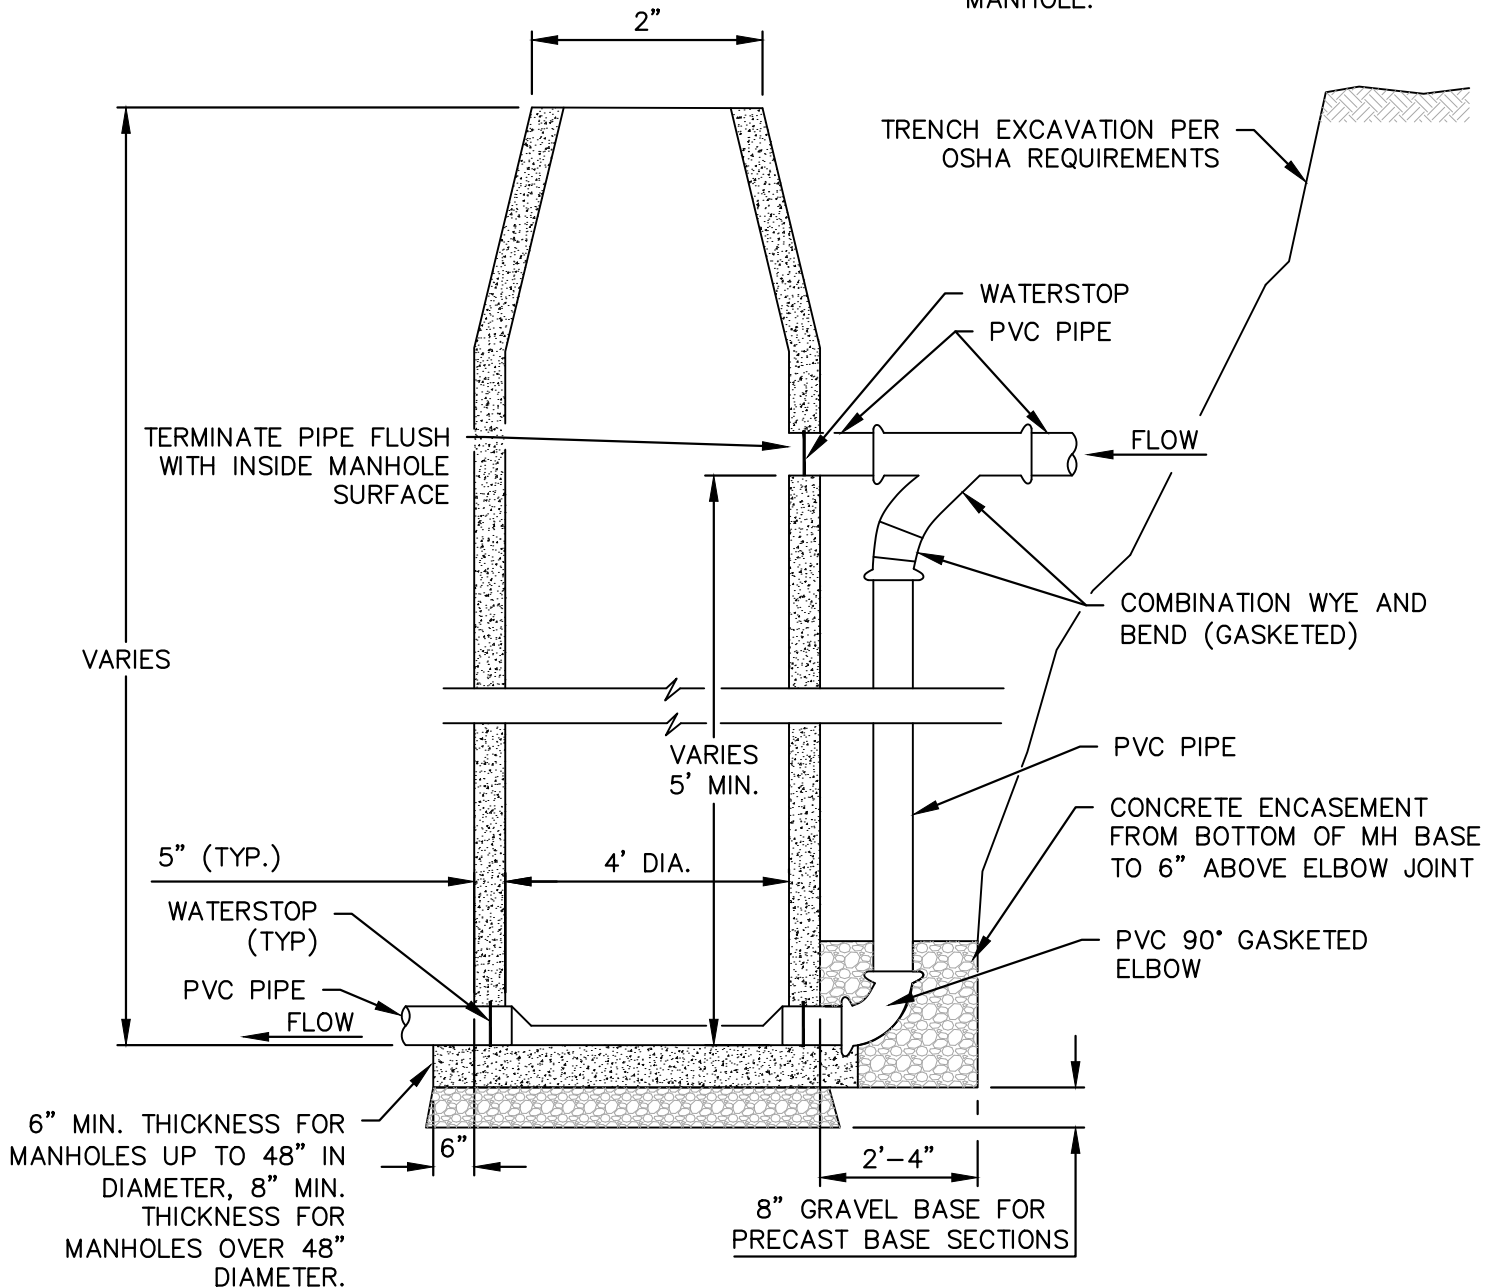

6C

DROP MANHOLE DETAIL - EXTERIOR DROP

NTS