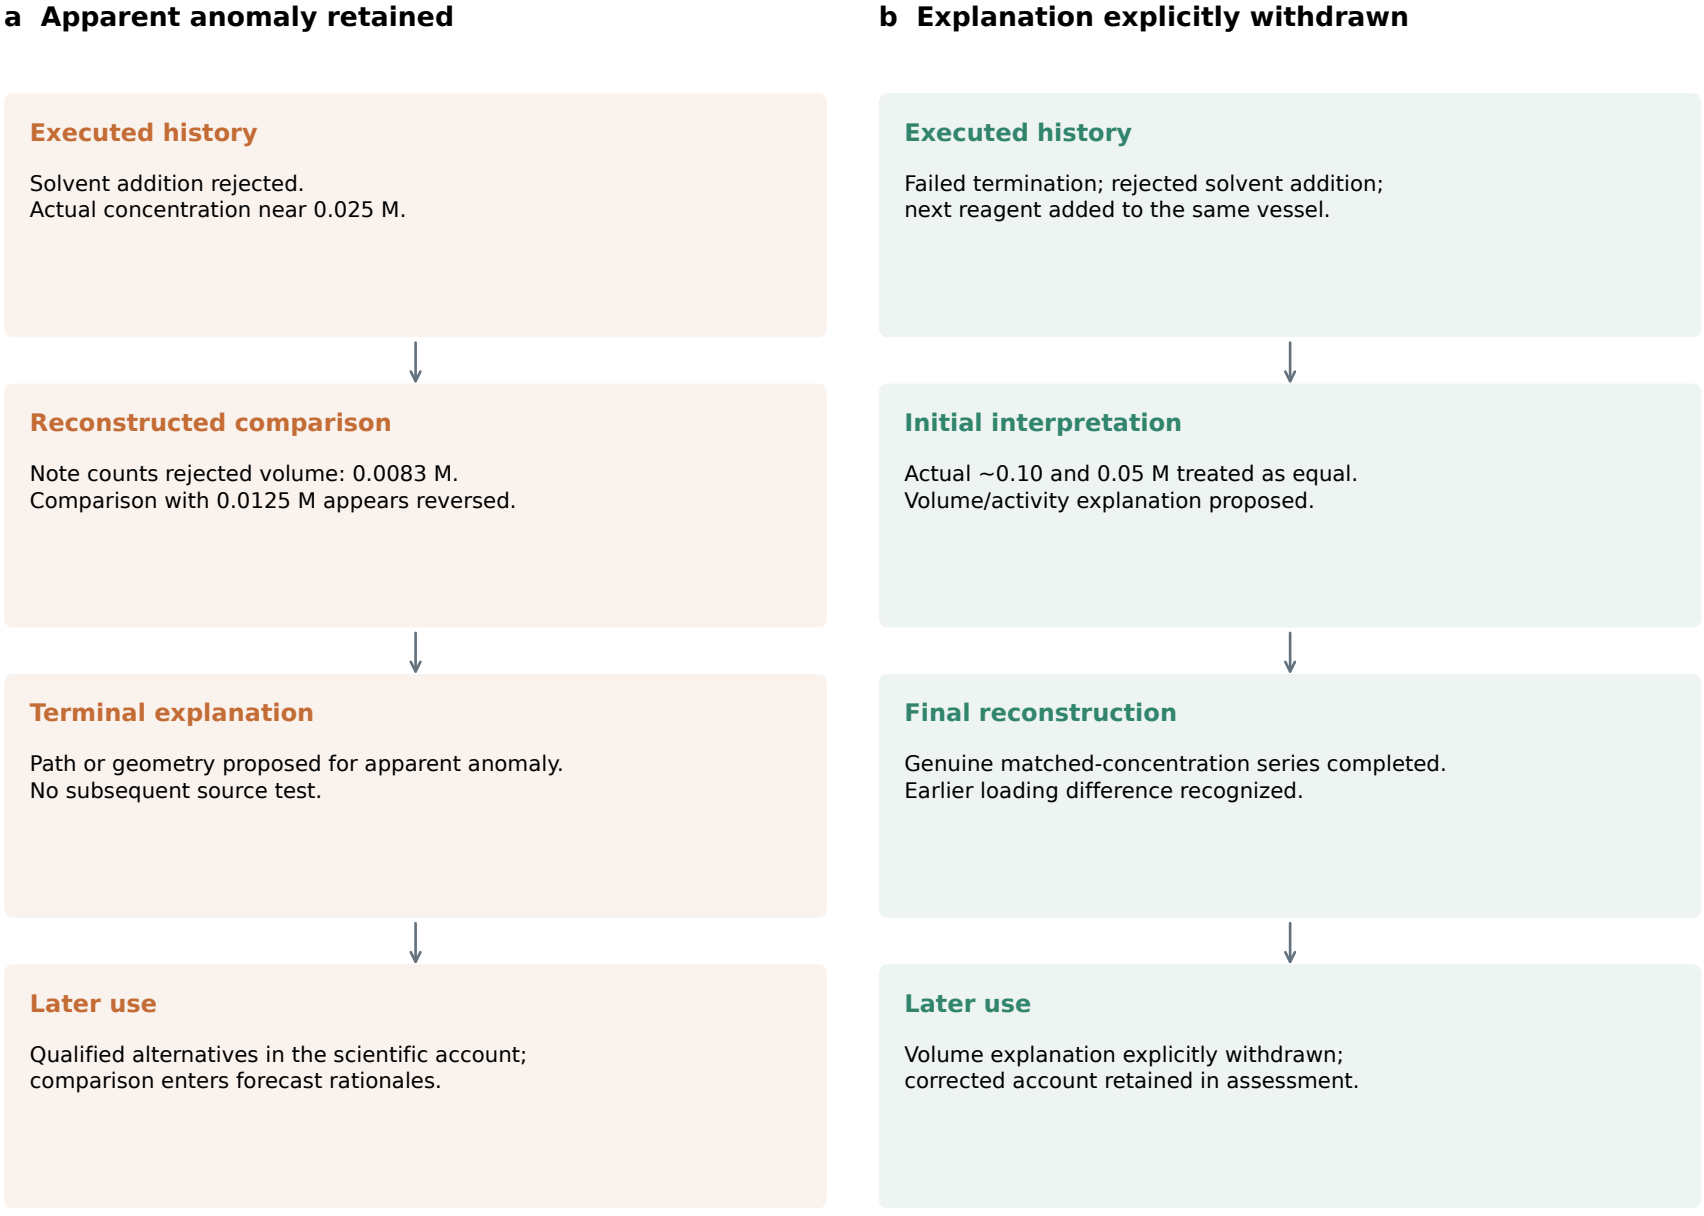
a Apparent anomaly retained
Executed history
Solvent addition rejected.
Actual concentration near 0.025 M.
Reconstructed comparison
Note counts rejected volume: 0.0083 M.
Comparison with 0.0125 M appears reversed.
Terminal explanation
Path or geometry proposed for apparent anomaly.
No subsequent source test.
Later use
Qualified alternatives in the scientific account;
comparison enters forecast rationales.
b Explanation explicitly withdrawn
Executed history
Failed termination; rejected solvent addition;
next reagent added to the same vessel.
Initial interpretation
Actual ~0.10 and 0.05 M treated as equal.
Volume/activity explanation proposed.
Final reconstruction
Genuine matched-concentration series completed.
Earlier loading difference recognized.
Later use
Volume explanation explicitly withdrawn;
corrected account retained in assessment.