FABRICATION MATERIALS

| NO | REMARKS | SIZE (MM) | QTY | DESCRIPTION |
|---|---|---|---|---|
| | | | | PIPE |
| 1 | | 350 | 19.5M | ANSI B36 10 PE SMLS PIPE STD |
| 2 | | 250 | 0.2M | ANSI B36 10 PE SMLS PIPE STD |
| 3 | | 150 | 1.9M | ANSI B36 10 PE SMLS PIPE STD |
| 4 | | 20 | 0.1M | ANSI B36 10 PE SMLS PIPE XS |
| | | | | FITTINGS |
| 5 | | 350 x 250 | 1 | REDU CONC ANSI B16.9 BW STD |
| 6 | | 350 x 150 | 1 | TEE ANSI B16.9 BW STD |
| 7 | | 350 x 20 | 1 | BONNEY THREDOLET NPT #3000 |
| 8 | | 350 | 4 | ELBOW LR ANSI B16.9 BW |
| 9 | | 150 | 3 | ELBOW LR ANSI B16.9 BW |
| | | | | FLANGES |
| 10 | | 350 | 4 | FLANGE WN ANSI B16.5 #150.RF |
| 11 | | 250 | 1 | FLANGE WN ANSI B16.5 #150.RF |
| 12 | | 150 | 1 | FLANGE WN ANSI B16.5 #150.RF |

ERECTION MATERIALS

| NO | REMARKS | SIZE (MM) | QTY | DESCRIPTION |
|---|---|---|---|---|
| | | | | GASKETS |
| 13 | | 350 | 3 | GASKET ANSI B16.21 #150.RF |
| 14 | | 250 | 1 | GASKET ANSI B16.21 #150.RF |
| | | | | BOLTS |
| 15 | | 25 | 12 | 133 STUD BOLT CW HVY HEX NUTS |
| 16 | | 25 | 12 | 127 STUD BOLT CW HVY HEX NUTS |
| 17 | | 22 | 12 | 114 STUD BOLT CW HVY HEX NUTS |
| | | | | VALVES / IN-LINE ITEMS |
| 18 | | 20 | 1 | VALVE GLOBE VOGT NPT #800 |
| | | | | INSTRUMENTS |
| 19 | PG_102_11_10_1070_1E | 20 | 1 | PRESSURE GAUGE |

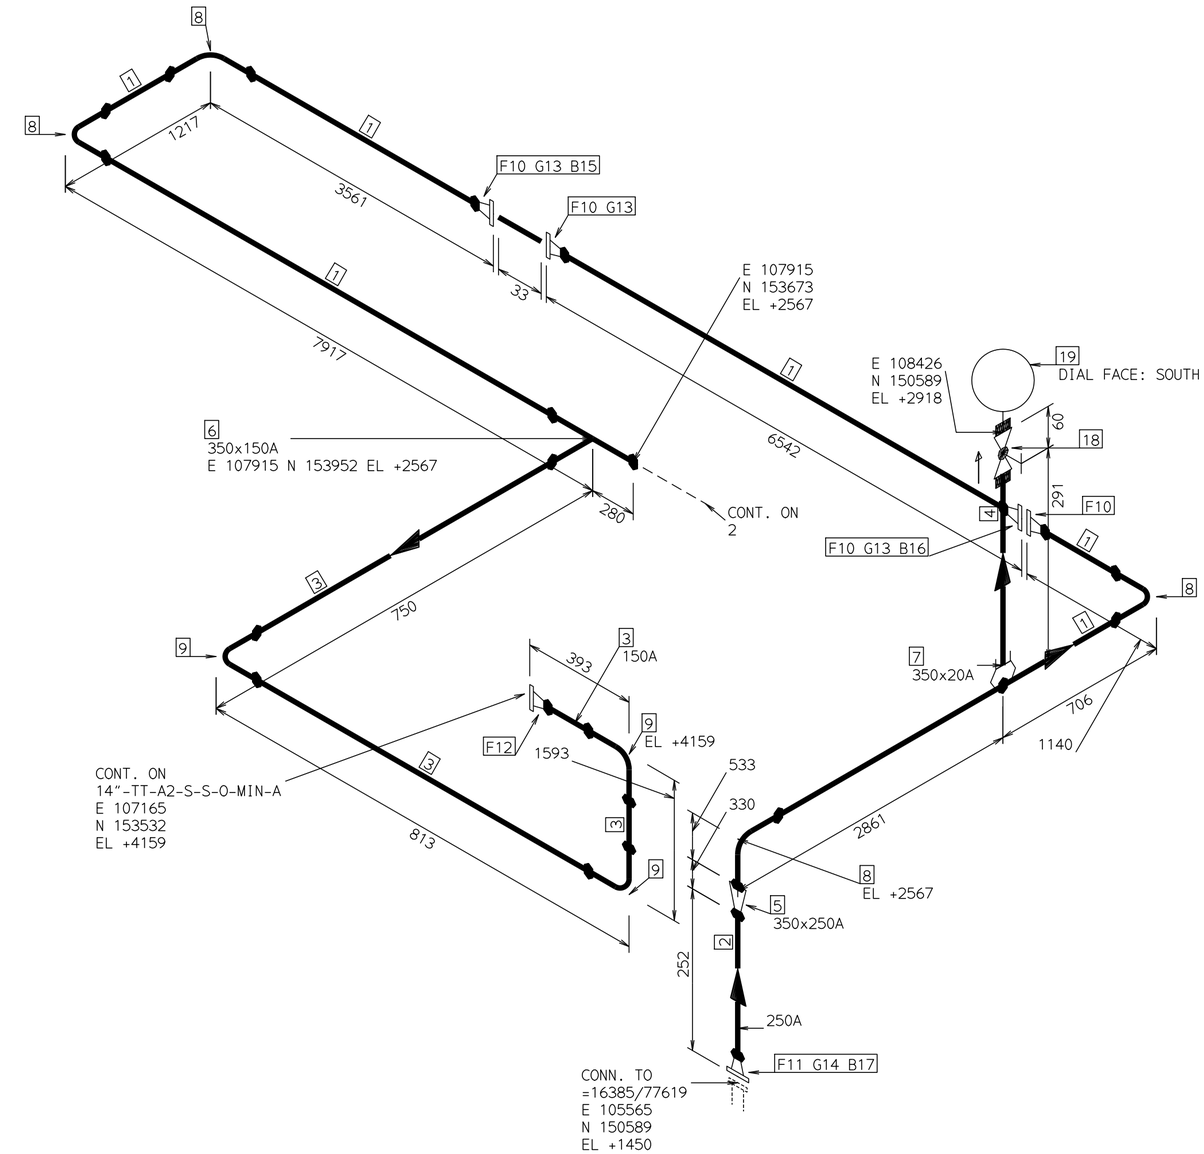


TEMPORARY ISO

TEMPORARY ISO DRAWING

| REV | DATE | DGND | CHKD | APRD | APRD | DESCRIPTION |
|---|---|---|---|---|---|---|
| | | | | | | |

ALL RIGHTS RESERVED
THIS DOCUMENT AND ANY DATA AND INFORMATION CONTAINED THEREIN ARE CONFIDENTIAL AND THE PROPERTY OF CHIYODA CORPORATION(CHIYODA) AND THE COPYRIGHT THEREIN IS VESTED IN CHIYODA. NO PART OF THIS DOCUMENT,DATA,OR INFORMATION SHALL BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER,EXCEPT WITH THE PRIOR WRITTEN PERMISSION OF CHIYODA.

FOR

CHIYODA CORPORATION

TITLE

PIPING ISOMETRIC DRAWING FOR

LINE_ID: 14"-TT-A2-S-S-0-DIS-A 1 OF 2

AREA : 14"-TT-A2-S-S-0-DIS-A

SCALE NONE | JOB NO. AHH20E

PROJECT: CAP

DRAWING NO. CAP-XX-XX-DW-XXXX

14"-TT-A2-S-S-0-DIS-A

REVISION

WORK NO.

EXTRACT DATE : 24 JUL 2019 13:35 ()

TEMPORARY ISO

14"-TT-A2-S-S-0-DIS-A