
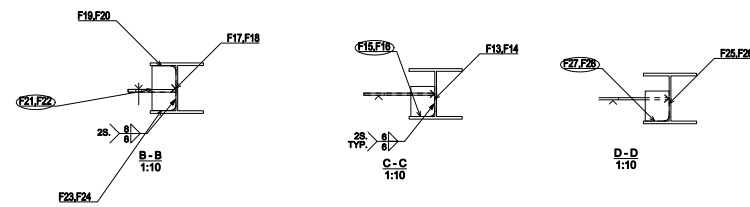


		FINISHING SPECIFICATION			
PAINTING CODE	Substrate	Surface Preparation and Blast Profile	Coat	Generic System Details	DFT (µm)
	CS	ISO 8501-1 grade Sa 2.5 or SSPC-SP 10	1.2	A) Epoxy / EBL	100-60
				B) Polyurethane	100-60
				C) System HEFT (µm)	100
FINISH COAT COLOR					

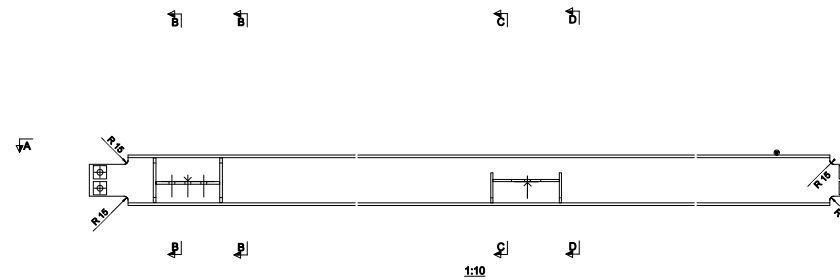

GENERAL NOTES

1. Steel structure fabrication shall comply with the requirements of latest issue of AISC358-70/100001.
2. Unless otherwise specified, bolt welds shall be as per following schedule:

$L \times L$
 $x = L/4$

ASSEMBLY TAIL LEGEND

WELD SYMBOL	WELD TYPE	WELD SIZE	WELD LENGTH	WELD SPACING
Weld Symbol	Weld Type	Weld Size	Weld Length	Weld Spacing

3. Where needed, mating area shall be provided on contact surface areas. Unless otherwise specified, mating size and pattern according to below requirements shall be used.

CASE 1
CASE 2
CASE 3

MAKING AREA
All mating flange, in mm

denotes mating site

4. (M) denotes assembly orientation mark.
5. Dimensions and coordinates are in millimeters, unless stated in meters.
6. All other dimensions shall be followed, drawing shall not be scaled off.
7. Steel welds to be provided as per document 4002-03-SW-10000001

00	04.02.2026	ISSUED FOR CONSTRUCTION	Zhang	Xiang	Zhang
REV.	DATE	REASON FOR ISSUE	PREPARED	DRAWN	APPROVED
   			MANUFACTURER		
			 Puyi Chemicals		
			VENDOR DRAWING No. AB0003		
			DOC. CLASS: 03		
PROJECT TITLE SILLEN EPC PE UNITS, LAO AND UI&O					
DRAWING TITLE INTERCONNECTING PIPE RACK (IPR) SECTION 1 SHOP DRAWING OF BEAM 8901IR004I01AB0003					
SHEET SIZE A1		PURCHASE ORDER NUMBER 7500137917		REVISION 00	
SCALE: 1:10		MATERIAL REQUISITION NUMBER 001T01		SHEET 1 of 1	