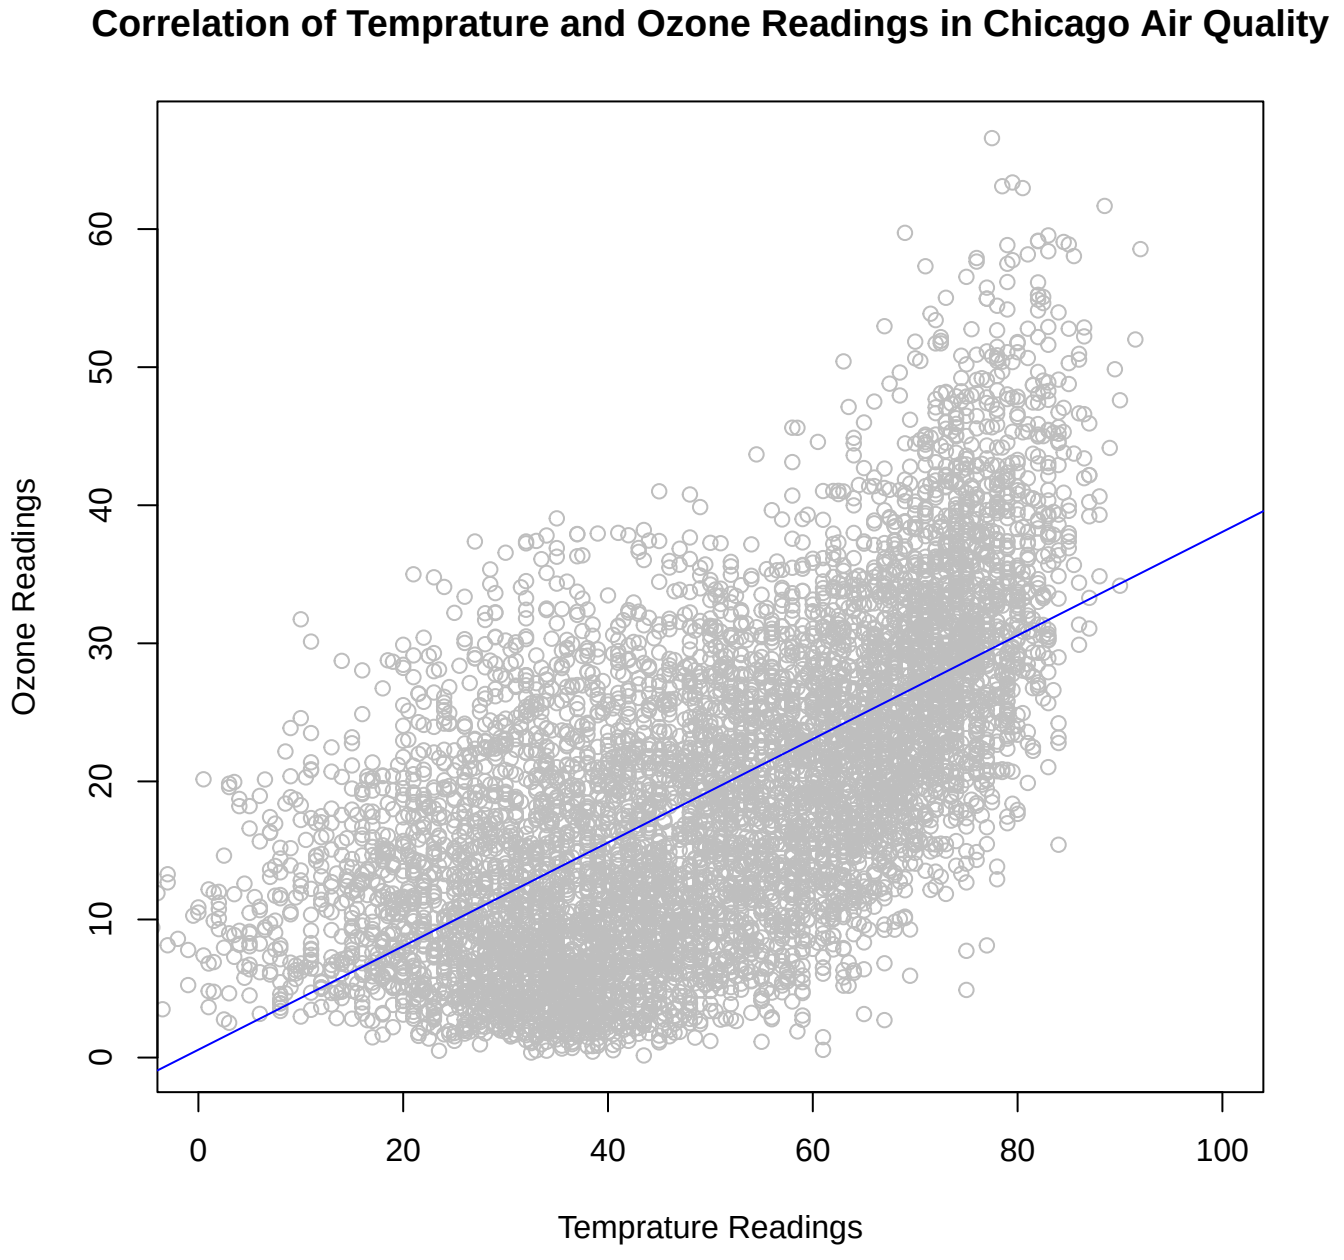
Correlation of Temprature and Ozone Readings in Chicago Air Quality
Ozone Readings
0
10
20
30
40
50
60
0
20
40
60
80
100
Temprature Readings

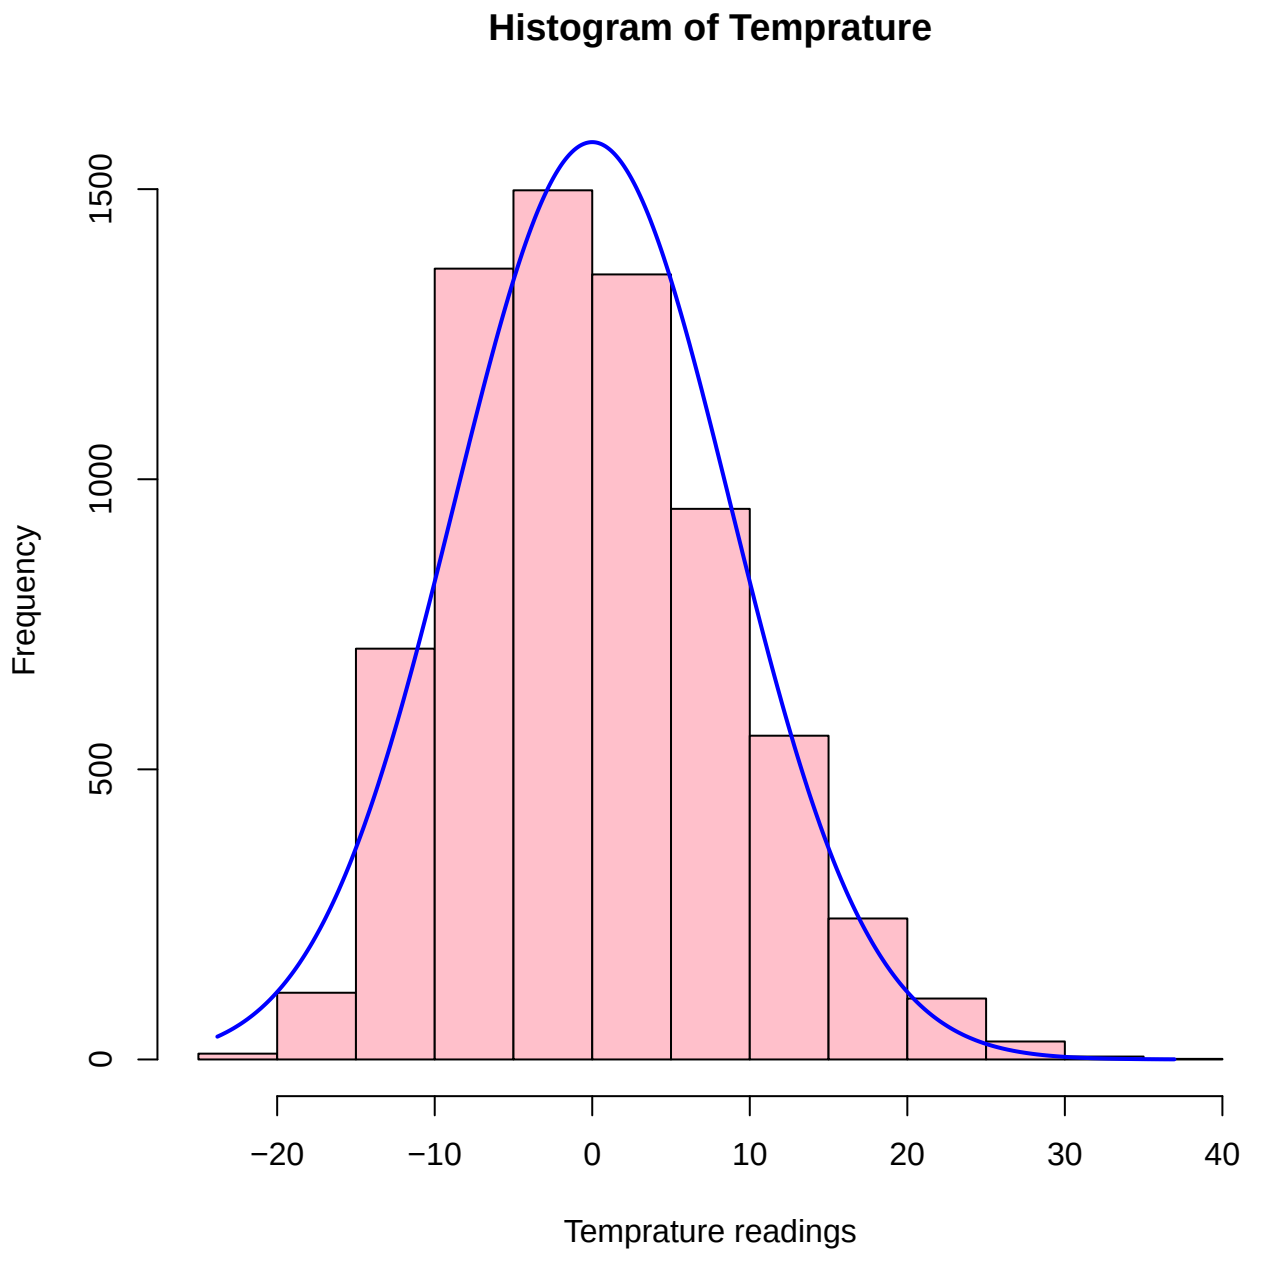
Histogram of Temprature
Frequency
0
500
1000
1500
−20
−10
0
10
20
30
40
Temprature readings