Subsystem A




FUNCTION GENERATOR



OSCILLOSCOPE

CH1 – I channel
CH2 – Q channel

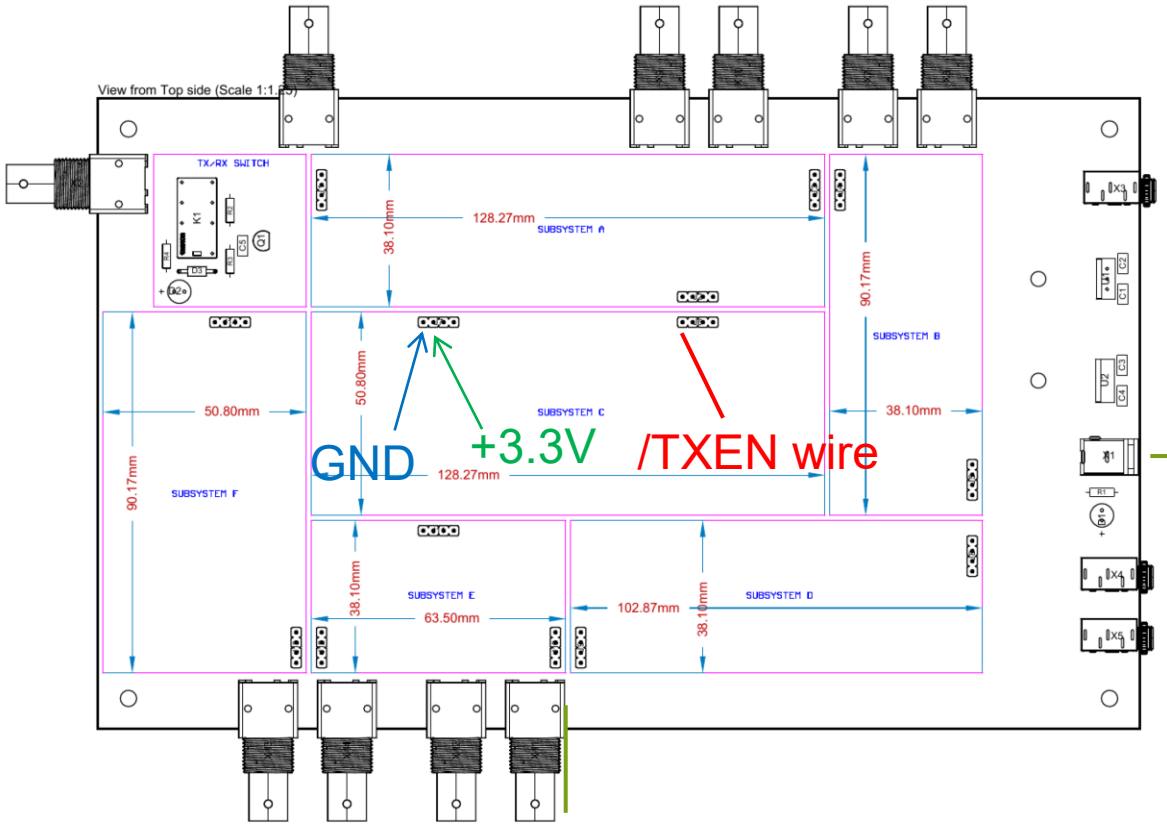

POWER SUPPLY: 12V



Subsystem B



1 BNC-to-RCA adapter required to connect stereo cable to oscilloscope CH2

OSCILLOSCOPE




FUNCTION GENERATOR



CH1 – I channel

CH2 – Q channel



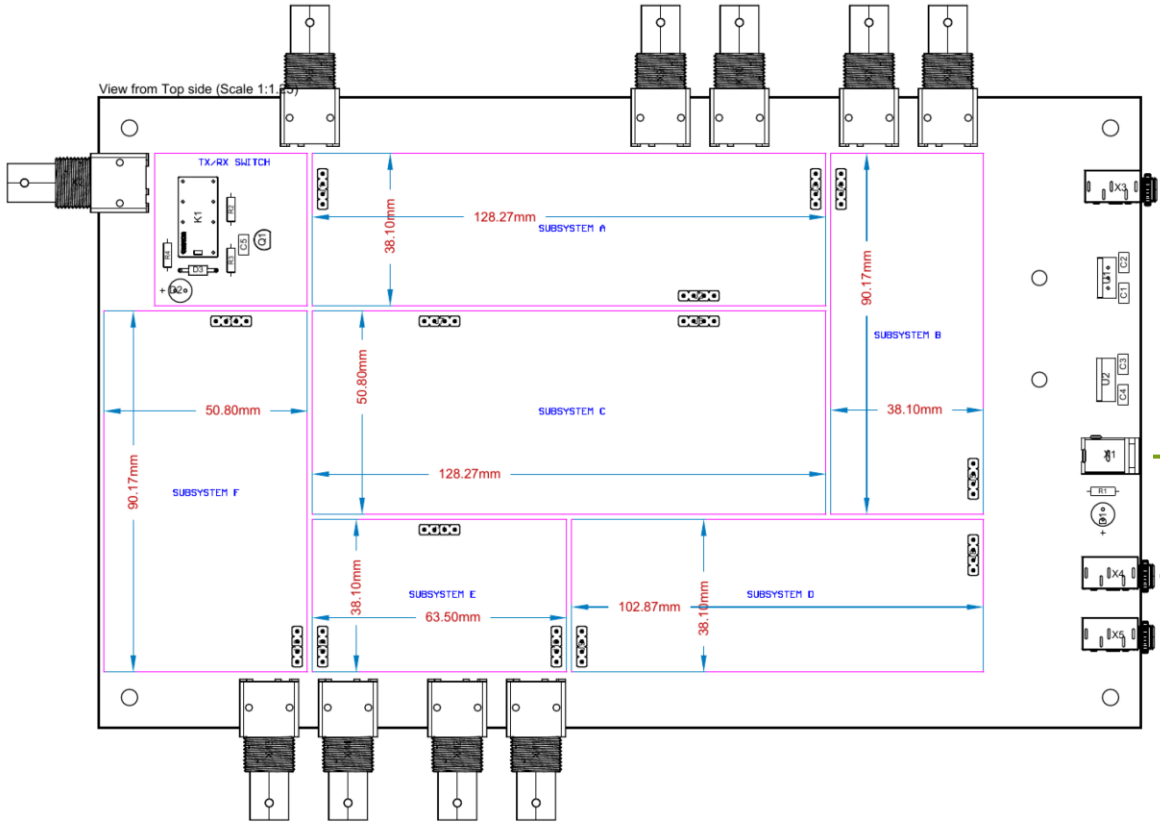

Stereo cable



POWER SUPPLY: 12V



Subsystem C




OSCILLOSCOPE

CH1 – 0 degrees
CH2 – 90 degrees





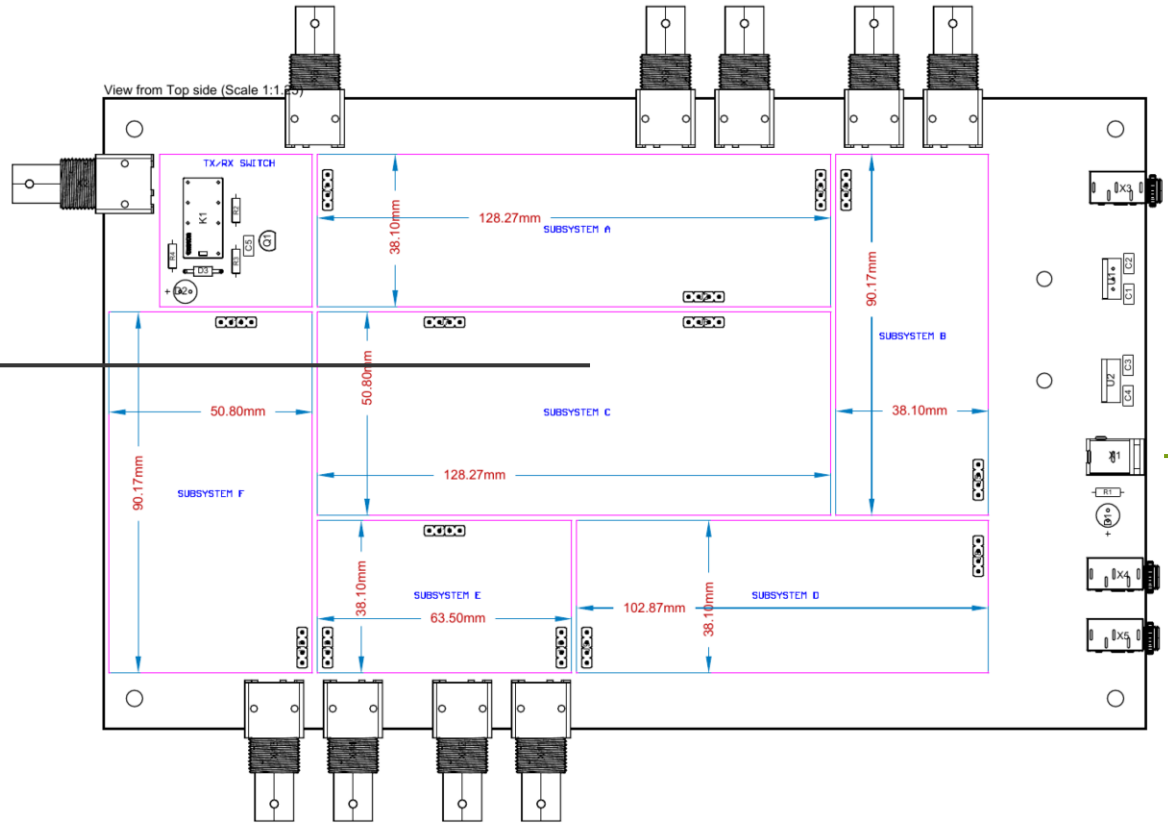

POWER SUPPLY: 12V



Subsystem F (Single-Ended Drive)

POWER SUPPLY: 12V



OSCILLOSCOPE




ATTENUATOR



FUNCTION GENERATOR



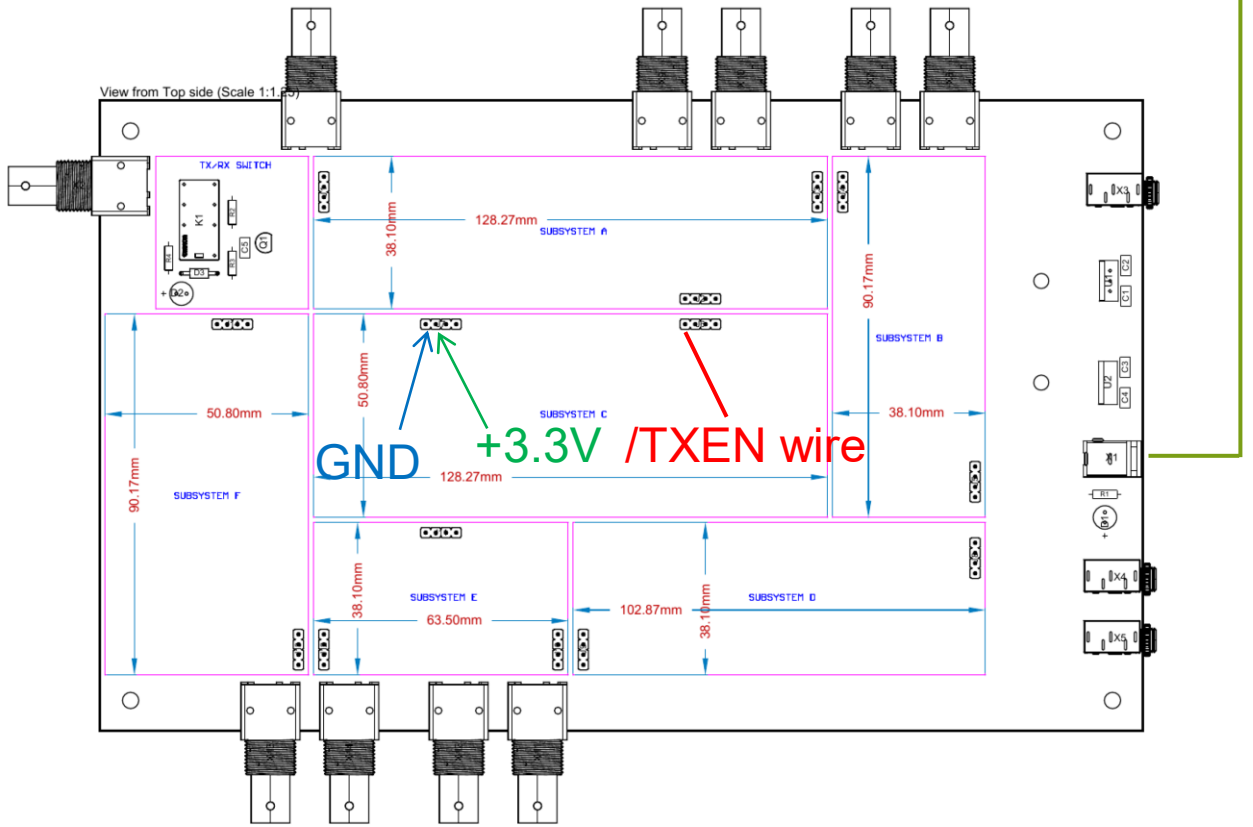

Use of attenuator is critical to load the PA with 50 ohms while reducing the output amplitude to a measurable range on the scope.

Subsystem F (Differential Drive)

POWER SUPPLY: 12V



OSCILLOSCOPE




ATTENUATOR



FUNCTION GENERATOR



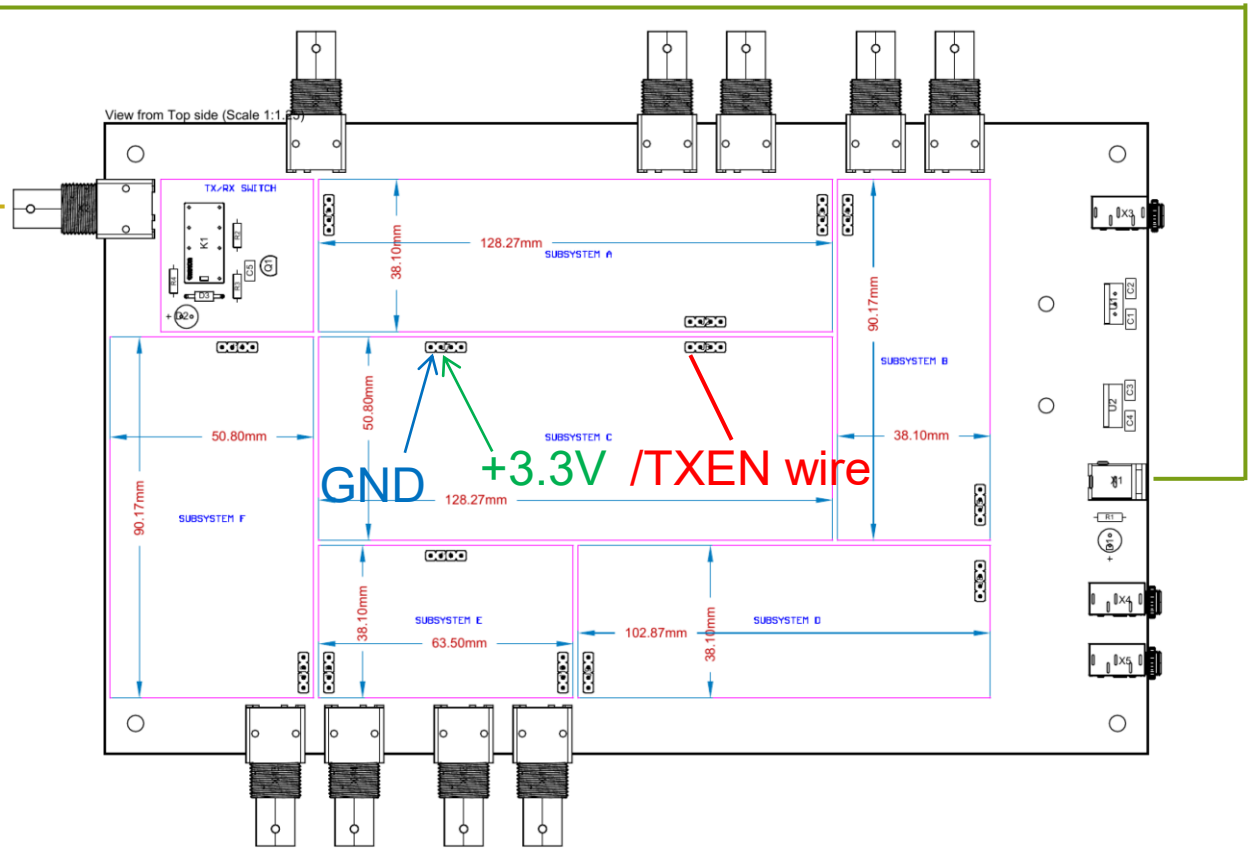

Use of attenuator is critical to load the PA with 50 ohms while reducing the output amplitude to a measurable range on the scope.