





BHARAT
ENGINEERS
energize the nation





 **BHARAT**
ENGINEERS
energize the nation

Our organization,
M/s. Bharat Engineers
Established in **Aug-2005**
and having consistent growth
year after year since than. .



Buying Bharat Engineers switchboards, Ensures

- ☐ Latest technology at an affordable price
- ☐ Commitment for product quality
- ☐ Commitment of product delivery
- ☐ Better technical competency
- ☐ Incredible ease of operation
- ☐ Optimum operational safety
- ☐ Best value for money
- ☐ Trouble free operational life
- ☐ Ease in operation and Maintatnance



Our Key Strengths

- ❑ Understanding and implementing customer needs & requirements.
- ❑ Design and manufacturing as per our type tested panel at CPRI & ERDA.
- ❑ Detailed documentation and drawings pre and post order stage.
- ❑ Detailed Engineering of GA Drawings on Solid works / 3 D
- ❑ Sheet metal fabrication precisely by latest technology
- ❑ In-house Pretreatment process (Seven tanks) on sheet metal surface for Anti corrosion.
- ❑ In-house Powder coating with proper pretreatment to ensure better finish and environment resistance.



Our Key Strengths

- ❑ Bus bars of uniform cross section throughout the length of the switchboard assembly.
- ❑ Bus bar fabrication on Latest CNC Machine for better conductivity and least resistance at Joints.
- ❑ All switchgears directly sourced from manufacturer for quality assurance, genuineness and service backup.
- ❑ New assembly techniques and modern manufacturing methods.
- ❑ Integrated with own testing facilities and stringent quality control, ensures high degree of reliability and safety of operating personnel's.
- ❑ Excellent Infrastructure.
- ❑ Adeptness of new technology



List of Products

- ❑ Design, Manufacturing & supply of all kinds of Electrical Distribution Panels. Such as PCC, MCC, PDB's, MLDB, LDB's, Feeder pillar.
- ❑ Design, Manufacturing & Supply of MV Panels up to 11 KV.
- ❑ Design, Manufacturing & Supply of all kinds of Motor Control Center both draw-out and fixed type.
- ❑ Design, Manufacturing & Supply of all kinds of Electrical Control Panels for, AHU, HVAC, Furnace and Process Plants.
- ❑ Design, Manufacturing & Supply of specialized panel such as AMF panel, changeover panels , VFD panels & APFC panels.



List of Products

- ❑ Design, Manufacturing & Supply of DG & Grid synchronizing panels.
- ❑ Design, Manufacturing & Supply of all kinds of Bus Ducts between Transformer & PCC .
- ❑ Design, Manufacturing & Supply of Bus Ducts for Internal power distribution system.
- ❑ Design, Manufacturing & Supply of Instrument Transformers (CT's and PT's)
- ❑ Design, Manufacturing & Supply of Control & Lighting Transformer up to 10 KVA.



- ❑ Power Sector
- ❑ Steel Industries
- ❑ Oil Refineries
- ❑ Effluent treatment Plants
- ❑ Textile Industries.
- ❑ Chemical Industries.
- ❑ Solar Plants
- ❑ Communication Industry
- ❑ Hospitality Industry
- ❑ And many more....



CNC Turret Punch Press



Make : Amada

Capacity : 200KN

Type : AE2510NT

Power : 40KVA

LXWXH : 4152X5120X2082,3028

Manufacturing Facilities

Amada CNC Bending Machine, type RGM



Spot Welding Machine



Busbar Cutting, Punching, Bending Machine

Busbar Bending Machine



Manufacturing Facilities

Powder Coating Oven

Capacity : [L x W x H]
3000m x 2300mm x 2400mm
Max Temp: 200°C



Powder Coating Spray Booth

Capacity: [L x W x H]
2700mm x 1900mm x 3000mm



Powder Coating

- I. Steel sheet surface treatment by seven tank process
- II. Test laboratory

Fabrication - Other


- I. Power Press - 80T
- II. Radial Drilling Machines
- III. Welding Machines

Assembly

- I. Pre-Assembly of Bus bar
- II. Components mounting and assembly
- III. Power and control wiring

CT /PT

- I. Transformer Winding Machine
- II. Vacuum Epoxy Resin Casting Plant

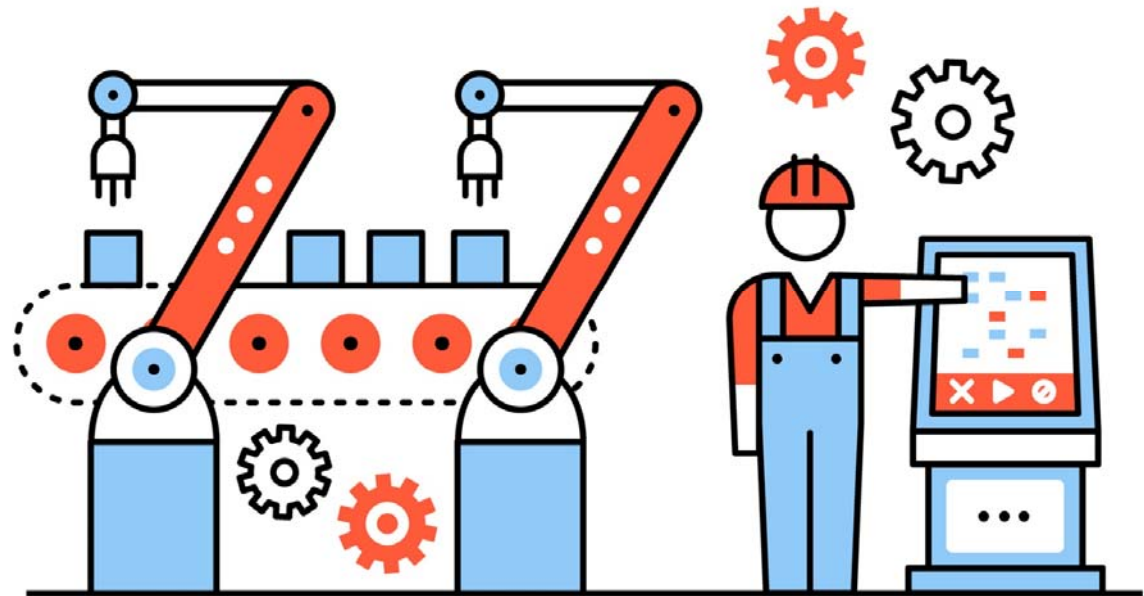

We are Authorised Franchisee of L&T



1

For PCC, MCC, APFC.

2

Compliance to IEC-61439 Part-1 & 2 Totally Type Tested Assembly Ti panel.

3

L&T Ti design is Type- Tested & Assembled as per IEC-61439.

4

We are also authorized Franchisee for MV Panels up to 11KV 2000A

Testing Facilities

1 Primary & Secondary Injection test kit: 0 -100A for relay testing

2 Instruments transformers test bridge: Amber IXR 2000

3 Standard Current Transformer :1KVA,0.1class,3200/5A,15A-440V

4 Three phase & single phase dimmer : 15A/2A,0-270V,50/60Hz. V.

5 Step up transformer : 0-1500V

6 HV tester : 0-5Kv & 0-100KV

7 Insulation tester : 1000V & 5000V, 500Mohm

8 Digital Micro-ohmmeter : 1999Microhm-19.99kOhm

9 AC Voltmeter : 0-600V, 0.2class




Testing Facilities

- 10 AC Ammeter : 0-100A
- 11 Polarity tester
- 12 Standard PT : 11kv/6.6kv
- 13 PT Burden Box : 200VA
- 14 High Frequency Generator Set. : 150 Hz.
- 15 HV tester : 0-5Kv & 0-100KV
- 16 11KV PT Testing Panel
- 17 Digital Multi meter : AC/DC Volt/A
- 18 Digital Coating Thickness Gauge : 0-1500 Microns



Our Esteemed Customers



Certificate

TRANSPACIFIC CERTIFICATIONS LIMITED



Certificate of Registration

This is to certify that
Quality Management System
of

BHARAT ENGINEERS
290/2, GIDC, Makarpura, Baroda-390010, Gujarat, India.

complies with the requirements of
ISO 9001:2015

This certificate is valid concerning all activities related to:

Manufacture and Supply of Electrical Switch Boards, Power Control Centre,
Motor Control Centre, Control and Relay Panels, Bus Ducts, Distribution
Boards, Enclosures, Marshalling Box, Instruments Transformer, Current
Transformers and Potential Transformers.

ANZSIC Code: 2859

12743

Certificate No.

Nov. 24, 2016

Date of Initial Registration

Nov. 24, 2016

Date of this Certificate

Nov. 23, 2019

Certification Expiry Date

Nov. 23, 2017

*Next Audit Due Date

Managing Director/Director



TRANSPACIFIC CERTIFICATIONS LIMITED

Website: www.transpacificcertifications.com Email: info@transpacificcertifications.com

Accreditation by Joint Accreditation System of Australia and New Zealand (Accreditation No. 520430334)

4 Pragma Centre, G/40th, A/C 20th, 4th Floor, 1st Floor

<http://www.transpacificcertifications.com>

This certificate is only valid if it is maintained on the TCL website at <http://www.transpacificcertifications.com>

The certificate of Registration remains the property of Transpacific Certifications Limited and shall be returned immediately upon request.

Version 1.10



LARSEN & TOUBRO



Certificate of Appointment

Bharat Engineers, Vadodara

is appointed as Franchise up to 22 November 2019
for manufacture and sale of Low Voltage Switchgear & Controlgear
assemblies in Ti design conforming to L&T's design and manufacturing
guidelines with L&T supplied components & switchgear products.

Ti design is a fully type tested assembly in accordance with IEC 61439
for Low Voltage Switchgear & Controlgear assembly.

L&T Electrical & Automation
TC 8, Mumbai 400 072, INDIA

Girish R. Tiwari
Vice President - Electrical Standard Products

Certificate



ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)
ERDA Road, Makarpura Industrial Estate, Vadodra-390 010, India.
SPARK : +91 (0265) 2642942, 2642904, 2642977, 3043120 / 29 / 30 / 31 / 33
Fax : +91 (0265) 2638382
E-mail : erda@erda.org
Web : http://www.erda.org



TEST REPORT

SHEET 01 OF 03

NAME AND ADDRESS OF CUSTOMER	
BHARAT ENGINEERS 290/2, GIDC MAKARPURA, VADODARA-390 010.	
TEST REPORT NO.: RP-1415-026024 DATE: 05/12/2014	
CUSTOMER REF. NO.	DATED
BE/ERDA/IP65	01/12/2014
DATE OF SAMPLE RECEIPT	DATE OF TESTING
01/12/2014	03/12/2014 to 05/12/2014
SAMPLE DESCRIPTION	
POWER DISTRIBUTION PANEL	
Rating: Rated Voltage: 415V Rated Insulation Voltage: 660V	
Containing: 4P Isolator: 1 no. RCCB: 3 nos. MCB: 18 nos.	
TEST DETAILS	TEST SPECIFICATION
1.0 IP 65 tests	Cl. No. 10.3 of IEC 61439-1:2011
Enclosures: i) Oscillogram No.: Nil ii) Photograph No.: ERDA-00067233/1 to 4 iii) Drg. No.: a) BE-766 (REV. 01) (SHEET NO. 01 of 01) b) BE-766 (REV. 0) (SHEET NO. 01 of 01) (Total 2 sheets)	
Test witnessed by: Mr. Narendra P. Solanki (Production Engineer) of M/s. Bharat Engineers, Vadodra.	
Remarks: Sample conforms to the requirement of IP 65 tests as per the standard.	
PREPARED BY	CHECKED BY
<i>[Signature]</i>	<i>[Signature]</i>
APPROVED BY	
<i>[Signature]</i>	

Notes: 1. This report relates only to the particular sample received for testing in good condition at ERDA.
2. This report cannot be reproduced in part under any circumstances.
3. Publication of this report requires prior permission in writing from Director, ERDA.
4. Only the tests asked for by the customer have been carried out.
5. In case of any dispute, Vadodra will be the exclusive jurisdiction & shall be construed as the place where the dispute has arisen.

Caution: ERDA is not responsible for the authenticity of photocopied or reproduced test reports.
ERDA provides support to customers for verification of the authenticity of test reports issued by ERDA.

IE 1534228



Central Power Research Institute
(Member of STL)
SWITCHGEAR TESTING & DEVELOPMENT STATION
GOVINDPURA, BHOPAL-462023, INDIA
Phone: +91(0755) 2586682 Fax: +91(0755) 2587774



TEST REPORT

SHEET 1 OF 3

Test Report Number	62002166	Date	4 APR 2009
Name & address of the customer	M/s Bharat Engineers, 290/2, GIDC, Makarpura, Vadodra - 390 010		
Name & address of the Manufacturer	M/s Bharat Engineers, 290/2, GIDC, Makarpura, Vadodra - 390 010		
Particulars of sample tested	LT Panel, 3230A New		
Type	ACB Panel		
Designation	BE - 270A		
Serial number	One		
Number of samples tested	20 th February, 2009		
CPRI sample code no.	BT088703950224		
Particulars of tests conducted	Verification of the short circuit withstand strength As per clause 8.2.1 of IEC 60439-1, 1099 with amendment no.1, 2004		
Test in accordance with Standard specification	Not applicable		
Sampling plan	NI		
Customer's requirement	NI		
Deviations if any	NI		
Name of the Witnessing persons	Shri Chavhan Parash & Shri K.G. Rathod.		
Customer's representative	NI		
Other than Customer's representatives	None		
Test subcontracted with	None		
access of the laboratory			
Documents constituting this report (in words)			
Number of sheets	Five		
Number of oscillograms	Two		
Number of graphs	Nil		
Number of photos	One		
Number of Test circuit diagrams	Two		
Number of drawings	Three		
(V.S. N. S. PATIL)		(S. N. S. PATIL)	
TEST ENGINEER		JOINT DIRECTOR	
AUTHORIZED SIGNATURES			

Certificate



ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)
ERDA Head, Makarpura Industrial Estate, Vadodra-390 010, India.
EPABX : +91 (0220) 2642942, 2642944, 2642977, 2043128 / 20 / 30 / 31 / 33
Fax : +91 (0220) 2638362 Web : www.erda.org
E-Mail : erda@erda.org, dir@erda.org



TEST REPORT

SHEET 1 OF 5

NAME & ADDRESS OF CUSTOMER BHARAT ENGINEERS, 290/2, GIDC, MAKARPURA, BARODA-390010.	REPORT No.: PLV/10/SC/1364 DATE: 24.01.2009	
	CUSTOMER REF.NO: NIL	DATED: 07.01.2009
	DATE OF SAMPLE RECEIPT: 07.01.2009	DATE OF TESTING: 07.01.2009 to 08.01.2009
	SAMPLE IDENTIFICATION ERDA ID. NO.: LSCLW0067521.01	
SAMPLE DESCRIPTION LT PANEL 3200 A Rated Operational Voltage (Ue) : 415V Rated Operational Current (Ie) : 3200A Rated Insulation Voltage (Ui) : 1100V Rated Frequency : 50 Hz. No. of Phases : Three + Neutral Rated short time withstand current & its duration: - 50 kArms for 1 sec. with an initial peak of 105 kA between phases. - 20 kArms for 1 sec. with an initial peak of 63 kA between adjacent phase and neutral. Quantity (Tested) : 1 No. Further details as per sheet No. 3 of 5	SR. NO.: J 270	
	DRAWING NO.: 870 REV. 1 SHEET NO. 01 870 REV. 1 SHEET NO. 02 870 REV. 1 SHEET NO. 03	
TEST DETAILS Verification of the short circuit withstand Strength (Cl. No. 8.2.3)		TEST SPECIFICATIONS IEC: 60439 - 1 (2004-04)
ENCLOSURES: NUMBER OF OSCILLOGRAM : TWO NUMBER OF PHOTOGRAPH : ONE NUMBER OF TEST CIRCUIT DIAGRAM : TWO NUMBER OF DRAWINGS : THREE		
TEST WITNESSED BY: Mr. DHAVAL PAREKH.		
REMARKS: The sample conforms to the requirements of verification of the short circuit withstand strength as per the standard.		
PREPARED BY	CHECKED BY	APPROVED BY

NOTE: 1. This report relates only to the particular sample received for testing in good condition at ERDA.
2. This report cannot be reproduced in part under any circumstances.
3. Publication of this report requires prior permission in writing from Director, ERDA.
4. Only test asked for by customer have been carried out.

TE 0163044



ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)
ERDA Head, Makarpura Industrial Estate, Vadodra-390 010, India.
EPABX : +91 (0220) 2642942, 2642944, 2642977, 2043128 / 20 / 30 / 31 / 33,
Fax : +91 (0220) 2638362
E-mail : erda@erda.org
Web : http://www.erda.org



TEST REPORT

Sheet: 1 of 2

NAME AND ADDRESS OF CUSTOMER BHARAT ENGINEERS 290/2, GIDC, MAKARPURA, VADODARA - 390010.	TEST REPORT NO.: LIP/5/2969 DATE : 16/03/2011	
	CUSTOMER REF. NO.:	DATE
	BE/ERDA/IP54/L2	17/01/2011
	DATE OF SAMPLE RECEIPT	DATE OF TESTING
		27/01/2011 to 28/01/2011
SAMPLE DESCRIPTION TYPICAL INDOOR TYPE PANEL Containing: 125A MCCB, 63A MCB	SAMPLE IDENTIFICATION ERDA Sample Code No: LSWGG00810/64/01 Drg. No.: BE 429-02 (Sheet 1 of 1) Sr. No.: Nil	
TEST DETAILS 1.0 IP 54 (category 2) tests	TEST SPECIFICATION IEC 60439-1-2004	
Enclosures: DRG. No.: BE 429-02 (Sheet 1 of 1)		
Test witnessed By: Mr. Khristi Aedvin Kumar of M/s. Bharat Engineers, Vadodara.		
Remarks: Sample conforms to the requirement of IP 54 (Category 2) test as per the Standard.		
Prepared by	Checked by	Approved by

Note: 1. This report relates only to the particular sample received for testing in good condition at ERDA.
2. This report cannot be reproduced in part under any circumstances.
3. Publication of this report requires prior permission in writing from Director, ERDA.
4. Only the tests asked for by the customer have been carried out.

TE 0632196

Certificate

ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION

ERDA Road, Makarpura Industrial Estate, Vadodra-390010, India.
EPABX: +91 (0265) 2642942, 2642954, 2642957, 3043128 / 29 / 30 / 31 / 33,
Fax : +91 (0265) 2636362,
E-mail : erda@erda.org
Web : http://www.erda.org



PETE/LIPS-

PROVISIONAL REPORT

DATE: 06/05/2016

To,
BHARAT ENGINEERS
290/2, G.I.D.C.,
MAKARPURA,
VADODARA - 390010.

- 1) Details of Equipment : **MCC PANEL**
Containing: ON Lamp - 09 Nos. - Red
OFF Lamp - 09 Nos. - Green, Trip Lamp - 09 Nos. - Amber
ON Push Button - 09 Nos., OFF Push Button - 09 Nos.
Vertical Copper busbar (30X10), Horizontal copper busbar (60X10)
Contactor - 185 A - Make Schneider - 02 Nos.
Contactor - 80 A - Make Schneider - 01 No.
Contactor - 25 A - Make Schneider - 02 Nos.
Contactor - 40 A - Make Schneider - 02 Nos.
MPCB - 9-14 A - Make Schneider - 02 Nos.
MPCB - 1.6-2.5 A - Make Schneider - 02 Nos.
MCB - 6A - Make Schneider - 02 Nos.
Sr. No.: BE/2015-16/10/37477
Drg. No.: DC-1056 (Rev.01) (Sheet No. 01) (Total sheet 01)
Manufactured by: M/s. Bharat Engineers, Vadodra.
ERDA Sample Code No.: ERDA-00140265

- 2) Reference Standard : IEC 60439-1 & 2 - 2011
3) Test Conducted : Internal Separation Test (Form 2a)
4) Sample received on : 05/05/2016
5) Customer Ref. No. & dated : BE/ERDA/2016-17/007 & dated 05/05/2016
6) Date of testing : 06/05/2016
7) Test witnessed by : Mr. Narendra P. Solanki of M/s. Bharat Engineers, Vadodra.

Note: Only the test asked for by the customer has been carried out.

- 8) Remarks : Sample conforms to the requirement of standard for the test carried out.

PREPARED BY

CHECKED BY

(G.SOM)
APPROVED BY

Note: This report is purely provisional. The results details are not binding on testing authority till final report is issued.

18/4437



ELECTRICAL RESEARCH AND DEVELOPMENT ASSOCIATION
(Accredited by the National Accreditation Board for Testing and Calibration Laboratories, Govt. of India)
ERDA Road, Makarpura Industrial Estate, Vadodra GIC 016, India.
EPABX : +91 (0265) 2642942, 2642954, 2642957, 3043128 / 29 / 30 / 31 / 33,
Fax : +91 (0265) 2636362
E-mail : erda@erda.org
Web : http://www.erda.org



TEST REPORT

Sheet: 1 of 2

NAME AND ADDRESS OF CUSTOMER		TEST REPORT NO: LIFS/2968	
BHARAT ENGINEERS 290/2, GIDC, MAKARPURA, VADODARA - 390010.		DATE : 16/03/2011	
SAMPLE DESCRIPTION TYPICAL OUTDOOR TYPE PANEL Containing: 125A MCCB, 63A MCB		CUSTOMER REF. NO.:	DATE
		BE/ERDA/TPS4/L2	17/01/2011
		DATE OF SAMPLE RECEIPT	DATE OF TESTING
		27/01/2011	27/01/2011 to 28/01/2011
SAMPLE IDENTIFICATION			
ERDA Sample Code No: LSWGO0810764/02			
Drg. No.: BE 429-01 (Sheet 1 of1)			
Sr. No.: Nil			
TEST DETAILS		TEST SPECIFICATION	
1.0 IP 55 (Category 2) tests		IEC 60439-1-2004	
Enclosures: DRG. No.: BE 429-01 (Sheet 1 of1)			
Test witnessed By: Mr. Khristi Aedvin Kumar of M/s. Bharat Engineers, Vadodra.			
Remarks: Sample conforms to the requirement of IP 55 (Category 2) test as per the Standard.			
Prepared by	Checked by	Approved by	

Note: 1. This report relates only to the particular sample received for testing in good condition at ERDA.
2. This report cannot be reproduced in part under any circumstances.
3. Publication of this report requires prior permission in writing from Director, ERDA.
4. Only the tests asked for by the customer have been carried out.

The following tests were carried out:

1) The sample was subjected to test voltage of 2.5 kV (RMS) at 50 Hz for one minute between all live parts connected together and the body. The sample withstood the test voltage.

Prepared by

Checked by

TE 0632192



Provisional Consent Order (CCA)

Gujarat Pollution Control Board
Paryavaran Bhavan, Sector-10/A,
Gandhinagar - 382010
Tele : 23222756

Consent No. AWH-108394 Valid upto: 31/03/2025

Application : CtO:CCA-Fresh, No. 174422 Dt. 21/05/2020, Granted On: 18/06/2020

PCB Id:75383

Besides streamlining and simplifying of regulatory regime, Gujarat Pollution Control Board has taken initiative in from of introduction of Consolidated Consent and Authorization (CC&A) which provides for a one shot application and clearance of the consents under Water Act, Air Act and Authorization under Hazardous Wastes Rules for a period of 5 years. Board issues consolidated consent and Authorization to an industrial unit for operation of plant/carrying out industrial activity specifying following conditions.

Consolidated Consent and Authorisation

In exercise of the power conferred under section-25 of the Water (Prevention and Control of Pollution) Act-1974, under section-21 of the Air (Prevention and Control of Pollution) Act-1981 and Authorization under rule 3(c)& 5(5) of the Hazardous Waste (Management, Handling and Transboundary Movement) Rules 2008 framed under the E(P) Act-1986.

And whereas Board has received consolidated Application No. (CtO:CCA-Fresh) 174422 and Dated 21/05/2020 for the consolidated consent and authorization (CC&A) of this Board under the provisions / rules of the aforesaid Acts Consent & Authorization is hereby granted as under.

CONSENT AND AUTHORISATION : (under the provisions / rules of the aforesaid environmental acts)

To,
M/s. Bharat Engineers,
290/2,,
GIDC Makarpura, City : Makarpura,
Dist : Vadodara, Tal : Vadodara, SIDC : Makarpura
Phone : 0265-2645006

1. Consent Order No: **AWH-108394** Valid Upto: **31/03/2025**

2. All Conditions under the AIR ACT-1981 WATER ACT-1974 HAZARDOUS ACT-2008 shall be Applicable to you as mentioned in the detailed Consent Order ***

Consented CETP: **Not Linked to any CETP**

Consented TSDF: **Not Regd with any TSDF**

3. GENERAL CONDITIONS :-

- This order is provisional order and detailed order is considered as final.
- All the conditions & provisions under the Water Act 1974, the Air Act 1981 and the Environment (Protection) Act – 1986 and the rules made there under shall be complied with *.
- All the conditions & provisions under the Hazardous Waste (Management, Handling and Trans boundary Movement) Rules 2008 as amended shall be complied
- The applicant shall provide portholes, ladder, platform etc at chimney(s) for monitoring the air emissions and the same shall be open for inspection to/and for use of Board's staff. The chimney(s) vents attached to various sources of emission shall be designed by numbers such as S-1, S-2, etc. and these shall be painted/ displayed to facilitate identification.
- The industry shall take adequate measures for control of noise levels from its own sources within the premises so as to maintain ambient air quality standards in respect of noise to less than 75dB(A) during day time and 70dB(A) during night time. Daytime is reckoned in between 6 a.m. and 10 p.m. and nighttime is reckoned between 10 p.m. and 6 a.m.
- In case of change of ownership/management the name and address of the new owners/ partners/ directors/ proprietor or equipment or working conditions as mentioned in the consents form / order should immediately be intimated to the Board.
- Industry shall have to display data outside the main factory gate with regard to quantity and nature of hazardous chemicals being handled in the plant, including waste water and air emissions and solid hazardous wastes generated within the factory premises.
- The CCA shall be produced for inspection at the request of an officer authorized by the Gujarat Pollution Control Board.
- Any unauthorized change in personnel, equipment or working conditions as mentioned in the CCA order by CCA holder shall constitute a breach of this CCA.
- Adequate plantation shall be carried out all along the periphery of the industrial premises in such a way that the density of plantation is atleast 1000 trees per acre of land and a green belt of 5 meters width is developed.
- The applicant shall have to submit the returns in prescribed form regarding water consumption and shall have to make payment of water cess to the Board under the Water Cess Act- 1977.

***** Note : ACT-Specific, Industry-specific, Area-specific Conditions alongwith Product, Waste water effluent details shall be precisely mentioned in the DETAILED Consent Order.**

***** Note : This is only provisional communication. The final Consent/Authorization in hard copy with duly signed by competent authority shall be the final and valid Consent/Authorization.**

For and on behalf of
Gujarat Pollution Control Board

(Member Secretary)



Products



Products



Address:

M/s Bharat Engineers
290/2, GIDC Makarpura,
Baroda-390010, Gujarat

Phone : 0265 2645006

Telefax : 0265 2645006

Mobile : +91-9879017654

Email : bharat_engrs@yahoo.com

Website : www.bharatengrs.com



