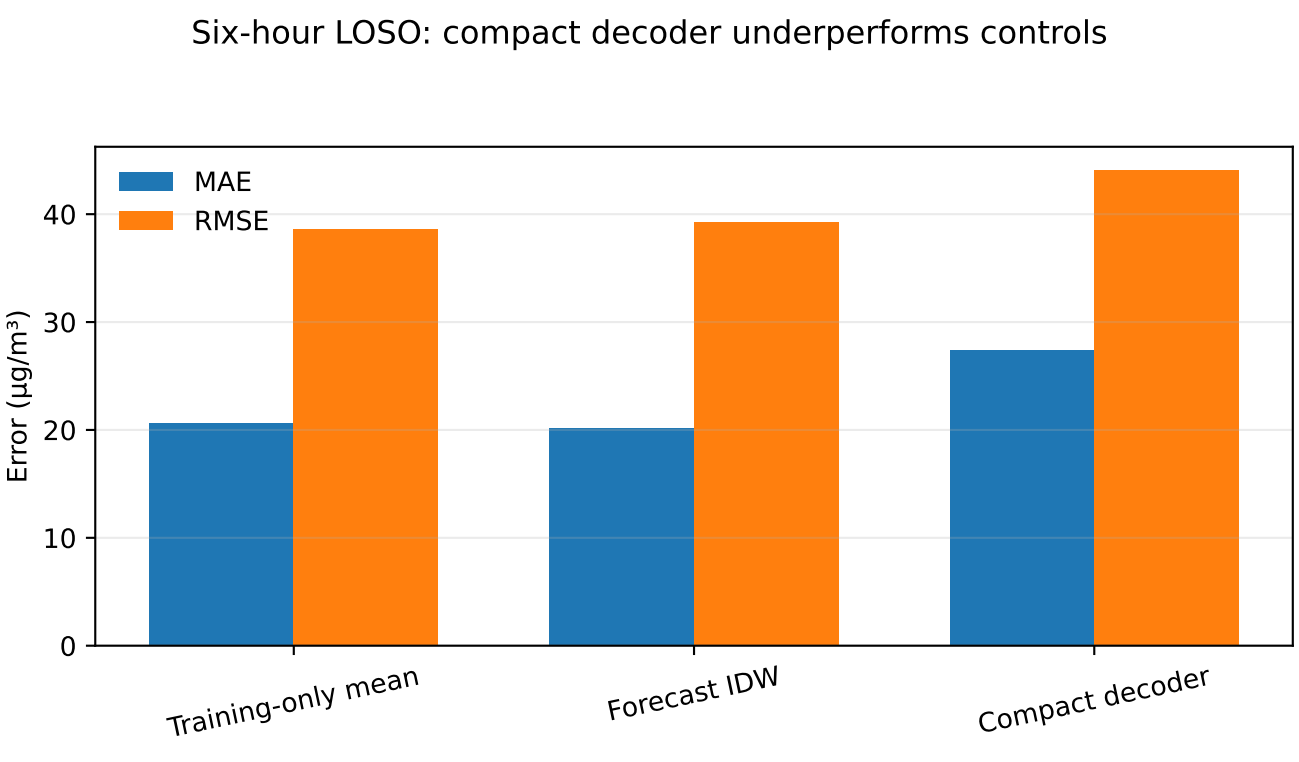
Six-hour LOSO: compact decoder underperforms controls
MAE
RMSE
Error (µg/m³)
0
10
20
30
40
Training-only mean
Forecast IDW
Compact decoder