GEOLAB & ENGINEERING KENYA LIMITED
Independent Materials Testing & Inspection Laboratories
Email : geolabengineeringltd@gmail.com
: info@geolabengineering.co.ke
Web : www.geolabengineering.co.ke
Cell : 0725643417, 0736 341 339

Head Office & Laboratories
Mina House - Garden Estate
P.O. Box 9514-00100 GPO
Nairobi - Kenya

PARTICLE SIZE DISTRIBUTION

BS 1377 2:1990: 9.2/9.3/9.4 & 9.5


Client:	GARMING CONSTRUCTION LIMITED					**Date submitted:**	16-Dec-25
Project/Site Name:	CENTRAL POWER PLANT-NAIVASHA					**Date tested:**	17-Dec-25
Sample ID:	BH B04	**Sample No.:**	TS/NAIVASHA/3090	**Sample depth (M):**	3.00	**Sampled and Submitted by:**	GEOLAB

Sample preparation details		**Moisture content at sample preparations**	
Initial quatered and air dried mass (gm)	264.4	**Wet weight of sample (gm)**	130.6
Washed and oven dried mass (gm)	254.3	**Dry weight of sample (gm)**	125.8
Fine mass (gm)	97.8	**Wet weight of water (gm)**	4.8
Fines percent (%)	38.5	**Moisture content (%)**	3.8

Soil Classification					
GRAVEL (%):	13.2	**CLAY/SILT (%):**	38.5	**USCS**	**SILTY SAND(SM)**
SAND (%):	48.4			**AASHTO**	**A-4**

Wet & Dry Sieve Analysis to BS 1377 2:1990: 9.2/9.3/9.4				**Hydrometer Analysis to BS 1377-2:1990:9.5**								
Sieve size (mm)	**Retained mass (gm)**	**% Retained (%)**	**Cumulative passing percentage (%**	**Dry Weight (g)**		-	**Hydrometer Type**		-			
63	0.0	0.0	100	**S.G (Mg/m^3)**		-	**Zero Correction factor**		-			
50	0.0	0.0	100.0	**Temprature (C^O)**		-	**S.G Correction factor**		-			
37.5	0.0	0.0	100.0	**K Factor**		-	**Temperature Correction Factor**		-			
28	0.0	0.0	100.0									
20	0.0	0.0	100.0									
14	0.0	0.0	100.0									
10	0.0	0.0	100.0	**Time, min**	**Actual HR rh**	**Adjusted HR(Rh)**	**Composite correction**	**Corrected HR**	**Effective depth (cm)**	**Diameter; D Kv(L/T)**	**% Fines in Suspension**	**% Fines based on whole sample**
6.3	6.5	2.6	97.4									
5	8.2	3.2	94.2	0.25	-	-	-	-	-	-	-	-
3.35	4.7	1.8	92.4	0.50	-	-	-	-	-	-	-	-
2.36	14.1	5.5	86.8	1	-	-	-	-	-	-	-	-
1.18	19.7	7.7	79.1	2	-	-	-	-	-	-	-	-
0.6	25.6	10.1	69.0	4	-	-	-	-	-	-	-	-
0.425	14.7	5.8	63.2	8	-	-	-	-	-	-	-	-
0.3	17.2	6.8	56.5	15	-	-	-	-	-	-	-	-
0.15	27.0	10.6	45.9	30	-	-	-	-	-	-	-	-
0.075	18.8	7.4	38.5	60	-	-	-	-	-	-	-	-
0.063	0.0	0.0	38.5	120	-	-	-	-	-	-	-	-
<0.063	97.8	38.5	-	240	-	-	-	-	-	-	-	-
<0.075		-	-	480	-	-	-	-	-	-	-	-
TOTAL	156.5	-	-	1440	-	-	-	-	-	-	-	-

PARTICLE SIZE DISTRIBUTION GRAPH

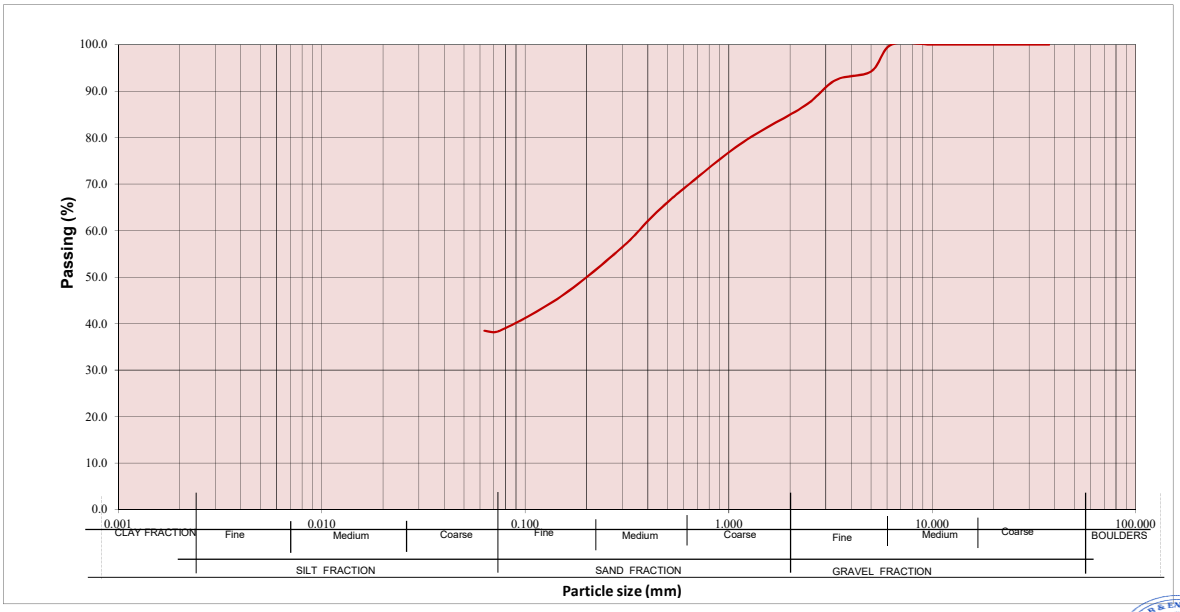

Tested by:	SHADRACH	**Date reported:**	18-Dec-25	**Checked by:**