Cransfield Materials Testing Center
Quality Assurance

Cransfield Materials Testing Center
P.O. Box 59401 - 00200
Nairobi, Kenya
Runda Grove House No. 278
Tel: +254 703410973/ +254 721740587
Email: info@cmtc.co.ke
Website: www.cmtc.co.ke


DENSITY/MOISTURE CONTENT RELATIONSHIP (BS 1377 PART- 4, 3.3 : 1990)

Client name:	AHP					**Date submitted:**	2026-06-09
Project/Site Name:	KIRIAINI AHP					**Date tested:**	2026-06-11
Sample ID:	BH1	**Sample depth (M):**	0.0 - 25.0	**Sampled and Submitted by:**	Cransfield		

Moisture addition	**A**	**B**	**C**	**D**	**E**	**F**
Moisture addition (cc)	0	20	40	60	80	100
Wt mould + wet mat. (g)	4390	4535	4650.4	4666	4622.8	4565
Wt mould + base (g)	2500	2500	2500	2500	2500	2500
Wt wet material (g)	1890	2035	2150	2166	2123	2065
Volume mould (cm³)	1000	1000	1000	1000	1000	1000
Bulk density (kg/m³)	1890	2035	2150	2166	2123	2065

Container No	**A**	**B**	**C**	**D**	**E**	**F**
Container + wet (g)	158	160	162	164	166	168
Wt dry material (g)	150	150	150	150	150	150
Wt of moisture (g)	8.00	10.00	12.00	14.00	16.00	18.00
Wt of container (g)	50	50	50	50	50	50
Moisture content (%)	8.0	10.0	12.0	14.0	16.0	18.0
Dry density (kg/m³)	1750	1850	1920	1900	1830	1750

DRY DENSITY / MOISTURE CONTENT RELATIONSHIP

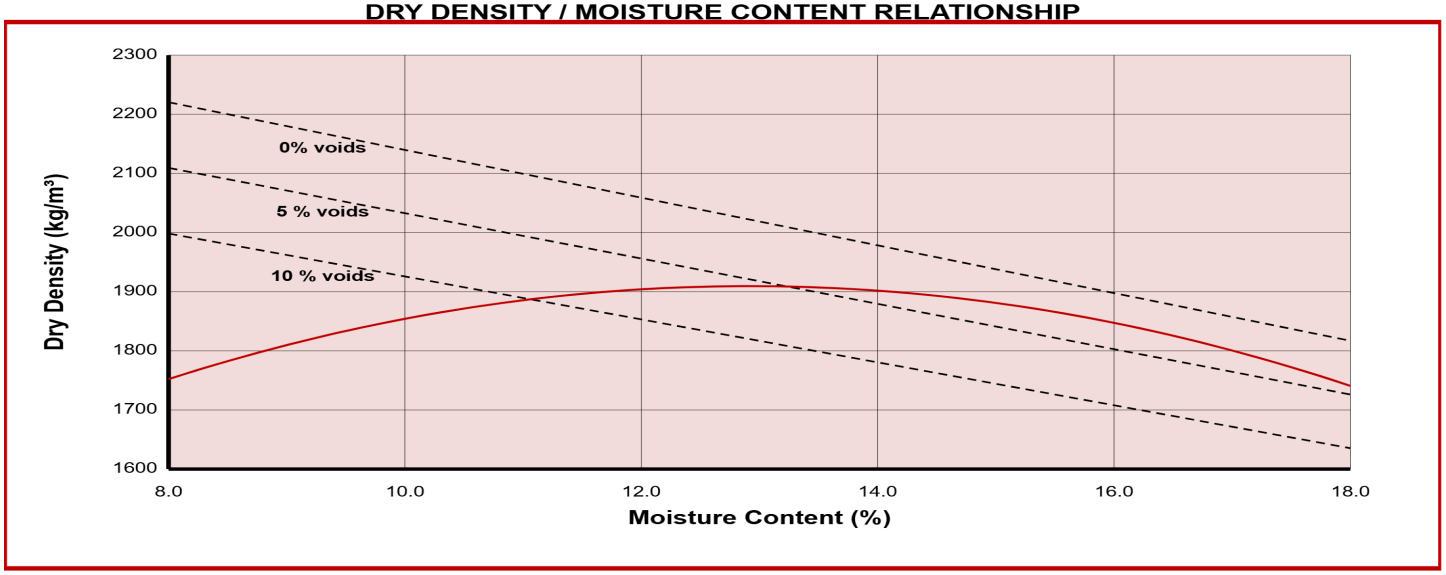

Maximum Dry Density (kg/m³):	**1909**	**Optimum Moisture Content (%):**	**12.9**
Bulk Density (kg/m³):	**2156**	**Determined from:**	Fitted compaction curve
Curve R²:	0.9745	**Particle density (Gs):**	2.70

Tested by Cransfield **Date reported** _____ **Checked by:**

CRANSFIELD MATERIAL TESTING
P.O. BOX 59401-00100 NAIROBI