Cransfield Materials Testing Center

Quality Assurance

Cransfield Materials Testing Center
P.O. Box 59401 - 00200
Nairobi, Kenya
Runda Grove House No. 278
Tel: +254 703410973/ +254 733725775
Email: info@cmtc.co.ke
Website: www.cmtc.co.ke

PARTICLE SIZE DISTRIBUTION

BS 1377 2:1990: 9.2/9.3/9.4 & 9.5

Client:	STATE DEPARTMENT FOR HOUSING AND URBAN DEVELOPMENT					**Date submitted:**	9-Jun-26
Project/Site Name:	PROPOSED CONSTRUCTION OF KIRIAINI AHP IN MATHIOYA CONSTITUENCY, MURANG'A COUNTY WITH ASSOCIATED AMENITIES AND INFRASTRUCTURE					**Date tested:**	11-Jun-26
Sample ID:	BH1	**Sample No.:**	-	**Sample depth (M):**	0.0-25.0	**Sampled and Submitted by:**	Cransfield

Sample preparation details		**Moisture content at sample preparations**		
Initial quatered and air dried mass (gm)	328.0	**Wet weight of sample (gm)**		186.5
Washed and oven dried mass (gm)	245.4	**Dry weight of sample (gm)**		149.0
Fine mass (gm)	176.4	**Wet weight of water (gm)**		37.5
Fines percent (%)	71.9	**Moisture content (%)**		25.2

Soil Classification					
GRAVEL (%):	22.8	**CLAY/SILT (%):**	71.9	**USCS**	**GRAVELLY ELASTIC SILT(MH)**
SAND (%):	5.3			**AASHTO**	**A-7-5**


Sieve size (mm)	**Retained mass (gm)**	**% Retained (%)**	**Cumulative passing percentage (%**
63	0.0	0.0	100
50	0.0	0.0	100.0
37.5	0.0	0.0	100.0
28	0.0	0.0	100.0
20	14.5	5.9	94.1
14	6.5	2.6	91.4
10	8.0	3.3	88.2
6.3	8.0	3.3	84.9
5	6.5	2.6	82.3
3.35	4.5	1.8	80.4
2.36	8.0	3.3	77.2
1.18	5.5	2.2	74.9
0.6	2.0	0.8	74.1
0.425	0.5	0.2	73.9
0.3	1.0	0.4	73.5
0.15	1.5	0.6	72.9
0.075	2.5	1.0	71.9
0.063	0.0	0.0	71.9
<0.063	176.4	71.9	-
<0.075		-	-
TOTAL	69.0	-	-

Hydrometer Analysis to BS 1377-2:1990:9.5

Dry Weight	**(g)**	-	**Hydrometer Type**		-
S.G	**(Mg/m^3)**	-	**Zero Correction factor**		-
Temprature	**(C^O)**	-	**S.G Correction factor**		-
K Factor		-	**Temperature Correction Factor**		-

Time, min	**Actual HR rh**	**Adjusted HR(Rh)**	**Composite correction**	**Corrected HR**	**Effective depth (cm)**	**Diameter; D Kv(L/T)**	**% Fines in Suspension**	**% Fines based on whole sample**
0.25	-	-	-	-	-	-	-	-
0.50	-	-	-	-	-	-	-	-
1	-	-	-	-	-	-	-	-
2	-	-	-	-	-	-	-	-
4	-	-	-	-	-	-	-	-
8	-	-	-	-	-	-	-	-
15	-	-	-	-	-	-	-	-
30	-	-	-	-	-	-	-	-
60	-	-	-	-	-	-	-	-
120	-	-	-	-	-	-	-	-
240	-	-	-	-	-	-	-	-
480	-	-	-	-	-	-	-	-
1440	-	-	-	-	-	-	-	-

PARTICLE SIZE DISTRIBUTION GRAPH

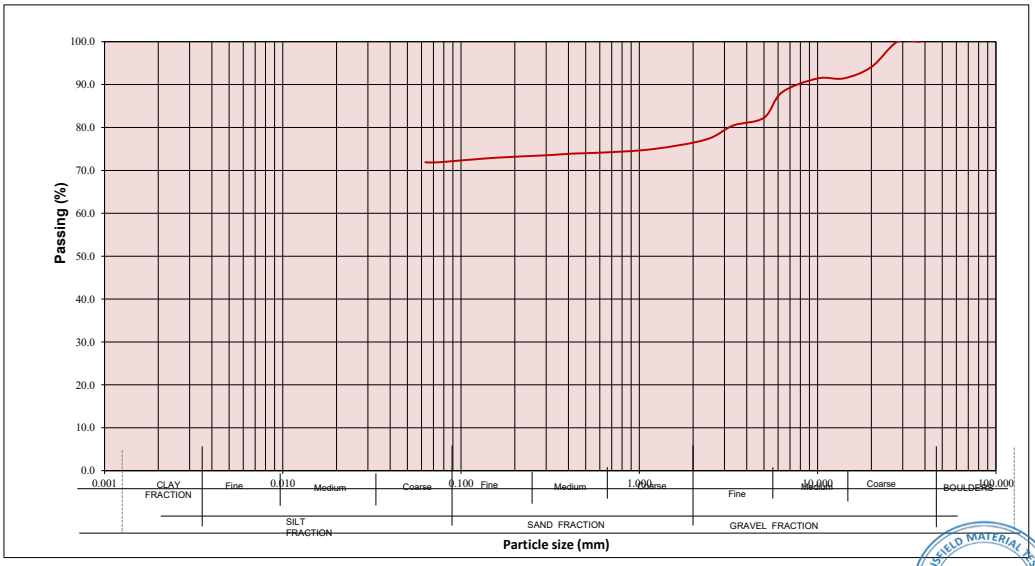

Tested by:	JILLO	**Date reported:**	13-Jun-26	**Checked by:**