PARTICLE SIZE DISTRIBUTION
BS 1377 2:1990: 9.2/9.3/9.4 & 9.5

Client:	SDHUD					**Date submitted:**	09-Jun-26
Project/Site Name:	KIRIAINI AHP					**Date tested:**	11-Jun-26
Sample ID:	BH1	**Sample No.:**	-	**Sample depth (M):**	0.0 - 25.0	**Sampled and Submitted by:**	Cransfield

Sample preparation details		
Initial quartered and air dried mass	**(gm)**	328
Moisture-corrected initial mass	**(gm)**	245.5
Washed and oven dried mass	**(gm)**	176.4
Fine mass	**(gm)**	69.0
Fines percent	**(%)**	28.1

Moisture content at sample preparations		
Wet weight of sample	**(gm)**	186.5
Dry weight of sample	**(gm)**	149.0
Wet weight of water	**(gm)**	37.5
Moisture content	**(%)**	25.2


Soil Classification					
GRAVEL (%):	22.8	**CLAY/SILT (%):**	71.9	**USCS**	GRAVELLY ELASTIC SILT(MH)
SAND (%):	5.3			**AASHTO**	A-7-5
D10 (mm):		**D60 (mm):**		**Cu / Cc:**	/
PI:		**Group Index:**	3	**LL / PL:**	/

Dry Weight	**(g)**	176.4	**Hydrometer Type**	152H
S.G (Mg/m³)		2.65	**Zero Correction factor**	0
Temperature (°C)		20	**Meniscus correction (g/L)**	0.1
K Factor		1.358	**Temperature Correction Factor**	0

Wet & Dry Sieve Analysis to BS 1377 2:1990: 9.2/9.3/9.4 | **Hydrometer Analysis to BS 1377-2:1990:9.5**

Sieve size (mm)	Retained mass (gm)	% Retained (%)	Cumulative passing percentage (%)	Time, min	Actual rh	Adjusted HR(Rh)	Composite correction	Corrected HR	Effective depth (cm)	Diameter; D K√(L/T)	% Fines in Suspension	% Fines based on whole sample
63	0	0.0	100.0	0.25	48	48.0	0.10	48.1	8.41	0.0792	43.8	43.8
50	0	0.0	100.0	0.50	48	48.0	0.10	48.1	8.41	0.0560	43.8	43.8
37.5	0	0.0	100.0	1	48	48.0	0.10	48.1	8.41	0.0396	43.8	43.8
28	0	0.0	100.0	2	48	48.0	0.10	48.1	8.41	0.0280	43.8	43.8
20	14.5	5.9	94.1	4	48	48.0	0.10	48.1	8.41	0.0198	43.8	43.8
14	6.5	2.6	91.4	8	48	48.0	0.10	48.1	8.41	0.0140	43.8	43.8
10	8.0	3.3	88.2	15	48	48.0	0.10	48.1	8.41	0.0102	43.8	43.8
6.3	8.0	3.3	84.9	30	48	48.0	0.10	48.1	8.41	0.0072	43.8	43.8
5	6.5	2.6	82.3	60	48	48.0	0.10	48.1	8.41	0.0051	43.8	43.8
3.35	4.5	1.8	80.4	120	48	48.0	0.10	48.1	8.41	0.0036	43.8	43.8
2.36	8.0	3.3	77.2	240	48	48.0	0.10	48.1	8.41	0.0026	43.8	43.8
1.18	5.5	2.2	74.9	480	48	48.0	0.10	48.1	8.41	0.0018	43.8	43.8
0.6	2.0	0.8	74.1	1440	48	48.0	0.10	48.1	8.41	0.0010	43.8	43.8
0.425	0.5	0.2	73.9									
0.3	1.0	0.4	73.5									
0.15	1.5	0.6	72.9									
0.075	2.5	1.0	71.9									
0.063	0.0	0.0	71.9									
<0.063	176.4	71.9	-									
TOTAL	**245.4**	-	-									

PARTICLE SIZE DISTRIBUTION GRAPH

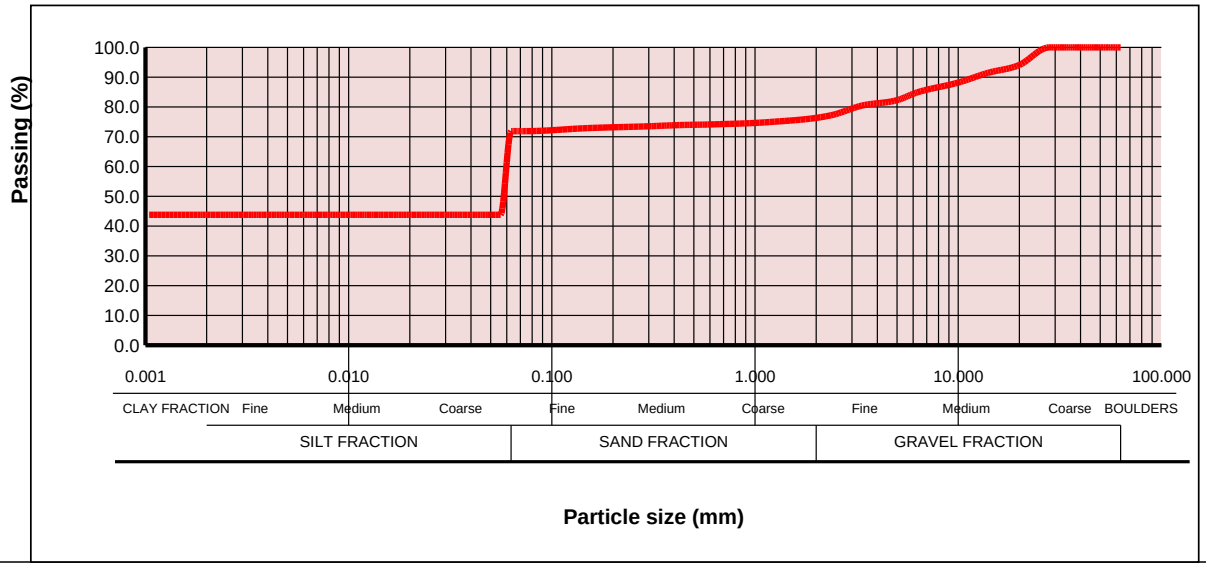

Tested by:	JILLO	**Date reported:**	13-Jun-26	Checked by: _____