

UNIT-1 COOLED CHILLER-1

05-12-2025

1440

TOTAL RUN TIME

182

POSITIVE MINUTES


1258

NEGATIVE MINUTES


5705

CH Day KWh


CHILLER LOAD,(TR%)

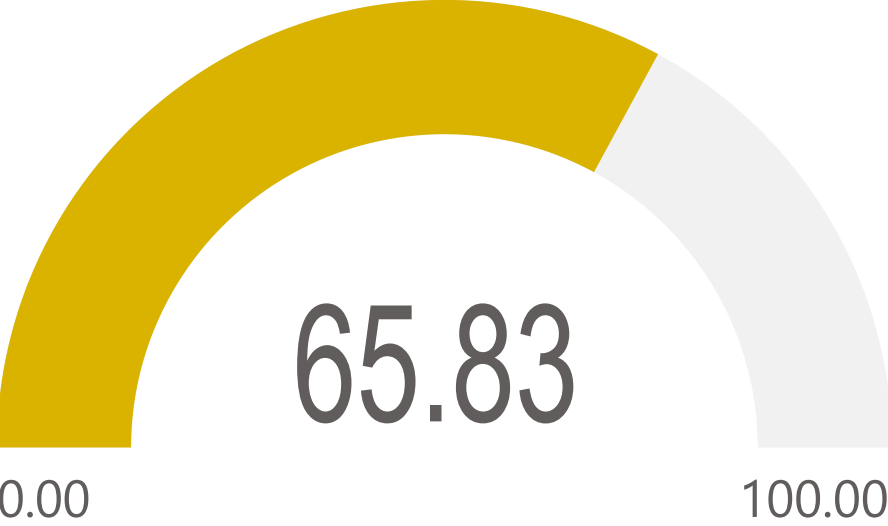


ACTUAL (kW/TR) V/S COMMITTED (i kW/TR)

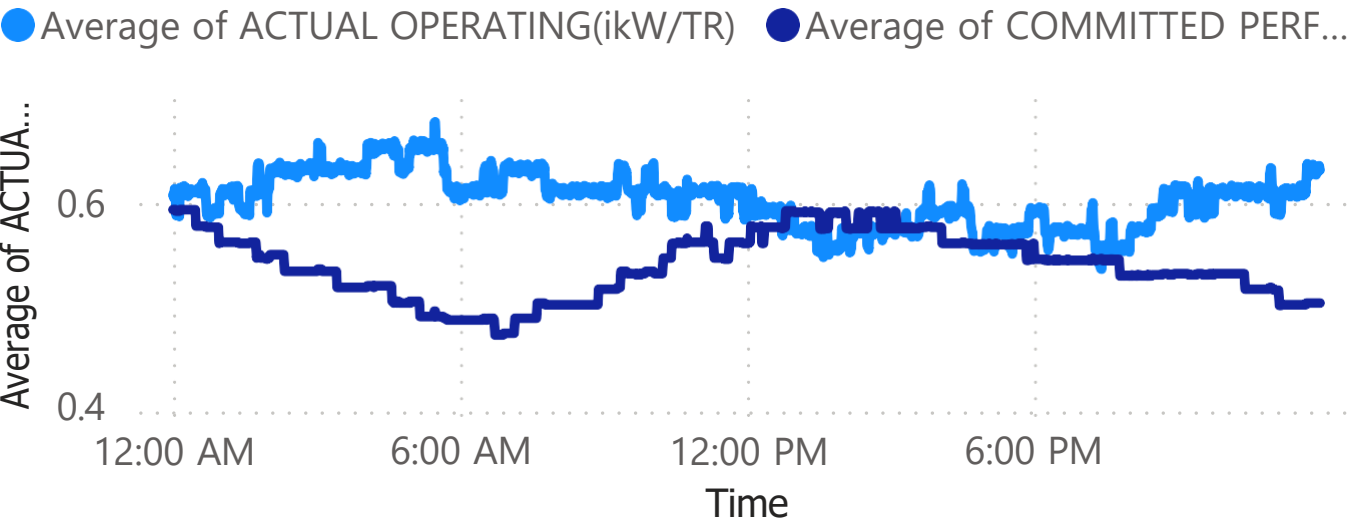


TR V/S kW

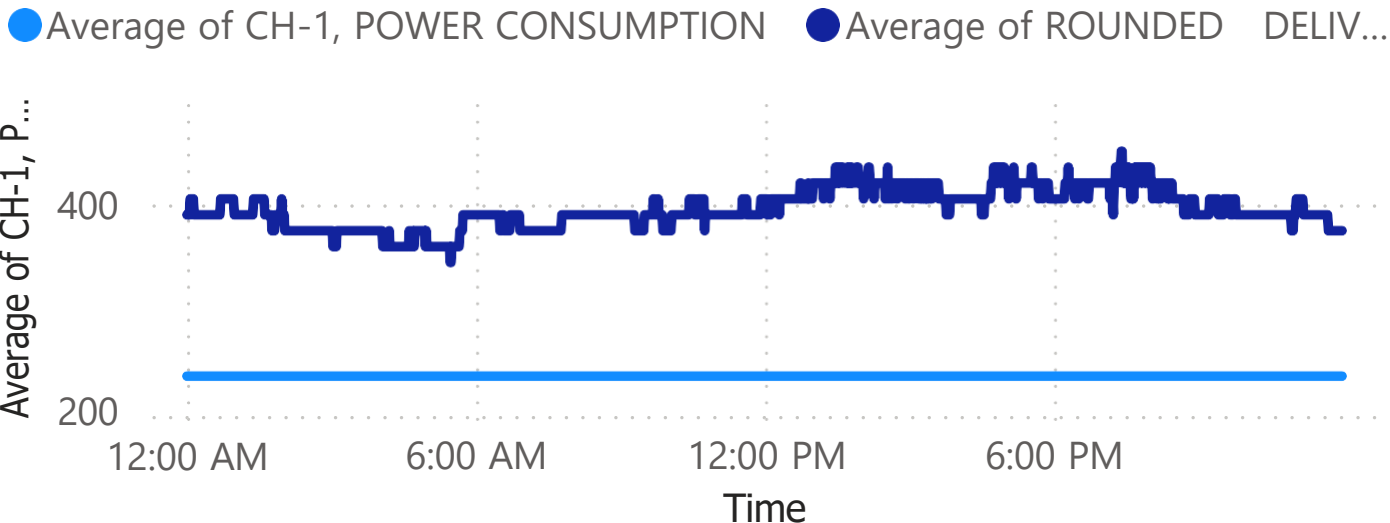

CT Approach

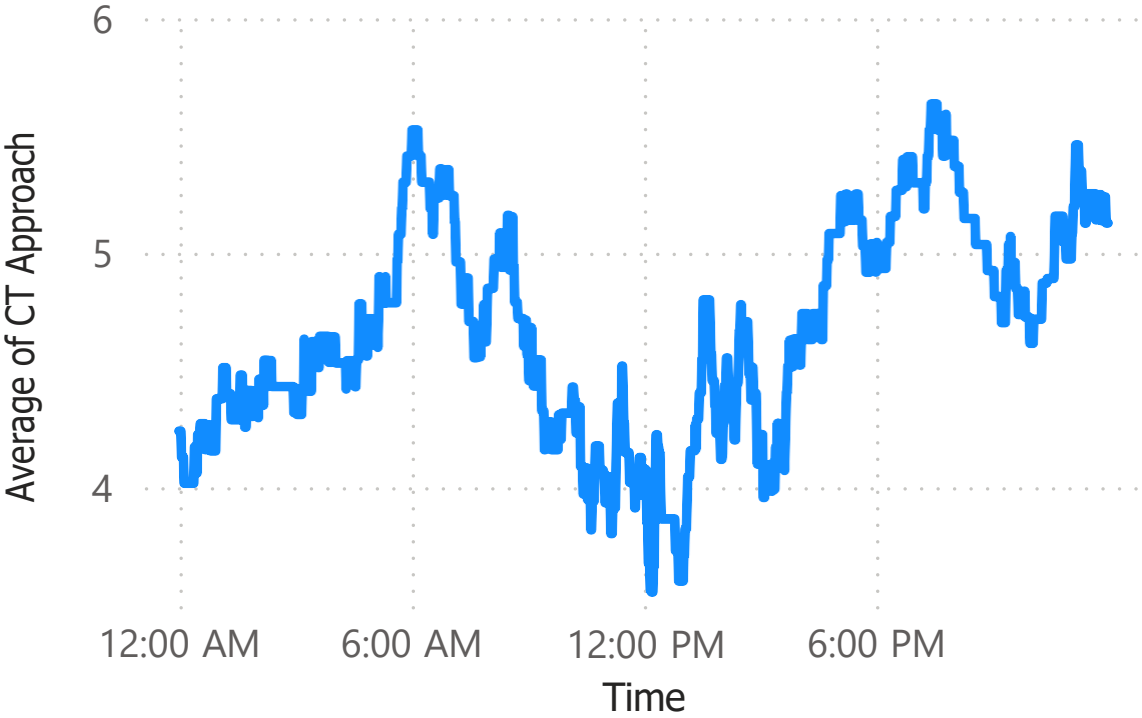

Wet bulb Temp

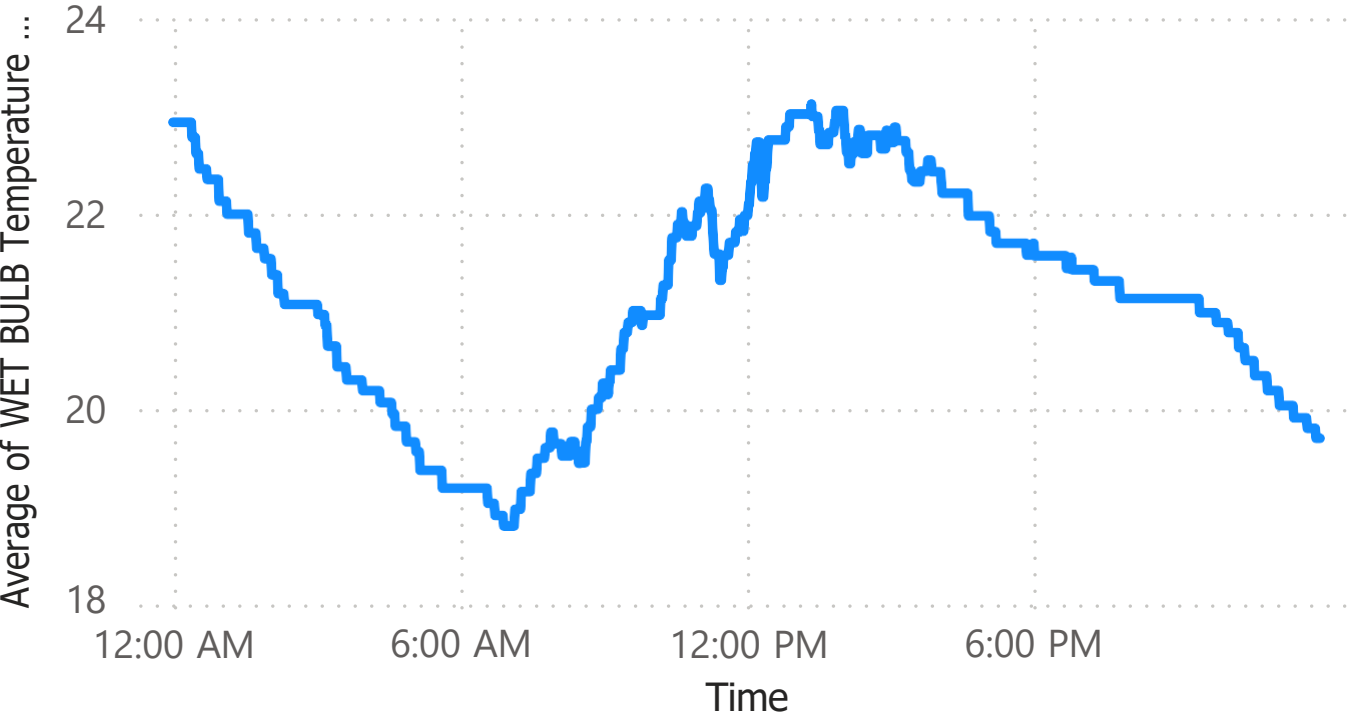

TOTAL TIME SPLIT

