

UNIT-12 CH-1

12/5/2025

1410

TOTAL RUN MINUTES

693

POSITIVE MINUTES


717

NEGATIVE_MINUTES


4,175.74

CH Daily kWh


CHILLER LOAD,(TR%)

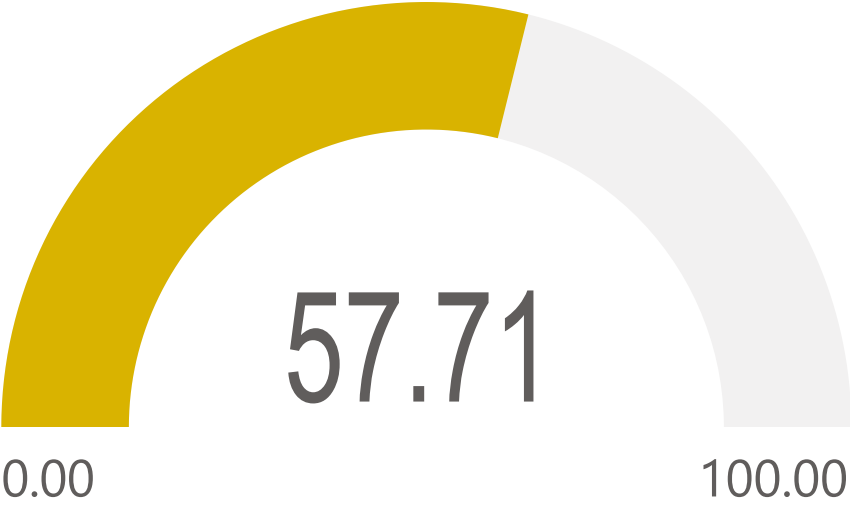


ACTUAL (kW/TR) V/S COMMITTED (ikW/TR)

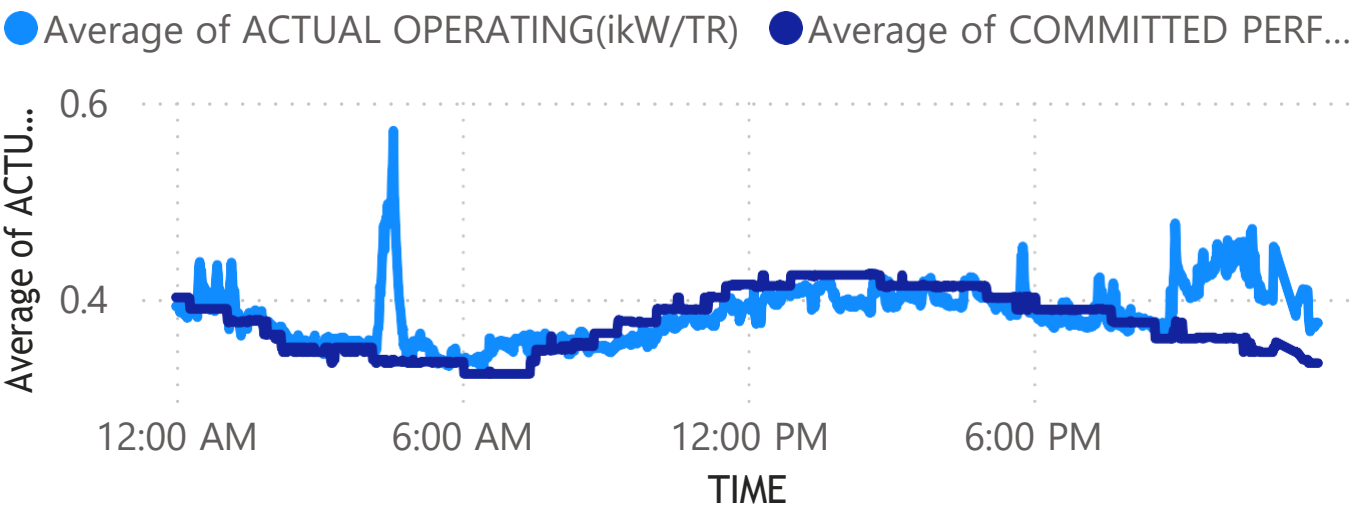


TR V/S kW

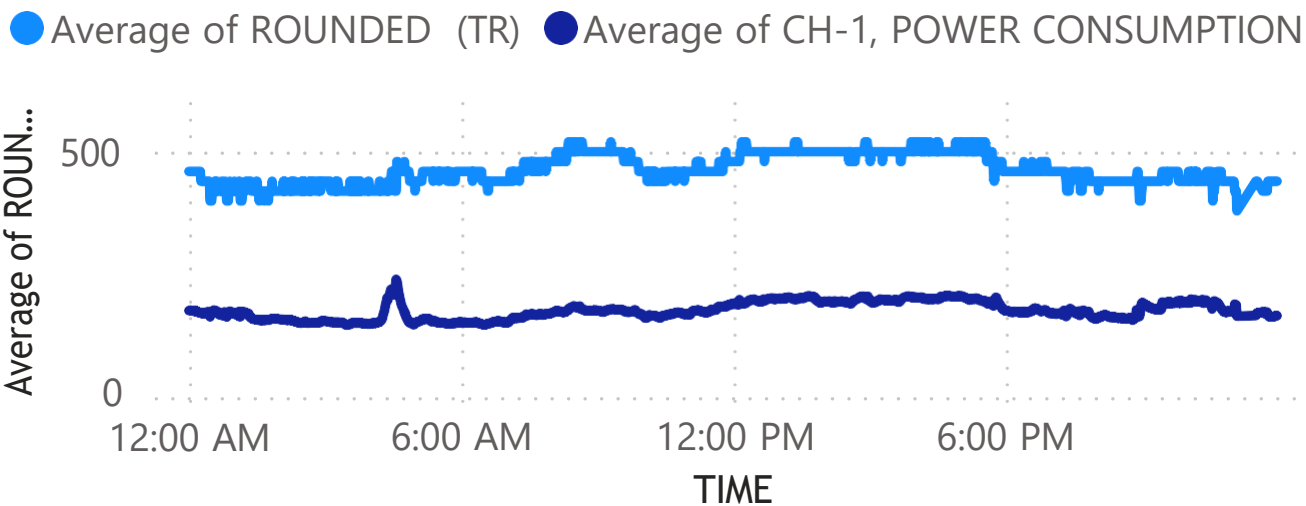


CT Approach

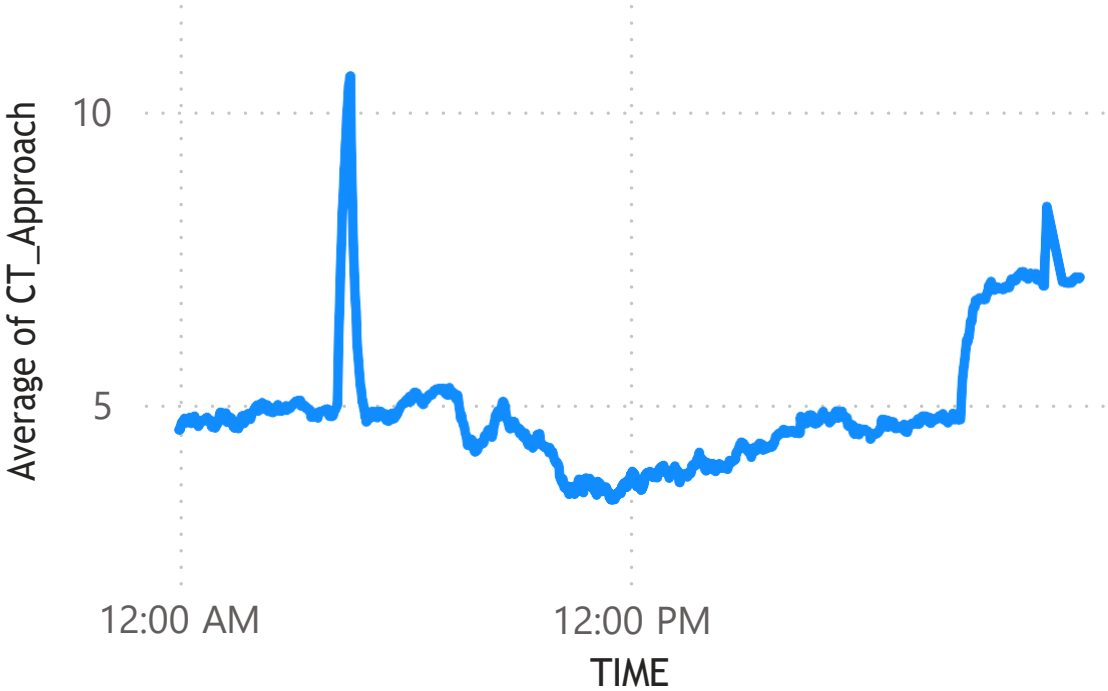

Wet bulb Temp

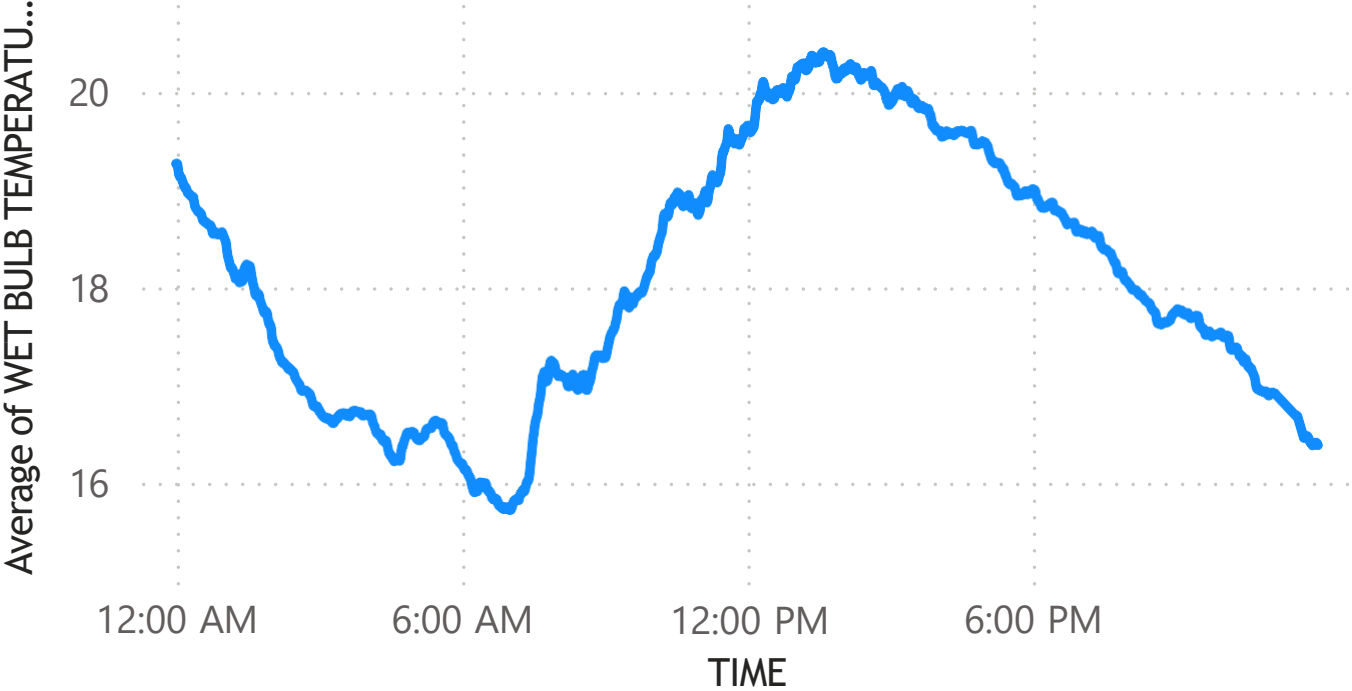

TOTAL TIME SPLIT

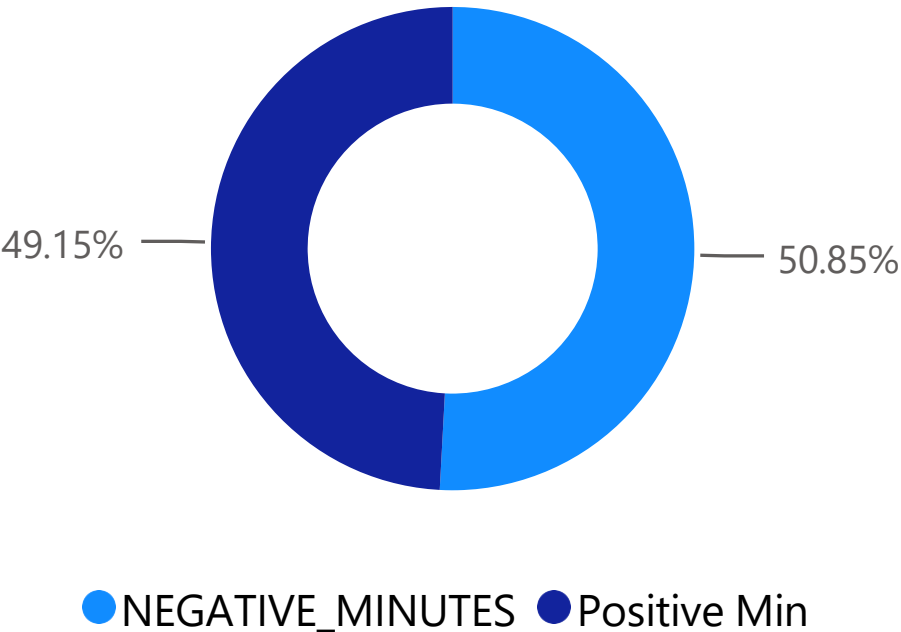

UNIT-12 CH-2

05-12-2025

1389

TOTAL RUN MINUTES

671

POSITIVE MINUTES


718

NEGATIVE MINUTES


4,549.37

CH Daily kWh


CHILLER LOAD,(TR%)

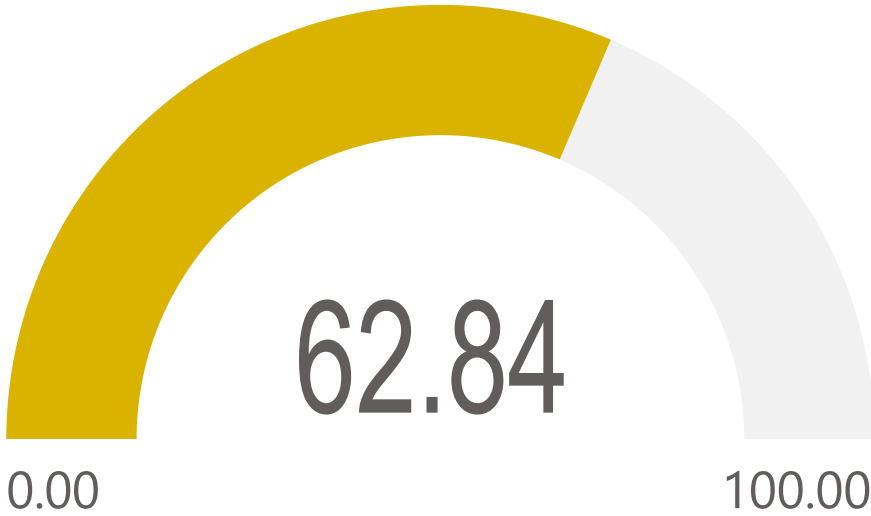


ACTUAL (kW/TR) V/S COMMITTED (ikW/TR)

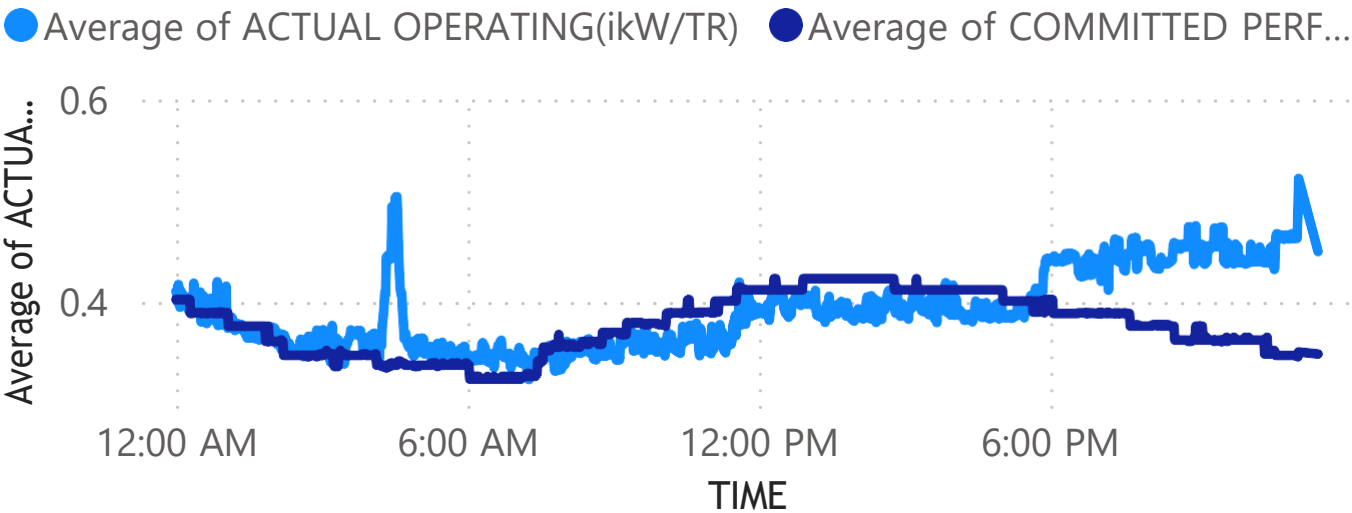


TR V/S kW

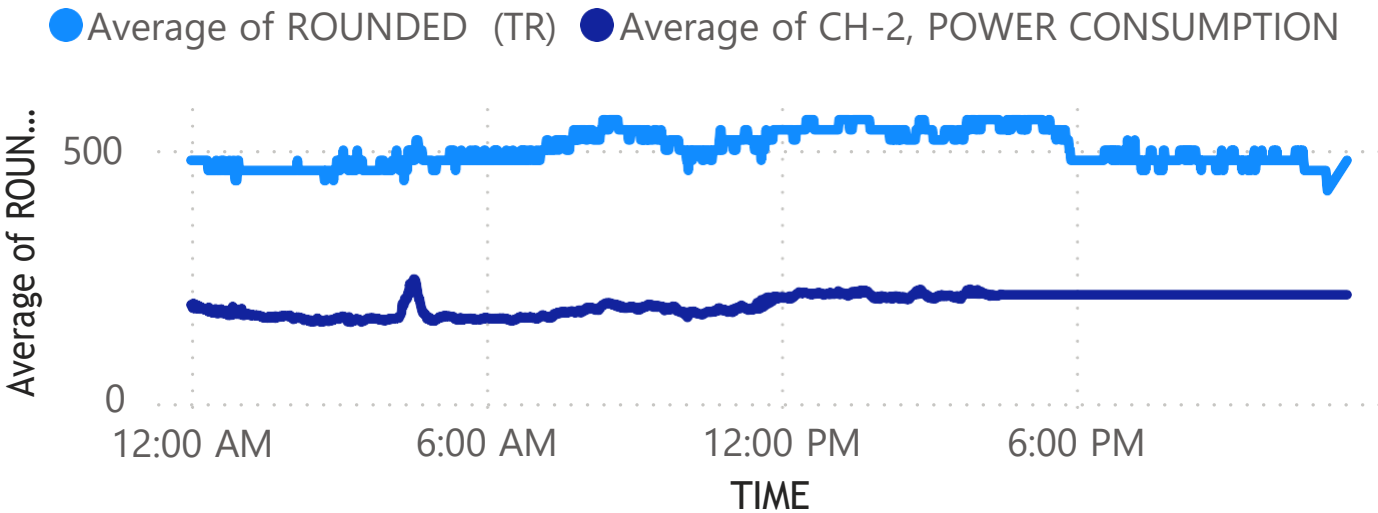

CT Approach

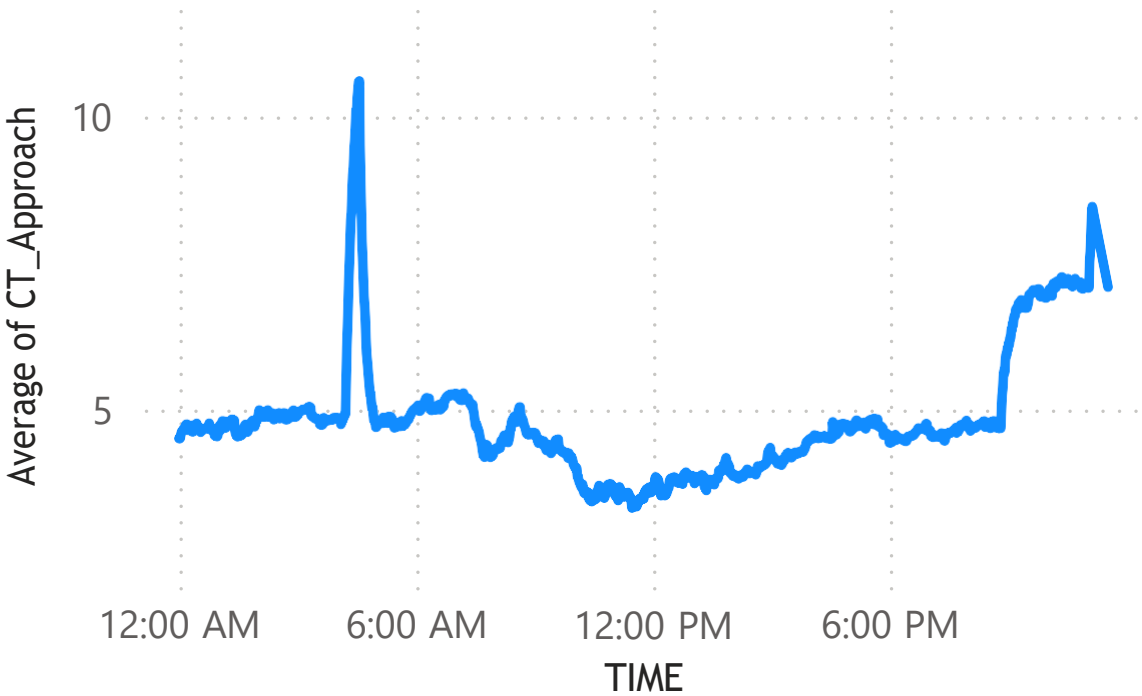

Wet bulb Temp

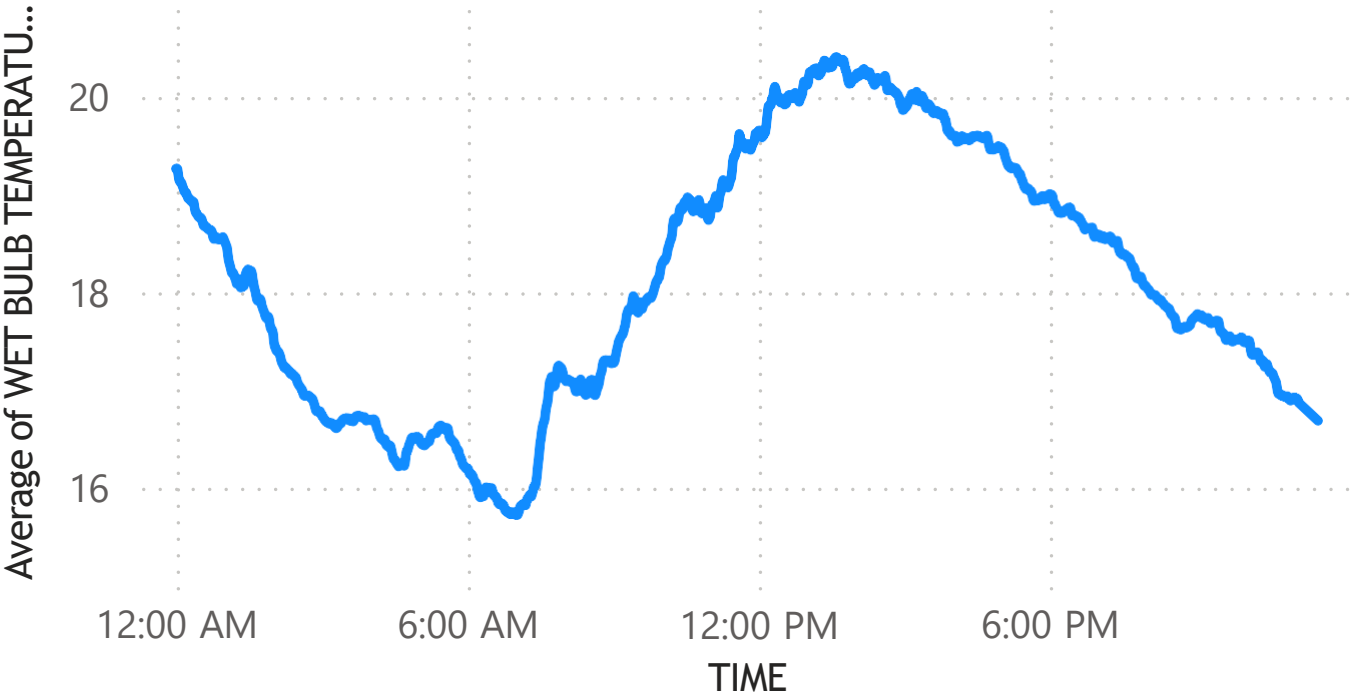

TOTAL TIME SPLIT

