

UNIT-3 CHILLER-1

05-12-2025

533

Total Run Minutes

0







POSITIVE MINUTES

533

NEGATIVE MINUTES

373.96

CH-1 Daily kWh

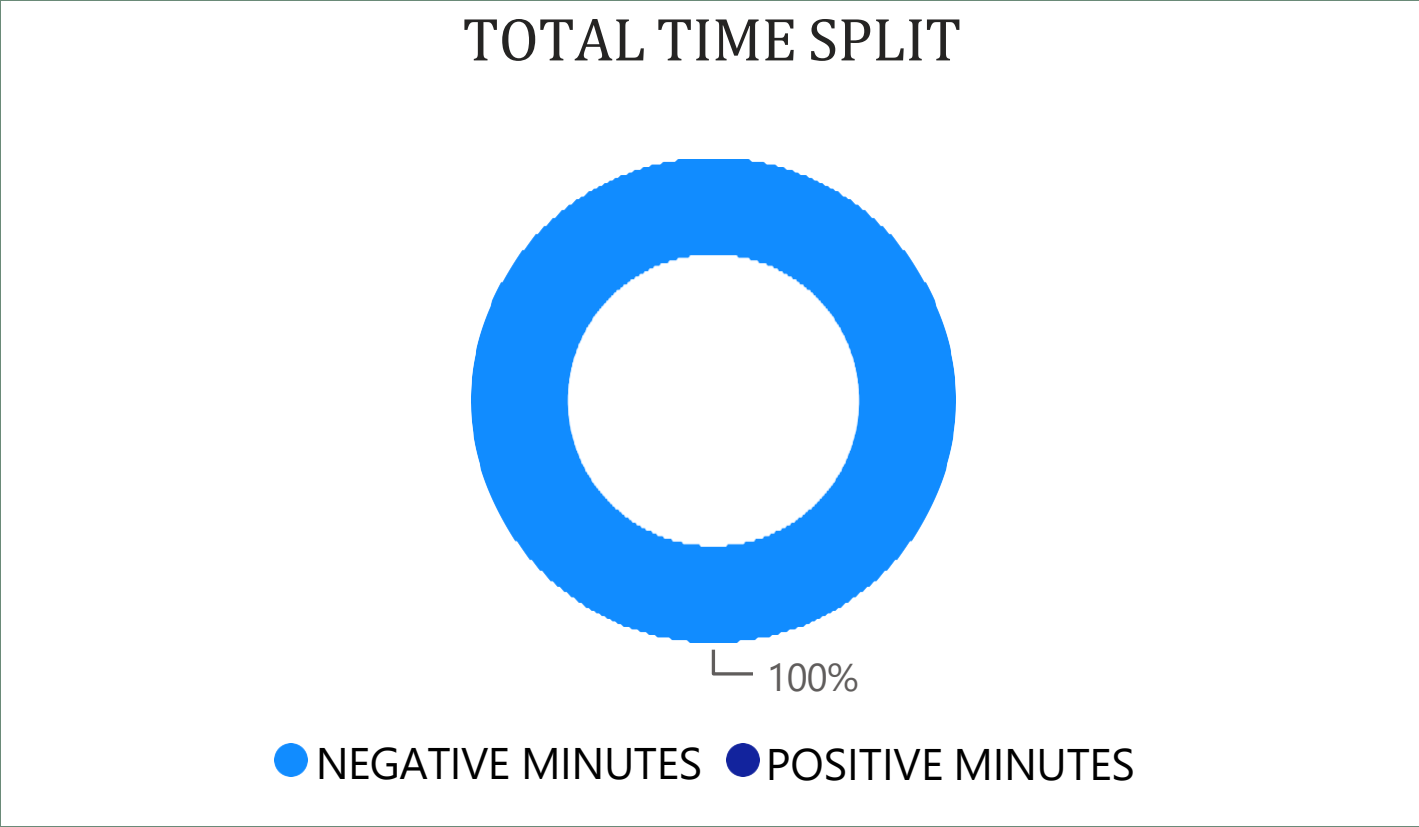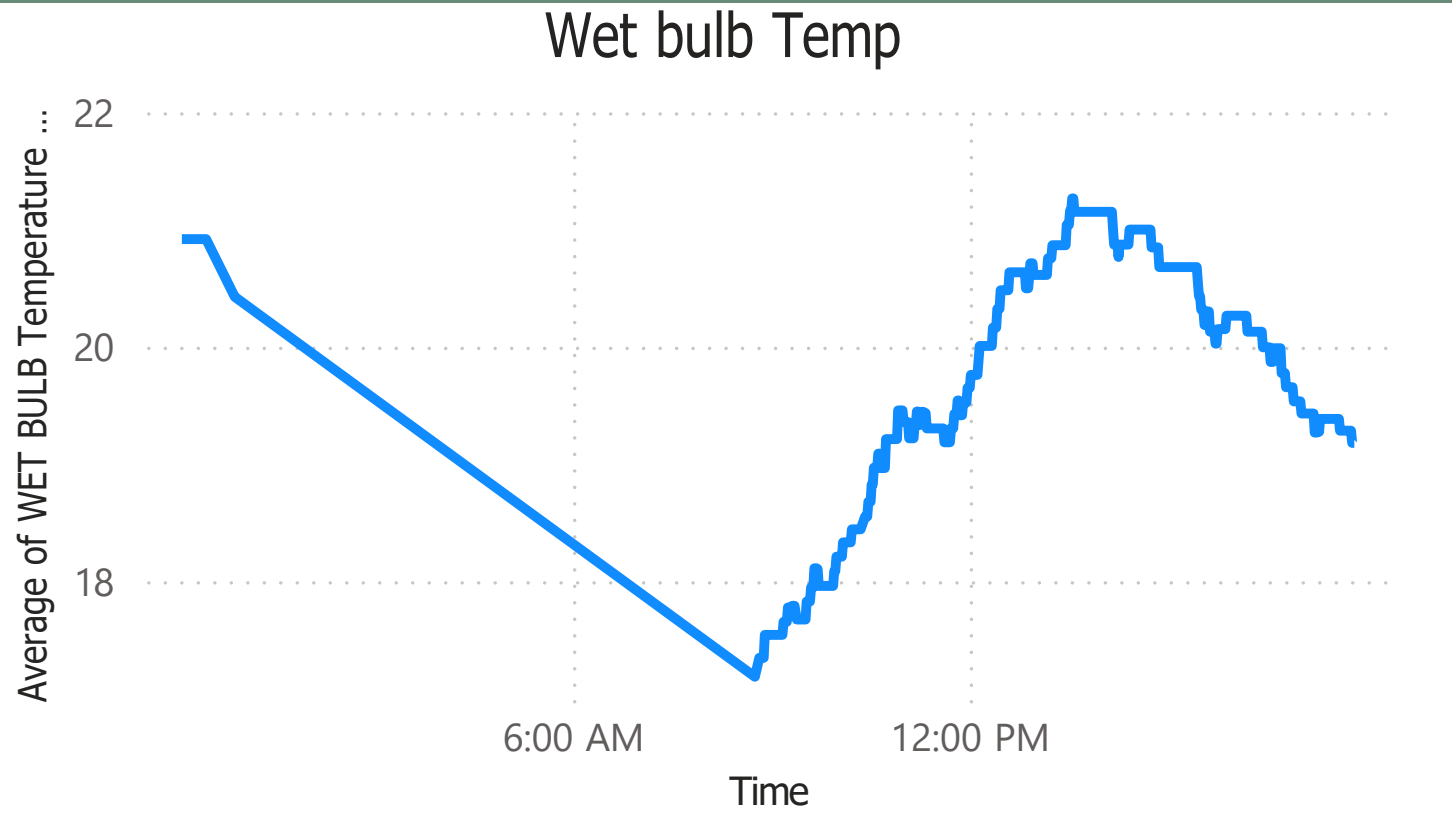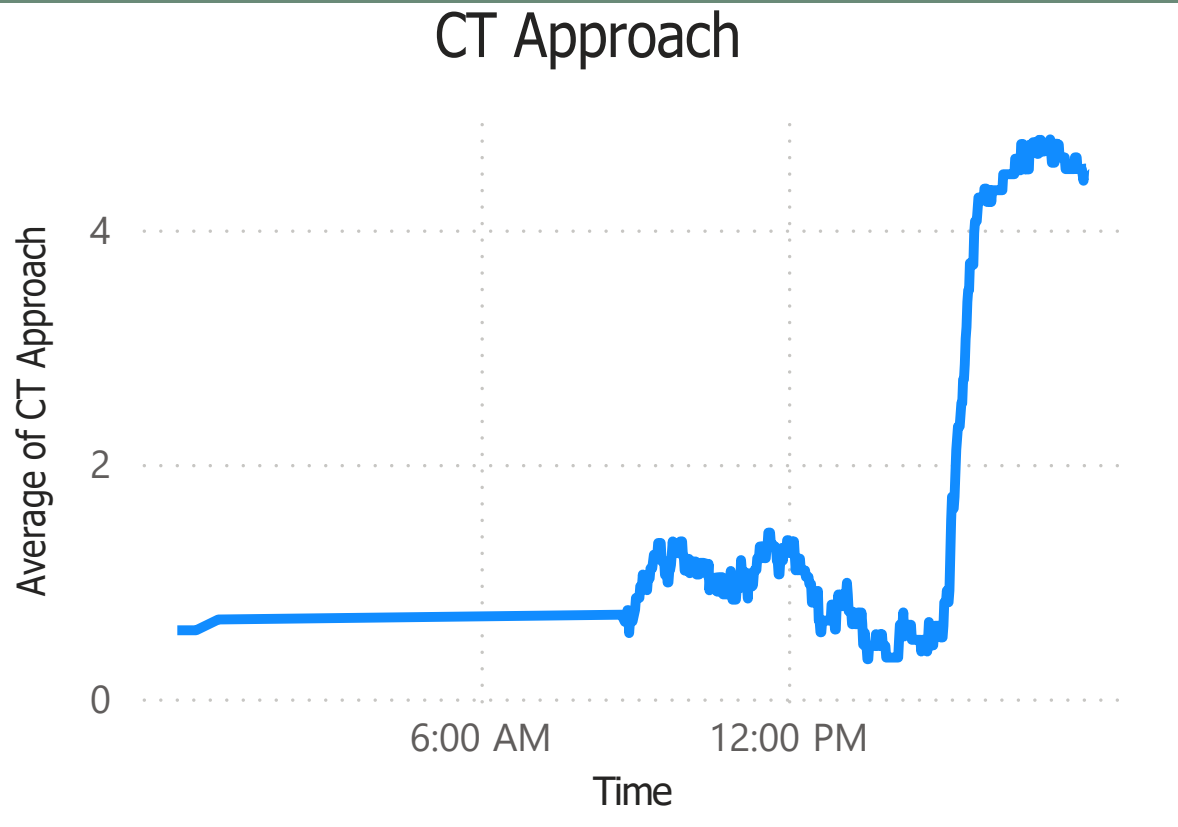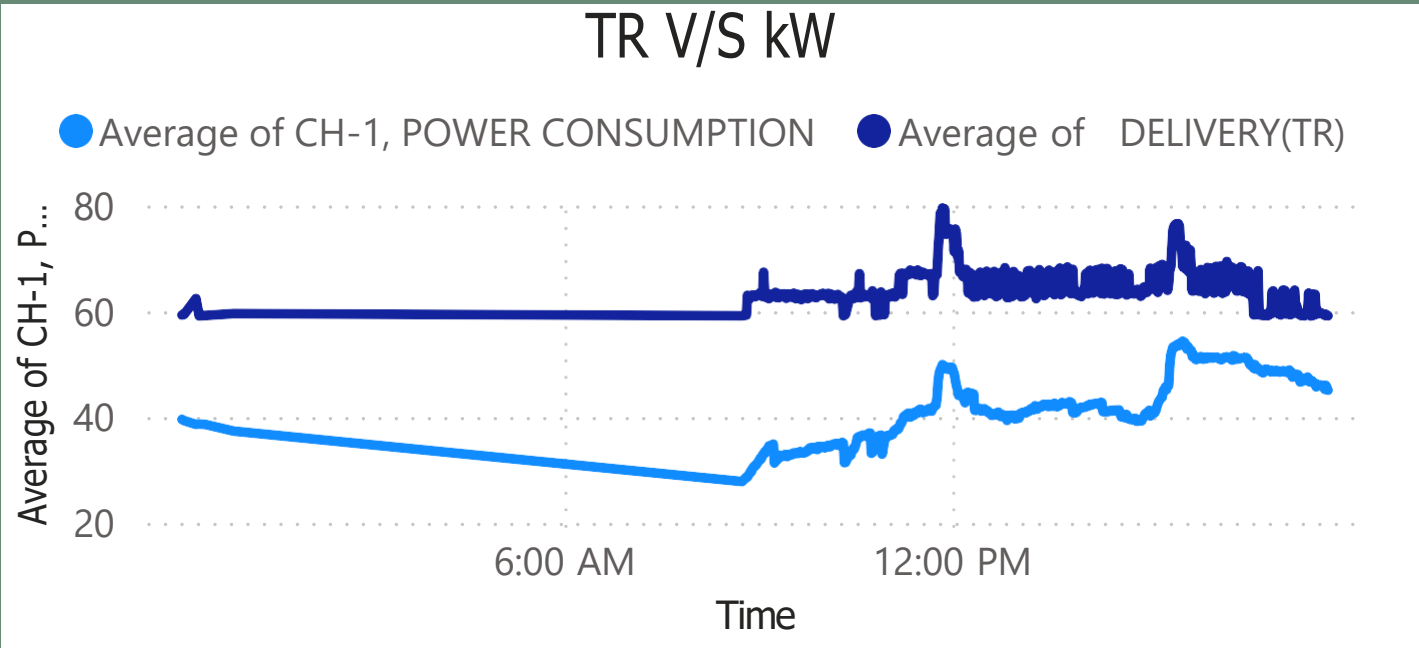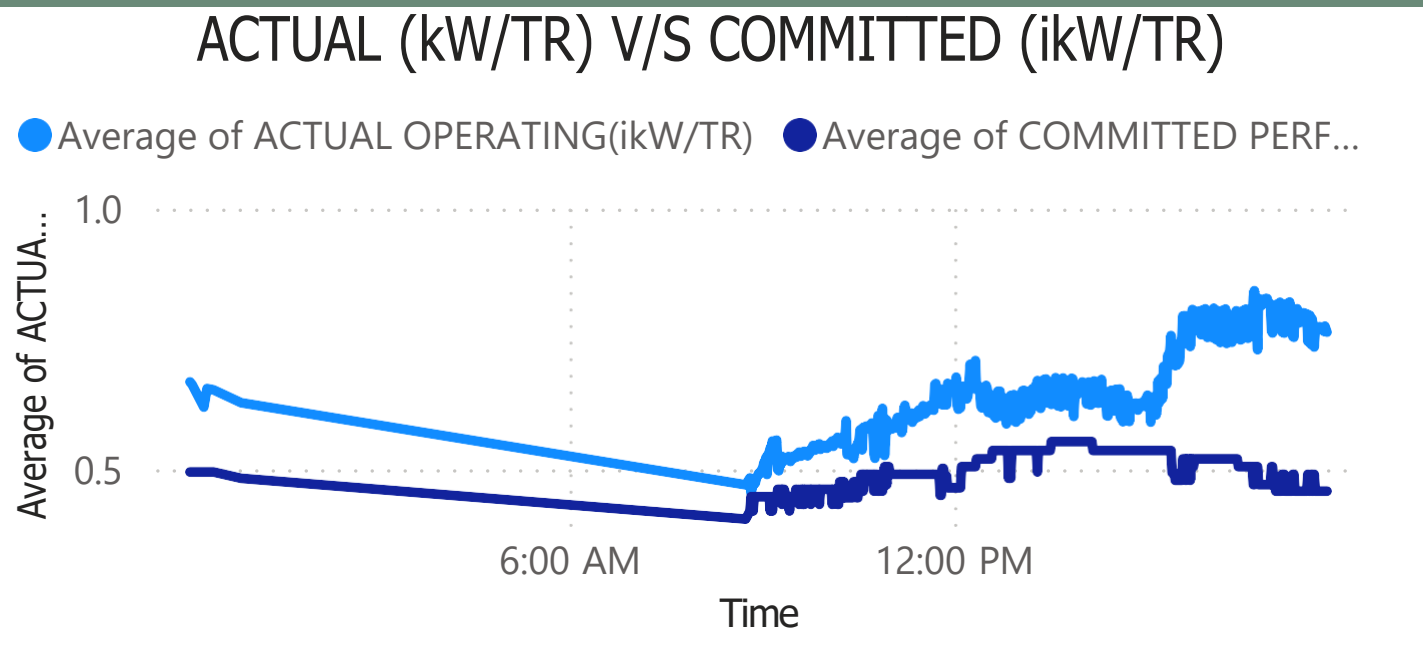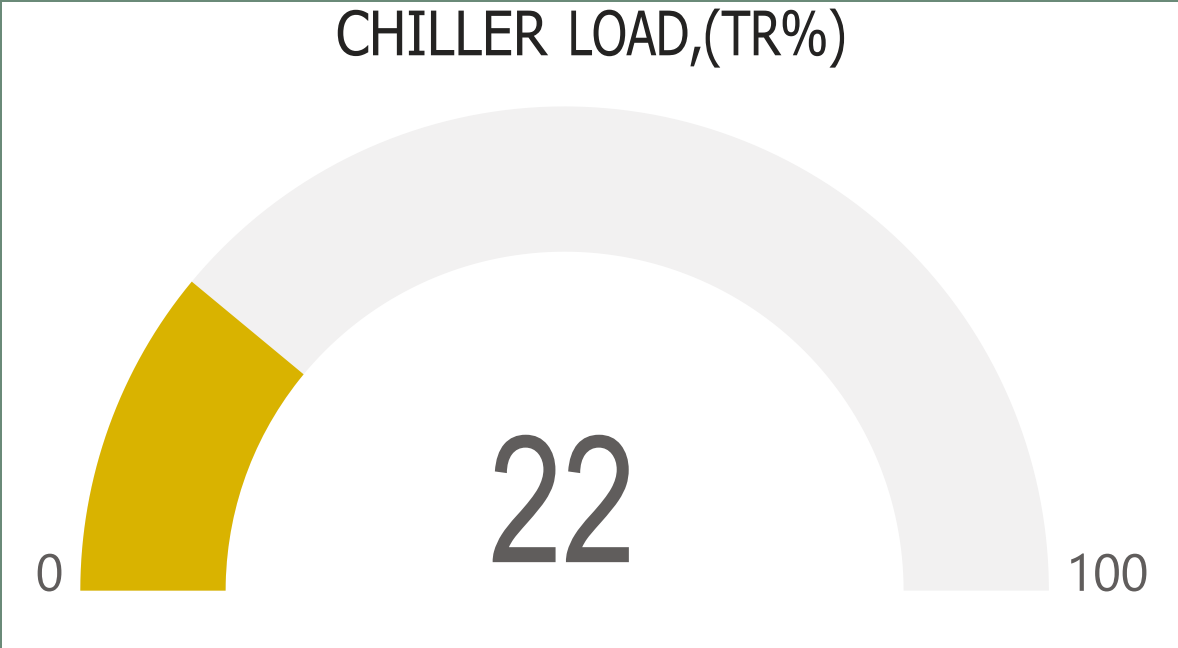

UNIT-3 CHILLER-2

(Blank)

(Blank)

TOTAL RUN MINUTES

0

POSITIVE MINUTES

0

NEGATIVE MINUTES

off

CH-2 Daily kWh

CHILLER LOAD,(TR%)



ACTUAL (kW/TR) V/S COMMITTED (i kW/TR)

Average of ACTUAL OPERATING(...)

TR V/S kW

Average of CH-2, POWER CONS...

CT Approach

Average of CT APPROACH

Wet bulb Temp

Average of WET BULB Temperature - Chill...

TOTAL TIME SPLIT