

CHILLER-1

05/12/2025

1107

TOTAL RUN MINUTES

600

POSITIVE MINUTE'S


507

NEGATIVE MINUTE'S


5,781.94

CH Day kWh


Average of CHILLER LOAD,(TR%)

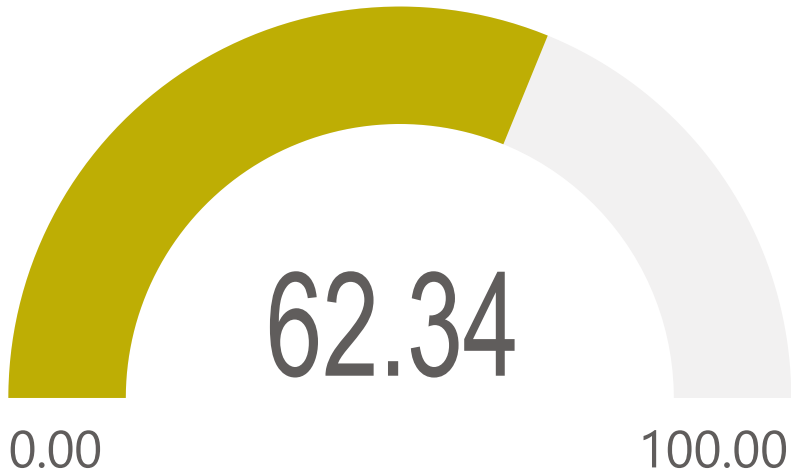


ACTUAL V/S COMMITED IKW/TR

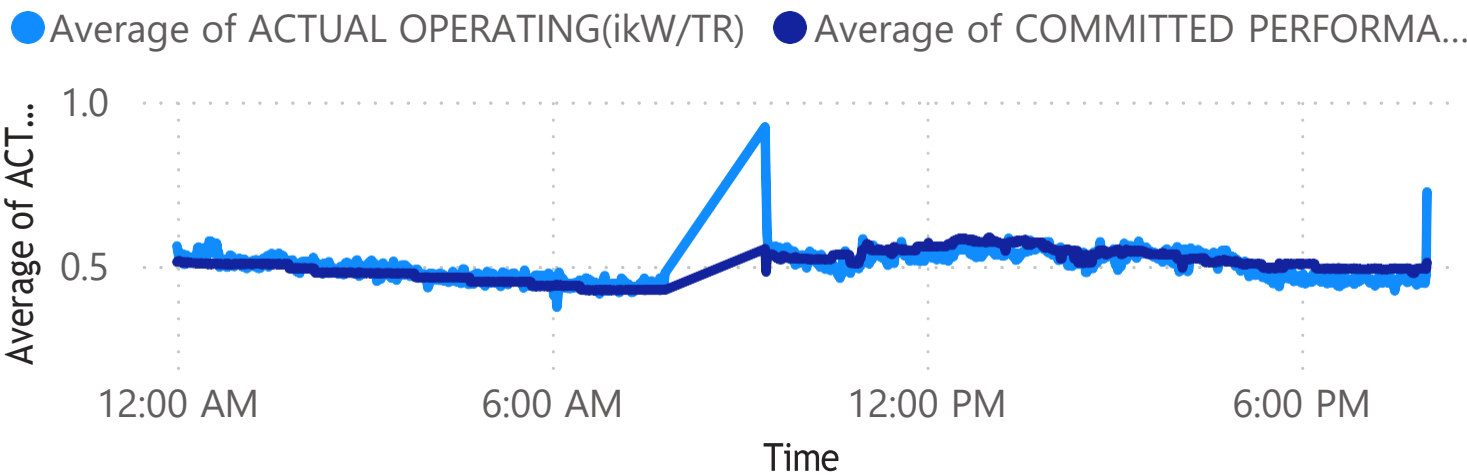


TR V/S kW

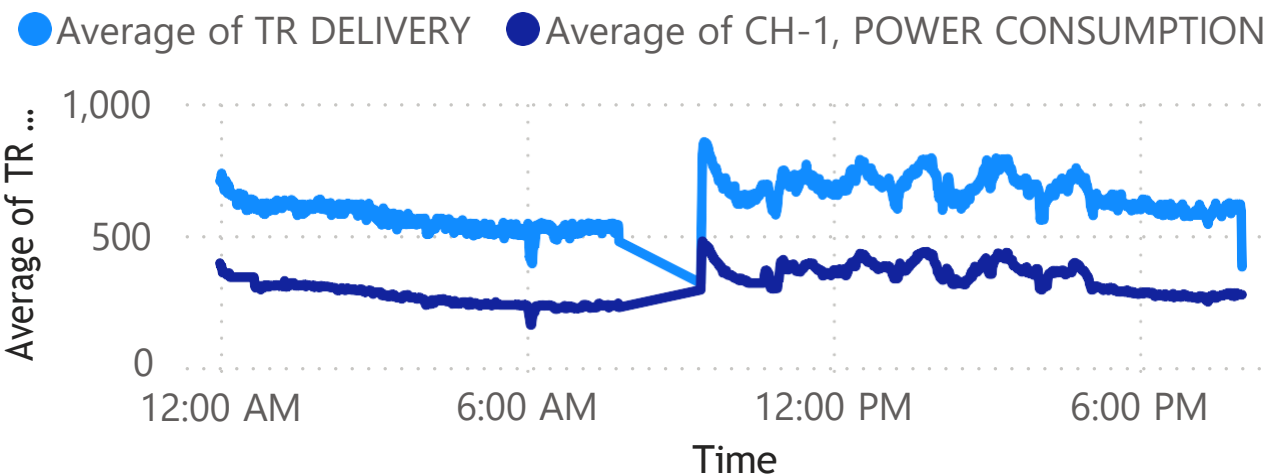


CT Approach

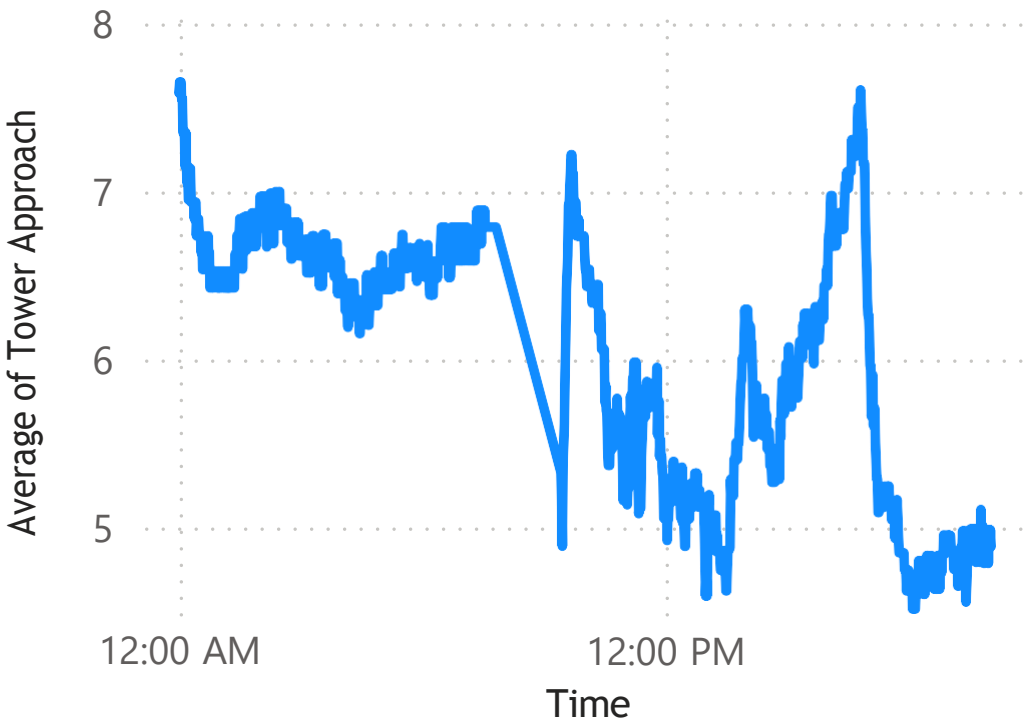

Wet bulb Temp

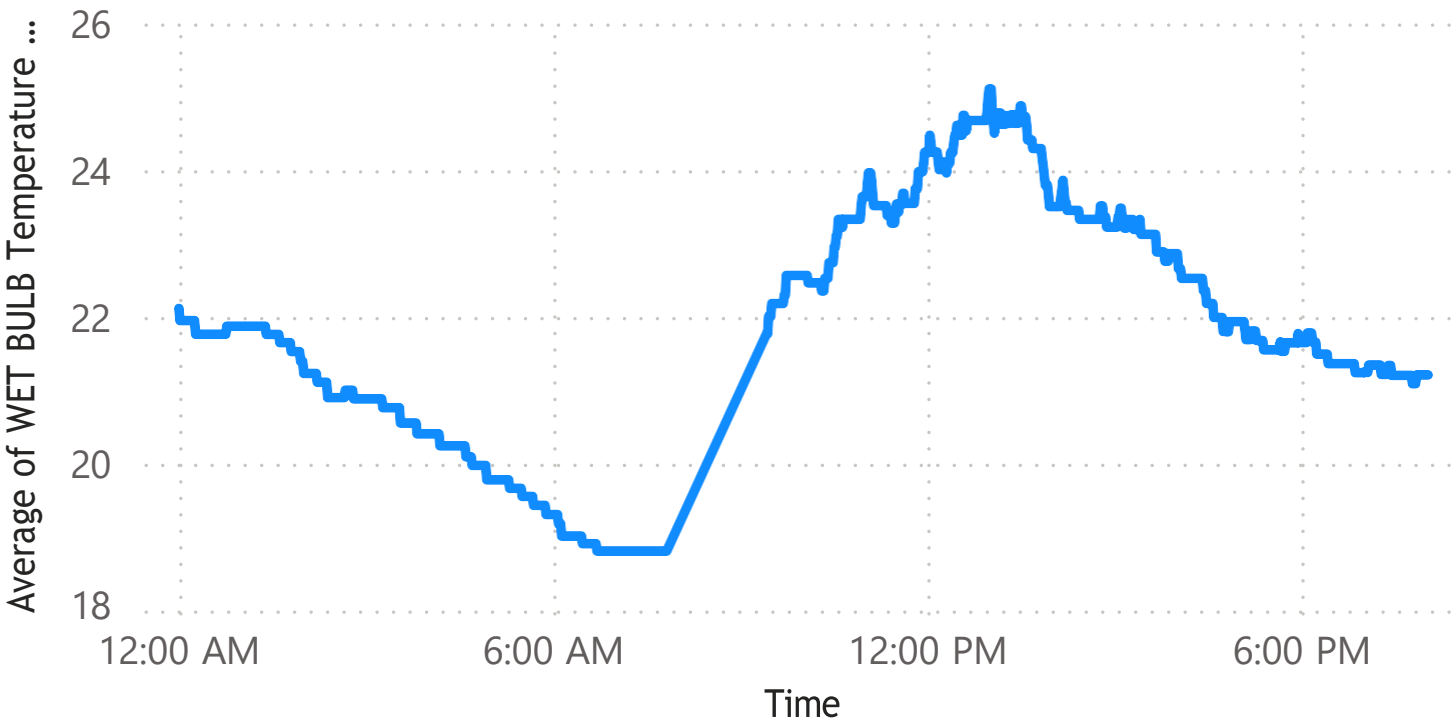

TOTAL TIME SPLIT

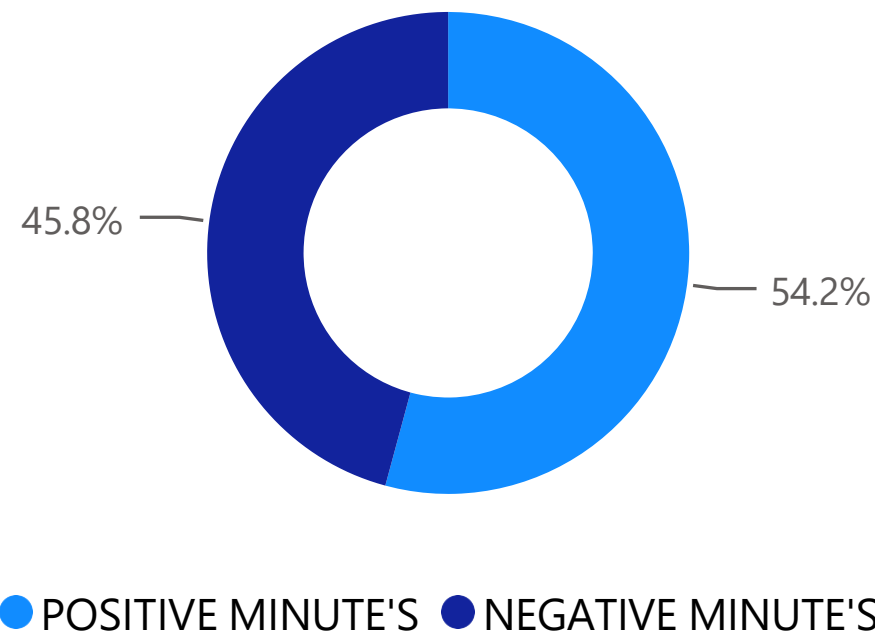

CHILLER-2

05/12/2025

1435

TOTAL RUN MINUTES

232

POSITIVE MINUTES


1203

NEGATIVE MINUTES


9,475.79

CH-2 Daily kWh


Average of CHILLER LOAD, (TR%)

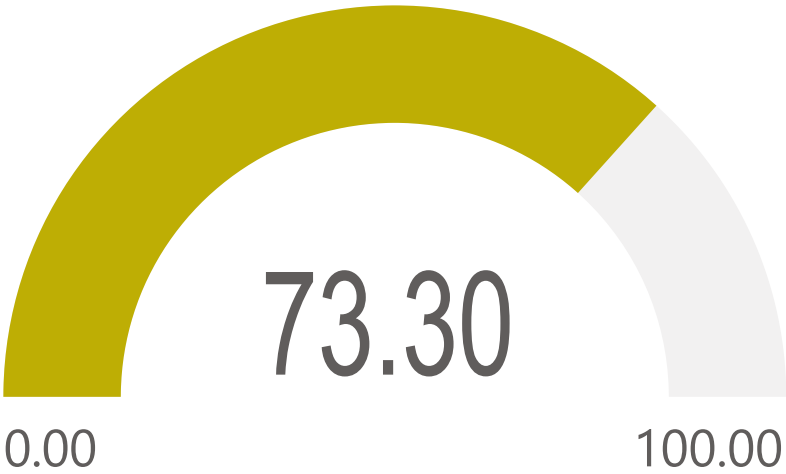


ACTUAL V/S COMMITED IKW/TR

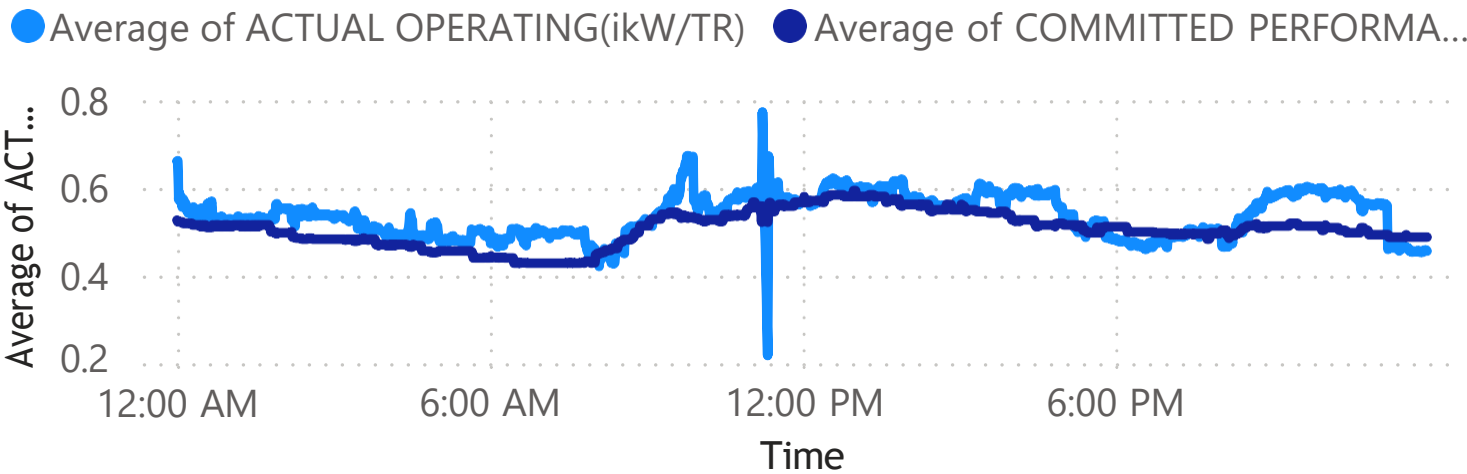


TR V/S kW

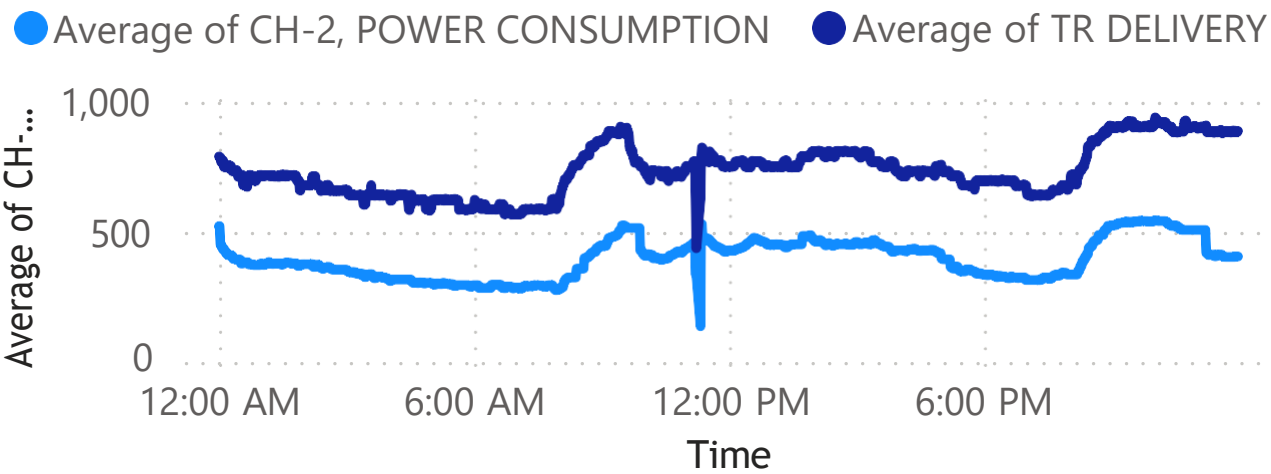


CT Approach

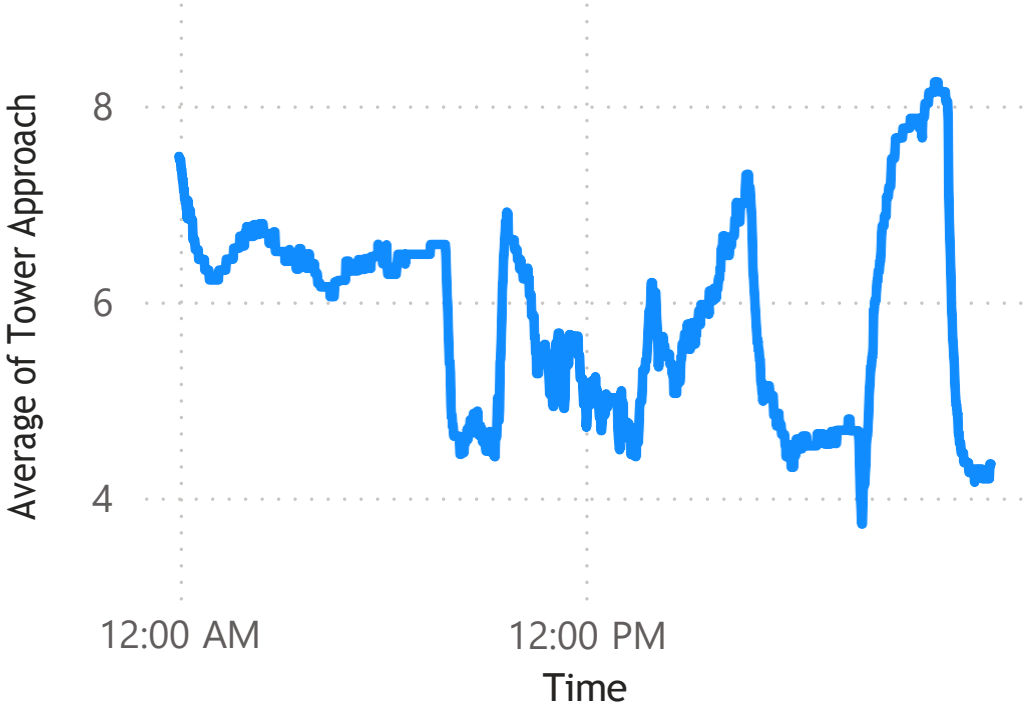

Wet bulb Temp

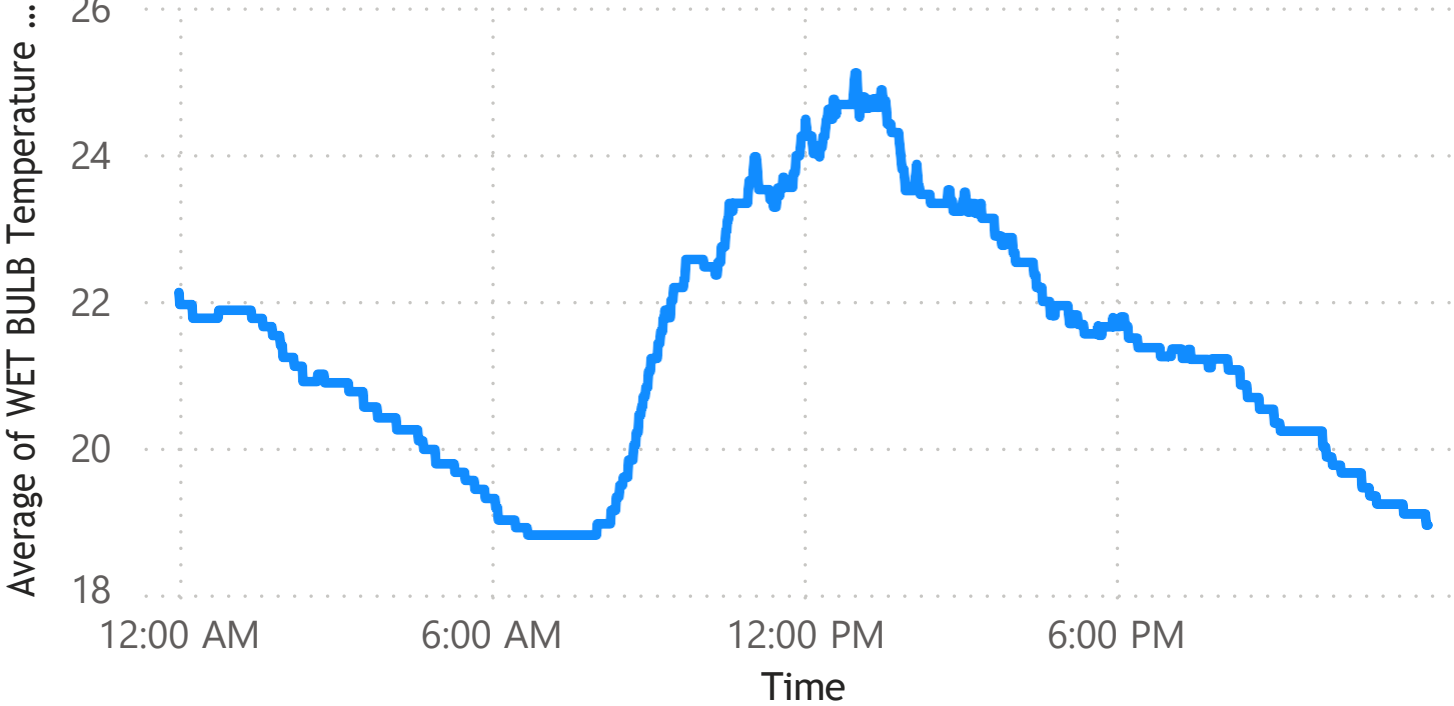

TOTAL TIME SPLIT

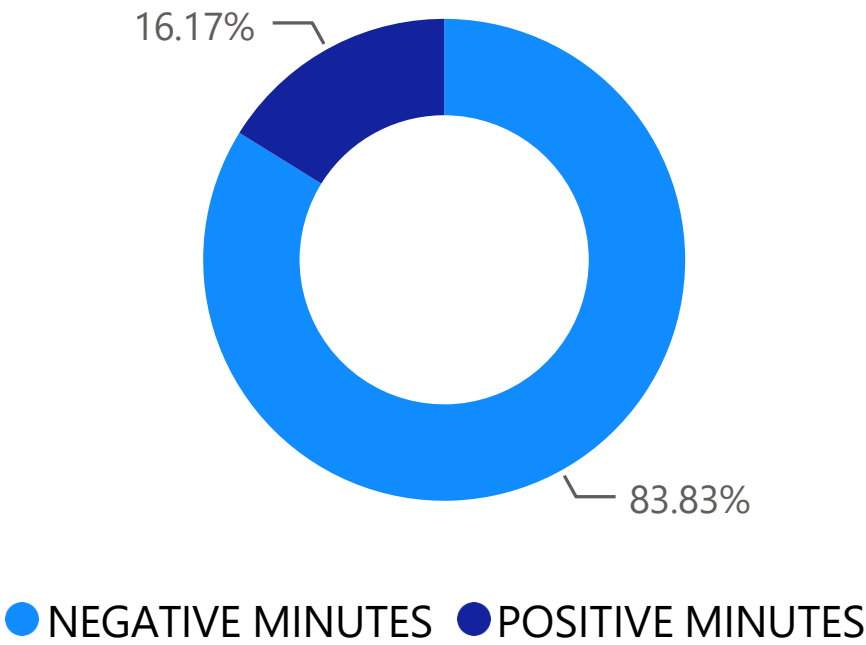

CHILLER-3

05/12/2025

1440

TOTAL RUN MINUTES

104

POSITIVE MINUTE


1336

NEGATIVE_MINUTES


9,205.12

CH-3 Daily kWh


Average of CHILLER LOAD,(TR%)

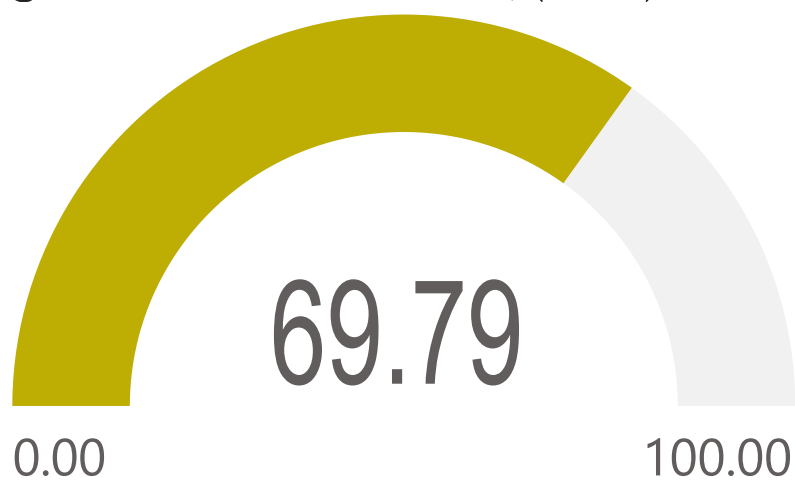


ACTUAL V/S COMMITED IKW/TR

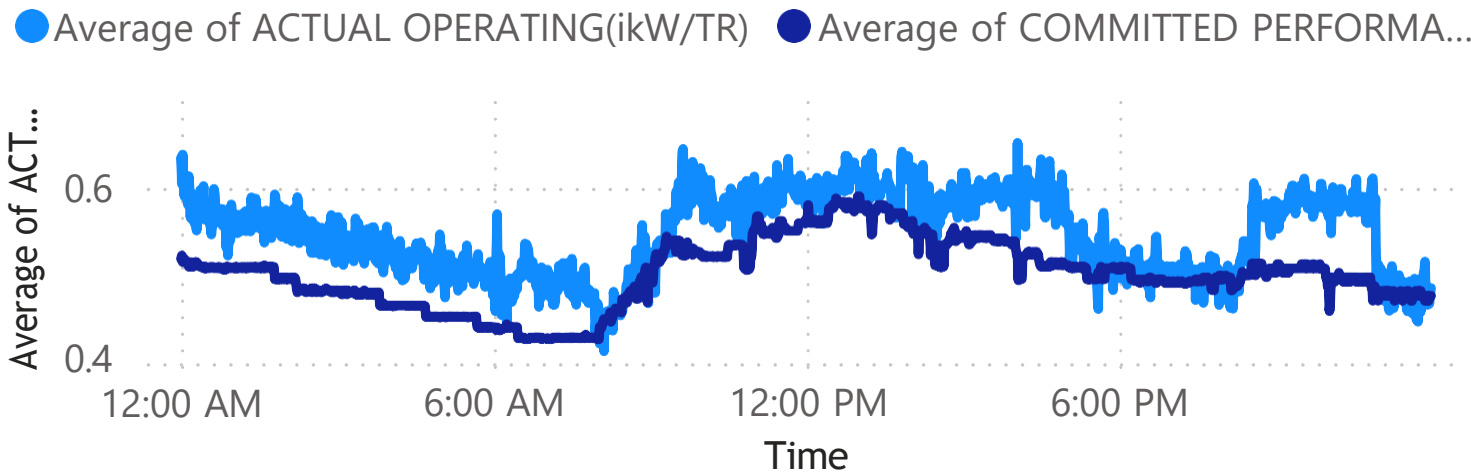


TR V/S kW

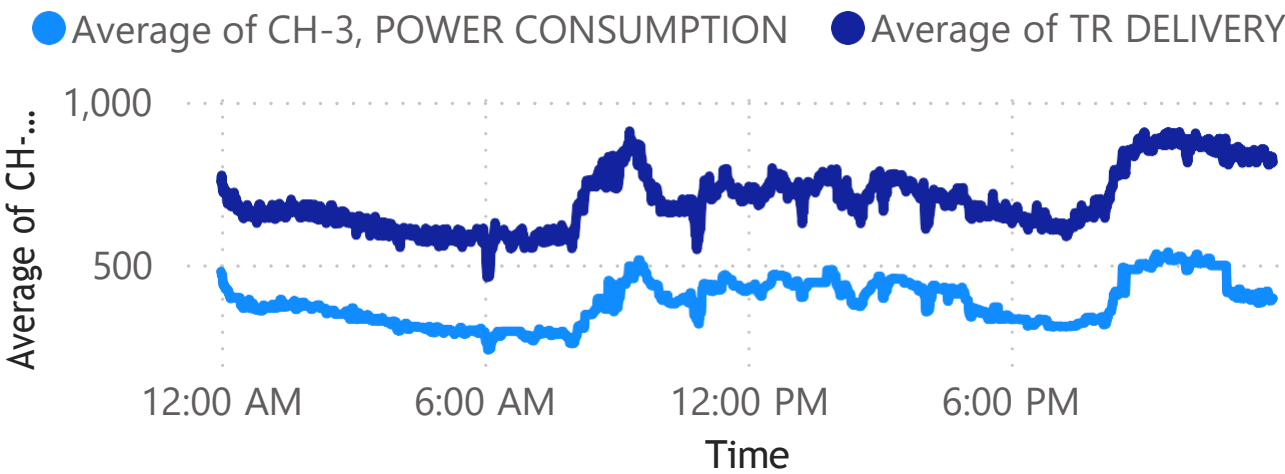

CT Approach

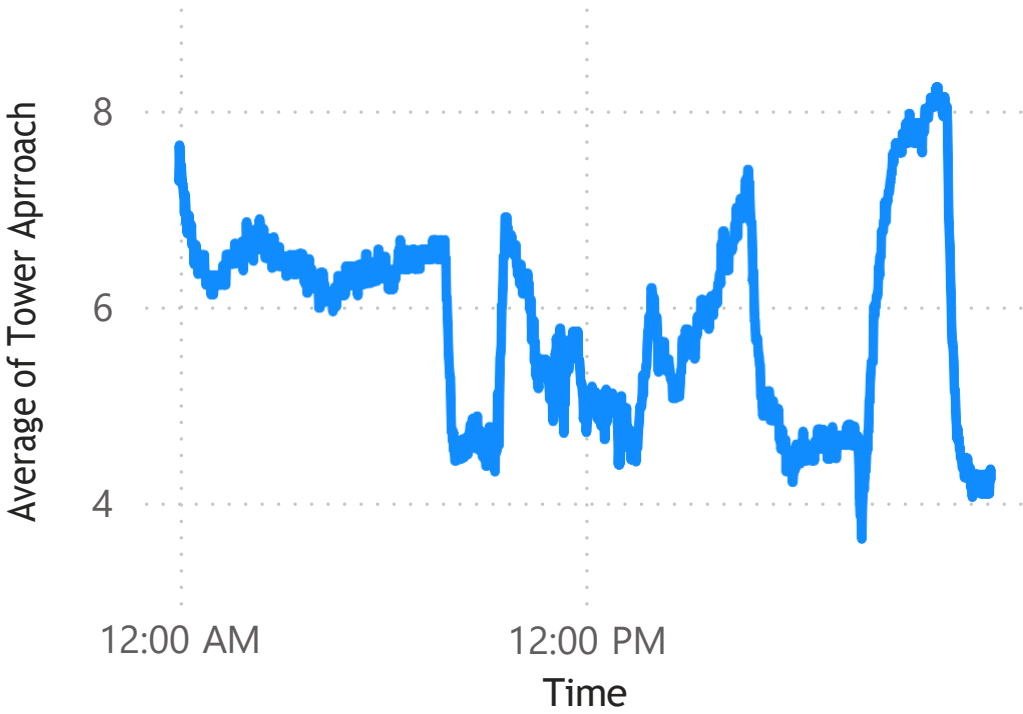

Wet bulb Temp

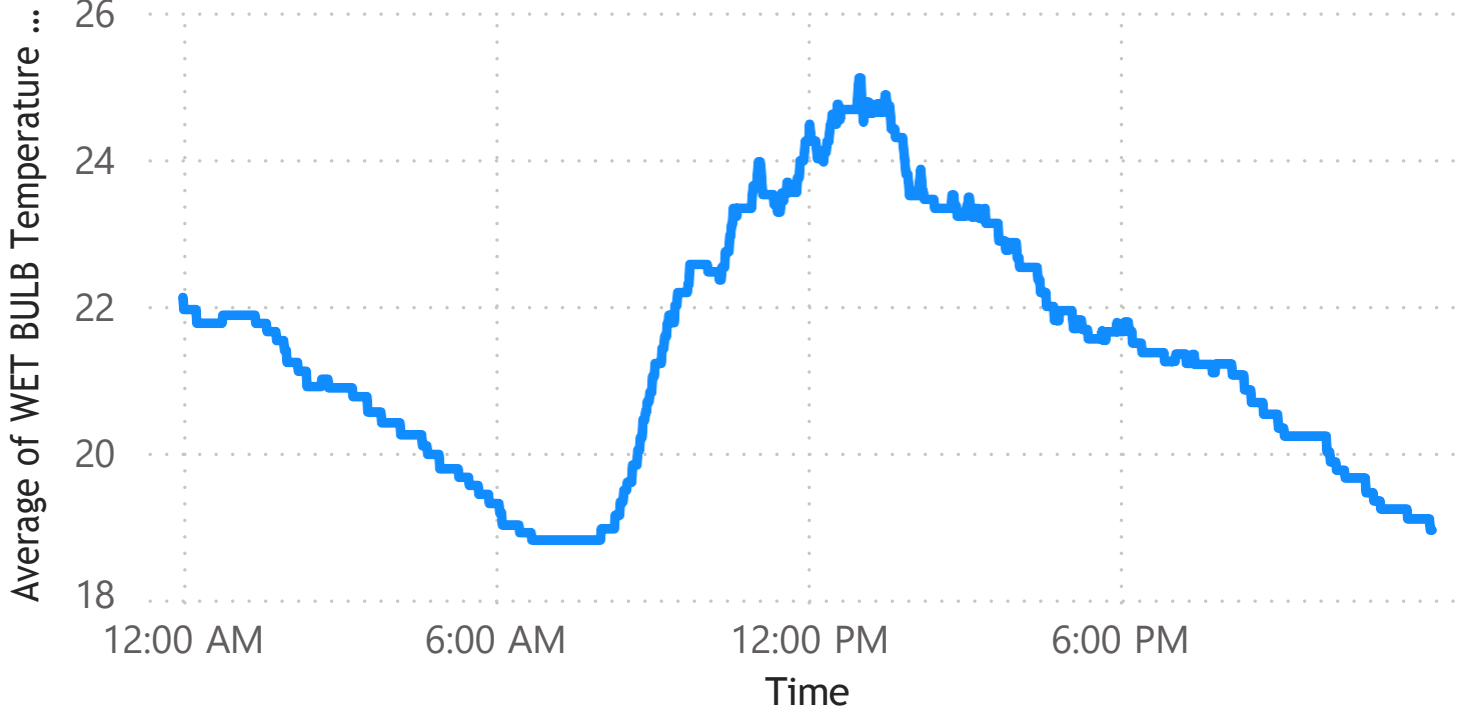

TOTAL TIME SPLIT

