

CH-11

05-12-2025

1440

TOTAL RUN TIME

218

POSITIVE MINUTES


1222

NEGATIVE_MINUTES


5,607.34

Daily kWh


CHILLER LOAD,(TR%)

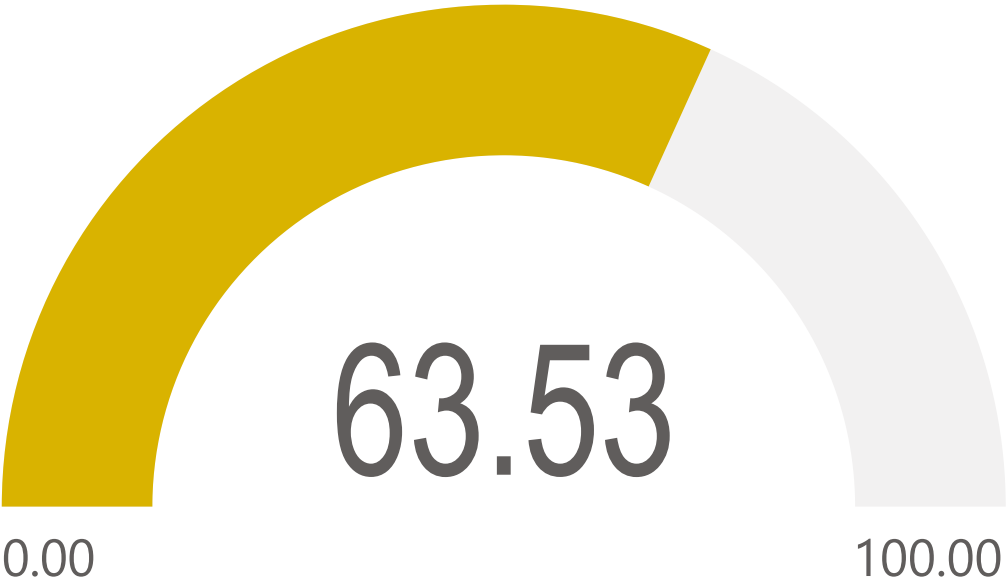


ACTUAL (kW/TR) V/S COMMITTED (ikW/TR)

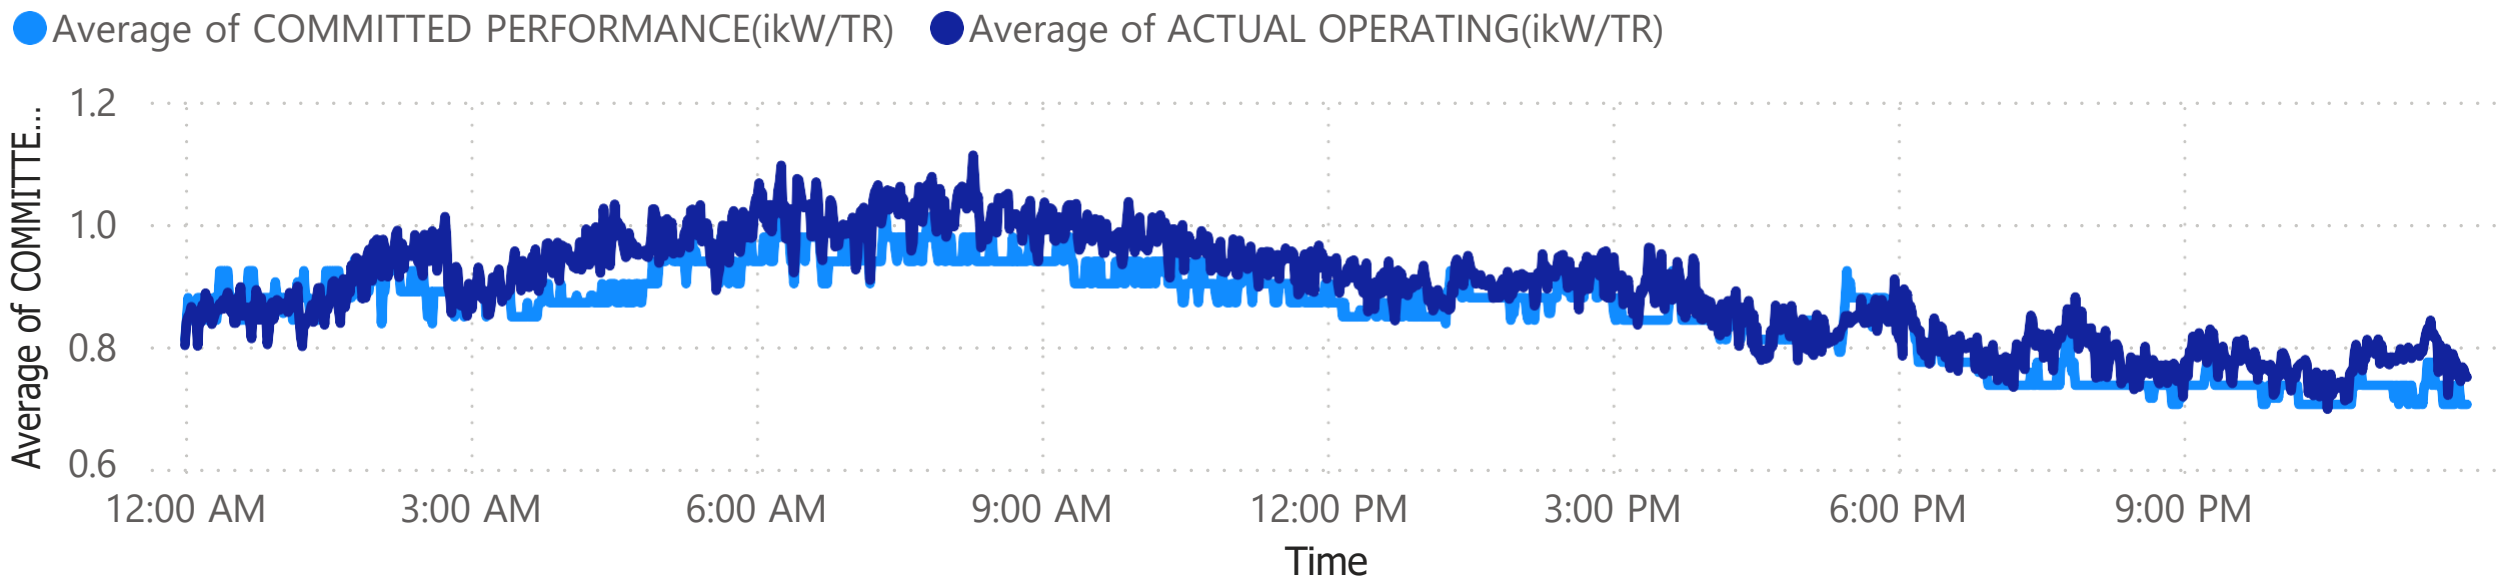

TOTAL TIME SPLIT

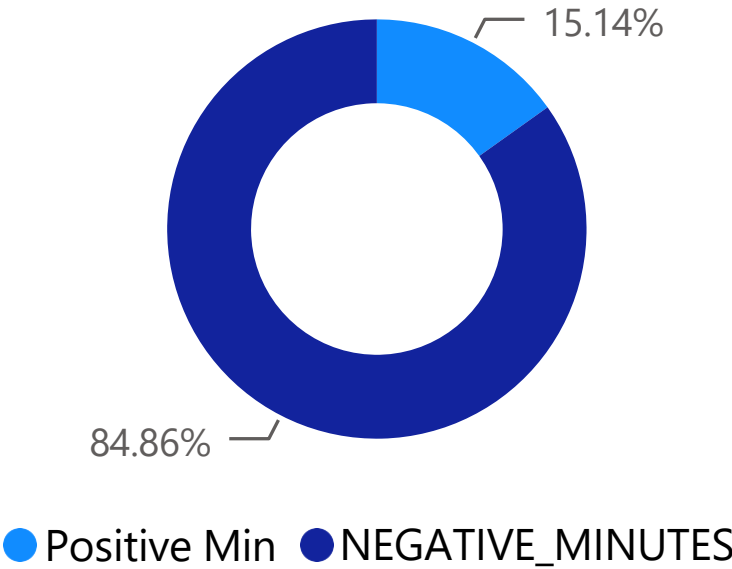

TR V/S kW

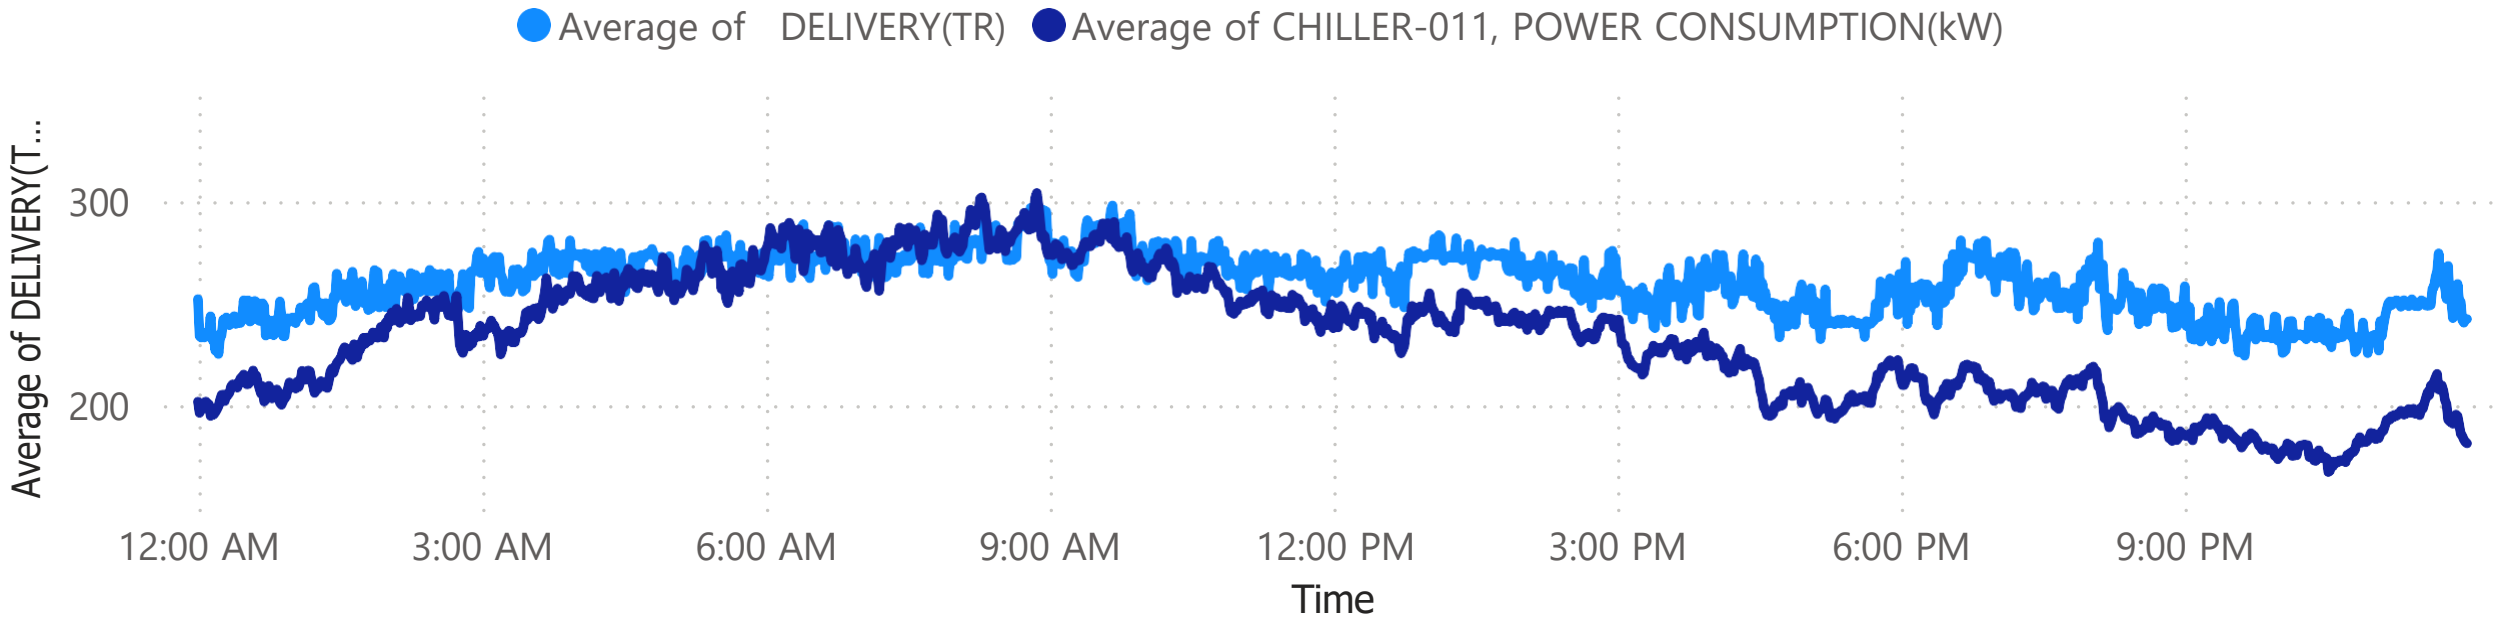

CH-12

05-12-2025

1440

TOTAL RUN TIME

150

POSITIVE MINUTES


1290

NEGATIVE MINUTES


5,869.00

CH Daily kWh


CHILLER LOAD,(TR%)

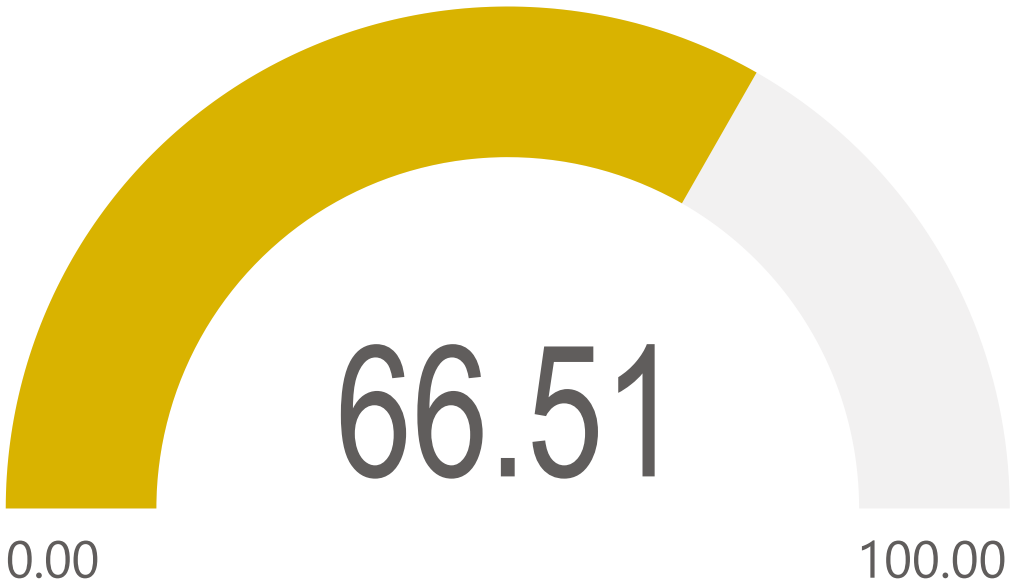

ACTUAL (kW/TR) V/S COMMITTED (ikW/TR)

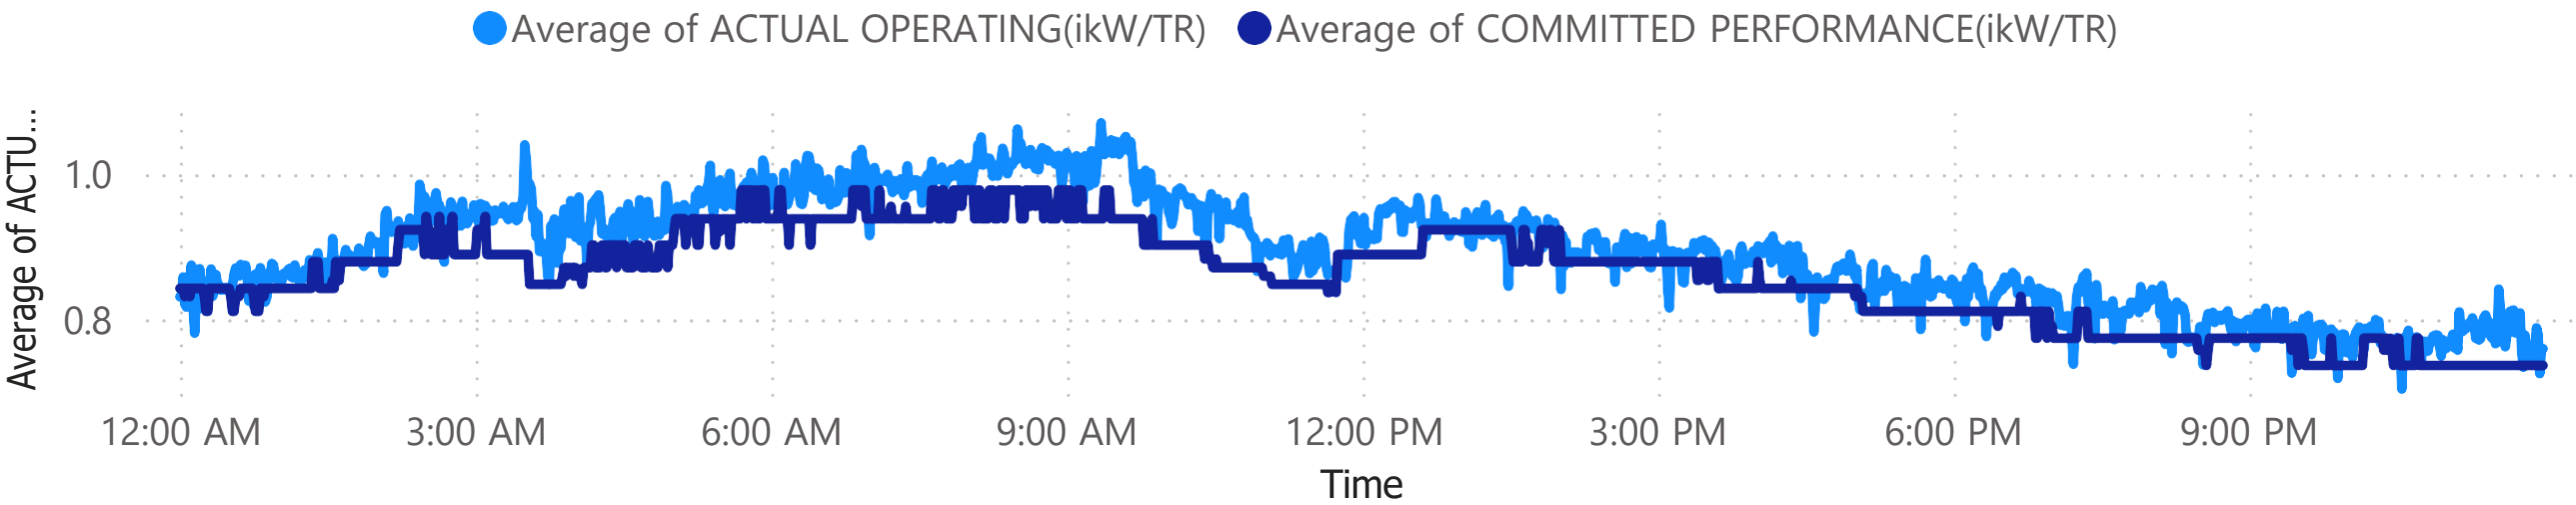

TOTAL TIME SPLIT

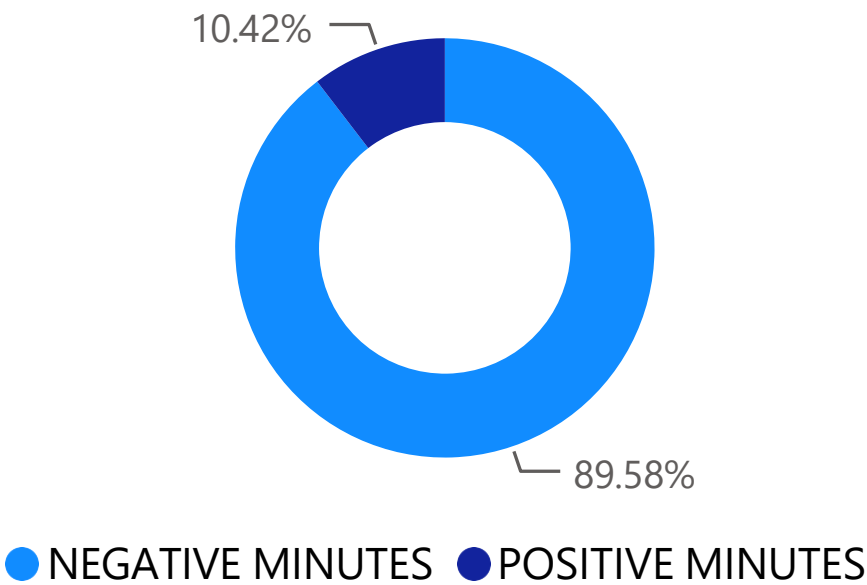

TR V/S kW

