


F07. Physical-pool observer diagnosis

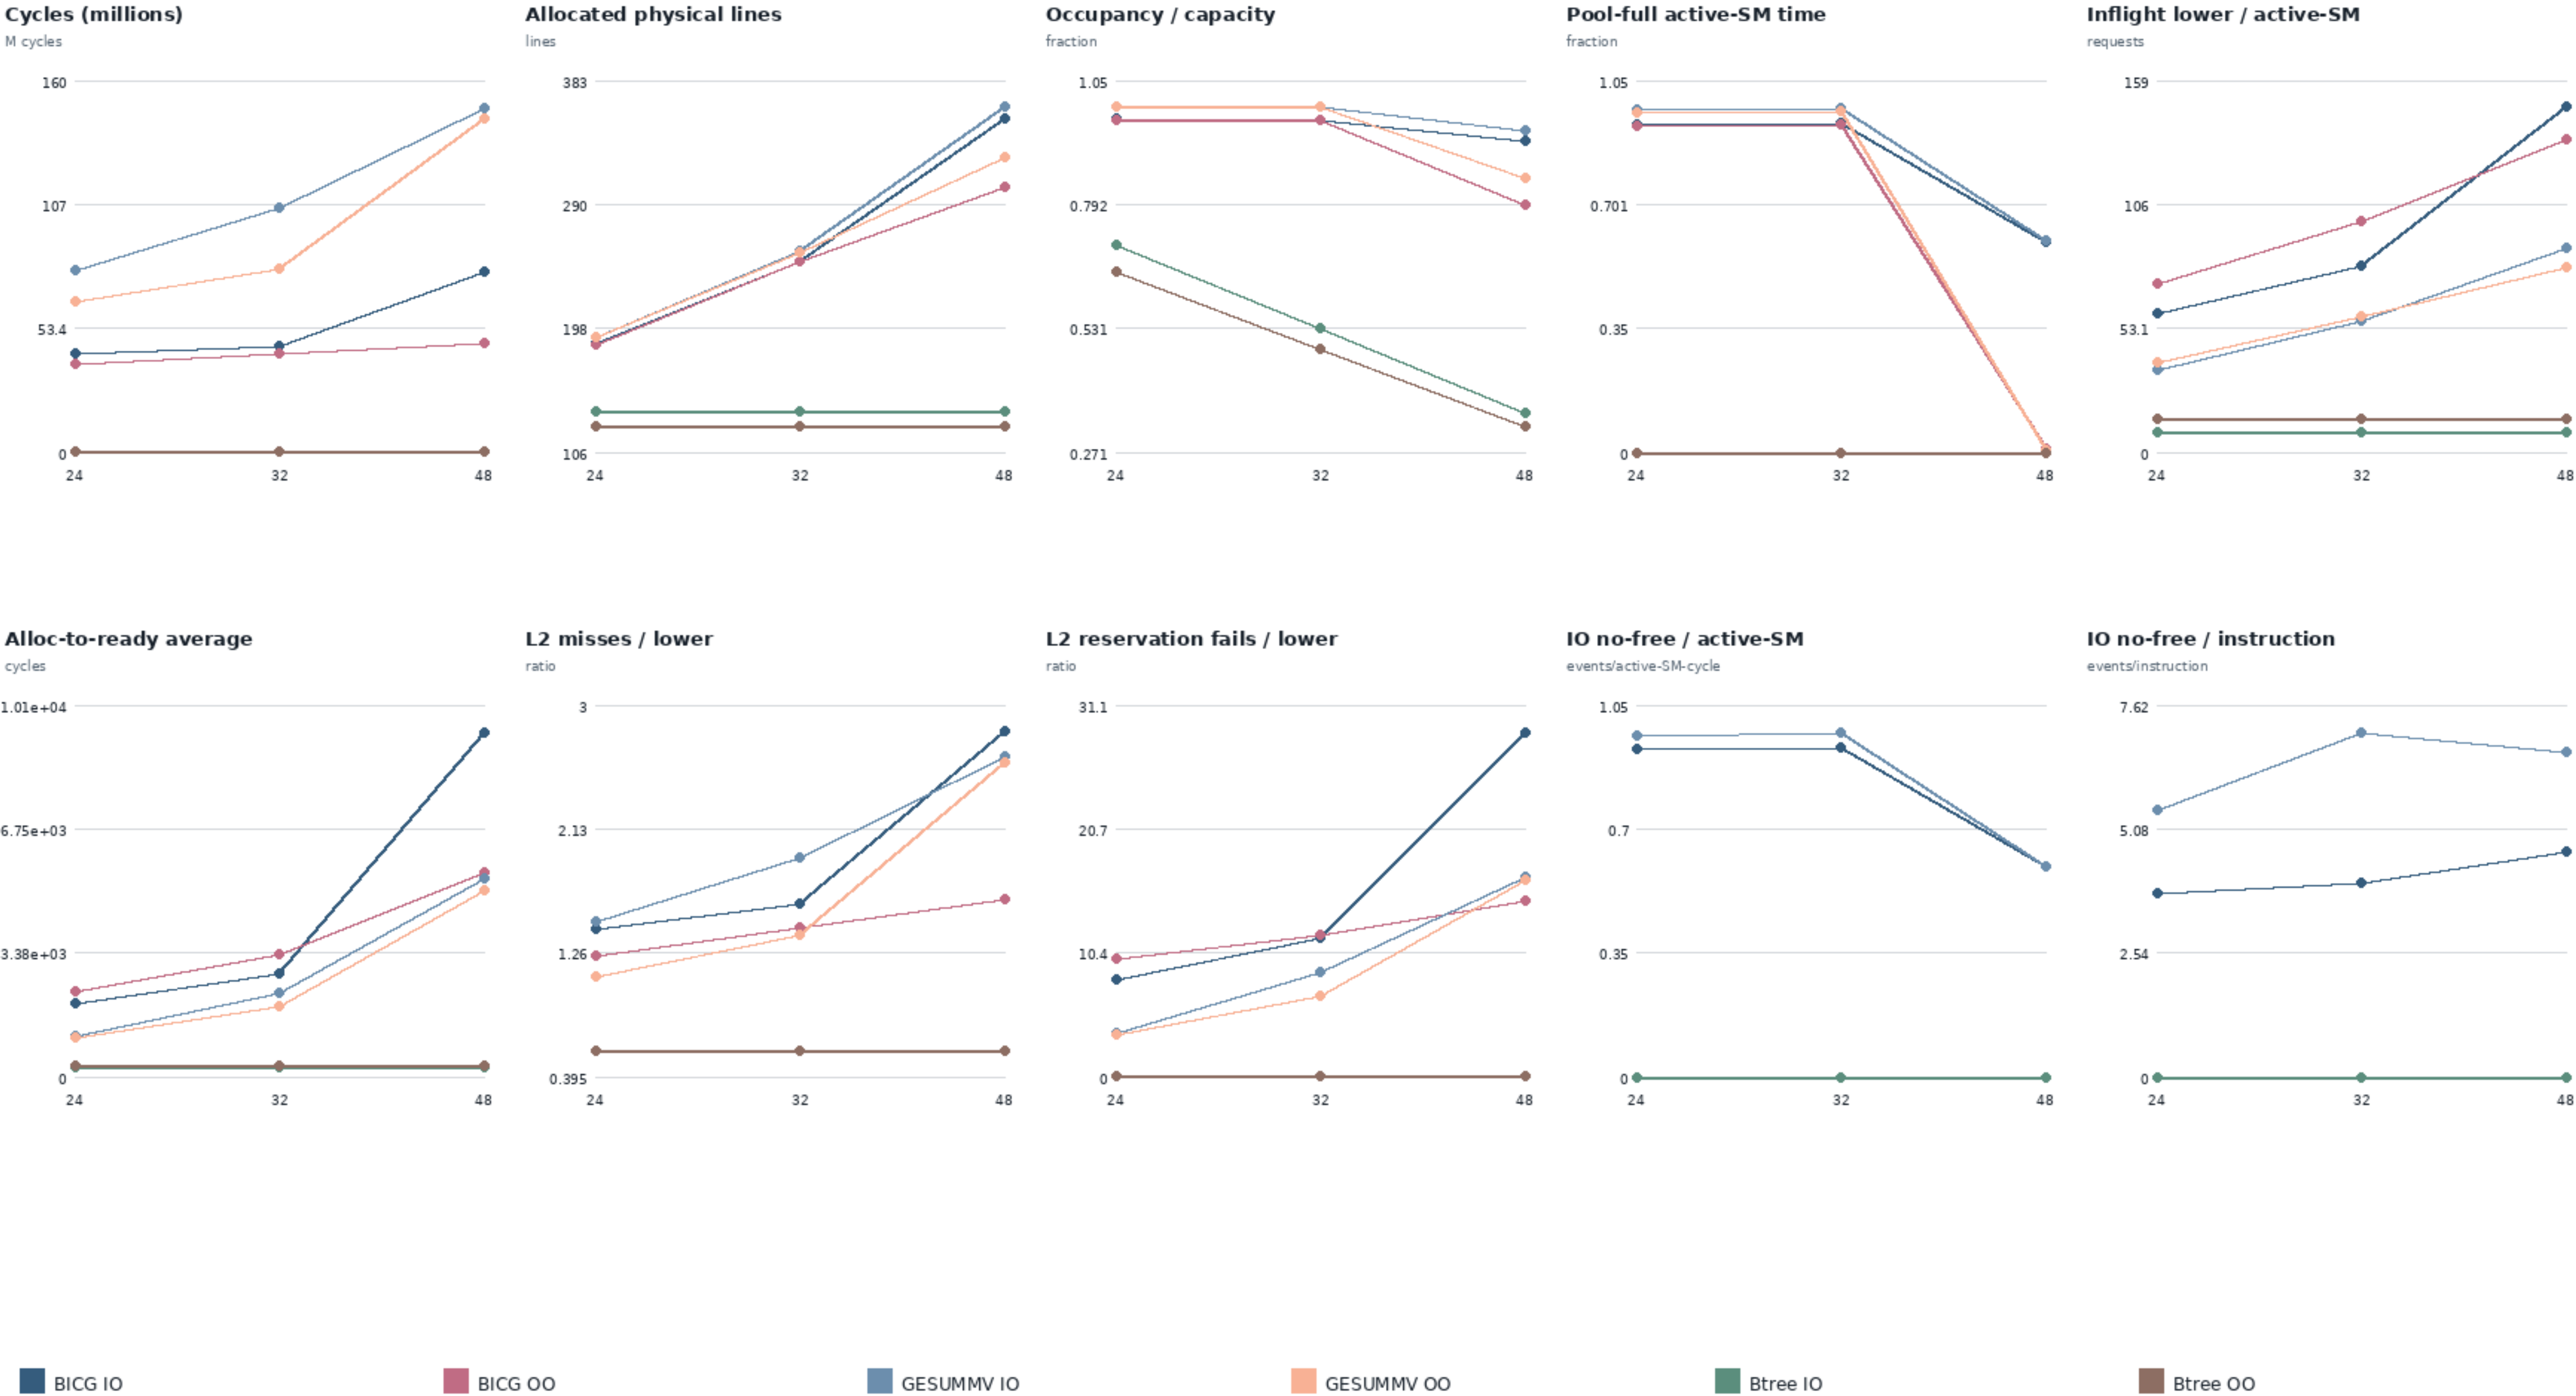

D4 diagnostic evidence: 3 workloads × 24/32/48 KiB × IO/OO. All time integrals use observer_sample_sm_cycles, never 64×global cycles.
Capacity is deliberately controlled; these co-varying internal mediator measures are not individually causal interventions.