



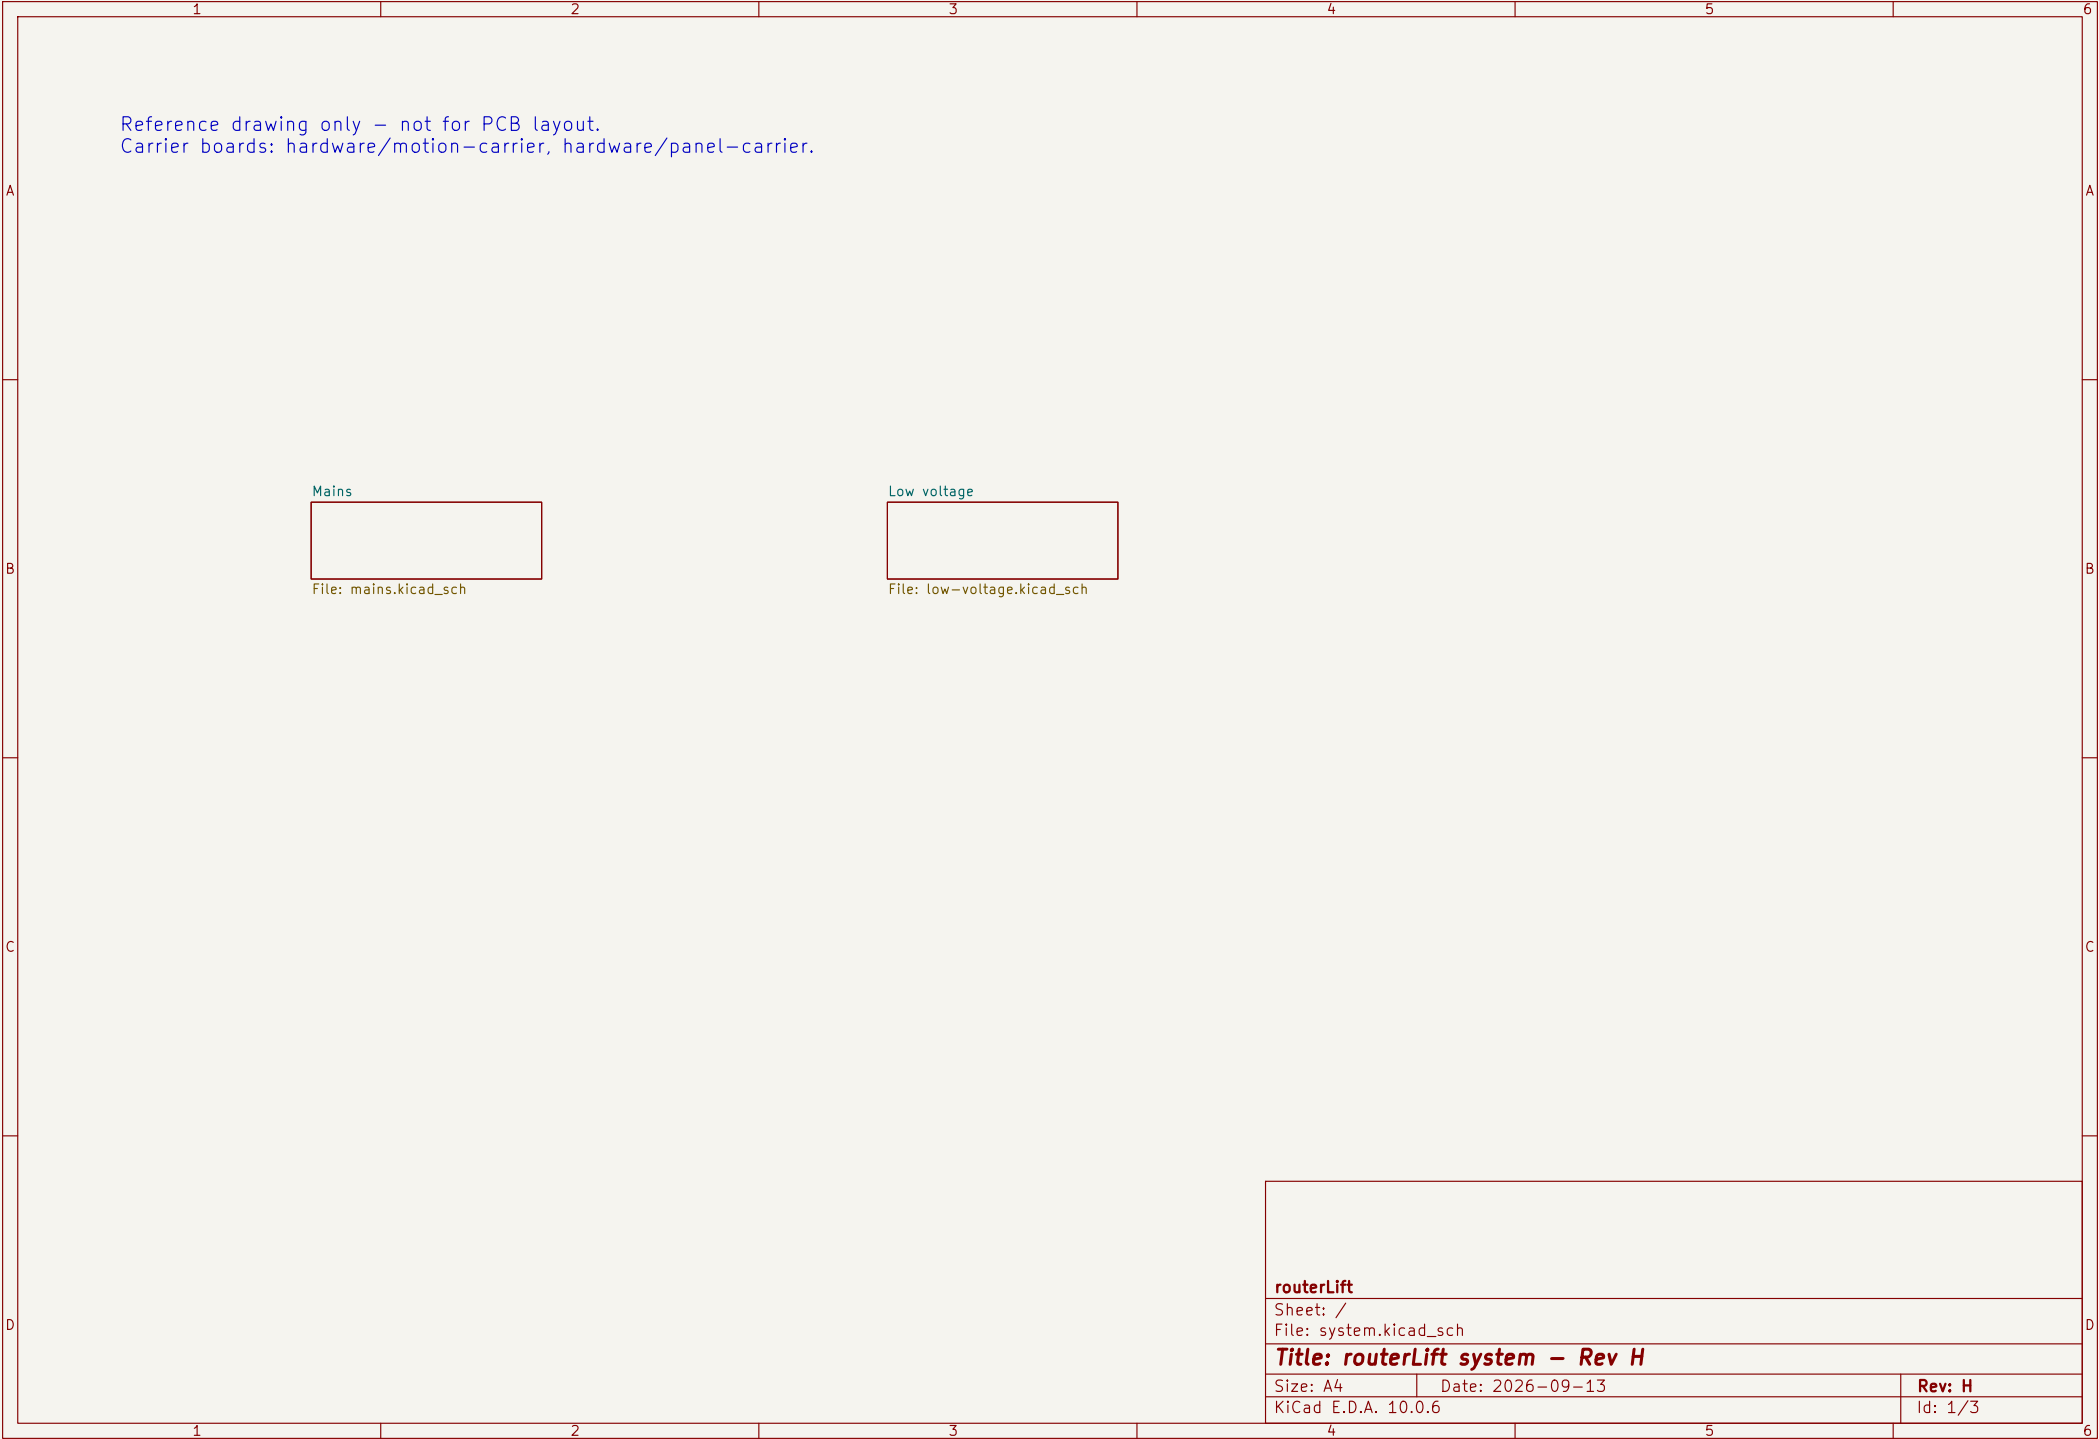

L: RCD -> fuse -> E-stop. The E-stop breaks L to BOTH the PSU and the contactor (SAF-01).
Key switch in series with the coil: key out = contactor cannot pull in (SAF-02).
Contactor is 2-pole: L1-T1 switches L, L2-T2 switches N to the router socket.
Contactor coil voltage UNVERIFIED - drawn as 230 V AC from L_STOP / N (BOM block A).
L_STOP and RELAY_NO continue on the low-voltage sheet (relay module contact).

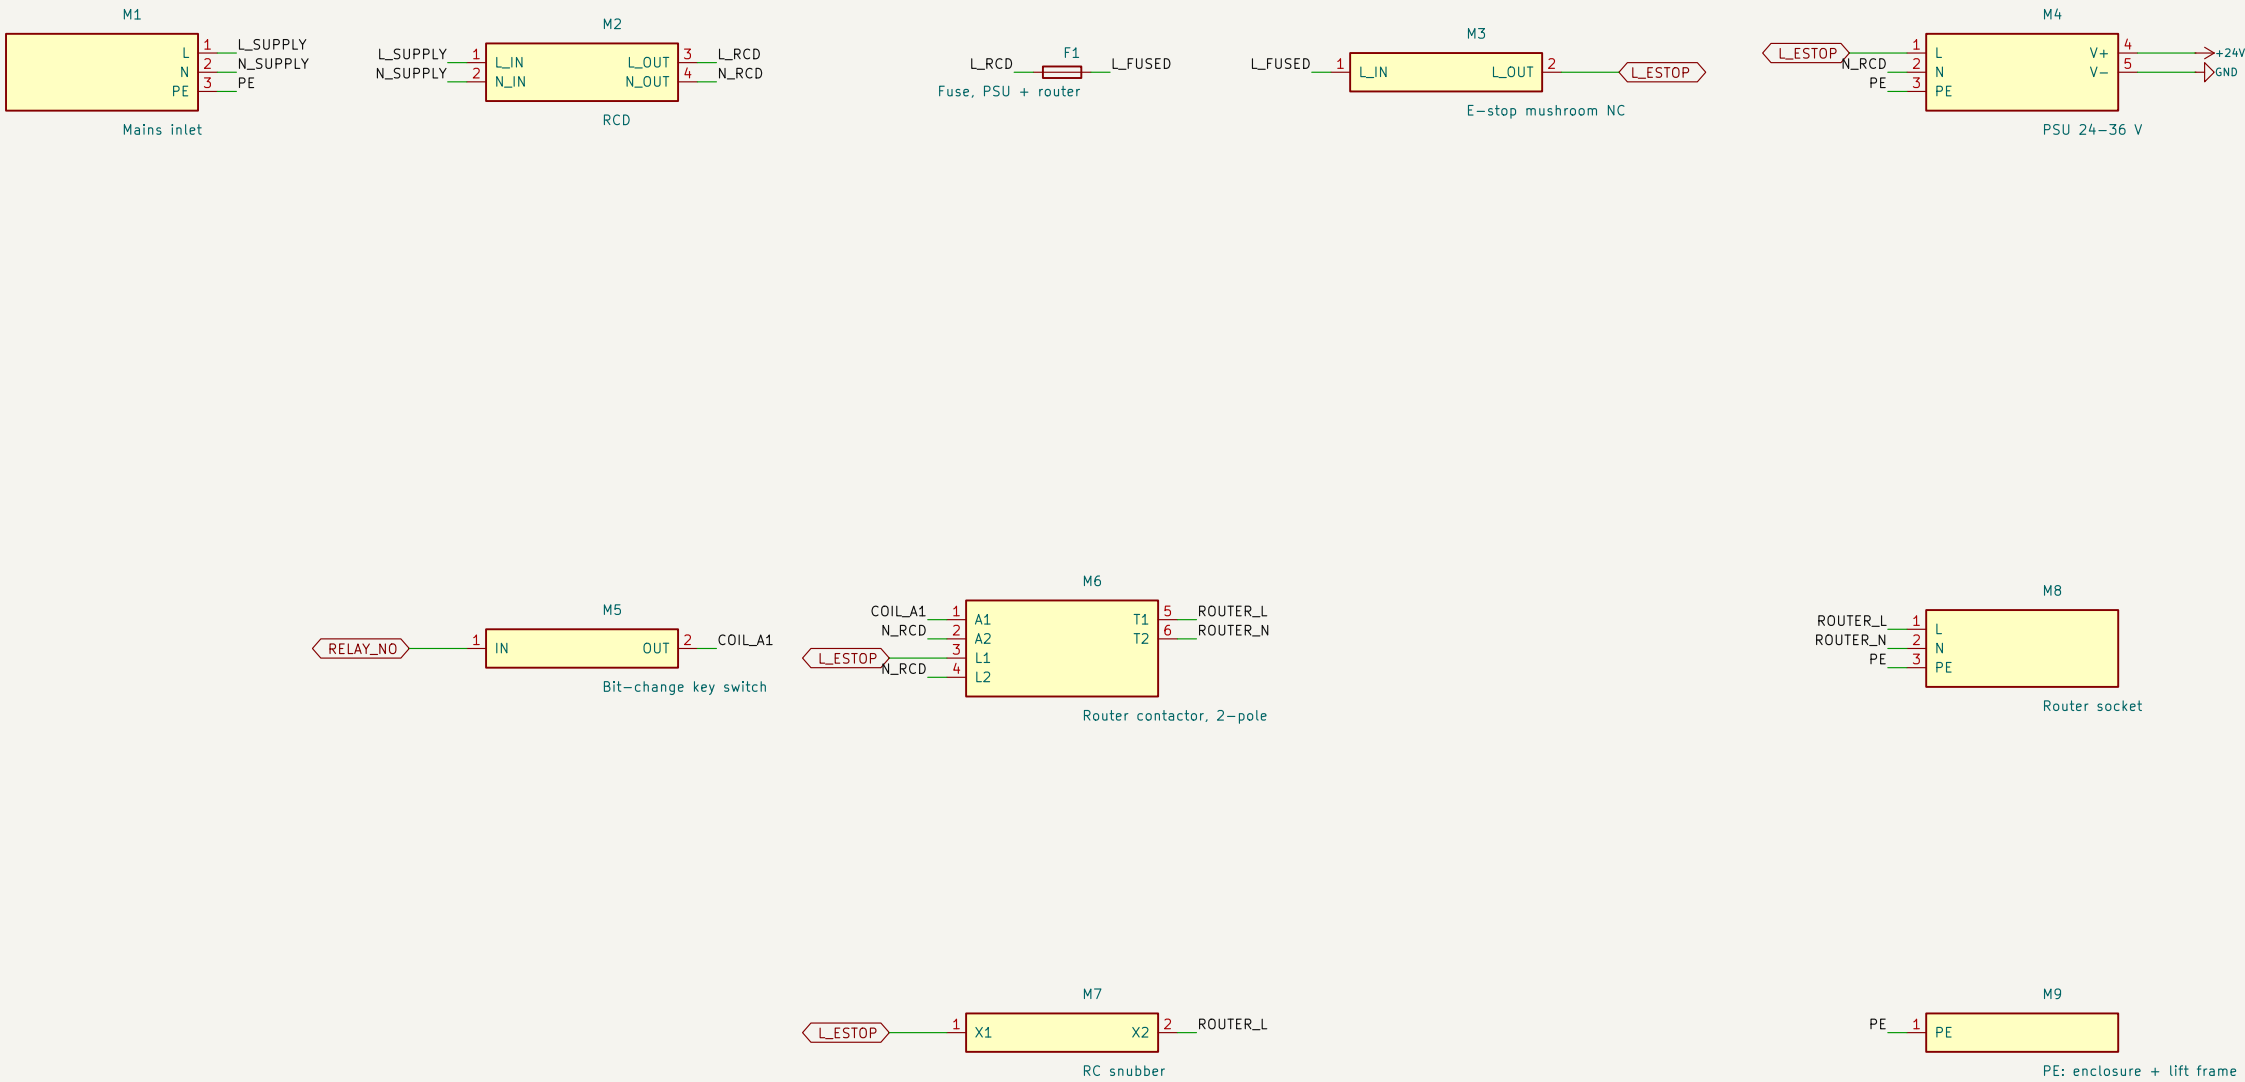

routerLift

Sheet: /Mains/
File: mains.kicad_sch

Title: Mains, E-stop and router power

Size: A3

Date: 2026-09-13

Rev: H

KiCad E.D.A. 10.0.6

Id: 2/3

GND = one star point at the PSU (PWR-04).
Motion 3V3 and panel 3.3 V are separate rails: the link carries GND, TX, RX only.
DRV_ALM (GPIO 35) reserved for future closed-loop driver – no-connect today.
FOOT_PEDAL drawn with a second contact for the HMI release mirror – UNVERIFIED.
A single shared contact would tie the two 3.3 V rails together through the pull-ups.
LEAD_P3 / LEAD_P4 are MX1.25 4-pin leads; carrier schematics give the pinout.

