



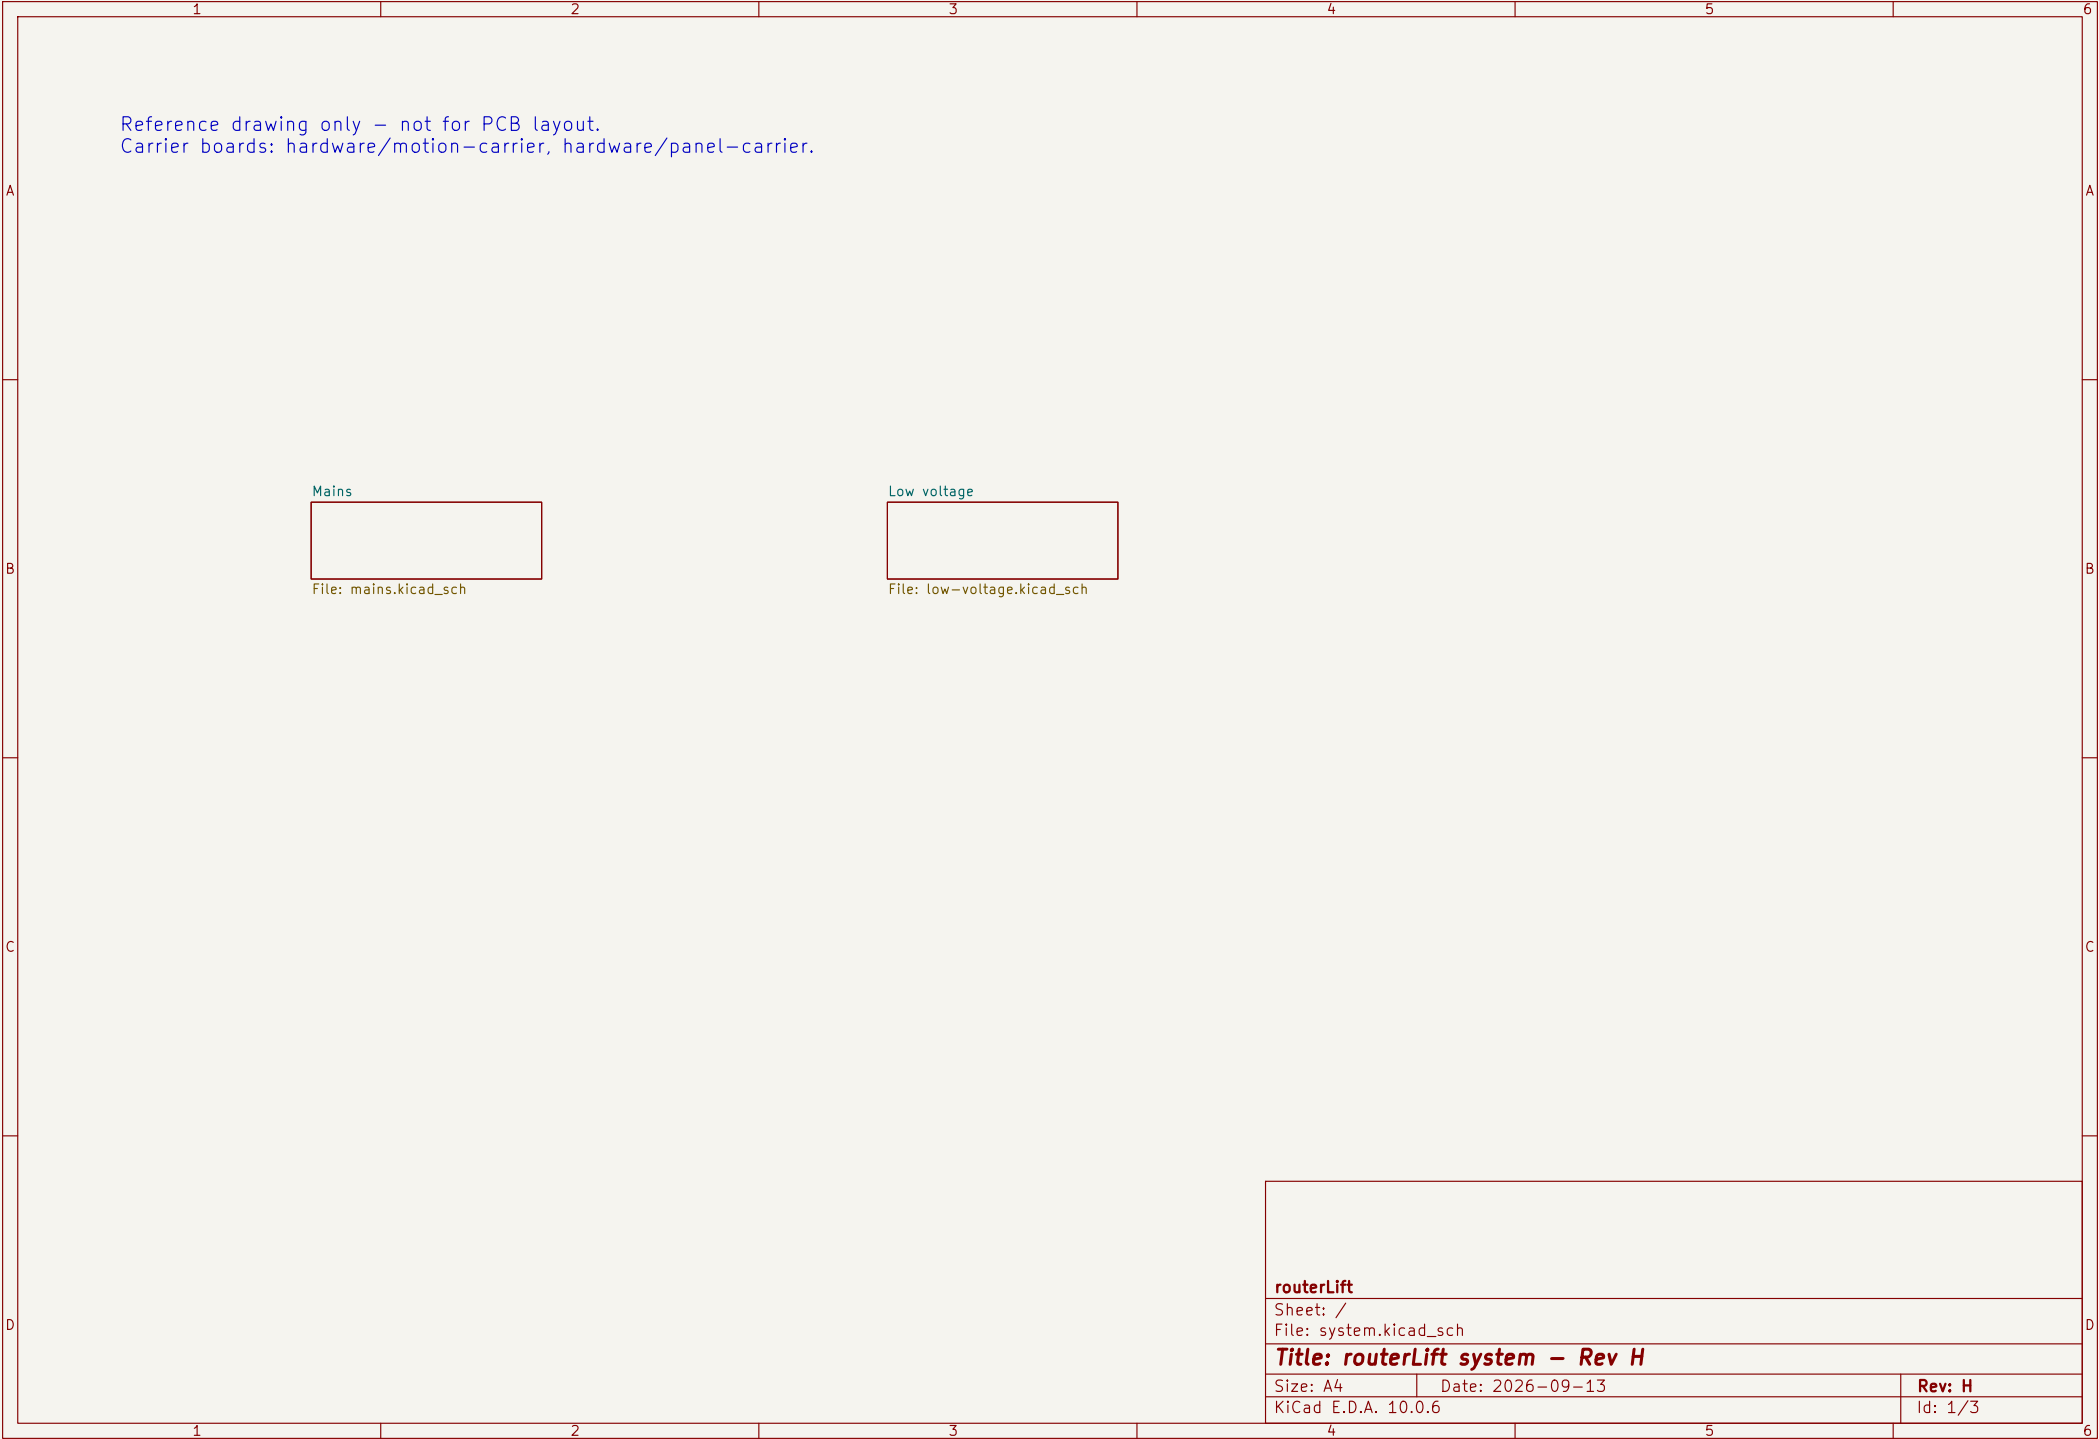

E-stop breaks L to BOTH the PSU and the contactor (SAF-01).
Key switch in series with the coil: key out = contactor cannot pull in (SAF-02).
Contactor coil voltage UNVERIFIED – drawn as 230 V AC from L_FUSED / N (BOM block A).
L_FUSED and RELAY_NO continue on the low-voltage sheet (relay module contact).
Contactor drawn single-pole (L only) per WIRING-RevH diagram 5; switching L and N with a 2-pole contactor is an open design choice.

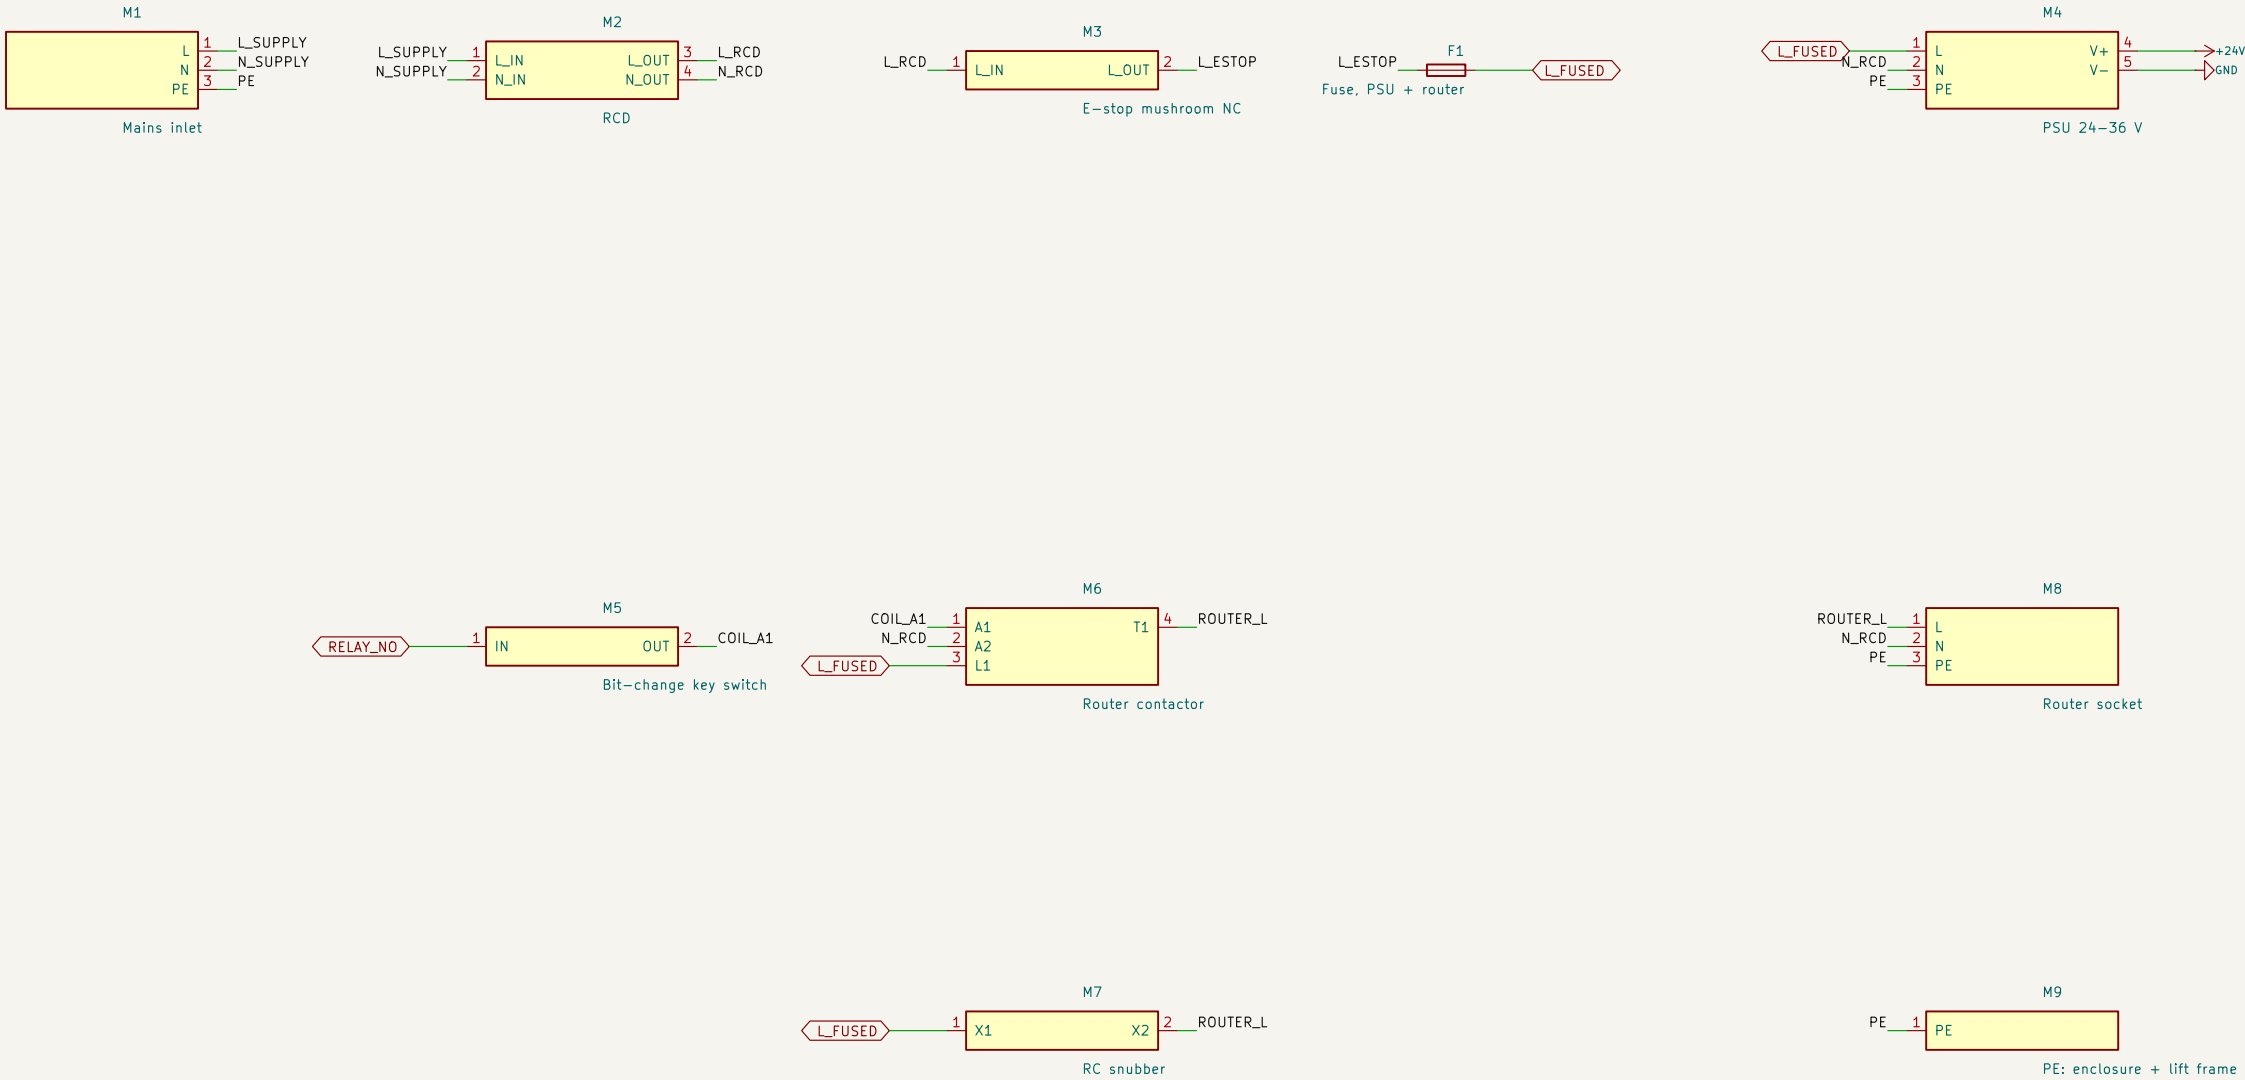

routerLift		
Sheet: /Mains/ File: mains.kicad_sch		
Title: Mains, E-stop and router power		
Size: A3	Date: 2026-09-13	Rev: H
KiCad E.D.A. 10.0.6	Id: 2/3	

GND = one star point at the PSU (PWR-04).
Motion 3V3 and panel 3.3 V are separate rails: the link carries GND, TX, RX only.
DRV_ALM (GPIO 35) reserved for future closed-loop driver – no-connect today.
FOOT_PEDAL drawn with a second contact for the HMI release mirror – UNVERIFIED.
A single shared contact would tie the two 3.3 V rails together through the pull-ups.
LEAD_P3 / LEAD_P4 are MX1.25 4-pin leads; carrier schematics give the pinout.

