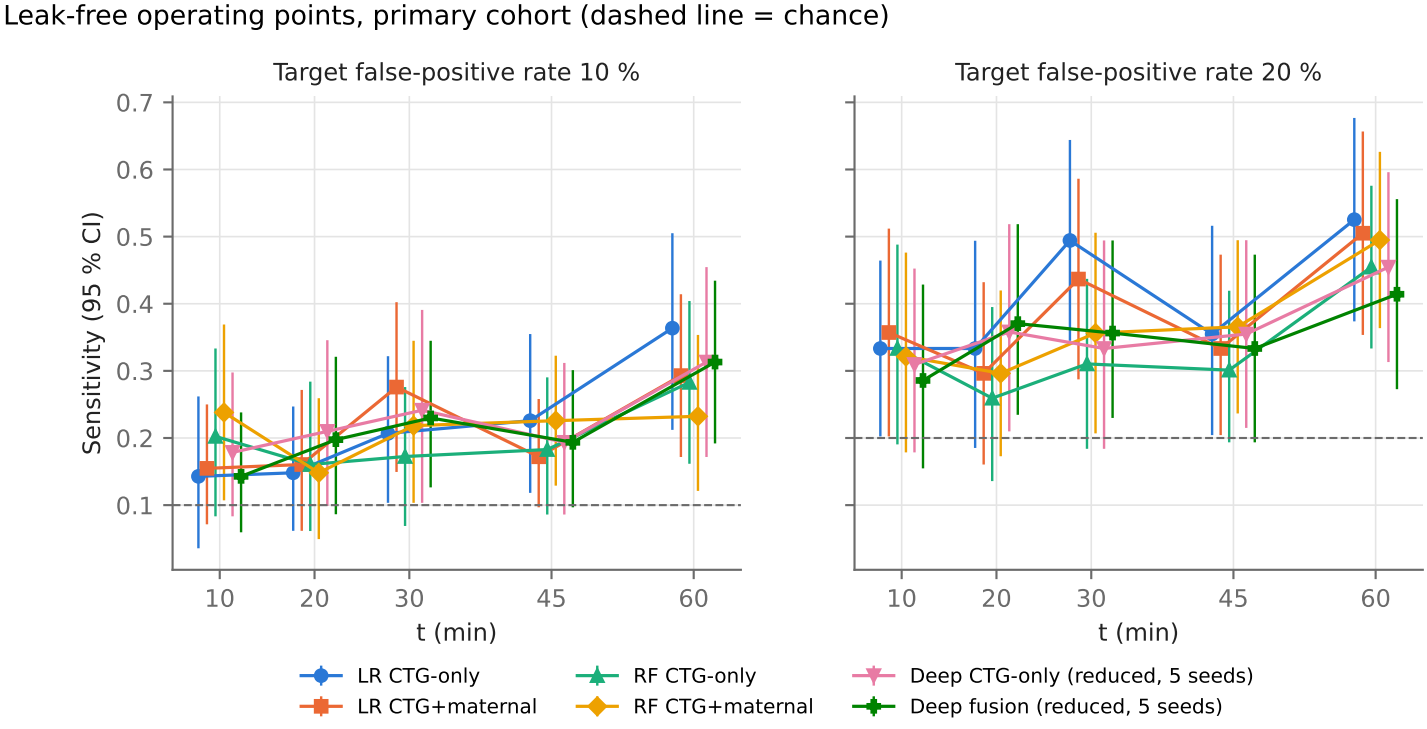
Leak-free operating points, primary cohort (dashed line = chance)
Target false-positive rate 10 %
Target false-positive rate 20 %
Sensitivity (95 % CI)
0.7
0.6
0.5
0.4
0.3
0.2
0.1
10
20
30
45
60
t (min)
LR CTG-only
LR CTG+maternal
RF CTG-only
RF CTG+maternal
Deep CTG-only (reduced, 5 seeds)
Deep fusion (reduced, 5 seeds)